


I/A Series[®] Hardware Control Processor 40

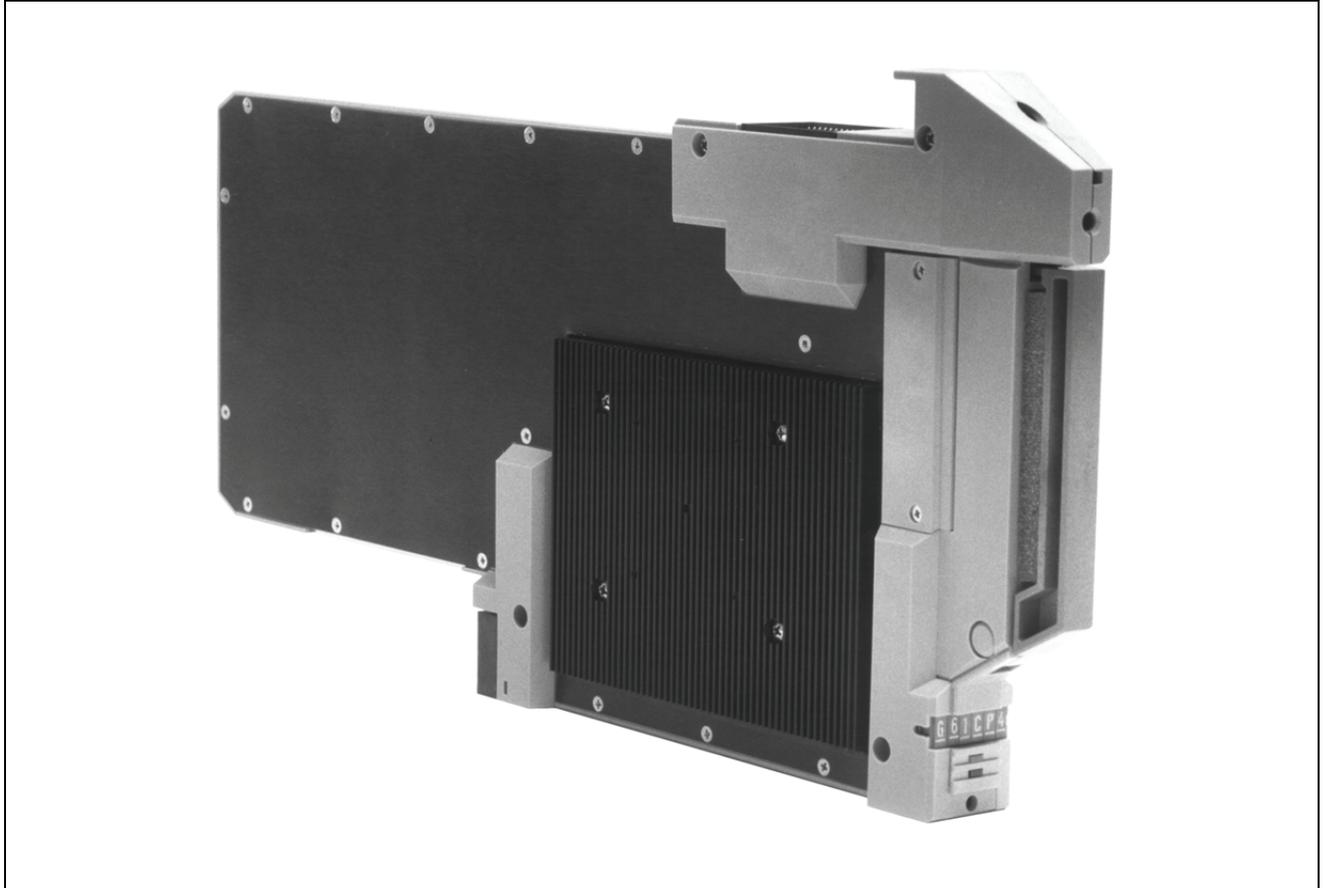

The Control Processor 40 is a high-end optionally fault-tolerant station in the Control Processor family (CP10, CP30, CP40) that has:

- a larger memory capacity to support a greater number of blocks
- a faster processor for increased block processing

With high performance, the CP40 is both economical and in line with today's advancing technology. Other members of the CP family are easily upgradable to CP40 capabilities.

The Control Processor 40 performs regulatory, logic, timing, and sequential control together with connected:

- Fieldbus Modules (FBMs)
- Fieldbus Cluster I/O Cards (FBCs)
- SPECTRUM Migration Integrator I/O
- SPEC 200 Migration Integrator I/O
- SPEC 200 MICRO Migration Integrator I/O

It also performs data acquisition (via the Fieldbus Modules), alarm detection and notification, and may optionally serve as an interface for one or more Panel Display Stations.

The non-fault-tolerant version of the Control Processor 40 is a single-width processor module. The fault-tolerant version consists of two single-width processor modules.



Enhanced Reliability

The Control Processor 40 offers optional fault-tolerance for enhanced reliability. The fault-tolerant control processor configuration consists of two parallel-operating modules with two separate connections to the Nodebus and to the Fieldbus.

The two control processor modules, married together as a fault-tolerant pair, are designed to provide continued operation of the unit in the event of virtually any hardware failure occurring within one module of the pair. Both modules receive and process information simultaneously, and faults are detected by the modules themselves. One of the significant methods of fault detection is comparison of communication messages at the module external interfaces. Upon detection of a fault, self-diagnostics are run by both modules to determine which module is defective. The non-defective module then assumes control without affecting normal system operations.

To further ensure reliable communications, the fault-tolerant control processor performs error detection and address verification tests in its Nodebus and Fieldbus interfaces.

For enhanced reliability during maintenance operations, the Control Processor 40 is equipped with a recessed reset button, located at the front of the module. This feature provides for manually forcing a module power off and on (reboot) without removing the module from the enclosure.

Diagnostics

The Control Processor 40 uses three types of diagnostic tests to detect and/or isolate faults:

- Power-up self-checks
- Run-time and watchdog timer checks
- Off-line diagnostics

Power-up self-checks are self-initiated when power is applied to the control processor. These checks perform sequential tests on the various control processor functional elements. Red and green indicators at the front of the control processor module reflect the successful (or non-successful) completion of the various phases of the control processor startup sequence.

The run-time and watchdog timer checks provide continuous monitoring of control processor functions during normal system operations. The operator is informed of a malfunction by means of printed or displayed system messages.

Off-line diagnostics are temporarily loaded into the system for the purpose of performing comprehensive tests and checks on various system stations and devices. Using the off-line diagnostics, a suspected fault in the control processor can be isolated and/or confirmed.

Fieldbus Modules

Fieldbus Modules provide connection of digital I/O, analog I/O, and Intelligent Transmitters to control processors. There are two types of Fieldbus Modules: Main and Expansion. Some main modules can be expanded using an expansion module.

A wide range of Fieldbus Modules is available to perform the signal conversion necessary to interface the control processor with field sensors and actuators. For further information on the Fieldbus Modules, refer to the Fieldbus Modules Product Specification Sheet (PSS 21H-3B1 B3).

Fieldbus Flexibility

The Control Processor 40 is used in three different Fieldbus configurations, which provide broad flexibility in Fieldbus implementation:

- Local Fieldbus (Figure 1) - Used only within the enclosure, the local bus can extend up to 10 m (30 ft). Up to 24 Fieldbus Modules (excluding expansion modules) attach directly to the local bus, which is redundant.

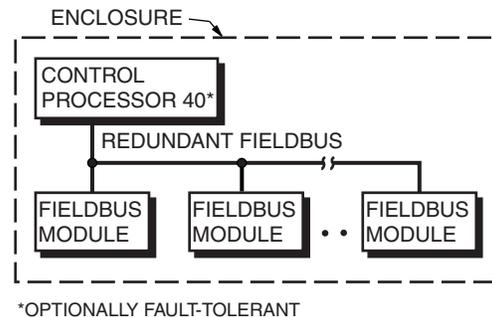


Figure 1. Local Fieldbus (Typical Configuration)

- Twinaxial (Dual-Conductor Coaxial) Fieldbus Extension (Figure 2) - Using twinaxial cable, the Fieldbus can optionally extend outside of the enclosure and can be up to 1800 m (6000 ft) in length. Up to 64 Fieldbus Modules (excluding expansion modules) attach to the extended bus through Fieldbus isolators. (Up to 24 Fieldbus Modules, excluding expansion modules, can connect to each isolator.) The twinaxial Fieldbus extension may be redundant.
- Fiber Optic Fieldbus Extension (Figure 3) - The fiber optic Fieldbus can optionally extend the distance as well as add application versatility and security. Overall Fieldbus length can be up to 20 km (12.4 mi). Like the twinaxial Fieldbus configuration, the fiber optic Fieldbus configuration supports up to 64 Fieldbus Modules (excluding expansion modules), up to 24 Modules per isolator.


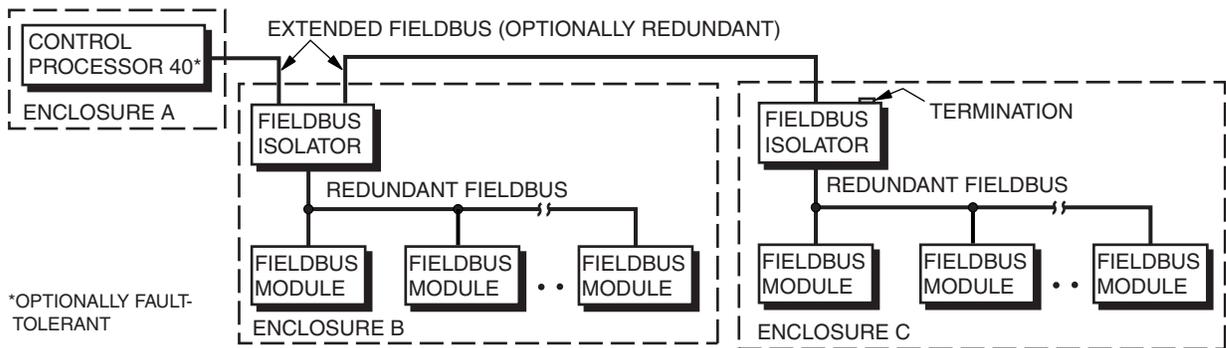


Figure 2. Twinaxial Fieldbus Extension (Typical Configuration)

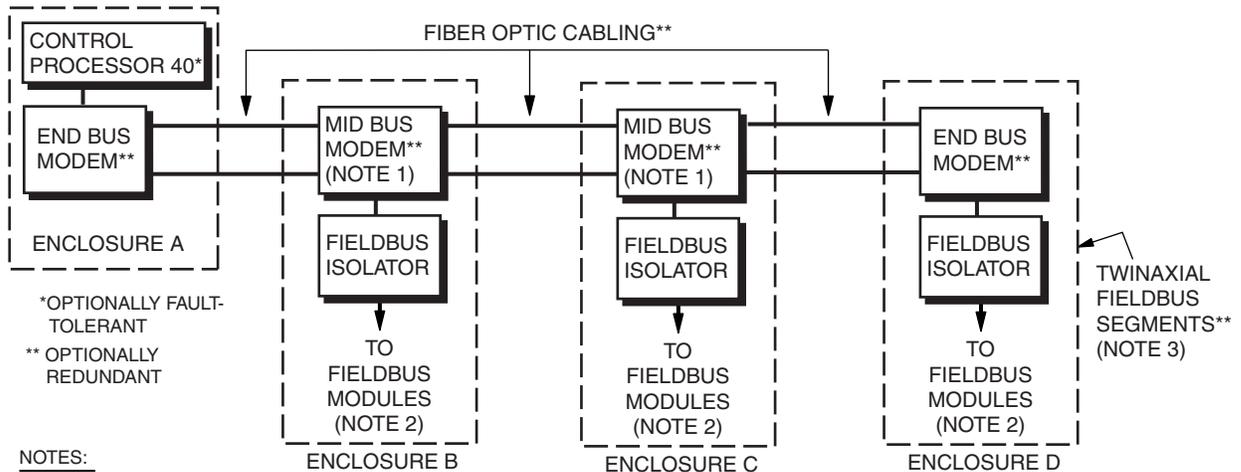

NOTES:

1. THE MID BUS MODEMS ARE USED WHEN THE CONFIGURATION ENCOMPASSES MORE THAN TWO ENCLOSURES. THEY MAY ALSO BE USED AS REPEATERS, WHERE ADDED FIBER OPTIC CABLING DISTANCE IS REQUIRED.
2. CONNECTION OF THE FIBER ISOLATORS TO THE FIELDBUS MODULES (FBMs) IS SIMILAR TO THAT SHOWN IN FIGURE 2.
3. ANY TWINAXIAL FIELDBUS SEGMENT CAN BE EXTENDED TO SERVICE FBMs IN ANOTHER ENCLOSURE. (TWINAXIAL CABLING BETWEEN ENCLOSURES IS SHOWN IN FIGURE 2.)

Figure 3. Fiber Optic Fieldbus Extension (Typical Configuration)

All three Fieldbus configurations use serial data communication complying with Electronic Industrial Association (EIA) Standard RS-485. The data transmission rate is 268.75 Kbps.

Panel Display Station Interfacing

The Control Processor 40 achieves the capability to interface Panel Display Stations when the DSI (Panel Display Station Interface) block is selected via the configurator. In this capacity, the Control Processor 40 can interface up to 24 Panel Display Stations, or a combination of Fieldbus modules (which may include associated Auto/Manual Stations) and Panel Display Stations mixed on the same Fieldbus. (Note, however, that per configuration rules, one Panel Display Station counts as two Fieldbus Modules.)

Control strategies should be planned such that all blocks involved with the Panel Display Station, Auto/Manual Station, and the control loops being monitored or controlled are in the same Control Processor 40, and ideally in the same compound.

The Control Processor 40 connects to the Panel Display Stations and Fieldbus Modules via either of two types of Fieldbus communications media: twinaxial cable or fiber optic cable. Figure 4 shows a typical twinaxial Fieldbus configuration, and Figure 5 shows a typical fiber optic Fieldbus configuration. (Refer to Fiber Optic Fieldbus Product Specification Sheet PSS 21H-7P1 B3 for additional fiber optic Fieldbus application information.)

Cluster I/O Subsystem Interfacing

The Control Processor 40 interfaces with the Fieldbus Cluster Input/Output Subsystem that consists of the Fieldbus, a multi-slot chassis configuration of a Fieldbus Processor (FBP10), analog/digital Fieldbus Cards (FBCs), and power supply and power monitor card. These Cluster I/O subsystems meet the needs of applications where a high number of channels per card are required. Figure 6 shows a typical twinaxial Fieldbus configuration. (Refer to the Fieldbus Cluster I/O Subsystem PSS 21H-2T1 B3 for additional information.)

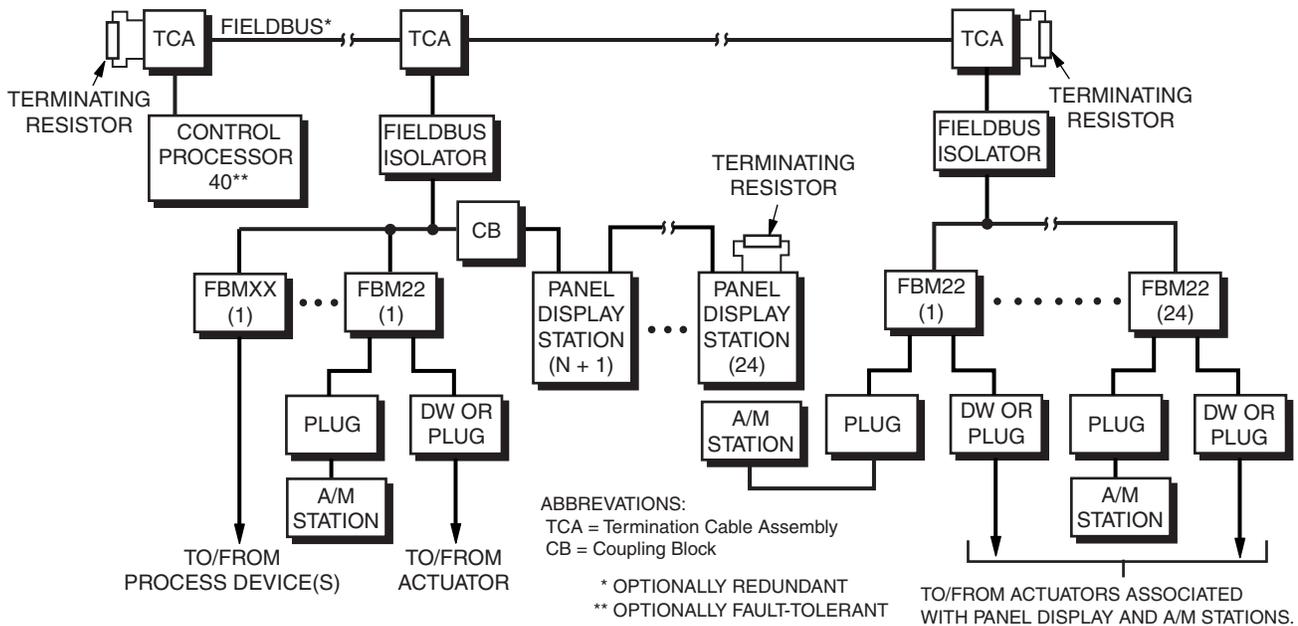


Figure 4. Panel Display Station Interface Configuration using Twinaxial Fieldbus (Typical Configuration)

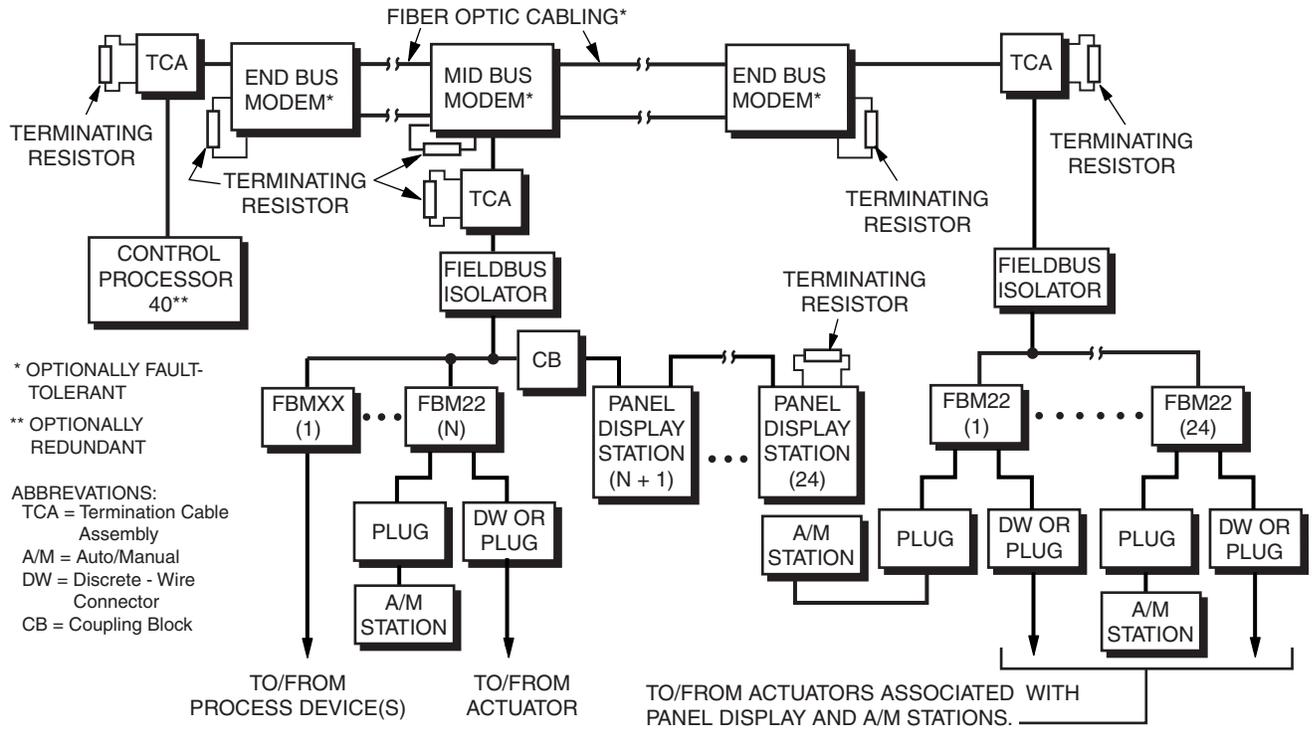


Figure 5. Panel Display Station Interface Configuration using Fiber Optic Fieldbus (Typical Configuration)

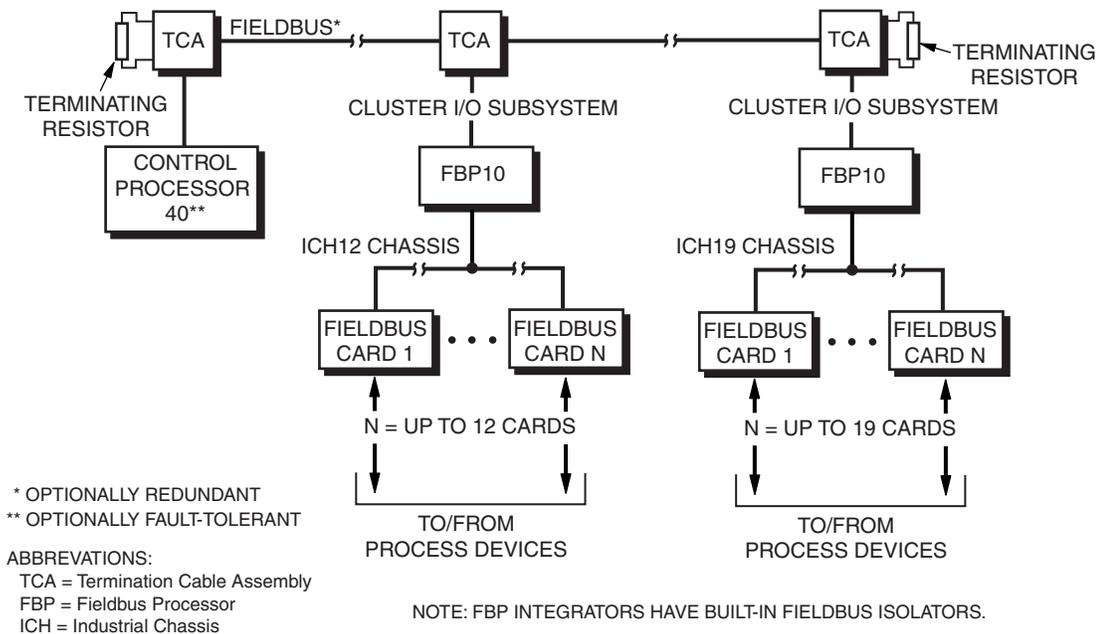


Figure 6. Twinaxial Fieldbus Cluster I/O Subsystem Interface Configuration (Typical Configuration)

SPECTRUM Migration Interfacing

The Control Processor 40 interfaces with a SPECTRUM Migration Integrator subsystem via a single or redundant I/A Series Fieldbus and a Fieldbus Processor (FBP) with built-in FBP isolator located within the subsystem. There are four different FBP integrators to accommodate Unit Control Modules (UCM), Field Input/Output Units (FIO), Universal Field Multiplexers (UFM), and Universal Input/Output Units (UIO).


The CP40 control strategy can include any of following SPECTRUM configurations:

- a single SPECTRUM Migration Integrator subsystem

- multiple types of SPECTRUM Migration Integrator subsystems
- Fieldbus Modules (FBMs) and/or other Fieldbus-based process interface subsystems along with the SPECTRUM Integrator subsystem(s)

Control is via the software resident in the FBP Integrator and in the SPECTRUM I/O Equipment Control Blocks (ECBs) operating at the CP level.

Figure 7 illustrates a typical configuration with multiple types of Integrator subsystems with nests of I/O cards. (Refer to PSS 21H-7Q1 B3 SPECTRUM Migration Integrators for additional information.)

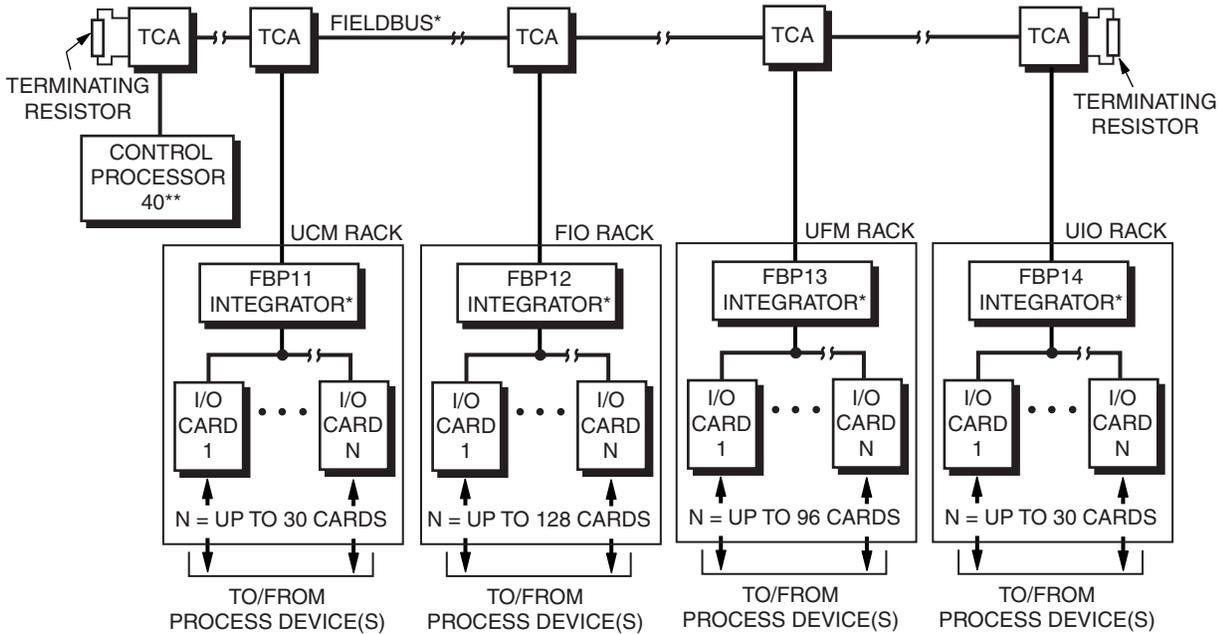

* OPTIONALLY REDUNDANT
 ** OPTIONALLY FAULT-TOLERANT

NOTE: FBP INTEGRATORS HAVE BUILT-IN FIELDBUS ISOLATORS.

ABBREVIATIONS:
 TCA = Termination Cable Assembly
 I/O = Input/Output
 FBP = Fieldbus Processor

Figure 7. Twinaxial Fieldbus SPECTRUM Migration Subsystem Interface Configuration (Typical Configuration)

SPEC 200 Control Interfacing

For migration of SPEC 200 control to I/A Series Systems, the Control Processor 40 interfaces via a single or redundant I/A Series Fieldbus with the SPEC 200 Control Integrator subsystem. This subsystem consists of individual Control Integrators, and Fieldbus Isolators attached within the SPEC 200 rack.

Control is via the software resident in the Control Integrator and in the SPEC 200 I/O Equipment Control Blocks (ECBs) operating at the CP level. Figure 8 illustrates a typical configuration with multiple Control Integrators in the SPEC 200 subsystem. (Refer to PSS 21H-7R1 B3 SPEC 200 Control Integrators for additional information.)

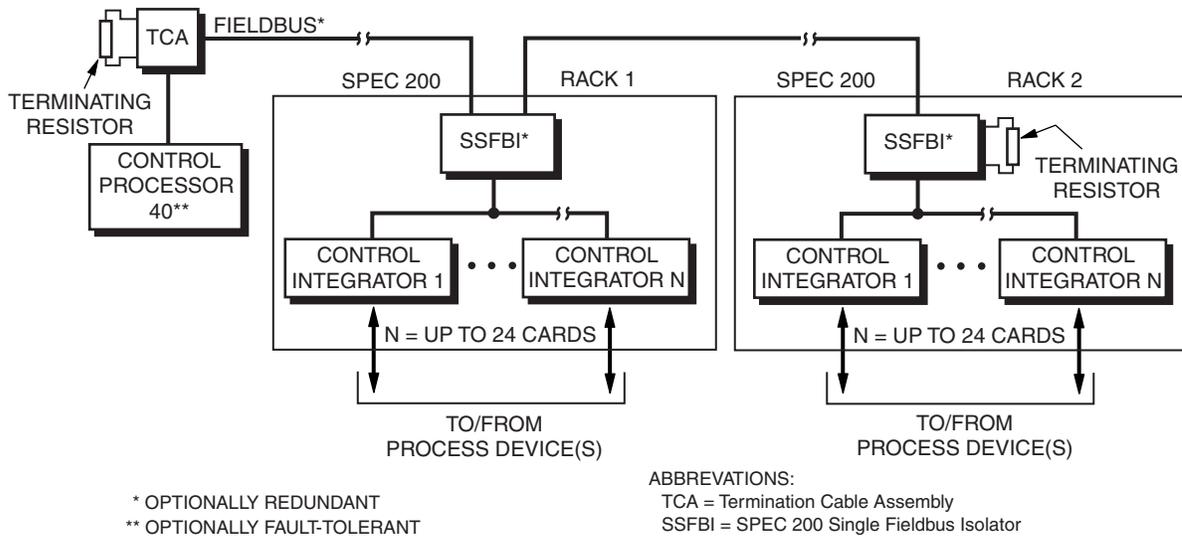


Figure 8. Twinaxial Fieldbus SPEC 200 Control Subsystem Interface Configuration (Typical Configuration)

SPEC 200 MICRO Control Interfacing

For migration of SPEC 200 MICRO control to I/A Series systems, the Control Processor 40 interfaces via a single or redundant I/A Series Fieldbus with the SPEC 200 MICRO Control Integrator subsystem. This subsystem consists of individual Control Integrators, and Fieldbus Isolators attached within the SPEC 200 MICRO rack (NCM or SPEC 200 2ANU).

Control is via the software resident in the Control Integrator and in the SPEC 200 MICRO I/O Equipment Control Blocks (ECBs) operating at the CP level. Figure 9 illustrates a typical configuration with multiple Control Integrators in the SPEC 200 MICRO subsystem. (Refer to PSS 21H-7R2 B3 SPEC 200 MICRO Control Integrators for additional information.)

Control Processor 40 Upgrade

Upgrading a Control Processor 30, Control Processor 10, Tank Processor 10, or Display Processor 10 to a CP40 involves:

- Replacing the existing Control Processor with a CP40
- Upgrading the software license
- Modifying the System Configurator to identify the CP40
- Loading existing compounds to the CP40

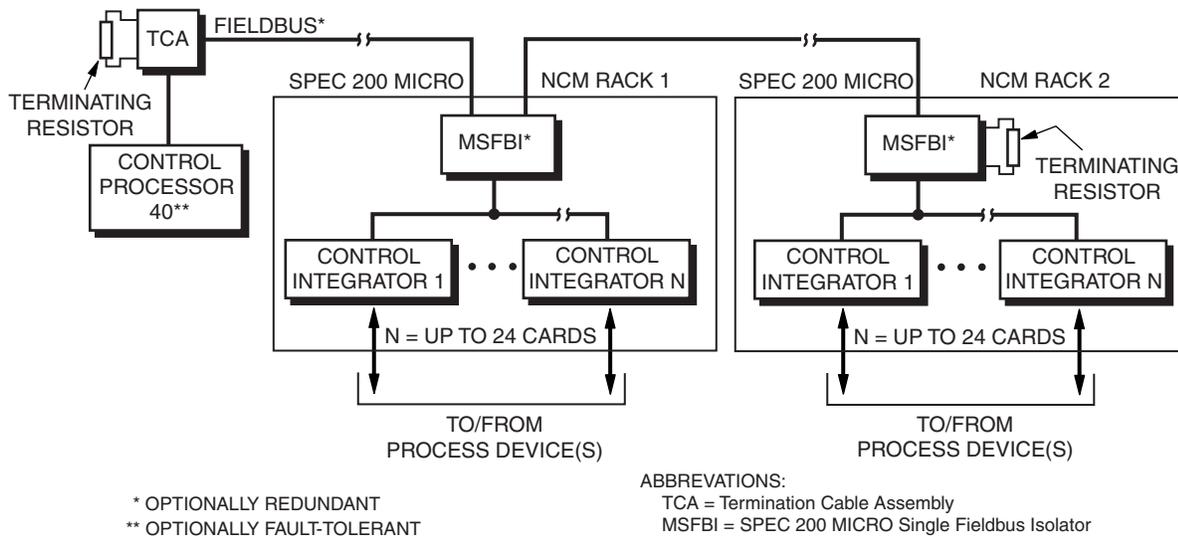


Figure 9.

Twinaxial Fieldbus SPEC 200 MICRO Control Subsystem Interface Configuration (Typical Configuration)

FUNCTIONAL SPECIFICATIONS

Processor Type

CONTROL PROCESSOR

Microprocessor-based Intel 486DX4 (running at 100 MHz) with stored programs, using high-speed communication capability.

NODEBUS PROCESSOR

82596CA LAN CoProcessor

FIELDBUS PROCESSOR

8344AH MicroController with serial port

Memory

SIZE

4 MB storage

ERROR DETECTION

Parity provides single-bit error detection for each byte.

Process I/O Communications

LOCAL TWINAXIAL^(A) FIELDBUS

Type

EIA RS-485

Distance

10 m (30 ft)

Transmission Rate

268.75 Kbps

EXTENDED TWINAXIAL^(A) FIELDBUS^(B)

Type

EIA RS-485

Distance

1800 m (6000 ft)

Transmission Rate

268.75 Kbps

FIBER OPTIC FIELDBUS^(C)

Type

Optical

Distance

20 km (12.4 mi)

Transmission Rate

268.75 Kbps

^(A)The twinaxial Fieldbus uses a dual-conductor coaxial cable.

^(B)Fieldbus Isolator(s) required.

^(C)Fiber Optic Modem(s) required.

^(D)Excluding expansion modules.

Process I/O Capacity

LOCAL

24 Fieldbus Modules^(D), maximum

EXTENDED

64 Fieldbus Modules^(D), maximum (24 maximum on any one Fieldbus isolator)

PANEL DISPLAY STATION INTERFACING

Up to 64 FBMs^(D) or FBM equivalents (24 maximum on any one Fieldbus isolator). One Panel Display Station counts as two FBMs. For example, if 24 FBMs are used, only 20 Panel Display Stations may be used.

Power Requirements

INPUT VOLTAGE (REDUNDANT VOLTAGE)

39 V dc typical

CONSUMPTION (PER NON-FAULT-TOLERANT MODULE)

15 W, maximum

Indicators

Red and green light-emitting diodes (LEDs) indicate operational status.

Internal Diagnostics

Self-checking performed at power-up. Runtime checks and watchdog timer function performed during operation.

ENVIRONMENTAL SPECIFICATIONS^(A)**Operating****TEMPERATURE**

0 to 60°C (32 to 140°F)

RELATIVE HUMIDITY

5 to 95% (Noncondensing)

ALTITUDE

-300 to +3,000 m (-1,000 to +10,000 ft)

Storage**TEMPERATURE**

-40 to +70°C (-40 to +158°F)

RELATIVE HUMIDITY

5 to 95% (Noncondensing)

ALTITUDE

-300 to +12,000 m (-1,000 to +40,000 ft)

Environmental Contamination Level

Class G3 (Harsh) as defined in ISA Standard S71.04

^(A) The environmental ranges can be extended by the type of enclosure containing the module. {Refer to the applicable Product Specification Sheet (PSS) which describes the specific enclosure that is to be used.}

PHYSICAL SPECIFICATIONS**Configuration**

Single-width processor module. The fault-tolerant version consists of two single-width processor modules with two interconnecting buses (X-bus and Z-bus).

Mass (Maximum)

1.7 kg (3.75 lb) for a single, non-fault-tolerant module.

Mounting

May be placed in any of the following mounting structure slots:

- 1 X 8 Mounting Structure
- Industrial Enclosures (IE16 and IE32), Structural Foam or Metal
- Field Enclosure 8, Structural Foam or Metal

In the fault-tolerant version, the two modules must be mounted in adjacent mounting structure slots with the two interconnecting buses.

The Foxboro Company

33 Commercial Street
Foxboro, Massachusetts 02035-2099
United States of America
Telephone 1-888-FOXBORO
(1-888-369-2676)

Foxboro, I/A Series, SPEC 200, SPEC 200 MICRO, and SPECTRUM are trademarks of The Foxboro Company.
Siebe is a registered trademark of Siebe, plc.
Intel is a trademark of Intel Corporation.

Copyright 1995-1998 by The Foxboro Company
All rights reserved