

AEG AS-P890-000 Remote I/O Processor



\$450.00

In Stock

Qty Available: 4

Used and in Excellent Condition

Open Web Page

<https://www.artisanng.com/76250-1>



Your **definitive** source
for quality pre-owned
equipment.

Artisan Technology Group

(217) 352-9330 | sales@artisanng.com | artisanng.com

All trademarks, brandnames, and brands appearing herein are the property of their respective owners.

- Critical and expedited services
- In stock / Ready-to-ship
- We buy your excess, underutilized, and idle equipment
- Full-service, independent repair center

Artisan Scientific Corporation dba Artisan Technology Group is not an affiliate, representative, or authorized distributor for any manufacturer listed herein.

Modicon Quantum 800 Series I/O Modules with Unity Reference Manual

September 2004

33002455 01



Telemecanique


Document Set

Presentation

This package contains the following **Quantum with Unity Pro** manuals:

- Quantum Hardware Reference Manual
 - Quantum Discrete and Analog I/O Reference Manual
 - Quantum Experts and Communication Reference Manual
 - Grounding and Electromagnetic Compatibility of PLC Systems User Manual
 - Quantum 800 Series I/O Reference Manual
-

Table of Contents



	Safety Information	17
	About the Book	19
Part I	Overview of Modicon Quantum 800 Series I/O Modules with Unity	21
	Introduction	21
Chapter 1	Modicon Quantum 800 Series I/O Modules with Unity — Overview and Configuration	23
	Configuring Modicon Quantum 800 Series I/O Modules with Unity	24
	Technical Features Overview—Modicon Quantum 800 Series I/O Modules with Unity	26
Chapter 2	Modicon Quantum 800 Series I/O Modules with Unity Addressing Modes	31
	Flat Addressing—Modicon Quantum 800 Series I/O Modules	32
	Topological Addressing—Modicon Quantum 800 Series I/O Modules with Unity	33
	Addressing Example—Modicon Quantum 800 Series I/O Modules with Unity ..	34
Chapter 3	Modicon Quantum 800 Series I/O Modules with Unity	35
	Main Features—Modicon Quantum 800 Series I/O Modules with Unity	36
	Indicators—Modicon Quantum 800 Series I/O Modules with Unity	37
	I/O Map—Modicon Quantum 800 Series I/O Modules with Unity	38
	Grounding Guidelines—Modicon Quantum 800 Series I/O Modules with Unity ..	39
	Installation Guidelines—Modicon Quantum 800 Series I/O Modules with Unity ..	40
	Requirements—Modicon Quantum 800 Series I/O Modules with Unity	44
	CE Installation—Modicon Quantum 800 Series I/O Modules with Unity	45
	Installation Parts List—Modicon Quantum 800 Series I/O Modules with Unity ..	46
	Key Pin Assignments—Modicon Quantum 800 Series I/O Modules	47
	Quick Start Test—Modicon Quantum 800 Series I/O Modules with Unity	50
	Analog Module Specifications—Modicon Quantum 800 Series I/O Modules with Unity	51

	Discrete Module Specifications—Modicon Quantum 800 Series I/O Modules with Unity	52
Part II	800 Series RIO Modules	53
	Introduction	53
Chapter 4	J890 & J892 RIO Interface Modules	55
	J890 & J892 Overview	56
	J890 & J892 DIP Switch Settings for the Drop Address	57
	J892 DIP Switch Settings for ASCII Devices	60
	J890 & J892 Indications	63
	J890 & J892 Installation and Connection	66
	J890 & J892 Connectivity on an S908 RIO Network	69
	J890 & J892 RIO Interface Error Codes	71
	J892 ASCII Error Codes	72
	J890 & J892 Specifications	73
Chapter 5	P890 & P892 RIO Processors	75
	P890 & P892 Overview	76
	P890 & P892 Indicators	78
	P890 & P892 Power Available	79
	P890 & P892 Switch Settings for the Drop Address	80
	P890 & P892 Installation	83
	P890 & P892 Specifications	84
Chapter 6	ASP890300 RIO Processor	87
	ASP890300 General Description	88
	Indicators	91
	Power, Backplanes, I/O and Typical Configuration	92
	Switch Settings	95
	Diagnostics	99
	Installation	102
	Specifications	104
Part III	800 Series Analog I/O Modules	109
	Introduction	109
Chapter 7	B846-001 & B846-002 Input Multiplexers	111
	B846-001 & B846-002 Overview	112
	B846-001 & B846-002 Field Connections	114
	B846-001 & B846-002 Specifications	115
	B846-001 Parameter Configuration	116

Chapter 8	B872-100 Analog Output	117
	B872-100, Analog Output	118
	B872-100 Data Value to Output Conversion	119
	B872-100 Field Connections	122
	B872-100 - Setting Module DIP-Switch	124
	Calibration	126
	B872-100 Specifications	131
	B872-100 Parameter Configuration	133
Chapter 9	B872-200 Analog Output	135
	B872-200 Overview	136
	B872-200 Data Value to Output Conversion	138
	B872-200 Field Connections	142
	B872-200 - Setting Module Jumpers	144
	B872-200 - Setting Module DIP-Switch	145
	B872-200 Calibration	147
	B872-200 Specifications	151
	B872-200 Parameter Configuration	152
Chapter 10	B873-002 & B875-002 Analog Input	153
	B873-002 & B875-002 Overview	154
	B873-002 & B875-002 Switch Settings and Indicators	155
	B873-002 & B875-002 Installation	156
	B873-002 & B875-002 Calibration	159
	B873-002 & B875-002 Throughput Rate	163
	B873-002 & B875-002 Field Connections	164
	B873-002 & B875-002 Specifications	166
	B873-002 Parameter Configuration	167
	B875-002 Parameter Configuration	168
Chapter 11	B873-012 & B875-012 Analog Input	169
	B873-012 & B875-012 Overview	170
	B873-012 & B875-012 Switch Settings and Indicators	171
	B873-012 & B875-012 Installation	172
	B873-012 & B875-012 Calibration	175
	B873-012 & B875-012 Throughput Rate	177
	B873-012 & B875-012 Field Connections	178
	B873-012 & B875-012 Specifications	180
	B873-012 Parameter Configuration	181
	B875-012 Parameter Configuration	182
Chapter 12	B875-102 High Speed Analog Input	183
	B875-102 High Speed Analog Input, Inputs	184
	B875-102 High Speed Analog Input, Performance Considerations	187
	B875-102 High Speed Analog Input, Communications with the PLC	191

	B875–102 High Speed Analog Input, Typical Circuit and Ground Connections	193
	B875–102 High Speed Analog Input, Switch Settings	194
	B875–102 High Speed Analog Input, Indicators	203
	B875–102 High Speed Analog Input, Recalibration	204
	B875–102 High Speed Analog Input, Installation	207
	B875–102 High Speed Analog Input, Specifications	210
	B875-102 Parameter Configuration	212
Chapter 13	B875-111 & B877-111 Analog Input	213
	B875–111 Analog Input, Overview	214
	B875–111 Analog Input, Module Configuration	216
	B875–111 Analog Input, Field Connections	220
	B875–111 Analog Input, Application Example	227
	B875–111 Analog Input, Calibration	233
	B875–111 Analog Input, Quick Reference	236
	B875–111 Analog Input, Specifications	237
	B875-111 Parameter Configuration	239
	B877-111 Parameter Configuration	240
	B877–111, Terminal Numbering and Output Connections	241
Chapter 14	B875–200 Configurable A/D Input	243
	B875–200 Configurable A/D Input, Overview	244
	B875–200 Configurable A/D Input, Input Pack Insertion	246
	B875–200 Configurable A/D Input, Module Configuration	247
	B875–200 Configurable A/D Input, Field Connections	250
	B875–200 Configurable A/D Input, Calibration	258
	B875–200 Configurable A/D Input, Available Input Packs	261
	B875–200 Configurable A/D Input, Input Pack Simplified Schematics	265
	B875–200 Configurable A/D Input, Specifications	271
	B875-200 Parameter Configuration	273
Part IV	800 Series Discrete I/O Modules	275
	Introduction	275
Chapter 15	B802–008 115 Vac Output	279
	B802–008 115 Vac Output, Overview	280
	B802–008 115 Vac Output, Field Connections	281
	B802–008 48 Vac Output, Specifications	282
	B802–008 Parameter Configuration	283
Chapter 16	B803–008 115 Vac Input	285
	B803–008 115 Vac Input, Overview	286
	B803–008 115 Vac Input, Field Connections	287
	B803–008 115 Vac Input, Specifications	288
	B803–008 Parameter Configuration	289

Chapter 17	B804–116 115 Vac Output	291
	B804–116 115 Vac Output, Overview	292
	B804–116 115 Vac Output, Field Connections	293
	B804–116 48 Vac Output, Specifications	294
	B804–116 Parameter Configuration	295
Chapter 18	B804–148 48 Vac Output	297
	B804–148 48 Vac Output, Overview	298
	B804–148 48 Vac Output, Field Connections	299
	B804–148 48 Vac Output, Specifications	300
	B804–148 Parameter Configuration	301
Chapter 19	B805–016 115 Vac Input	303
	B805–016 115 Vac Input, Overview	304
	B805–016 115 Vac Input, Field Connections	305
	B805–016 115 Vac Input, Specifications	306
	B805–016 Parameter Configuration	307
Chapter 20	B806–032 115 Vac Output	309
	B806–032 115 Vac Output, Overview	310
	B806–032 115 Vac Output, Field Connections	312
	B806–032 115 Vac Output, Fusing Guidelines	313
	B806–032 115 Vac Output, Specifications	314
	B806–032 Parameter Configuration	315
Chapter 21	B806–124 24 Vac Output	317
	B806–124 24 Vac Output, Overview	318
	B806–124 24 Vac Output, Field Connections	320
	B806–124 24 Vac Output, Specifications	321
	B806–124 Parameter Configuration	322
Chapter 22	B807–132 115 Vac Input	323
	B807–132 115 Vac Input, Overview	324
	B807–132 115 Vac Input, Field Connections	326
	B807–132 115 Vac Input, Specifications	329
	B807–132 Parameter Configuration	330
Chapter 23	B808–016 230 Vac Output	331
	B808–016 230 Vac Output, Overview	332
	B808–016 230 Vac Output, Field Connections	333
	B808–016 230 Vac Output, Specifications	334
	B808–016 Parameter Configuration	335
Chapter 24	B809–016 230 Vac Input	337
	B809–016 230 Vac Input, Overview	338
	B809–016 230 Vac Input, Field Connections	339
	B809–016 230 Vac Input, Specifications	340

	B809–016 Parameter Configuration	341
Chapter 25	B810–008 115 Vac Isolated Output.	343
	B810–008 115 Vac Output, Overview	344
	B810–008 115 Vac Output, Field Connections	345
	B810–008 115 Vac Isolated Output, Specifications	346
	B810–008 Parameter Configuration	347
Chapter 26	B814–108 Relay Output.	349
	B814–108 Relay Output, Overview	350
	B814–108 Relay Output, Configuration	351
	B814–108 Relay Output, Field Connections	352
	B814–108 Relay Output, Specifications.	353
	B814–108 Parameter Configuration	354
Chapter 27	B816 Isolated Output.	355
	B816 Parameter Configuration	355
Chapter 28	B817–116 and B817–216 115/230 Vac Isolated Input	357
	B817–116 (115 Vac) and B817–216 (230 Vac) Isolated Input, Overview	358
	B817–116 (115 Vac) and B817–216 (230 Vac) Isolated Input, Field Connections	359
	B817–116 (115 Vac) and B817–216 (230 Vac) Isolated Input, Specifications.	362
	B817–116 and B817–216 Parameter Configuration	363
Chapter 29	B818 24 Vac Output.	365
	B818—Setting Module DIP Switch	366
	B818 24Vdc Output, Field Connections.	367
	B818 24 Vdc (True High) Output, Specifications.	368
	B818 Parameter Configuration	369
Chapter 30	B819–232 230 Vac Input	371
	B819-232, 230 Vac Input, Keying and Wiring	372
	B819-232, 32 Point Input, Specifications.	374
	B819-232 Parameter Configuration	375
Chapter 31	B820–008 10–60 Vdc Output	377
	B820–008 10–60 Vdc Output, Overview	378
	B820–008 10–60 Vdc Output, Field Connections	379
	B820–008 10–60 Vdc Output, Specifications.	380
	B820–008 Parameter Configuration	381
Chapter 32	B821–108 10–60 Vdc Input (True High)	383
	B821–108 10–60 Vdc Input (True High), Overview	384
	B821–108 10–60 Vdc Input (True High), Field Connections	385
	B821–108 10–60 Vdc Input (True High), Specifications	386

	B821–108 Parameter Configuration	388
Chapter 33	B824–016 24 Vdc Output (True High)	389
	B824–016 24 Vdc Output (True High), Overview	390
	B824–016 24 Vdc Output (True High), Field Connections	391
	B824–016 24 Vdc Output (True High), Specifications	392
	B824–016 Parameter Configuration	393
Chapter 34	B825–016 24 Vdc Input (True High)	395
	B825–016 24 Vdc Input (True High), Overview	396
	B825–016 24 Vdc Input (True High), Field Connections	397
	B825–016 24 Vdc Input (True High), Specifications	398
	B825–016 Parameter Configuration	399
Chapter 35	B826–032 24 Vdc Output (True High)	401
	B826–032 Parameter Configuration	401
Chapter 36	B827–032 24 Vdc Input (True High)	403
	B827–032 24 Vdc Input (True High), Overview	404
	B827–032 24 Vdc Input (True High), Field Connections	405
	B827–032 24 Vdc Input (True High), Specifications	406
	B827–032 Parameter Configuration	407
Chapter 37	B828–016 5 V TTL Output	409
	B828–016 5 V TTL Output, Overview	410
	B828–016 5 V TTL Output, Field Connections	411
	B828–016 5 V TTL Output, Specifications	412
	B828–016 Parameter Configuration	413
Chapter 38	B829–116 Fast Response 5 V TTL Input	415
	B829–116 Fast Response 5 V TTL Input, Overview	416
	B829–116 Fast Response 5 V TTL Input, Field Connections	417
	B829–116 Fast Response 5 V TTL Input, Specifications	418
	B829–116 Parameter Configuration	419
Chapter 39	B832–016 24 Vdc Output (True Low)	421
	B832–016 24 Vdc Output (True Low), Overview	422
	B832–016 24 Vdc Output (True Low), Field Connections	423
	B832–016 24 Vdc Output (True Low), Specifications	424
	B832–016 Parameter Configuration	425
Chapter 40	B833–016 24 Vdc Input (True Low)	427
	Overview	427
	B833–016 24 Vdc Input (True Low), Overview	428
	B833–016 24 Vdc Input (True Low), Field Connections	429
	B833–016 24 Vdc Input (True Low), Specifications	430
	B833–016 Parameter Configuration	431


Chapter 41	B836–016 12—250 Vdc Isolated Output	433
	B836–016 12—250 Vdc Isolated Output, Overview	434
	B836–016 12—250 Vdc Isolated Output, Field Connections	435
	B836–016 12—250 Vdc Isolated Output, Specifications	437
	B836–016 Parameter Configuration	438
Chapter 42	B837–016 24 Vac/Vdc Input (True High)	439
	B837–016 24 Vac/Vdc Input (True High), Overview	440
	B837–016 24 Vac/Vdc Input (True High), Field Connections	441
	B837–016 24 Vac/Vdc Input (True High), Specifications	442
	B837–016 Parameter Configuration	443
Chapter 43	B838–032 24 Vdc Output (True High)	445
	B838–032 24 Vdc Output (True High), Overview	446
	B838–032 24 Vdc Output (True High), Field Connections	447
	B838–032 24 Vdc Output (True High), Specifications	448
	B838–032 Parameter Configuration	449
Chapter 44	B840–108 Relay Output	451
	B840–108 Relay Output, Overview	452
	B840–108 Relay Output, Field Connections	454
	B840–108 Relay Output, Specifications	455
	B840–108 Parameter Configuration	456
Chapter 45	B842–008 Reed Relay Output	457
	B842–008 Reed Relay Output, Overview	458
	B842–008 Reed Relay Output, Field Connections	459
	B842–008 Reed Relay Output, Specifications	460
	B842–008 Parameter Configuration	461
Chapter 46	B849–016 48 Vac/Vdc Input (True High)	463
	B849–106 48 Vac/Vdc Input (True High), Overview	464
	B849–016 48 Vac/Vdc Input (True High), Field Connections	466
	B849–016 48 Vac/Vdc Input (True High), Specifications	467
	B849–016 Parameter Configuration	468
Chapter 47	B853–016 115 Vac/125 Vdc Input (True High)	469
	B853–016 115 Vac/125 Vdc Input (True High), Overview	470
	B853–016 115 Vac/125 Vdc Input (True High), Field Connections	472
	B853–016 115 Vac/125 Vdc Input (True High), Specifications	473
	B853–016 Parameter Configuration	474
Chapter 48	855–016 Intrinsically Safe Input	475
	B855–016 Intrinsically Safe Input, Overview	476
	B855–016 Intrinsically Safe Input, Installation	477
	B855–016 Intrinsically Safe Input, Specifications	481
	B855–016 Parameter Configuration	483

Chapter 49	B862–001 Register Output	485
	B862–001 Register Output, Overview	486
	B862–001 Register Output, Switch Settings	487
	B862–001 Register Output, Field Connections	488
	B862–001 Register Output, Specifications	491
	B862–001 Parameter Configuration	492
Chapter 50	B863–032 Monitored 24 Vdc Input	493
	B863–032 Monitored 24 Vdc Input, Overview	494
	B863–032 Monitored 24 Vdc Input, Field Connections	495
	B863–032 Monitored 24 Vdc Input, Specifications	496
	B863–032 Parameter Configuration	497
Chapter 51	B863–132 24 Vdc Input	499
	B863–132 24 Vdc Input, Overview	500
	B863–132 24 Vdc Input, Switch Settings	501
	B863–132 24 Vdc Input, Field Connections	502
	B863–132 24 Vdc Input, Configuration	503
	B863–132 24 Vdc Input, Specifications	504
	B863–132 Parameter Configuration	505
Chapter 52	B864–001 Register Output	507
	B864–001 Register Output, Overview	508
	B864–001 Register Output, Switch Settings	509
	B864–001 Register Output, Field Connections	510
	B864–001 Register Output, Specifications	513
	B864–001 Parameter Configuration	514
Chapter 53	B865–001 Register Input	515
	B865–001 Register Input, Overview	516
	B865–001 Register Input, Switch Settings	518
	B865–001 Register Output, Field Connections	519
	B865–001 Register Input, Specifications	522
	B865–001 Parameter Configuration	524
Chapter 54	B868–001 Register Output	525
	B868–001 Register Output, Overview	526
	B868–001 Register Output, Switch Settings	527
	B868–001 Register Output, Field Connections	528
	B868–001 Register Output, Specifications	531
	B868–001 Parameter Configuration	532
Chapter 55	B869–002 Register Input	535
	B869–002 Register Input, Overview	536
	B869–002 Register Input, Switch Settings	538
	B869–002 Register Output, Field Connections	539
	B869–002 Register Output, Specifications	541

	B869–002 Parameter Configuration	542
Chapter 56	B881–001 Latched 24 Vdc Input	545
	B881–001 Latched 24 Vdc Input, Overview	546
	B881–001 Latched 24 Vdc Input, Field Connections	549
	B881–001 Latched 24 Vdc Input, Specifications	550
	B881–001 Parameter Configuration	551
Chapter 57	B881–508 125 Vdc Output	553
	B881–508 125 Vdc Output, Overview	554
	B881–508 125 Vdc Output, Fault Conditions	555
	B881–508 125 Vdc Output, Field Connections	556
	B881–508 125 Vdc Output, Specifications	557
	B881–508 Parameter Configuration	558
Chapter 58	B882–032 24 Vdc Diagnostic Output and B818 20-28 Vac Discrete Output	559
	B882–032 24 Vdc Diagnostic Output, Overview	560
	B882–032 24 Vdc Diagnostic Output, Fault Conditions	561
	B882–032 24 Vdc Diagnostic Output, Field Connections	563
	B818, 20-28 Vac Output, Keying and Wiring	564
	B882–032 24 Vdc Diagnostic Output, Dip Switch Settings	566
	B882–032 24 Vdc Diagnostic Output, Specifications	567
	B818, 20-28 Vac Output, Specifications	568
	B882–032 Parameter Configuration	569
	B818 Parameter Configuration	570
Chapter 59	B882–116 24 Vdc Output	571
	B882–116 24 Vdc Output, Overview	572
	B882–116 24 Vdc Output, Field Connections	573
	B882–116 24 Vdc Output, Configuration	574
	B882–116 24 Vdc Output, Switch Settings	577
	B882–116 24 Vdc Output, Specifications	578
	B882–116 Parameter Configuration	580
Part V	800 Series Special Purpose Modules	583
	Introduction	583
Chapter 60	B882–239 High Speed Counter	585
	B882–239 High Speed Counter, Overview	586
	B882–239 High Speed Counter, Keying and Wiring	587
	B882–239 High Speed Counter, Specifications	589
	B882–239 Parameter Configuration	591

Chapter 61	B883–001 High Speed Counter	593
	B883–001 High Speed Counter, Overview	594
	B883–001 High Speed Counter, Keying and Wiring	595
	B883–001 High Speed Counter, Specifications	597
	B883–001 Parameter Configuration	598
Chapter 62	B883–101 and B883–111 CAM	599
	B883-101 & B883-111 CAM, Overview	600
	B883–101 and B883–111 CAM, Keying and Wiring	601
	B883–101 and B883–111 CAM, Specifications	602
	B883–101 and B883–111 Parameter Configuration	603
Chapter 63	B883–200 Thermocouple Input Module	605
	B883–200 Thermocouple Input, Overview	606
	B883–200 Thermocouple Input, Keying and Wiring	607
	B883–200 Thermocouple Input, Specifications	609
	B883–200 Parameter Configuration	610
Chapter 64	B883–201 RTD Input	613
	B883–201 RTD Input, Overview	614
	B883–201 RTD Input, Keying and Wiring	615
	B883–201 RTD Input, Specifications	617
	B883–201 Parameter Configuration	618
Chapter 65	B884–002 PID	621
	B884–002 PID, Overview	622
	B884–002 PID Control, Keying and Wiring	623
	B884–002 PID Control, Specifications	625
	B884–002 Parameter Configuration	626
Chapter 66	B885–002 ASCII / BASIC	629
	B885–002 ASCII / BASIC, Overview	630
	B885–002 ASCII / BASIC, Keying and Wiring	631
	B885–002 ASCII / BASIC, Specifications	632
	B885–002 Parameter Configuration	633
Index	635

Safety Information



Important Information

NOTICE

Read these instructions carefully, and look at the equipment to become familiar with the device before trying to install, operate, or maintain it. The following special messages may appear throughout this documentation or on the equipment to warn of potential hazards or to call attention to information that clarifies or simplifies a procedure.



The addition of this symbol to a Danger or Warning safety label indicates that an electrical hazard exists, which will result in personal injury if the instructions are not followed.



This is the safety alert symbol. It is used to alert you to potential personal injury hazards. Obey all safety messages that follow this symbol to avoid possible injury or death.



DANGER

DANGER indicates an imminently hazardous situation, which, if not avoided, **will result** in death, serious injury, or equipment damage.



WARNING

WARNING indicates a potentially hazardous situation, which, if not avoided, **can result** in death, serious injury, or equipment damage.



CAUTION


CAUTION indicates a potentially hazardous situation, which, if not avoided, **can result** in injury or equipment damage.

PLEASE NOTE

Electrical equipment should be serviced only by qualified personnel. No responsibility is assumed by Schneider Electric for any consequences arising out of the use of this material. This document is not intended as an instruction manual for untrained persons.

© 2004 Schneider Electric. All Rights Reserved.

About the Book



At a Glance

Document Scope This manual is a reference document for the Modicon Quantum 800 Series I/O Modules with Unity. The manual provides an overview, keying and wiring information, specifications, and parameter configuring information for four types of modules:

- RIO drop
- analog
- discrete
- special purpose

Note: 984LL and IEC notation

The manual displays both 984LL and IEC notation, but most module descriptions use 984LL notation. Conversion charts appear in the first chapters.

- (See *Converting Direct Address Notation*, p. 25)
- (See *Introduction*, p. 32)

Note: Audience

Users should be familiar with automation controls and be qualified to install and operate automation equipment.

Note: Module availability

- Some modules may no longer be available for sale.
- For the status of particular modules, please contact your local sales office.
- To locate a sales office,
 1. visit <http://www.schneider-electric.com>
 2. Select your country in the drop-down menu.

Validity Note

The data and illustrations found in this documentation are not binding. We reserve the right to modify our products in line with our policy of continuous product development. The information in this document is subject to change without notice and should not be construed as a commitment by Schneider Electric.

Related Documents

Title of Documentation	Reference Number
Quantum Hardware Reference Manual	UNYUSE10010V11E (part of this package)
Grounding and Electromagnetic Compatibility of PLC Systems User Manual	UNYUSE10010V11E (part of this package)

Product Related Warnings

Schneider Electric assumes no responsibility for any errors that may appear in this document. If you have any suggestions for improvements or amendments or have found errors in this publication, please notify us.

No part of this document may be reproduced in any form or by any means, electronic or mechanical, including photocopying, without express written permission of Schneider Electric.

All pertinent state, regional, and local safety regulations must be observed when installing and using this product. For reasons of safety and to ensure compliance with documented system data, only the manufacturer should perform repairs to components.

When controllers are used for applications with technical safety requirements, please follow the relevant instructions.


Failure to use Schneider Electric software or approved software with our hardware products may result in injury, harm, or improper operating results.

Failure to observe this product related warning can result in injury or equipment damage.

User Comments

We welcome your comments about this document. You can reach us by e-mail at TECHCOMM@modicon.com

Overview of Modicon Quantum 800 Series I/O Modules with Unity



Introduction

At a Glance

This part provides a global overview of the 800 Series I/O modules. The content provides the description of generic features common to all modules.

What's in this Part?

This part contains the following chapters:

Chapter	Chapter Name	Page
1	Modicon Quantum 800 Series I/O Modules with Unity—Overview and Configuration	23
2	Modicon Quantum 800 Series I/O Modules with Unity Addressing Modes	31
3	Modicon Quantum 800 Series I/O Modules with Unity	35

Modicon Quantum 800 Series I/O Modules with Unity—Overview and Configuration

1

At a Glance

Purpose

This chapter describes both configuring the modules with Unity Pro and the available 800 Series I/O modules, including their basic technical features.

What's in this Chapter?

This chapter contains the following topics:

Topic	Page
Configuring Modicon Quantum 800 Series I/O Modules with Unity	24
Technical Features Overview—Modicon Quantum 800 Series I/O Modules with Unity	26

Configuring Modicon Quantum 800 Series I/O Modules with Unity

Introduction

To configure a Series 800 I/O module under Unity, configure a RIO drop, which contains I/O modules. The following description gives you step by step instructions to implement and configure Series 800 I/O modules into a Modicon Quantum with Unity system.

Adding a RIO Bus

To add a RIO Bus to a Modicon Quantum with Unity system,

Step	Action	Comment
1	From the Project Browser "Configuration" tree, open the local Quantum rack	The graphical representation of the local Quantum rack opens.
2	Double-click an empty slot in the rack where you want to place your RIO head.	The "New Device" dialog window opens.
3	Open the "Communication" tree and double-click on the 140 CRP 93X 00 module.	The RIO head module is added to the local Quantum rack. In the Project Browser "Configuration" tree the "RIO bus" is automatically added.

Adding a 800 I/O Drop

To add a 800 I/O Drop to a Modicon Quantum with Unity system,

Step	Action	Comment
1	From the Project Browser "Configuration" tree, double-click the "RIO bus"	The graphical representation of the RIO bus opens.
2	Double-click an empty node of the RIO bus	The "New Device" dialog window opens.
3	In the "New Device" dialog window, select both the appropriate rack from the "800 IO Drop" tree and a "Drop-end communicator" module.	A new 800 I/O rack containing a communication module is added to your RIO bus.
4	Click OK.	

Adding a 800 I/O Module

To add a new I/O module to your RIO Drop

Step	Action	Comment
1	From the "RIO Bus" configuration window, double-click an empty slot in the rack where you want to place your I/O module.	The "New Device" dialog window opens.
2	From the "New Device" window, open the list of analog or discrete modules and double-click on the appropriate module.	The I/O module is added to the rack.

Configuring a Module

To configure an I/O module,

1. Double click on the module.

When the configuration window opens, enter the following parameters:

Parameter Name	Description
MAPPING	Define whether access is either 1. Bits (%I-1x, %M-0x) 2. Words (%IW-3x, %MW-4x)
INPUTS STARTING ADDRESS	In the address type, as defined by the MAPPING parameter, enter the starting address of the input data.
INPUTS ENDING ADDRESS	Parameter automatically calculated by the system.
OUTPUTS STARTING ADDRESS	In the address type, as defined by the MAPPING parameter, enter the starting address of the output data.
OUTPUTS ENDING ADDRESS	Parameter automatically calculated by the system.
OUTPUT TYPE	Define whether data value is interpreted either as 1. BINARY 2. BCD

Converting Direct Address Notation

Use the following table to convert 984LL notation to IEC notation.

Outputs and Inputs	984LL Notation Register Addresses	IEC Notation		
		System Bits and Words	Memory Addresses	I/O Addresses
output	0x	System Bit	%Mx	%Qx
input	1x	System Bit	%Ix	%Ix
input	3x	System Word	%IWx	%IWx
output	4x	System Word	%MWx	%QWx

Technical Features Overview—Modicon Quantum 800 Series I/O Modules with Unity

Introduction

The following tables provide an overview of the technical features for all Series 800 I/O.

- RIO Interface modules (See *RIO Interface Modules*, p. 26)
 - Analog I/O modules (See *Analog Modules*, p. 27)
 - Discrete I/O modules (See *Discrete Modules*, p. 28)
 - Special Purpose I/O modules (See *Special Purpose Modules*, p. 30)
-

RIO Interface Modules

The following table displays a summary of the technical data for the RIO interface modules. For detailed information about a module, see its chapter.

Module	Type	Range	Channels	Remarks
J890	Drop Interface	-	-	-
J892	Drop Interface	-	-	-
P890	Direct Interface	-	-	-
P892	Direct Interface	-	-	-

Analog Modules The following table displays a summary of the technical data for the analog modules. For detailed information about a module, see its chapter.

Module	Type	Range	Channels	Remarks
B846-001	In	0-5 V 1-5 V +/- 10 V	16	Reed-Relay-Multiplexer for voltage input as front end for A/D-Converter B873/875. 1 Word (Bin)
B846-002	In	4-20 mA	16	Reed-Relay-Multiplexer for current input (Input impedance 250 Ohm) as front end for A/D-Converter B873/875. 1 Word (Bin)
B872-100	Out	4-20 mA	4	User supply required.
B872-200	Out	0-5 VDC 0-10 VDC +/- 5 VDC +/- 10 VDC	4	Operating range selectable per channel. No user supply required.
B873-002	In	1-5 VDC 4-20 mA	4	4 Words (Bin)
B875-002	In	1-5 VDC 4-20 mA	8	8 Words (Bin)
B873-012	In	+/- 10 VDC	4	4 Words Out (Bin)
B875-012	In	+/- 10 VDC	8	8 Words Out (Bin)
B875-102	In	1-5 VDC 0-5 VDC 0-10 V +/- 5 V +/- 10 V 4-20 mA 0-20 mA 0-40 mA +/- 20 mA +/- 40 mA	4 (8)	High Speed
B875-111	In	1-5 VDC 0-5 VDC 0-10 V +/- 5 V +/- 10 V 4-20 mA 0-20 mA +/- 20 mA	8 differential or 16 single	8 Words (Bin) As B877 = 16 Words (Bin)
B875-114	In	0-2 mA	8 differential	
B875-200	In	4-20 mA 1-5 V RTD/TC 0-10 V 0-20 mA	8	A/D Converter with plug able input amplifier modules

Discrete Modules

The following table displays a summary of the technical data for the discrete modules. For detailed information about a module, see its chapter.

Module	Type	Range	Channels	Remarks
B802-008	Out	80 - 130 Vac cont. / 47 - 63 Hz	8	Individually isolated
B803-008	In	80 - 130 Vac cont. / 47 - 63 Hz	8	Individually isolated
B804-116	Out	80 - 130 Vac cont. / 47 - 63 Hz	16	Isolated 2 groups / 8 points per group
B804-148	Out	40 - 56 Vac / 47 - 63 Hz	16	Isolated 2 groups / 8 points per group
B805-016	In	80 - 130 Vac cont. / 47 - 63 Hz	16	Isolated 2 groups / 8 points per group
B806-032	Out	80 - 130 Vac cont. / 47 - 63 Hz	32	
B806-124	Out	20 - 28 Vac cont. / 47 - 63 Hz 32 Vac RMS max. for 10 s	32	2 groups / 16 points per group
B807-132	In	80 - 130 Vac cont. / 47 - 63 Hz	32	4 groups / 8 points per group
B808-016	Out	180 - 260 Vac / 47 - 63 Hz	16	2 groups / 8 points per group
B809-016	In	160 - 260 Vac / 47 - 63 Hz	16	2 groups / 8 points per group
B810-008	Out	80 - 130 Vac cont. / 47 - 63 Hz	8	Isolated
B814-108	Out	0 - 30 Vdc 0 - 240 Vac / 47 - 63 Hz	8	Relay
B817-116	In	115 Vac	16	Isolated
B817-216	In	230 Vac	16	Isolated
B820-008	Out	10 - 60 Vdc	8	True high
B821-108	In	10 - 60 Vdc	8	True high
B824-016	Out	20 - 28 Vdc	16	True high
B825-016	In	20 - 28 Vdc	16	True high
B827-032	In	18 - 30 Vdc	32	True high
B828-016	Out	5 V TTL	16	
B829-116	In	5 V TTL	16	High speed TTL

Module	Type	Range	Channels	Remarks
B832-016	Out	20 - 28 Vdc	16	True low
B833-016	In	20 - 28 Vdc	16	True low
B836-016	Out	12 - 250 Vdc	16	Isolated
B837-016	In	20.4 - 27 Vac / 47 - 63 Hz 19.2 - 30 Vdc	16	Isolated 2 groups / 8 points per group
B838-032	Out	20 - 30 Vdc	32	True high
B840-108	Out	0 - 300 Vdc max. 0 - 230 Vac max. / 47 - 63 Hz	8	Relay
B846-001	In	0-5 V 1-5 V ± 10 V	16	1 Word Out (Bin)
B846-002	In	4-20 mA	16	1 Word Out (Bin)
B849-016	In	41 - 53 Vac / 47 - 63 Hz 39 - 58 Vdc	16	
B853-016	In	80 - 130 Vac / 47 - 63 Hz 85 - 150 Vdc	16	True high
B855-016	In	11.4 - 12.6 Vdc	16	Isolated
B863-032	In	18-30 Vdc true high 24 Vdc nominal	32	
B863-132	In	0 - 30 Vdc	32	
B864-001	Out		8	8 channel reg. mux
B865-001	In	5 V TTL	8	8 channel reg. mux
B881-001	In	20 - 28 Vdc	16	
B881-508	Out	5 - 140 Vdc maximum	8	
B882-032	Out	19.2 - 28 Vdc	32	
B882-116	Out	19.2 - 30 Vdc	16	

Special Purpose Modules

The following table displays a summary of the technical data for the special purpose modules. For detailed information about a module, see its chapter.

Module	Type	Range	Channels	Remarks
B882-239	High Speed Counter	30 kHz 350 Hz		4 inputs 3 outputs
B883-001	High Speed Counter	50 kHz	2	3 outputs
B883-101	CAM	4	-	-
B883-200	Thermocouple Input	Centigrade Fahrenheit Millivolts	10 In	Open circuit detect Self-calibrated
B883-201	RTD Input	Centigrade Fahrenheit	8	American European Linear
B884-002	PID Loop	N/A	2	Open/closed loop
B885-002	ASCII/ BASIC	N/A	2	RS232 RS422

Modicon Quantum 800 Series I/O Modules with Unity Addressing Modes

2

At a Glance

Purpose

To allow an easy transition from the register addressing (3x, 4x) of 984LL to the IEC addressing modes used in Unity Pro, this chapter describes

- Flat Addressing
- Topological Addressing

What's in this Chapter?

This chapter contains the following topics:

Topic	Page
Flat Addressing—Modicon Quantum 800 Series I/O Modules	32
Topological Addressing—Modicon Quantum 800 Series I/O Modules with Unity	33
Addressing Example—Modicon Quantum 800 Series I/O Modules with Unity	34

Flat Addressing—Modicon Quantum 800 Series I/O Modules

Introduction

The Modicon Quantum with Unity modules follow a system of flat address mapping. To work properly, each module requires a determinate number of bits and/or words. The IEC addressing system is equivalent to the 984LL register addressing. Use the following assignments:

- 0x is now %Mx
- 1x is now %Ix
- 3x is now %IWx
- 4x is now %MWx

Use the following table to convert 984LL notation to IEC notation.

Outputs and Inputs	984LL Notation Register Addresses	IEC Notation		
		System Bits and Words	Memory Addresses	I/O Addresses
output	0x	System Bit	%Mx	%Qx
input	1x	System Bit	%Ix	%Ix
input	3x	System Word	%IWx	%IWx
output	4x	System Word	%MWx	%QWx

To access the I/O data of a module,

Step	Action
1	Enter the address range in the configuration screen.

Examples

The following examples show the relationship between 984LL register addressing and IEC addressing:

000001 is now %M1
 100101 is now %I101
 301024 is now %IW1024
 400010 is now %MW10

Topological Addressing—Modicon Quantum 800 Series I/O Modules with Unity

Introduction

Use topological addressing to access I/O data items. Identify the topological location of the module within a Modicon Quantum with Unity system using the following notation:

```
%<Exchangetype><Objecttype>[\b.e\]r.m.c[.rank]
```

Abbreviations used:

- **b** = bus
- **e** = equipment (drop)
- **r** = rack
- **m** = module slot
- **c** = channel

Note: When addressing,

1. The [b.e] defaults to \1.1\ in a local rack and does not need to be specified.
2. The rank is an index used to identify different properties of an object with the same data type (value, warning level, error level).
3. The rank numbering is zero-based, and if the rank is zero, omit the entry.

For detailed information on I/O variables, please refer to the *Unity Pro Reference Manual*.

Example

Reading Values

To read	Action
input value (rank = 0) from channel 7 of an analog module located in slot 6 of a local rack:	Enter %IW1.6.7[.0]
input value (rank = 0) from channel 7 of an analog module located in drop 3 of RIO bus 2:	Enter %IW\2.3\1.6.7[.0]
'out of range' value (rank = 1) from channel 7 of an analog module located in slot 6 of a local rack:	Enter %I1.6.7.1[.0]

Addressing Example—Modicon Quantum 800 Series I/O Modules with Unity

Analog Module

The following example compares the 2 possible addressing modes. An 8-channel analog input module B875-200 with the following configuration data is used:

- mounted in slot 5 of the RIO rack #3 located at drop 4 on bus 2
- starting input address is 201 (input word %IW201)
- end input address is 208 (input word %IW208)

To access the I/O data from the module you can use the following syntax:

Module data	Flat addressing	Topological addressing	Concept addressing
Channel 3	%IW203	%IW\2.4\3.5.3	300203

For comparison, the register addressing as used with Concept is added in the last column.

Discrete Module

The following example compares the 2 possible addressing modes. An 32-channel discrete output module B838-032 with the following configuration data is used:

- mounted in slot 4 of the RIO rack #3 located at drop 4 on bus 2
- starting output address is 101 (output word %MW101)
- end output address is 102 (output word %MW102)

To access the I/O data from the module you can use the following syntax:

Module data	Flat addressing	Topological addressing	Concept addressing
Output 5	%MW101.11	%QW\2.4\3.4.1.1.11	300101
Output17	%MW102.15	%QW\2.4\3.4.1.2.15	300102

For comparison, the register addressing as used with Concept is added in the last column. As Concept does not support direct addressing of a bit in a word, the bit extraction has to be performed in the user program.

The same configuration as before but data mapped into bits:

- mounted in slot 4 of the RIO rack #3 located at drop 4 on bus 2
- starting output address is 1 (output %M1)
- end output address is 32 (output %M32)

To access the I/O data from the module you can use the following syntax:

Module data	Flat addressing	Topological addressing	Concept addressing
Output 5	%M5	%Q\2.4\3.4.5	000005
Output17	%M17	%Q\2.4\3.4.17	000017

For comparison, the register addressing as used with Concept is added in the last column.

Modicon Quantum 800 Series I/O Modules with Unity

3

At a Glance

Purpose

This chapter describes in brief the Modicon Quantum with Unity 800 Series I/O modules. Detailed information about each module is covered in individual chapters.

What's in this Chapter?

This chapter contains the following topics:

Topic	Page
Main Features—Modicon Quantum 800 Series I/O Modules with Unity	36
Indicators—Modicon Quantum 800 Series I/O Modules with Unity	37
I/O Map—Modicon Quantum 800 Series I/O Modules with Unity	38
Grounding Guidelines—Modicon Quantum 800 Series I/O Modules with Unity	39
Installation Guidelines—Modicon Quantum 800 Series I/O Modules with Unity	40
Requirements—Modicon Quantum 800 Series I/O Modules with Unity	44
CE Installation—Modicon Quantum 800 Series I/O Modules with Unity	45
Installation Parts List—Modicon Quantum 800 Series I/O Modules with Unity	46
Key Pin Assignments—Modicon Quantum 800 Series I/O Modules	47
Quick Start Test—Modicon Quantum 800 Series I/O Modules with Unity	50
Analog Module Specifications—Modicon Quantum 800 Series I/O Modules with Unity	51
Discrete Module Specifications—Modicon Quantum 800 Series I/O Modules with Unity	52

Main Features—Modicon Quantum 800 Series I/O Modules with Unity

- List of Features**
- Each module offers
- Status indicators
 - Front accessible fuses
 - Handle that permits easy installation and removal
 - Safe, nonconductive front that permits easy access of test probes
 - Each point electrically isolated from logic by an optical coupler
- Each module
- Is removable without disturbing rigid field wiring system
 - Designed for harsh plant floor environments
 - Satisfies SWC requirements of both IEEE and ANSI guidelines
-

Operating Facts Note the following.

Fact about	Description
Voltage transients	The I/O signals can withstand the severe voltage transients normally encountered in industrial environments without damage to the I/O module or controller.
Communication failures	All I/O points shut OFF in the event of a communication failure between a Modicon controller and the I/O module. Shut OFF occurs within 300 ms of the signal loss. The module's ACTIVE indicator will also shut OFF.
Installing modules	The I/O modules can be inserted into any location in the 800 series I/O structure. The module slides easily into the module housing and does not interfere with any other module's operation.
Logic circuitry	The module's protective case shields the logic circuitry from any electrical interference and minimizes the possibility of any noise being coupled from the user side of the circuitry to adjacent modules.
Grounding	A ground is automatically established when the module is inserted into the housing. This low impedance earth ground originates from the housing's backplane.

Indicators—Modicon Quantum 800 Series I/O Modules with Unity

Types of Indicators

The status indicators on the front of the module are listed below.

Indicator	Description
Active	The green indicator <ul style="list-style-type: none"> ● is ON when the module has passed its power diagnostics without error ● remains ON until the background diagnostics detect <ol style="list-style-type: none"> 1. an error condition 2. loss of internal voltage 3. loss of communication with the CPU
Discrete I/O	These red output indicators, when ON, indicate that power is available at the output of the module for use by field devices.
Blown Fuse	These red indicators, when ON, indicate that a fuse is blown.
Over Range	These red indicators, when ON or FLICKERING, indicate that one or more inputs have exceeded the valid input range.
Under Range	These red indicators, when ON or FLICKERING, indicate that one or more inputs have dropped below the valid input range.
Field Power	These red indicators, when ON, indicate that field power is supplied.

<p>Note: The active indicator does not represent the condition of the I/O points. The indicator may be lit with one or more of the I/O points not working properly.</p>
--

I/O Map—Modicon Quantum 800 Series I/O Modules with Unity

I/O Map Characteristics

The I/O Map is used to direct the flow of data between the various I/O modules and the logic program. It is the tie between the references used in the logic program and the I/O module connection points.

The I/O Map also tells the controller how to use an input signal in user logic and where to send an output signal. The format of register data (BCD binary coded decimal or BIN binary) is specified on the I/O Map screen. The screen objective is to load the card selections and reference number selections to complete the configuration of the I/O.

In the Configuration Overview screen, the number of I/O drops and I/O modules must be specified. These numbers are checked when entries to the I/O Map screen are made.

Grounding Guidelines—Modicon Quantum 800 Series I/O Modules with Unity

Ground and Shield Guidelines


The following table provides guideline notes on Ground and Shield Practices.

1	To have proper case ground, the housing must be connected to an earth ground.
2	When using shielded, field circuit wires, do not ground the shield at both ends of the circuit (for example, the module and the field device).
3	Single point grounding should be used where possible.
4	Priority for shield grounding: <ol style="list-style-type: none">1. Field side device case, if metal2. Earth ground, as close to the field side device or module as possible3. From shield to frame


Installation Guidelines—Modicon Quantum 800 Series I/O Modules with Unity

Installing an 800 Series I/O Module The following table provides the steps involved, to install an 800 Series I/O Module:

Step	Action
1	Remove module from its shipping box.
2	Check for damage. If damaged, contact your salesman or distributor for correct procedure.
3	Ensure power to housing is OFF.
4	Designate the housing slot for this module.
5	Locate required connector assembly. (Modicon Part number AS-8534-000 or AS-8535-000). This assembly consists of one or two 20-pin connectors. Note: Remove the keying tabs on the connector prior to installing the module.
6	Remove old duct. Remove only if a different connector/cabling duct assembly is already present in the designated housing slot.
7	(Optional Step) If there is a module to the immediate left of the slot designated for the new module's installation, temporarily remove it.

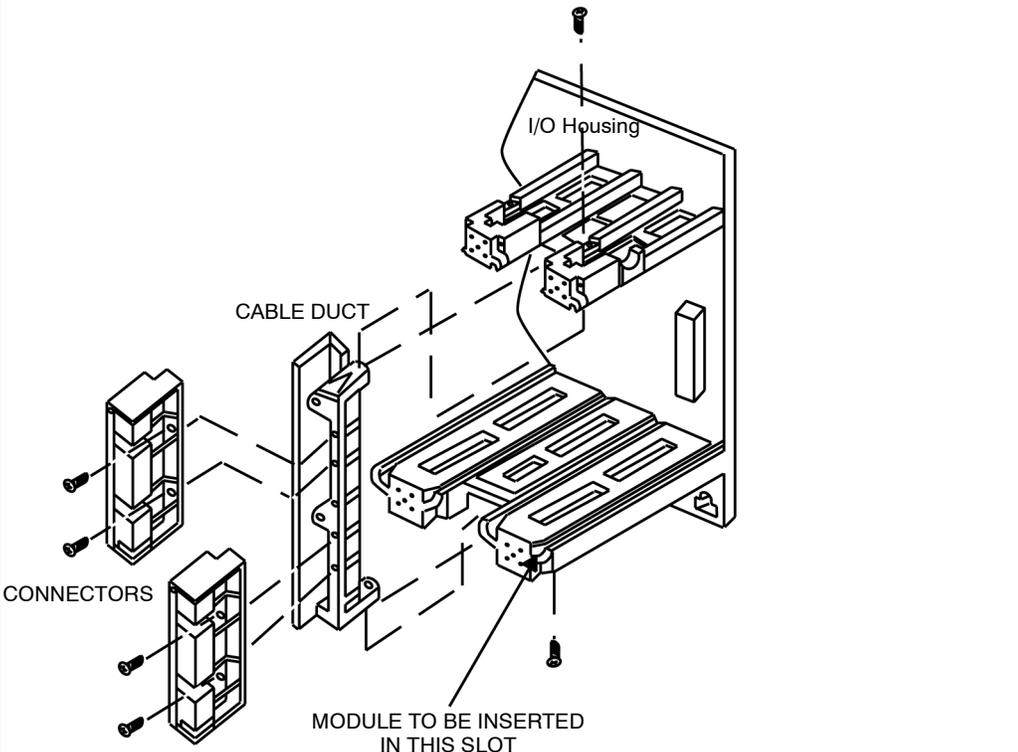Step	Action
8	<p data-bbox="318 443 1336 569">Refer to the following figure. Mount the new field connector/duct assembly to the left of the module's designated housing slot. At both the top and bottom, secure the assembly to the housing. Use the two Phillips-head machine screws provided. Cabling Duct/Field Connector Assembly for the 800 Series I/O Module.</p> 

Connecting an 800 Series I/O Module Step Action Element

Step	Action
1	<p>Field Connection Connect field side wiring to proper pins on the field connector. Terminals accept either two 14-AWG size wires or one 12-AWG size wire per point.</p> <p>Note:</p> <ol style="list-style-type: none"> 1. All low current input modules are susceptible to fretting (wear) corrosion of field wiring connectors; these modules include analog, D/A, A/D, TTL. Muxs, etc. (B873, B875, B846, etc.). 2. Schneider Electric recommends applying NYOGEL 759G lubricant to the connector to prevent fretting. Modicon part number is 99-C759-x00. 3. When making connections to this module, electrical equipment should be serviced only by qualified personnel. 4. If you are using stranded wire, ensure that loose or projecting strands do not short circuit or ground the other terminals. 5. Schneider Electric recommends that you use solid wire. 6. When performing this step, refer to the appropriate chapter in the manual of the 800 Series module you are installing for the appropriate connector type.
2	<p>Re-install any module temporarily removed.</p> <p>Note: When performing this step, refer to Appendix A for illustrations of optional key pin patterns for the 800 Series module you are installing. Appendix A contains key pin patterns for all 800 series I/O modules.</p>
3	<p>When using key pins¹, install them above and below the selected housing slot for this module.</p> <p>1. Key pins are provided with housing shipment.</p> <p>The following figure shows an optional mechanical keying system (Key Pin Location) used to match the module type with a particular slot in the housing.</p> <p>LOOKING AT FRONT OF HOUSING - OVER MODULE SLOT</p> <div style="display: flex; align-items: center;"> <div style="border: 1px solid black; padding: 5px; margin-right: 20px;">  </div> <div> <p>When facing housing, place the knurled end of the key pins into the holes indicated by the "P." Use a 1/2" plastic head mallet or equivalent to drive the pin into the housing approximately 1/4 of an inch.</p> </div> </div> <div style="margin-top: 20px;"> <div style="border: 1px solid black; padding: 5px; display: inline-block;">  </div> <p>NOTE: The keying system is optional.</p> </div>

Step	Action
4	Insert module into housing. Firmly but carefully seat the edge connector in the backplane. Note: First time installation of a module may be tight.
5	Secure module to housing. Use captive slotted mounting screws at the top and bottom of the module's front panel.
6	After confirming all modules are properly installed, 1. apply applicable field power 2. re-apply power to the programmable controller
7	I/O Map the module.
8	Start the controller.
9	Confirm that the module's active light is illuminated.

Requirements—Modicon Quantum 800 Series I/O Modules with Unity

Requirements List


The following requirements should be followed for installations complying with the CE marking.

Requirement for	Description
Power supply and I/O lines	All wiring for power supply and I/O lines must be in grounded steel conduits (EMT) or must use braided shielded cable. If shielded cable is used, the braid must have 80% or more shield coverage, and the outside diameter of the braid (without jacket) must be in the range of 0.189 ... 0.237 in (4.8 ... 6.0 mm).
Cable shields	All cable shields must be grounded, using clips on the Grounding Bar (Modicon part number CER001). Shield is not terminated at module field connector.
Grounding	Install braided earth ground to both <ul style="list-style-type: none">● grounding clip (or clips as required)● backplane ground reference
Line filters	Use a 110/220 Vac Line Filter (Schaffner part number FN670-30/6). Install as shown in the AC power input figure.


CE Installation—Modicon Quantum 800 Series I/O Modules with Unity

Remote Drop Example

The following graphics show the correct CE installation for a remote drop.

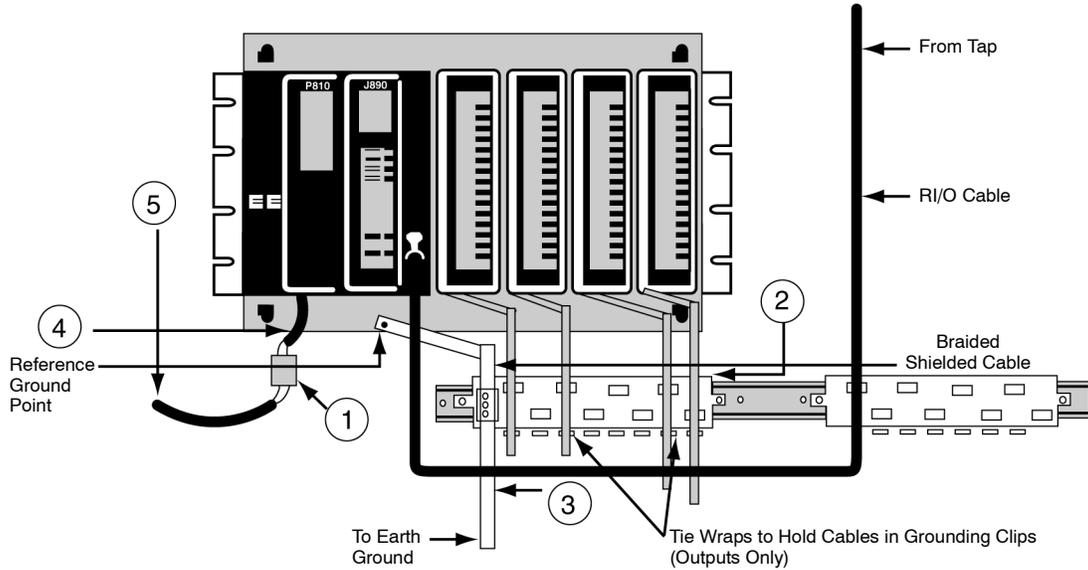

Typical CE Installation for a Remote Drop

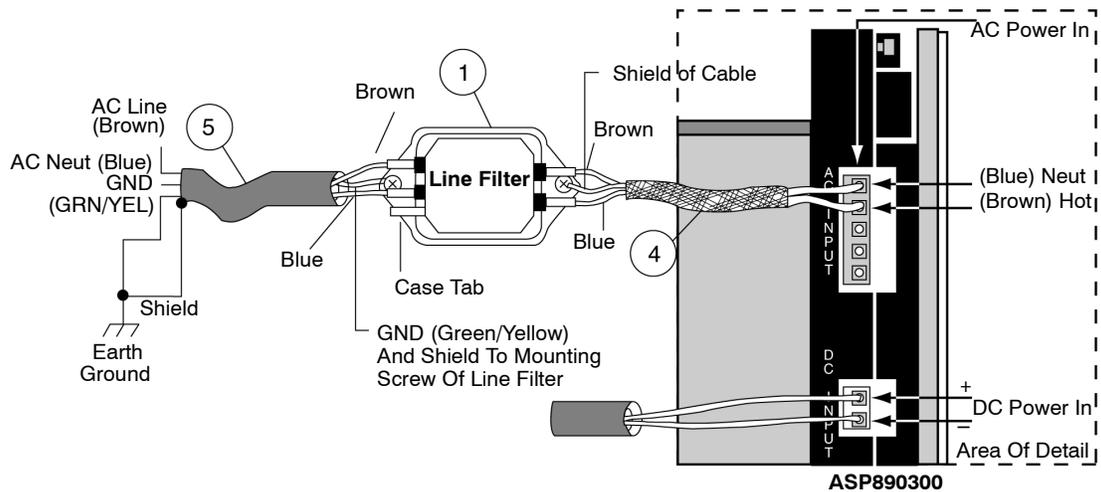

Installation Parts List—Modicon Quantum 800 Series I/O Modules with Unity

**Manufacturers
Part Numbers/
Instructions**

Callout	Vendor	Part Number	Description	Instructions
1	Schaffner	FN670-3/06	Line Filter (Fast on terminals) Dimensions: Length: 3.4 in (85 mm) Width: 2.2 in (55 mm) Height: 1.6 in (40 mm) Mounting Holes: 0.2 in (5.3 mm) dia. 3 in (75 mm) centerline mounted Fast on Terminals: 0.25 in (6.4 mm)	Install next to the 984 CPU.
2	Modicon	CER001 or equivalent	Grounding Bar	All cable shields must be grounded. NOTE: Not required if using steel conduit.
3			Flat Ground Braided Cable	
4	Oflex	35005 3 conductor 100cy Series	Shielded Cable maximum length: 30 in (760 mm)	The shield is terminated at the EMI Line Filter and open at CPU end. The third conductor is not used.
5	Oflex	35005 3 conductor 100cy Series	Shielded Cable	Terminate the shield at panel ground, at EMI Filter.

Key Pin Assignments—Modicon Quantum 800 Series I/O Modules

Charts The key pin assignments chart is provided in the following tables.

AS-B803-008

AS-B803-008

	AS-B802-008	AS-B803-008	AS-B804-016	AS-B805-016	AS-B806-032
	AS-B808-016	AS-B809-016	AS-B820-008	AS-B821-008 AS-B821-108	AS-B822-008*
	AS-B824-016	AS-B825-016	AS-B826-032	AS-B827-032	AS-B875-011 AS-B875-012
	AS-B840-008 AS-B840-108	AS-B841-008*	AS-B850-016*	AS-B842-008	AS-B852-016*
	AS-B855-016	AS-B810-008	AS-B828-016	AS-B873-011	AS-B833-016
	AS-B862-001	AS-B863-001	AS-B864-001	AS-B857-032*	AS-B851-016*
	AS-B865-001	AS-B868-001	AS-B869-001	AS-B872-002	AS-B873-001
	AS-B875-111	AS-B881-308	AS-B872-100	AS-B872-200*	AS-B875-200
	AS-B819-232*	AS-B804-148	AS-B882-116		
		AS-B806-124			

NOTE: ● Indicates keying pin locations.

NOTE: * Indicates these modules may be obsoleted or superseded. Please contact your local distributor for more details.

The key pin assignments chart is provided in the following table.

					
	AS-B807-032	AS-B814-001 AS-B814-108	AS-B814-002	AS-B816-016	AS-B817-116
	AS-B823-008*	AS-B846-002	AS-B836-016	AS-B837-016	AS-B849-016
	AS-B829-016 AS-B829-116	AS-B872-011	AS-B883-200	AS-B8883-211	AS-B817-216
	AS-B853-016	AS-B883-001	AS-B886-001	AS-B884-001	AS-B883-201
	AS-B832-016	AS-B883-101 AS-B883-111	AS-B886-011	AS-B885-001 AS-B885-002	AS-B838-032
	AS-B846-001	AS-B881-001	AS-B882-239	AS-B984-100	AS-B885-100
	AS-B875-001 AS-B875-002	AS-B875-101 AS-B875-102	AS-B880-108	AS-B880-208	AS-B882-032
	AS-B863-032	AS-B881-508	AS-B881-408	AS-B863-132	AS-B875-114
					
					

NOTE: ● Indicates Keying pin locations.

NOTE: * Indicates these modules may be obsoleted or superseded. Please contact your local distributor for more details.

Quick Start Test—Modicon Quantum 800 Series I/O Modules with Unity

Running Quick Start Test

The following table provides the steps for running a Quick Start Test:

Step	Action
1	Determine which channel and slot location are being used for this module.
2	Wire a field device to the appropriate terminals (refer to the individual wiring diagrams/field connector drawings for that particular I/O module) on either the AS-8534-000 low density connector, or AS-8535-000 high density connector, (refer to the Specification section for your particular I/O module to determine which connector is required.)
3	Stop the controller.
4	Install the I/O module.
5	I/O Map the module, at the desired discrete or register reference.
6	Start the controller.
7	Confirm that the modules active light is illuminated. (may require Step 8 wiring first).
8	To turn an Input ON apply the required power to the appropriate terminals (refer to the individual wiring diagrams/field connector drawings for your particular I/O module), and confirm that the red I/O light is illuminated after turning I/O point ON.

Analog Module Specifications—Modicon Quantum 800 Series I/O Modules with Unity

Environmental

Specifications for the 800 Series I/O analog modules.

Operating	Temperature	0 to 60 °C (32 to 140 °F)
	Humidity	0 to 95% (noncondensing) at 60° C
Storage	Temperature	-40 to 85°C (-40 to 185°F)
	Humidity	0 to 95% (noncondensing) at 60° C
Isolation	Field to System	2000 VAC steady state maximum at 60 Hz for one minute
	Between Groups	2500 VDC for 60 seconds without breakdown Leakage current shall not exceed 1.5 mA
Shock	Operating	+/-15 G peak, 11 ms, half-sine wave
	Nonoperating	+/-15 G peak, 11 ms, half-sine wave
Vibration	Operating	0.005" D.A. Sine from 10 to crossover frequency (57 to 62 Hz) 1.0 G from crossover frequency to 500 Hz
	Nonoperating	0.029 G sq/Hz, 10-50 Hz rolloff at -8db/octive from 50 Hz to 500 Hz
EMI	Per MIL-STD 461B.	
RFI	Per FCC Class A.	
Surge Withstand Capability	Per IEEE 472-1974 and ANSI C37.90A-1974	

Mechanical

Specifications for the 800 Series I/O analog modules.

Dimensions (W x H x D)	2.0 x 10.5 x 8.0 in. (50.8 x 266.7 x 203.2 mm.)
Weight	2.4 lbs. (1.1 kg.)
Space Required	1 I/O slot.

See individual chapters for module specific Specifications.

Discrete Module Specifications—Modicon Quantum 800 Series I/O Modules with Unity

Environmental

Specifications for the 800 Series I/O discrete modules.


Operating	Temperature	0 to 60°C (32 to 140°F)
	Humidity	0 to 95% (noncondensing) at 60°C
Storage	Temperature	-40 to 85°C (32 to 140°F)
	Humidity	0 to 95% (noncondensing) at 60°C
Isolation	Field to System	2000 VAC steady state maximum at 60 Hz for 1 min.
	Between Groups	2500 VDC for 60 s without breakdown. Leakage current shall not exceed 1.5 mA.
Shock	Operating	15 G peak, 11 ms, half sine wave
	Nonoperating	15 G peak, 11 ms, half sine wave
Vibration	Operating	0.005 in D.A. Sine from 10 to crossover frequency (57—62 Hz) 1.0 G from crossover frequency to 50 Hz
	Nonoperating	0.029 G sq/Hz, 10—50 Hz rolloff at -8dB/octave from 50—500 Hz
EMI	MIL-STD 461B	
RFI	FCC Class A	
Surge Withstand Capability	IEEE 472-1974 and ANSI C37.90A-1974)	

Mechanical

Specifications for the 800 Series I/O discrete modules.

Dimensions (W x H x D)	2.0 x 10.5 x 8.0 in. (50.8 x 266.7 x 203.2 mm.)
Weight	2.4 lbs. (1.1 kg.)
Space Required	1 I/O slot

800 Series RIO Modules



Introduction

At a Glance

This part provides an overview of the 800 Series RIO modules. The content describes the modules' features.

What's in this Part?

This part contains the following chapters:

Chapter	Chapter Name	Page
4	J890 & J892 RIO Interface Modules	55
5	P890 & P892 RIO Processors	75
6	ASP890300 RIO Processor	87

J890 & J892 RIO Interface Modules

4

At a Glance

Purpose

This chapter explains features and operation of the J890 & J892 RIO Interface Modules.

What's in this Chapter?

This chapter contains the following topics:

Topic	Page
J890 & J892 Overview	56
J890 & J892 DIP Switch Settings for the Drop Address	57
J892 DIP Switch Settings for ASCII Devices	60
J890 & J892 Indications	63
J890 & J892 Installation and Connection	66
J890 & J892 Connectivity on an S908 RIO Network	69
J890 & J892 RIO Interface Error Codes	71
J892 ASCII Error Codes	72
J890 & J892 Specifications	73

J890 & J892 Overview

Module Features A J890 or J892 module may be used to provide the drop interface between a 984 Programmable Controller and a remote drop of 800 Series I/O on an S908 Remote I/O (RIO) network. Both interface modules are available in two models - one with a single F connector for RIO cable connection and one with two F connectors. In addition, the J892 contains two half-duplex ports that will support ASCII input/output devices at the remote drop.

Module Table J89x Modules

Part number	RIO cable ports	ASCII ports
AS-J890-101	1	0
AS-J890-102	2	0
AS-J892-101	1	2
AS-J892-102	2	2


J890 & J892 DIP Switch Settings for the Drop Address

DIP Switch Location

This J890/J892 Interface devices both have a set of DIP switches located on the back of the module. These switches are used to set a unique RIO network address for the remote drop where the interface will reside. The drop address must be set on the Interface module before it is installed in the I/O housing.

Interface Rear View


Rear view of J890 & J892 interface.

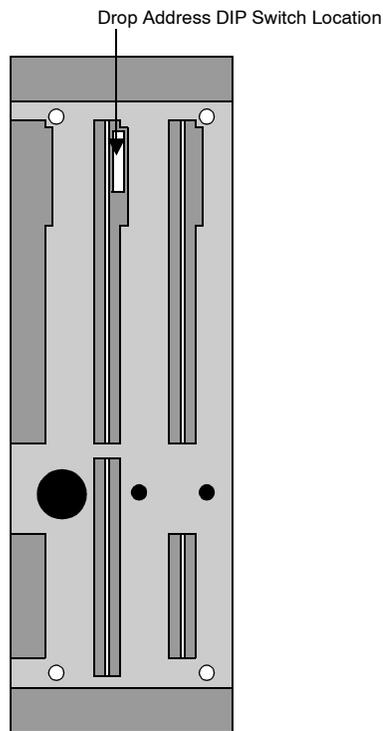

Switch Settings for Drop Address The drop address DIP switch has eight positions

Note: If the Unity controller at the head end of the RIO network supports both a local I/O drop and remote I/O, then drop address # 1 is reserved for the local drop and the first remote drop is addressed as drop # 2. If the Unity controller does not support local I/O, the first remote drop is addressed as drop # 1. For a complete list of 984 controllers and their I/O support capabilities, refer to the Modicon Remote I/O System Planning and Installation Guide (890 USE 101 00).

Switch positions for drop addressing.

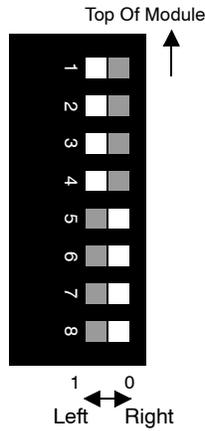

Switch assignment for drop addressing

Switches	Functions
Positions 1 ... 5	Drop address 1 - 32 set in the 1 direction (to the left)
Positions 6 ... 8	not used set in the 0 direction (to the right)

**Mapping Dip
Switch Settings
for Drop Address**

Dip switch settings for the drop address

	Switches				
	1	2	3	4	5
Drop Address					
1	0	0	0	0	0
2	1	0	0	0	0
3	0	1	0	0	0
4	1	1	0	0	0
5	0	0	1	0	0
6	1	0	1	0	0
7	0	1	1	0	0
8	1	1	1	0	0
9	0	0	0	1	0
10	1	0	0	1	0
11	0	1	0	1	0
12	1	1	0	1	0
13	0	0	1	1	0
14	1	0	1	1	0
15	0	1	1	1	0
16	1	1	1	1	0
17	0	0	0	0	1
18	1	0	0	0	1
19	0	1	0	0	1
20	1	1	0	0	1
21	0	0	1	0	1
22	1	0	1	0	1
23	0	1	1	0	1
24	1	1	1	0	1
25	0	0	0	1	1
26	1	0	0	1	1
27	0	1	0	1	1
28	1	1	0	1	1
29	0	0	1	1	1
30	1	0	1	1	1
31	0	1	1	1	1
32	1	1	1	1	1


J892 DIP Switch Settings for ASCII Devices

DIP Switch Location


J892 Interface devices have an additional set of DIP switches located at the back of the module for setting ASCII device addresses and ASCII communication parameters. If you want to support ASCII devices at this drop, the ASCII switch setting must be made before the module is installed in the I/O housing.

Interface Rear View

Rear view of J892 interface.

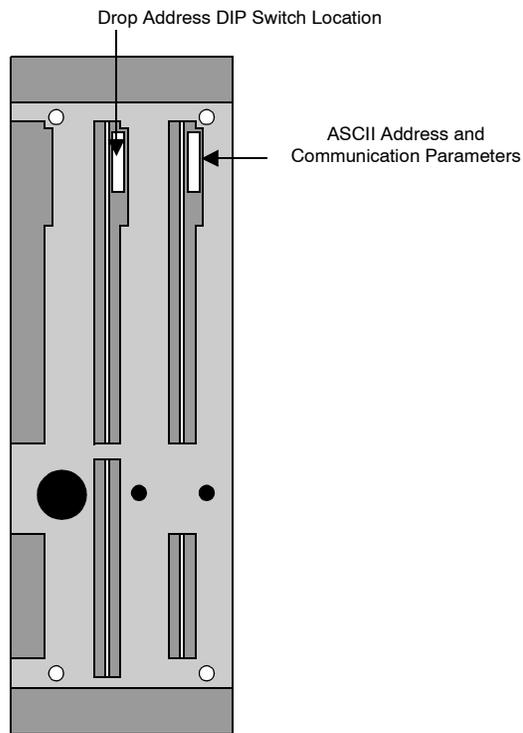

Switch Settings The drop address DIP switch has eight positions. Switch positions for ASCII device settings.

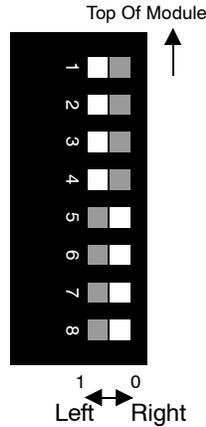

Switches 3 ... 6 are used to set ASCII device addresses on the RIO network. The remaining switches are used to specify ASCII communication parameters.

Switch Settings for ASCII Communication

Switch settings for ASCII communication

Switches	ASCII Communication Function
1	RS-232C handshaking for the bottom ASCII port 1 = Data terminal ready/hardware handshake 0 = XON/XOFF
2	RS-232C handshaking for the top ASCII port 1 = Data terminal ready 0 = XON/XOFF
3 ... 6	Port address 1 - 32 Device addressing in pairs
7	Continuous confidence test mode* 1 = Local diagnostic (J892 will not communicate when set to 1 position (left)) 0 = On-line (Normal setting)
8	Not used, always set in the 0 position (right)

Mapping Switch Settings for ASCII Device Addresses


Switch settings for ASCII device addresses

	Switches			
	3	4	5	6
ASCII ports address				
1, 2	0	0	0	0
3, 4	1	0	0	0
5, 6	0	1	0	0
7, 8	1	1	0	0
9, 10	0	0	1	0
11, 12	1	0	1	0
13, 14	0	1	1	0
15, 16	1	1	1	0
17, 18	0	0	0	1
19, 20	1	0	0	1
21, 22	0	1	0	1
23, 24	1	1	0	1
25, 26	0	0	1	1
27, 28	1	0	1	1
29, 30	0	1	1	1
31, 32	1	1	1	1

J890 & J892 Indications

Overview On the face of both the J890 and J892 RIO Interface modules are a set of LEDs that indicate the RIO processing status of the module and one or two BNC cable ports used to connect the drop to the RIO network.


J890 Front View AS-J890 Front View

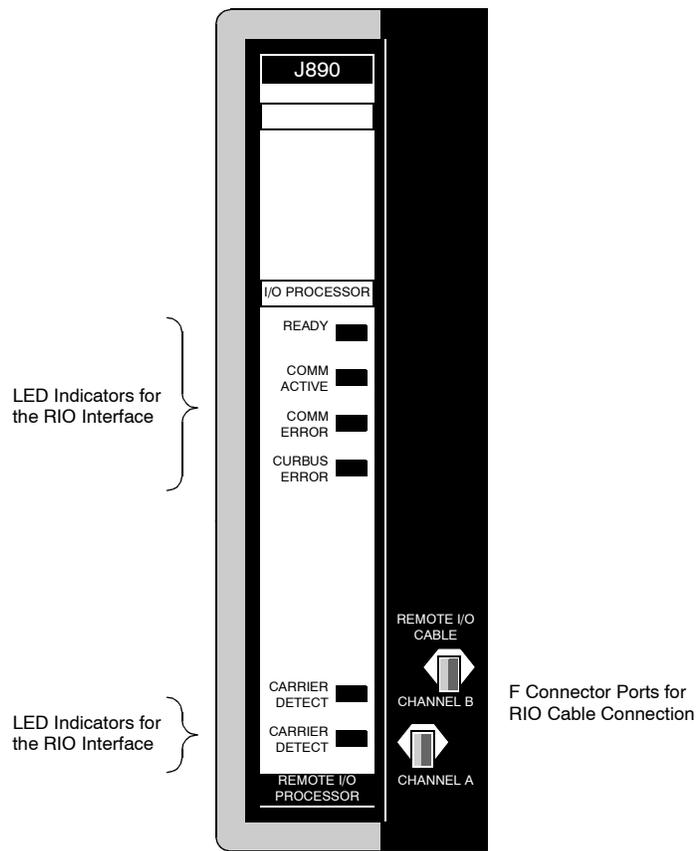

The J892 has additional LEDs that indicate the ASCII device processing status at the drop and a pair of 25-pin, D-shell, female ports for connecting ASCII devices at the drop.

Note: The LED indicators on the front panels also provide diagnostic information. Various flash patterns indicate errors detected in the RIO interface and/or in the ASCII interface.

J892 Front View J892 Front View

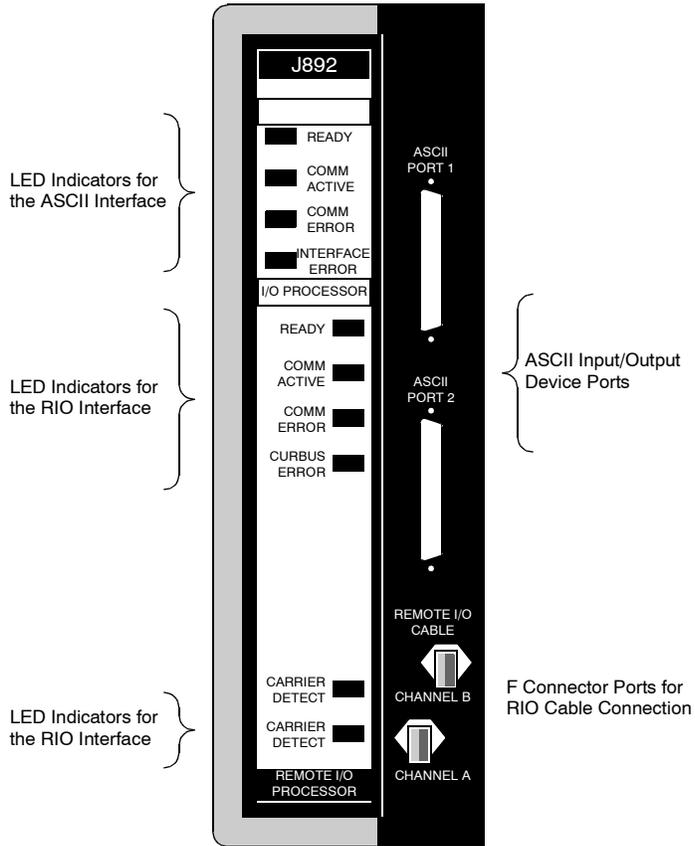

**J890 and J892
LED Status
Indications for
RIO Interface**

J890 and J892 LED Status Indications for RIO Interface.

Name	Color	Indication (when ON)
READY	Green	RIO interface board successfully passed power-up test
COMM ACTIVE	Green	I/O data being received or sent
COMM ERROR	Red	Communications error between J890 / J892 and 984
OURBUS ERROR	Red	Detected communications error between J890 / J892 and I/O
CARRIER DETECT	Green	Processor sensed carrier signal

Note: The COMM ERROR LED for the RIO Interface is ON if only one port on a dual port interface is connected, indicating that no signals are present at the unconnected port. Communications with the 984 are not effected.

**J892 LED Status
Indications for
ASCII Interface**

J892 LED Status Indications for ASCII Interface

Name	Color	Indication (when ON)
READY	Green	ASCII board successfully passed power-up test
COMM ACTIVE	Green	ASCII data being received or sent
COMM ERROR	Red	Detected communications error between J892 and ASCII device
INTERFACE ERROR	Red	Detected ASCII communications error in the J892

Note: The COMM ERROR LED for the RIO Interface is ON if only one port on a dual port interface is connected, indicating that no signals are present at the unconnected port. Communications with the 984 are not effected.

J890 & J892 Installation and Connection

Introduction

After the appropriate switch settings have been made, follow these steps to install the J890/J892 Interface module in a primary (AS-H819-103 or AS-H827-103, AS-H827-107) 800 Series I/O Housing. The module is 1.5 slots wide.

Installing the J890/J892 Module

The following table lists the steps for installing the J890/J892 Module:

Step	Action
1	Turn off the power to the I/O housing.
2	If you are installing a J892, make sure that SW7 on the ASCII communications DIP switch pack is set to the 0 position (on-line).
3	Insert the Interface module in slots 2 and 3 of the primary housing (directly to the right of the power supply unit). Press the module firmly to ensure that it is seated properly. Position of a J890 interface module in a primary I/O housing.
<p>The diagram shows a top-down view of a rack-mounted I/O housing. On the left is a vertical module labeled 'P810' (Primary Power Supply) in slot 1. To its right are two slots, 2 and 3, which are occupied by a single, wider module labeled 'J890' (J890 RIO Interface). To the right of the J890 module are four more slots, which are currently empty and labeled as '800 Series I/O (remaining slots)'. Arrows from the text labels above point to the respective components in the housing. Two captive screws are shown at the top and bottom of the J890 module, which are to be tightened in step 4.</p>	
4	Tighten the two captive screws located at the top and bottom of the interface module.

Connecting the J890/J892 to a Drop Cable The following table lists the steps for connecting the J890/J892 to a Drop Cable:

Step	Action
1	I/O drop malfunction Do not disconnect the drop cable while the system is running; disconnecting can cause other I/O drops to malfunction.
2	<p>a: If the drop cable connection is a F connector nut, install it directly onto an RIO cable port using a 7/16 in open-end wrench-finger tightening is not sufficient (see Figure below (a))</p> <p>b: If the drop cable connection is a BNC connector nut, use a Modicon 52-0752-000 F-to-BNC adapter to make the RIO drop connection (see Figure below (b))</p> <div style="text-align: center;"> </div>

J890 & J892 RIO Interface Modules

Step	Action
3	If you are installing a J892 for ASCII device support, connect the ASCII device cables to the ASCII ports at this time.
4	Apply power to the I/O housing. The I/O drop is ready for checkout; refer to Appendix B for diagnostic messages provided by the LEDs on the J890/J892 front panels. Note: For a complete discussion of planning and installing an RIO drop, refer to the Modicon Remote I/O System Planning Guide (GM-0984-RIO).

J890 & J892 Connectivity on an S908 RIO Network

User Connections


Any 984 Programmable Controller that supports the S908 RIO network can employ 800_Series I/O at any or all of its remote drops, and any remote drop of 800_Series I/O can use a J890 or J892 as the drop interface module.

The J890/J892 Interface modules are compatible with all 800 Series I/O modules used in a S908 RIO network and may support up to 1024 input and 1024 output bits in a drop (depending on the capability of the head-end controller).

A J890/J892 Interface is a 1.5 slot module designed to be installed in the two slots immediately to the right of the primary power supply in the primary housing of a drop. The Interface sends data to and receives data from the 800 Series I/O via the drop's backplane; it communicates with the RIO processing unit in the controller via the RIO cable system.

In addition to managing the I/O data flow within the drop and over the RIO network, a J890/J892 is also used to define the address of the drop on the RIO network. Each module is equipped with a set of DIP switches with which you can set a unique drop address. The J892 also provides a second set of DIP switches for specifying ASCII device addresses. The locations of the switch packs and their addressing scheme are defined in *P890 & P892 Switch Settings for the Drop Address, p. 80* and *J892 DIP Switch Settings for ASCII Devices, p. 60*.

J890/J892 Drop and Network Communications

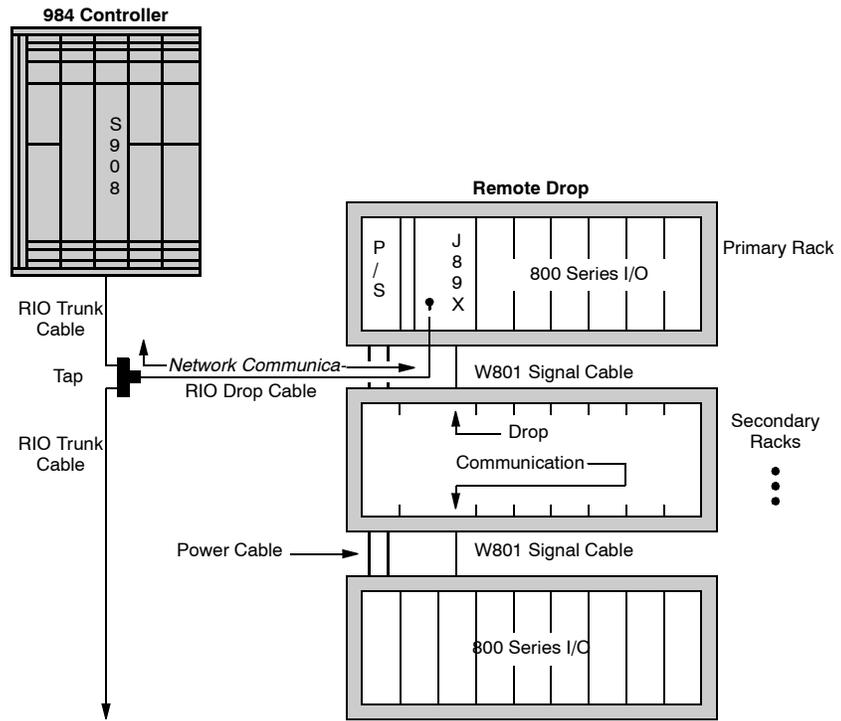

J890 & J892 RIO Interface Error Codes

Introduction

When power is applied to the I/O housing after the J890/J892 Interface module has been installed in the drop, the module performs a set of confidence tests on itself. If any faults are detected in the RIO processing portion of the module, the RIO LEDs on the front panel will display a flash pattern of error codes.

Error Codes

J890/J892 I/O processor board test error codes

Failed Diagnostic	READY	COMM ACTIVE	COM ERROR	INTERFACE ERROR
Machine Dead	OFF	OFF	OFF	OFF
PROM Test	OFF	Flashing	OFF	OFF
RAM Test	OFF	OFF	Flashing	OFF
LAN Test	OFF	Flashing	Flashing	OFF
CPU Test	OFF	OFF	OFF	Flashing
OBM Test	OFF	Flashing	OFF	Flashing
Switch Test	OFF	OFF	Flashing	Flashing

The interface error (OBM) test may be caused by an I/O module that has shorted the I/O bus. All of the other diagnostic error codes indicate an internal failure in the remote I/O processing portion of the J890/J892 interface.

J892 ASCII Error Codes

Introduction

Confidence tests can also be run on the J892 module to test the ASCII portion of the device. To establish the ASCII confidence test mode on the J892 board, set SW7 to 1 (to the left) on the eight-position DIP switch. This will run the loop test.

Error Codes

J892 ASCII board test error codes

Failed Diagnostic	READY	COMM ACTIVE	COM ERROR	INTERFACE ERROR
Machine Dead	OFF	OFF	OFF	OFF
PROM Test	Flashing	OFF	OFF	OFF
RAM Test	OFF	Flashing	OFF	OFF
HDLC Digital	Flashing	Flashing	OFF	OFF
HDLC Analog	OFF	OFF	Flashing	OFF
Serial Port Low	Flashing	OFF	Flashing	OFF
Interrupt Low	OFF	Flashing	Flashing	OFF
Serial Port High	Flashing	Flashing	Flashing	OFF
Interrupt High	OFF	OFF	OFF	Flashing
Baud Rate Low	Flashing	OFF	OFF	Flashing
Baud Rate High	OFF	Flashing	OFF	Flashing
Switch Test	Flashing	Flashing	OFF	Flashing
Modem Disconnect	OFF	OFF	Flashing	Flashing
Modem DSR Error	Flashing	OFF	Flashing	Flashing

With the exception of the switch test, these diagnostic error codes indicate an internal failure in the ASCII processing portion of the J892 interface.

J890 & J892 Specifications

Introduction

The following tables give specifications for the J890 & J892 modules.

Customer Part Numbers

Customer part numbers

Customer Part Number	Description
AS-J890_101	Contains one F connector RIO cable port, Supports linear and dual RIO cable topologies, No ASCII device support
AS-J890_102	Contains two F connector RIO cable ports, Supports a redundant RIO cable topology, No ASCII device support
AS-J892_101	Contains one F connector RIO cable port, Supports linear and dual RIO cable topologies, Two 25-pin female connectors for ASCII device support
AS-J892_102	Contains two F connector RIO cable ports, Supports a redundant RIO cable topology, Two 25-pin female connectors for ASCII device support

Communications

Communications

Rate	1.544 Mbits/s
Comm Link Time	< 1 ms for 256 I/O points
Drop Hold-Up Time	programmable from 0.3 s to 100 minimum (100 ms increments)

System Power Requirements

System Power Requirements

J890 Load	1.85 A at + 5 V
J892 Load	4.0 A at + 5 V

P890 & P892 RIO Processors



5

At a Glance

Purpose

This chapter explains features and operation of the P890 & P892 RIO Processors.

What's in this Chapter?

This chapter contains the following topics:

Topic	Page
P890 & P892 Overview	76
P890 & P892 Indicators	78
P890 & P892 Power Available	79
P890 & P892 Switch Settings for the Drop Address	80
P890 & P892 Installation	83
P890 & P892 Specifications	84

P890 & P892 Overview

General Description

The P890/P892 Remote I/O Processors provide a direct interface between 984 PC and 800 Series I/O. Both modules include an integrated power supply that supplies 3 amps of power to adjacent 800 series I/O modules. In addition, the P892 processor provides two half duplex ASCII ports.


The P890/P892 processor is mounted directly into a primary 19- or 27-inch 800 Series I/O housing (H819/H827-209). The connection between the processor and the I/O modules is made through the housing backplane. The remote I/O system coaxial cabling provides the communications path between the P890/P892 processor and the RIO Head.

The P890/P892 processors are compatible with all Unity programmable controllers that support the S908 remote I/O system. The P890/P892 processors are compatible with all 800 Series I/O modules: discrete, analog, register and intelligent. The actual number of remote I/O drops and I/O points per drop supported depends on the controller size.

The P890/P892 processors support a single remote I/O cable configuration. Cable runs from the 984 Controller through taps that have drop cables to the P89X remote interfaces.

The P890/P892 processor power supply supports two separate power sources, 115/230VAC and 24VDC. The AC power source is switch selectable between 115v and 230v settings. The top ON/OFF switch controls the AC power and the bottom ON/OFF switch controls the 24VDC source. Either source can be used to power the P890/P892. The 24VDC can be used as a backup power source to the 115/230VAC. The single slot P890/P892 can provide a maximum of 3 amps to power 800 series I/O modules. For systems needing more power, expander power supplies should be inserted in the next I/O housing.

Front, Bottom and Side View

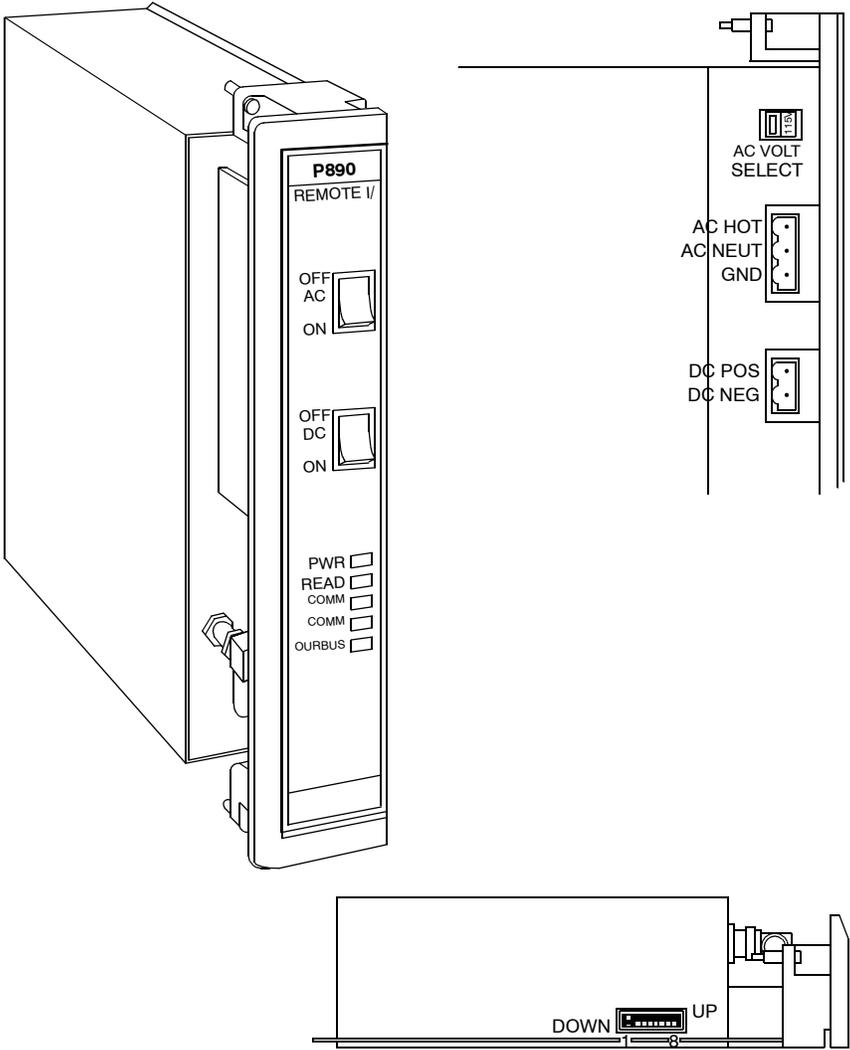

P890 & P892 Indicators

Overview

The following table shows P890/P892 processor indicator lights and provides the name, color and indication when on. The I/O processor lights are on both processors. The ASCII error indicator is only on the P892 Processor.

Indicator Lights for P890 and P892

Indicator lights for I/O processor P890 and P892.

Name	Color	Indication (when ON)
Power OK	Green	All Voltages are OK.
Ready	Amber	I/O processor board successfully passed power-up tests.
Comm Active	Green	I/O comm active between P89X and 984.
Comm Error	Red	A communications error has been detected between the processor and the controller.
Ourbus Error	Red	A communications error has been detected between the processor and the I/O modules.

Indicator Light ASCII (P892 only)

ASCII error indicator light


Name	Color	Indication (when ON)
ASCII Error	Red	An ASCII communications error has been detected at the processor.

P890 & P892 Power Available

Overview

Power supplied for I/O use
+5VIO @ 3Amp max*
+4.3V @ 3Amp max*
-5V @ .25Amp
* The +5VIO and +4.3V combined total load current should not exceed 3 Amps.
The P890/P892 processors provide a fast drop scan rate, less than 5 milliseconds for 256 I/O points. The communication link time to the RIO Head is less than 1 millisecond with up to five immediate retries.

Typical Configuration

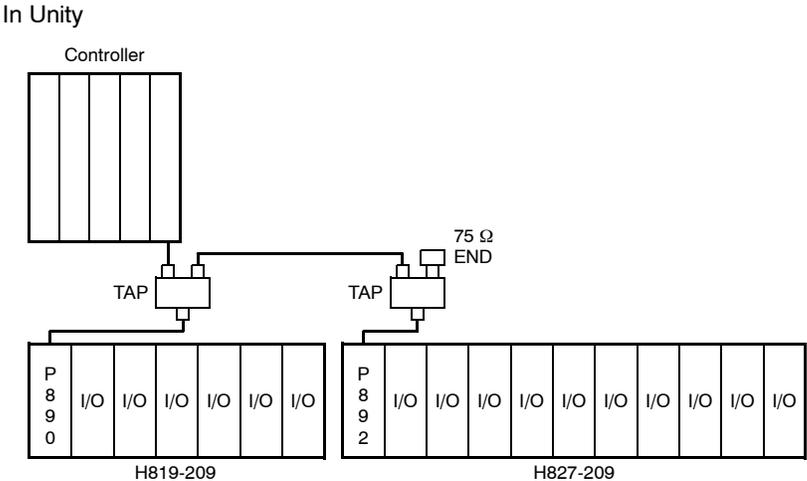


P890 & P892 Switch Settings for the Drop Address

Overview

Before installing the P890 or P892 processor, you must set the switches located on the bottom of the unit. The P890/P892 processor has one set of eight switches used to select drop/port address and ASCII communications handshake method.

P890/P892 Drop Address Switch Settings

View of the Switches

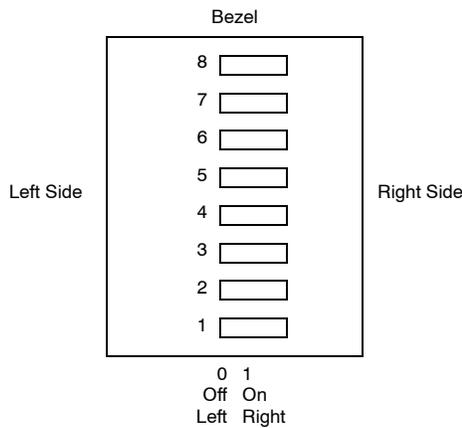

Description of the Switches

Switches	Functions
For P890 &P892 1-6	drop/port address 1-32 binary form
For P890 ONLY 7-8	not used, set to left
For P892 ONLY 7 8	hand shaking for port 1 hand shaking for port 2 L = Data Terminal Ready/Data Set Ready R = Xon/Xoff

Note: You MUST go into the Traffic Cop software and set the ASCII port number to match your switch selection, noting the drop.

Note: Drop and port addresses are related. Switch settings for Drop #3 correspond to ASCII ports 5 and 6.

Drop Address Switch Settings The drop address is set by the setting switches one through six in the switchpack as shown in the table.

Switches							
1	2	3	4	5	6		
						Drop Address	Port Number For P892 ONLY
L	L	L	L	L	L	1	1,2
R	L	L	L	L	L	2	3,4
L	R	L	L	L	L	3	5,6
R	R	L	L	L	L	4	7,8
L	L	R	L	L	L	5	9,10
R	L	R	L	L	L	6	11,12
L	R	R	L	L	L	7	13,14
R	R	R	L	L	L	8	15,16
L	L	L	R	L	L	9	17,18
R	L	L	R	L	L	10	19,20
L	R	L	R	L	L	11	21,22
R	R	L	R	L	L	12	23,24
L	L	R	R	L	L	13	25,26
R	L	R	R	L	L	14	27,28
L	R	R	R	L	L	15	29,30
R	R	R	R	L	L	16	31,32
L	L	L	L	R	L	17	N/A
R	L	L	L	R	L	18	N/A
L	R	L	L	R	L	19	N/A
R	R	L	L	R	L	20	N/A
L	L	R	L	R	L	21	N/A
R	L	R	L	R	L	22	N/A
L	R	R	L	R	L	23	N/A
R	R	R	L	R	L	24	N/A
L	L	L	R	R	L	25	N/A
R	L	L	R	R	L	26	N/A
L	R	L	R	R	L	27	N/A
R	R	L	R	R	L	28	N/A
L	L	R	R	R	L	29	N/A
R	L	R	R	R	L	30	N/A
L	R	R	R	R	L	31	N/A

Switches							
1	2	3	4	5	6		
						Drop Address	Port Number For P892 ONLY
R	R	R	R	R	L	32	N/A


Note: Drop addresses 1 to 16 can be used as RIO and ASCII. However, drop addresses 17 to 32 can ONLY be used as RIO.

9-Pin ASCII Ports Correct cable configuration is dependent upon the requirements of the unit attached to the ascii port.

Pin Number	Designation
1	Chassis Ground (CG)
2	Receive (RXD)
3	Transmit (TXD)
4	Data Terminal Ready (DTR)
5	Signal Ground (SG)
6	Data Set Ready (DSR)
7	Request to Send (RTS)
8	Clear to Send (CTS)
9	No Connection (N.C.)

Sample Pin Layout for a 9-Pin ASCII Port

The following graphic depicts one possible pin layout for a cable connecting a P892 ASCII port and another device using hardwired flow control. Actual pin numbers may vary from device to device.

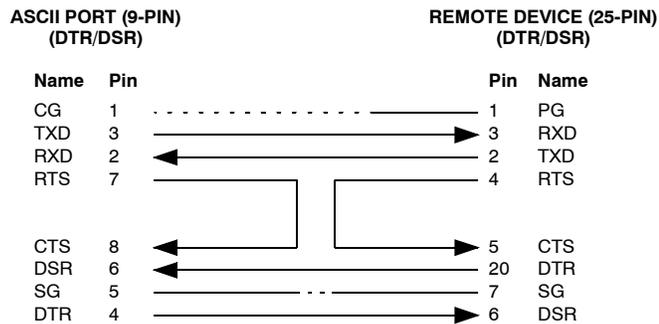

P890 & P892 Installation

Introduction

The following procedure describes how to install a P890 or P892 processor. The processor is installed in an H819/H827-209 800 Series I/O Housing in the left-most slot.

Note: To ensure proper operation of this module, you must have one of the following revisions (or higher) of MODICON Traffic Cop software:
 P190 AS-T984-302 Version 2.01 Rev.J
 IBM AS-DIBM-902 Version 3.01 Rev.X
 If you do not have a tape or diskette with one of the above software levels, call MODICON Customer Service at 1-800-468-5342 and obtain the proper software.

Procedure for Installation

How to Install a P890 or P892 processor

Step	Action
1	Set the address/handshake switch as shown in <i>P890/P892 Drop Address Switch Settings, p. 80</i> .
2	Ensure that the power supply switches are OFF and power to the housing is OFF. Also, set the 115/230 VAC switch based upon your power requirement. Do not insert the P890 or P892 processor if power is supplied to the unit.
3	Remove the plastic cover to connect the power cables, once they are in place replace the plastic cover.
4	Wire up the power cable for either AC (three pin plug) or DC (two pin plug) depending upon the application.
5	Connect remote I/O cable to the P890 or P892 F-connector.
6	Remove the ASCII port connector covers. Connect the ASCII device cable(s). For the P892 only.
7	Insert the P890/P892 into the H819/H827-209 housing in the left-most slot. Press firmly to ensure that the processor is seated properly in the housing.
8	Tighten the two captive screws located at the top and bottom of the processor.
9	Turn the power supply on. The I/O drop is ready for checkout.

P890 & P892 Specifications

Topology

Topology

Cabling	Single coaxial cable 75 ohm RG-6 type
Connector	F-Type

Communications

Communications

Rate	1.544 MHZ
Drop scan time	< 5 ms for 256 I/O points
Comm link time	< 1 ms for 256 I/O points
Drop hold up time	programmable from 300msec to 6553.6sec (100 msec increments)

Power Supplied to I/O

Power Supplied to I/O

+5VIO	@3Amp*
+4.3V	@3Amp*
-5V	@.25Amp

*The +5VIO and +4.3V combined can not exceed 3 Amps.

Power Requirements

115/230VAC +/- 15% @ .75Amps, 47-63Hz
 24VDC +/- 15% @ 2Amps Max.

AC Power Loss Hold up time

8.3 mSec

RFI

Meets applicable FCC requirements for industrial equipment

EMI

Radiated Susceptibility	MS 461B RS03
Conducted Susceptibility	MS 461N CS02

Surge Withstand

IEEE 472_1974, ANSI C37.90a

Static Discharge 15kv to all exterior surfaces, connectors covered or terminated properly, mounted on grounded panel.

Environmental Operating Conditions

Humidity	0 - 95% non-condensing
Temperature	0 - 60°C
Temperature Storage	- 40 / +80 degrees C
Shock	+/- 10G's, 11ms. 3pulses per axis
Vibration Sine	5Hz to 50 Hz @ .0005 in D.A. 30min/axis 50 Hz to 500 Hz @ .625G ² 30min/axis
Vibration Random	10Hz to 50 Hz @ .029G ² /HZ 60 Hz to 300 Hz @ .029G ² -8db/octave
Altitude	10,000 ft max

Physical

Dimensions (W x H x D)	3.53.in x 10.46in. x 8.25in. (8.97cm x 26.59cm x 20.95cm)
Diagnostics	Power-up confidence tests Run time confidence tests

ASP890300 RIO Processor



6

At a Glance

Purpose

This chapter explains the features and operation of the ASP890300 RIO Processor

What's in this Chapter?

This chapter contains the following topics:

Topic	Page
ASP890300 General Description	88
Indicators	91
Power, Backplanes, I/O and Typical Configuration	92
Switch Settings	95
Diagnostics	99
Installation	102
Specifications	104

ASP890300 General Description

Overview

The MODICON ASP890300 800 I/O Remote I/O processor with Power provides an interface between PLCs and 800 Series Remote I/O modules. Two half-duplex ASCII ports are available.

The basic modes of operation are P890/P892/J890 replication (AS-P89X-000 and AS-J890-X0X) and J892 emulation (AS-J892-X0X).

The ASP890300 Processor is compatible with all Schneider Electric controllers that support the S908/CRP-type Remote I/O networks and all 800 Series I/O modules. Remote I/O communication is accomplished over single or dual coaxial cable networks. The number of drops and points supported depends on the system PLC. Operating modes are rotary switch-selectable, and include single or dual RI/O cable. These, in part, eliminate improper Comm Error LED indications when operating with a single cable connecting the drop.

Rotary switch selectable operating modes, plus two executive reflash options are:

- J890/P890 single or dual RI/O cable operation
- J892 and P892 single or dual RI/O cable operation
- RTU or ASCII reflash modes

Executive software stored in flash memory may be updated through ASCII Port 1.

ASP890300 Compatibility

Those replacing the P89X processors will find the ASP890300 both power and backplane compatible. Some connector rewiring will be required. J890 or J892 processor replacement will require a backplane replacement. Depending on the number of I/O modules in the drop, a replacement may also include an additional power supply and rewiring.

Note: Equipment replacement guidelines, including those for J810/J812 and 984 slot-mount controllers are described in Appendix A. Please review this material before performing an upgrade.

The ASP890300 Processor is mounted into primary 10-, 19- or 27-inch 800 Series I/O backplanes. These provide connectivity between the processor and I/O modules.


Power

The processor is self-powered from either 115/230VAC or 24VDC sources. These power sources are independently switched ON/OFF on the front panel. The 115V/230VAC inputs are jumper-selectable on the power connector.

Up to 7A of combined +5.0VDC and +4.3VDC load current is supplied by the processor to I/O in the primary backplane. No other power supplies may be used to augment the ASP890300. Power for I/O modules in secondary backplanes can be provided by auxiliary supplies interconnected with appropriate cables.


**Front, Bottom,
and Left Side
View**

The ASP890300 is depicted below.

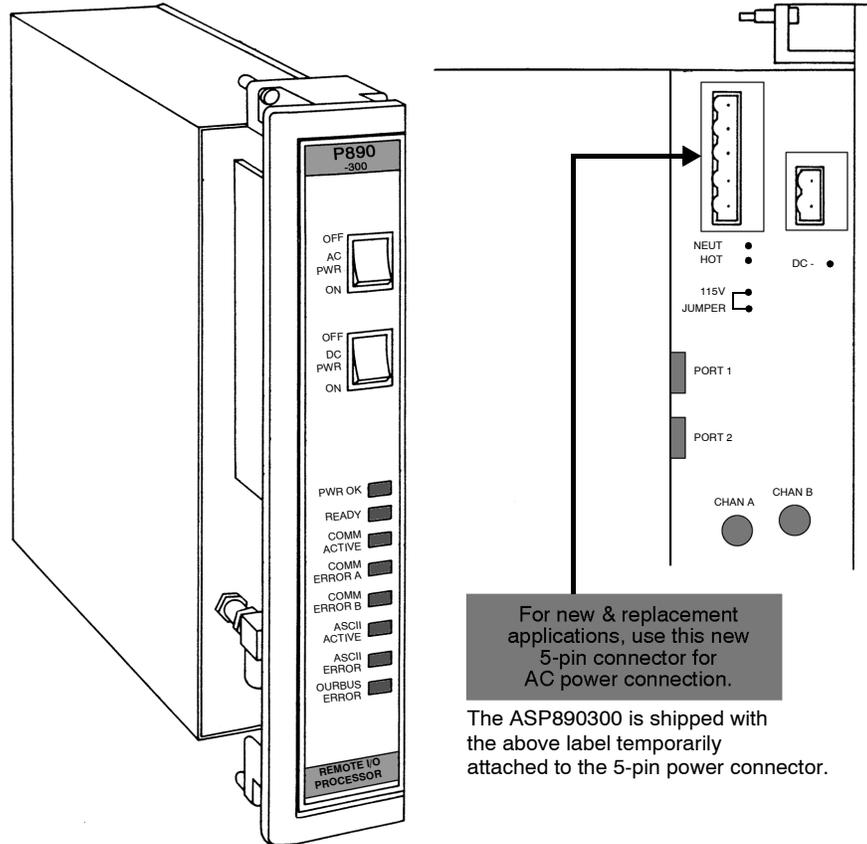


For new & replacement applications, use this new 5-pin connector for AC power connection.

The ASP890300 is shipped with the above label temporarily attached to the 5-pin power connector.

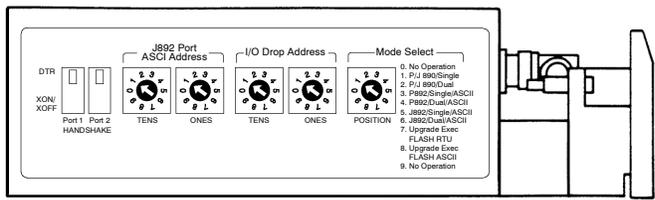

**Right Side View
and Label**

The label is on the lower, right side. The label is upside-down.

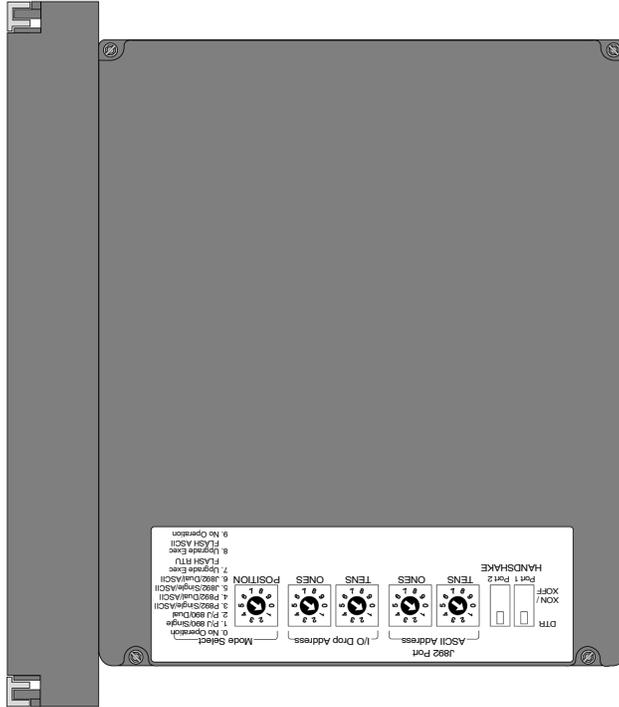

Indicators

LED Indicators

The following table describes the LED Indicators.

LED Nomenclature	Color	Function/Indication
PWR OK	Green	Power voltages are good and within specified specifications.
READY	Green	All internal diagnostics have completed successfully and the unit is available for normal operation.
COMM ACTIVE	Green	Unit is successfully and actively communicating on the remote I/O network.
COMM ERROR A	Red	Cable A is experiencing communications errors due to any of the following: <ul style="list-style-type: none"> ● broken cable ● poor or loose coaxial connection ● intermittent noise ● mode selector switch is in wrong position
COMM ERROR B	Red	Cable B is experiencing communications errors due to any of the following: <ul style="list-style-type: none"> ● broken or missing cable ● poor or loose coaxial connection ● intermittent noise ● mode selector switch is in wrong position
ASCII ACTIVE	Green	ASCII port is active.
ASCII ERROR	Red	Unit is experiencing errors with ASCII communication port.
OURBUS ERROR	Red	Unit is experiencing errors with a local I/O module, or: <ul style="list-style-type: none"> ● the entry in the traffic cop does not match the I/O module type; ● the I/O module is not present; or ● the I/O module is no longer operative.

Power, Backplanes, I/O and Typical Configuration

Power Supplied for I/O

The following table describes the power supplied for I/O use. The combination of the +5V and +4.3V loads shall not exceed 7.0A

Voltage	Current
+5.0VDC	7.0A
+4.3VDC	6.0A
-5.0VDC	0.5A

AC Power Input Connections

The following table describes the ASP890300 AC power connector.

Terminal	Nomenclature	Function
1	N	Neutral AC Line
2	L	Hot AC Line
3	G	Ground
4	Jumper inserted between 4 and 5 for 115V operation	
5		

	DANGER
	HAZARDOUS VOLTAGE <ul style="list-style-type: none"> • Disconnect all power before working on equipment. • Verify correct terminal connections when wiring. Failure to follow this precaution will result in death, serious injury, or equipment damage.

DC Power Input Connections

The following table describes the ASP890300 DC power connector.

Terminal	Nomenclature	Function
1	DC+	+24.0VDC
2	DC-	Common

Input Power Connectors Part Numbers

The following table lists part numbers for input power connectors.

Input	Part Number
AC	52-0378-000 (5-terminal)
DC	52-0380-000 (2-terminal)

Note: The ASP890300 is shipped with these connectors installed.

Compatible Backplanes


The following backplanes are compatible with the ASP890300.

Name	Description
AS-H810-208*	10", ASP890300 plus three I/O modules.
AS-H810-209*	10", ASP890300 plus three I/O modules.
AS-H819-209	19", ASP890300 plus six I/O modules.
AS-H827-209	27", ASP890300 plus ten I/O modules.

*Repair/service exchange only

Typical Configuration

Here is a typical ASP890300 configuration.

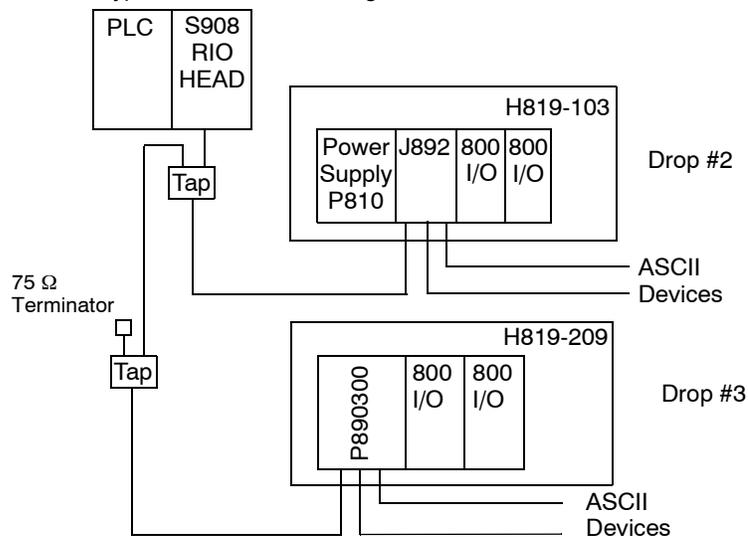

Remote I/O

The following table describes ASP890300 remote I/O.

Compatibility	All S908 Commands and Responses
Cable Medium	Coax, Single or Redundant Options
Termination	75Ω Internal
Shield Grounding Method	Capacitor Coupled to Chassis Ground
Device Address	1-32

Drop I/O Capacity

The following table describes ASP890300 drop I/O capacity.

Max Number of 800 Racks	5 Max: 1 Primary, 4 Secondary
Max Number of Inputs	1024 Points/64 Words
Max Number of Outputs	1024 Points/64 Words
Max I/O	2048 Points/128 Words
Drop Hold Up Time	300ms to 6553.6 seconds 10ms increments
Drop Scan Time	5ms for 256 I/O Points

ASCII Port Capacity


The following table describes ASP890300 ASCII port capacity.

Total Number ASCII Ports per Drop	2
Total Number ASCII Drops per System	16
Total Number ASCII Ports per System	32

Switch Settings

Switch Label

The following graphic shows the switch label.

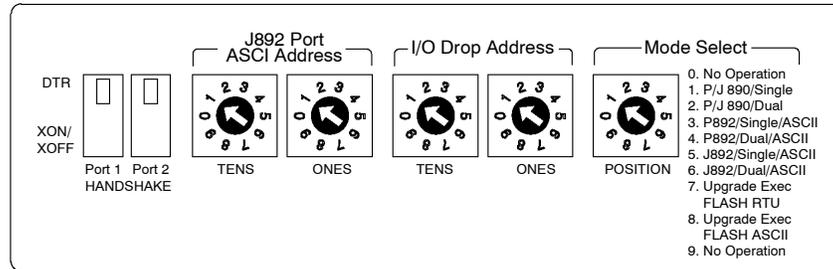

Mode Select Switch

The following table describes the ASP890300 mode select switch.

Rotary Switch Position	Label Nomenclature	Function
0	No Operation	Not Used
1	P/J 890/Single	P89x/J89x Single Cable/ASCII Disabled
2	P/J 890/Dual	P89x/J89x Dual Cable/ASCII Disabled
3	P892/Single/ASCII	P892 Single Cable/ASCII Enabled Port Address Switch Disabled
4	P892/Dual/ASCII	P892 Dual Cable/ASCII Enabled Port Address Switch Disabled
5	J892/Single/ASCII	J892 Single Cable/ASCII Enabled Port Address Switch Enabled
6	J892/Dual/ASCII	J892 Dual Cable/ASCII Enabled Port Address Switch Enabled
7	Upgrade Exec FLASH RTU	Flash Update via Port 1 using RTU Mode parameters Drop Functionally Disabled
8	Upgrade Exec FLASH ASCII	Flash Update via Port 1 using ASCII Mode parameters Drop Functionally Disabled
9	No Operation	Not Used

- Switch settings read only on power up
- Invalid switch position setting will be indicated by flashing Comm Error A and Comm Error B LEDs

I/O Drop Address Switches

The following table describes the ASP890300 drop address switches.

Switch Type	Function	Numbered	Valid Setting
10 Position Rotary	Ones	0 - 9	0 - 9
10 Position Rotary	Tens	0 - 9	0 - 3

- Switch settings read only on power up
- Drop address settings of 0 or greater than 32 are invalid addresses
- Invalid address setting will be indicated by flashing Comm Error A and Comm Error B LEDs

P892 (Mode 3/4) ASCII Port Addressing

The following table describes the ASP890300's P892 (Mode 3/4) ASCII port addressing determined by the I/O drop address switches.

Drop Address	ASCII Address	Drop Address	ASCII Address
1	1,2	9	17,18
2	3,4	10	19,20
3	5,6	11	21,22
4	7,8	12	23,24
5	9,10	13	25,26
6	11,12	14	27,28
7	13,14	15	29,30
8	15,16	16	31,32

- Switch settings read only on power up
- ASCII port rotary address switches disabled in this mode
- ASCII port addresses are related to the drop address and are based upon this table
- Drops 17 through 32 can still be used for 800 I/O, but cannot have associated ASCII ports

J892 Port ASCII Address Switches

The following table describes the ASP890300 ASCII port address switches.

Switch Type	Function	Numbered	Valid Setting
10 Position Rotary	Ones	0 - 9	0 - 9
10 Position Rotary	Tens	0 - 9	0 - 3

- Switch settings read only on power up
- Switch valid for Modes 5/6 only
- ASCII port address settings of 0 or greater than 31 are invalid addresses
- Invalid address setting will be indicated by flashing Comm Error A and Comm Error B LEDs

J892 (Mode 5/6) ASCII Port Addressing

The following table describes the ASP890300's J892 (Mode 5/6) ASCII port addressing determined by the J892 port ASCII address switches.

Switch Setting	ASCII Port Address	Switch Setting	ASCII Address
1 or 2	1, 2	17 or 18	17, 18
3 or 4	3, 4	19 or 20	19, 20
5 or 6	5, 6	21 or 22	21, 22
7 or 8	7, 8	23 or 24	23, 24
9 or 10	9, 10	25 or 26	25, 26
11 or 12	11, 12	27 or 28	27, 28
13 or 14	13, 14	29 or 30	29, 30
15 or 16	15, 16	31 or 32	31, 32

- Switch settings read only on power up
- ASCII port rotary address switches enabled in this mode
- ASCII port addresses of 0 and greater than 32 are invalid
- Invalid address setting will be indicated by flashing Comm Error A and Comm Error B LEDs

ASCII Port Handshake Switch

The following table describes the ASCII port handshake switch.

2 Position DIP Switch	Function
Port 1	Data Terminal Ready
	XON/XOFF
Port 2	Data Terminal Ready
	XON/XOFF

- Switch settings read only on power up

ASCII Port Interface Connector

The following table describes the ASCII port interface connector.

Female 9 Pin D-Type Pin Number	Signal Name	Description
1		Not Used
2	RXD	Receive Data
3	TXD	Transmit Data
4	DTR	Data Terminal Ready
5	SGND	Signal Ground
6	DSR	Data Set Ready
7	RTS	Request to Send
8	CTS	Clear to Send
9		Not Used

- D-sub shell tied to chassis ground.

ASCII Port Parameters

The following table describes programmable ASCII port parameters.


Port Address	1-32
Baud Rate	50, 75, 110, 134, 150, 300, 600, 1200, 1800, 2000, 2400, 3600, 4800, 7200, 9600, 19200
Data Bits	5, 6, 7, 8
Parity	None, Odd, Even
Stop Bits	1 or 2

ASCII Cable Distance

The maximum cable distance is 50 feet (15 meters).

Sample Pin Layout

The following figure describes one possible pin layout for a cable connecting a ASP890300 ASCII port and another device using hardwired flow control. Actual pin numbers may vary between remote devices.

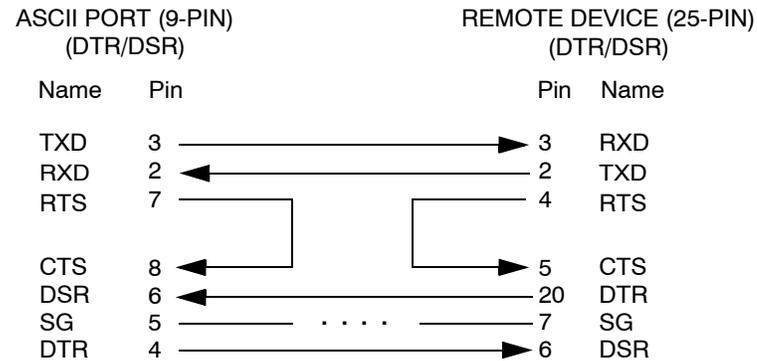

Diagnostics

Overview

The ASP890300 performs two classes of confidence tests, power-up tests and run-time tests. The power-up tests are designed to detect problems within the board hardware before lighting the ready LED and going on-line to receive and hand off data. The run-time tests attempt to catch board hardware problems while the ASP890300 is handling data and will force the unit to go off line if errors are detected. Errors always cause the ASP890300 to flash appropriate LEDs and to turn off the ready LED. The only way of returning to normal operation from a fatal error is to power cycle the unit.

Confidence Tests

The following table describes actions performed by ASP890300 confidence tests.

Confidence Test	Action Performed
Flash Checksum	Performs a checksum of the executive flash
RAM Data Test	Verifies RAM data integrity
RAM Address Test	Verifies RAM address integrity
LAN Controller	Verifies LAN controller integrity
OBM Test	Verifies OURBUS integrity

**Flashing LED
Error Codes**

The following table describes the ASP890300 flashing LED codes.

Comm Active Flashes	Error Condition
0	Power Down Interrupt
1	Kernel Mode
2	Not Used
3	OBM Error
4	Bad/Unexpected Interrupt
	LAN Chip Error
	Receive Abort Error
	Transmission Loop Time-out
	Transmission DMA Time-out
	Cable A Initialization Error
	Cable A DMA Xfer Error
	Cable B DMA Xfer Error
	Cable A Dump Data Error
	Cable A DMA Hung
	Cable B DMA Hung
	Cable A/B DRQ Hung
	Power Up LAN Error
	Cable B Initialization Error
5	RAM Address Error
6	RAM Data Error
7	Exec Checksum Error
8	Kernel Detected Error
*	*Invalid Switch Setting

*Comm A/B Error LEDs flash together indicating an invalid switch setting.
Examples: Invalid Loop Address, Invalid ASCII Port Address, Invalid Mode Setting.

If an ASP890300 Remote I/O Processor exhibits any of the above flashing LED codes, follow the steps below.

If . . .	Then . . .
an ASP890300 Remote I/O Processor stops operating and exhibits any of the flashing LED codes in the previous table,	cycle the processor power off and back on when it is safe to do so.
Comm Active is flashing in any of the following patterns: <ul style="list-style-type: none">● one blink● seven blinks, or● eight blinks,	power cycle as above, then reflash the executive software.
neither of the above two actions restore normal operation,	replace the processor.

Installation

Overview

The following procedure describes how to install an ASP890300 Processor. The processor is installed in an H810-208, H810-209, or H819/H827-209 800 Series I/O Housing in the left-most slot.

Panel Software Requirements

The ASP890300 is a direct replacement for the ASP89X-000 processor. If you need to reconfigure a program, you may use any panel software that supports P89X processors. Select the P89X when traffic copping (I/O mapping).

Installing a ASP890300 Processor

Use the following procedure to install an ASP890300 Processor.

Step	Action
1	Set the processor's Mode Select and Drop Address switches appropriately. <ul style="list-style-type: none">● For example, when replacing or emulating an AS-P890-000, AS-J890-001, or AS-J890-101, select Rotary Switch Position 1.
2	If using ASCII communications, set the processor's Port Address and Handshake switches as required. <ul style="list-style-type: none">● The Port 1/Port 2 Handshake and J892 Port ASCII Address switches are ignored if the Mode switch setting indicates ASCII is disabled.● The Handshake switches are enabled if a switch position indicating ASCII Enabled is selected.● The J892 Port ASCII switches are enabled as indicated.

	DANGER
	<p style="text-align: center;">HAZARDOUS VOLTAGE</p> <ul style="list-style-type: none"> ● Disconnect all power before working on equipment. ● Verify correct terminal connections when wiring. <p>Failure to follow this precaution will result in death, serious injury, or equipment damage.</p>

Step	Action
3	Ensure the processor power source is switched off. Connect power wires to the appropriate AC or DC power connector terminals. If using AC power, for 115VAC operation, insert a jumper between terminals 4 and 5.
4	Connect the Remote I/O coaxial cables. Plug the power connectors into the processor. NOTE: Due to space restrictions (especially if the backplane is rack-mounted), drop cables must be RG-6 maximum. If using dual cables, the suggested method for cable connection is to attach the CHAN A cable first, then the CHAN B. When disconnecting, reverse the process, and remove the CHAN B cable first.
5	Insert the processor into the leftmost slot of the backplane. Press firmly to ensure it is properly seated in the backplane.
6	Tighten the captive screws at the top and bottom of the processor.
7	If used, plug the ASCII connectors into the processor.
8	For AC application, switch on "AC Pwr" For DC application, switch on "DC Pwr"
9	Apply power when the system is ready for processor operation. Make sure that the PWR OK and RDY LEDs are ON . If the system PLC is in RUN mode, make sure that the COMM ACTIVE LED is ON and the OURBUS ERROR LED is OFF .

Specifications

ASP890300 Specifications

The following table describes the specifications of the ASP890300.

Remote I/O Cabling	Coaxial cable 75 ohm
Remote I/O Connector	F-Type
Remote I/O Communications Rate	1.544 MHz
I/O scan time	Less than 5ms for 256 I/O points
RIO comm link time	Less than 1ms for 256 I/O points
Drop hold up time	Programmable from 300ms to 6553.6 sec (in 100ms increments)
Power supplied to I/O (Short circuit proof)	+5VIO, 7A max* +4.3V, 6A max* -5V, 0.5A max *The +5VIO and +4.3V combined cannot exceed 7A.
Power Requirements	115VAC, 1.1A, 50/60Hz 230VAC, 0.65A, 50/60Hz 24VDC, 4A
Inrush Current	30A @ 115VAC 25A @ 24VDC
Power Loss Hold up time	1 cycle AC loss 1ms @ 24VDC

Power Supply

The following table describes ASP890300 power supply testing. (These requirements do not apply to the DC auxiliary input.)

Test	Reference	Spec. Limit
Isolation AC Line to Output		2500 VDC 1780VAC
Electro-Static Discharge	IEC 1000-4-2	4KV Conducted 8KV Air Gap
Radio Frequency Interference	IEC 1000-4-3	10V/m 27MHz-1GHz
Fast Transient	IEC 1000-4-4	2.0KV Comm mode 2.0KV Diff mode
Surge Withstand	IEC1000-4-5	2.0KV Comm Mode 1.0KV Diff Mode
Conducted RF Susceptibility	IEC1000-4-6	0.15KHz-80MHz 10Vrms
Damped Oscillatory Wave	IEEE472	2.5KV Diff Mode 2.5KV Comm Mode

RIO Interface

The following table describes ASP890300 RIO interface testing.

Test	Reference	Spec. Limit
Isolation Coax to Backplane		500 VDC
Electro-Static Discharge	IEC 1000-4-2	4KV Conducted 8KV Air Gap
Radio Frequency Interference	IEC 1000-4-3	10V/m 27MHz-1GHz
Fast Transient	IEC 1000-4-4	1.0KV Cap Clamp
Surge Withstand	IEC1000-4-5	2.0KV to Shield
Conducted RF Susceptibility	IEC1000-4-6	0.15KHz-80MHz 10Vrms
Damped Oscillatory Wave	IEEE472	2.5KV to Shield

ASCII Ports

The following table describes ASP890300 ASCII ports testing.

Test	Reference	Spec. Limit
Isolation		No Test
Electro-Static Discharge	IEC 1000-4-2	4KV Conducted 8KV Air Gap
Radio Frequency Interference	IEC 1000-4-3	10V/m 27MHz-1GHz
Fast Transient	IEC 1000-4-4	1.0KV Cap Clamp
Surge	IEC1000-4-5	2.0KV to Shield
Conducted RF Susceptibility	IEC1000-4-6	0.15KHz-80MHz 10Vrms
Damped Oscillatory Wave	IEEE472	No Test <30 meters

Electromagnetic Emissions

The following table describes ASP890300 electromagnetic emissions testing.

Test	Reference	Spec. Limit
Radiated Emission	EN 55011	30-230MHz in situ at 10M 40dbuV 230-1000MHz in situ at 10M 47dbuV
Conducted Emission	EN55011	0.15-.5MHz 70(66) quasi peak (avg.) dbuV 0.5MHz-30MHz 73(60) quasi peak (avg.) dbuV

- Requires external filter

**Temperature/
Vibration**

The following table describes ASP890300 temperature and vibration testing.


Parameter	Reference	Specification Limits
Storage Temperature	IEC 68-2-14	-40 to +85°C
Operating Temperature	IEC 68-2-14	0 to 60°C Ambient
Humidity Non-Operating	IEC 68-2-3	95% RH at 60°C non-condensing
Humidity Operating	IEC 68-2-3	95% RH at 60°C non-condensing
Altitude	MIL-STD-810	15,000 feet
Vibration Operating	IEC-68-2-6	10-57Hz: 0.075mm Dual Axis
Shock Operating 3 shocks/axis	IEC 68-2-27	15g, 11ms
Free Fall Unpackaged	IEC 68-2-32	1m

Agency Approvals

The following table describes ASP890300 agency approvals.

Agency
UL 508
CSA 22.2-142
CE

800 Series Analog I/O Modules



Introduction

At a Glance

This part provides a detailed description of the 800 Series analog I/O modules. It includes technical data and wiring information for each module.

What's in this Part?

This part contains the following chapters:

Chapter	Chapter Name	Page
7	B846-001 & B846-002 Input Multiplexers	111
8	B872-100 Analog Output	117
9	B872-200 Analog Output	135
10	B873-002 & B875-002 Analog Input	153
11	B873-012 & B875-012 Analog Input	169
12	B875-102 High Speed Analog Input	183
13	B875-111 & B877-111 Analog Input	213
14	B875-200 Configurable A/D Input	243

B846-001 & B846-002 Input Multiplexers



At a Glance

Purpose

The purpose of this chapter is to describe the features and functionality of the B846-001 & B846-002 Input Multiplexers.

What's in this Chapter?

This chapter contains the following topics:

Topic	Page
B846-001 & B846-002 Overview	112
B846-001 & B846-002 Field Connections	114
B846-001 & B846-002 Specifications	115
B846-001 Parameter Configuration	116

B846-001 & B846-002 Overview

Characteristics

Both the B846-001 Voltage Analog Multiplexer (MUX) and the B846-002 Current Analog Multiplexer (MUX) input modules accept 16 analog signals and connect one multiplexed signal to the output terminals of the module. The value of a 16-bit discrete output (coil) or register assigned to the module determines which input signal is connected to the output.

The B846's receive a command from a PLC that tells the module which analog channel to connect to the output terminals. This communication is accomplished via an output register (4x), which is specified when traffic-copping the I/O system. The value of the output register dictates which channel is selected.

Features

Module	Feature
B846-001	Multiplexes analog voltage signals (+/-10 V, +/-5V, 1-5 V)
	Accommodates all voltage levels up to +/- 10 V
B846-002	Multiplexes analog current signals (4-20 mA)
	Accommodates an input range of 4-20mA
B846-001 and B846-002	Compatible with B873 and B875 Analog Input Modules
	Communications ACTIVE indicator
	Module's handles permit easy installation and removal
	Channel indicators
	Available with built-in resistors for 4-20mA loop operation
	Detects communication failures
	Designed for harsh plan floor environments
	Remove module without disturbing rigid field wiring system
	Meets IEEE surge withstand capability tests
	Designed UL and CSA standards

Each channel of the B846 has a high reliability DPST reed relay. The module is updated with every scan of the PLC, and the switched output is stable within ten milliseconds. The relay contacts are guaranteed to respond within 10 mS including diagnostics.

Each individual input channel may be wired with available 250 Ohm precision resistors. Wiring allows continuous 4-20mA current loop operation when the B846 output is connected to a 1-5V analog input.

Indicators on the module's bezel identify the input channel being enabled by the controller. The sixteen input channels are numbered from 0 to 15.


All outputs shut OFF in the event of a communications failure. Shut-off occurs within 300 ms of the signal loss. The module's ACTIVE indicator will also shut OFF.

The B846 module can be inserted into any location in the 800 Series I/O structure. The module slides easily into the housing and does not interfere with any other module's operation. An optional mechanical keying system can be used to match the module type with a particular slot in the housing to ensure proper module replacement. User connections are made to a standard screw terminal strip. The rigid wiring system permits module insertion or removal without disturbing the wiring. The module's protective case shields the logic circuitry from any electrical interference and minimizes the possibility of any noise being coupled from the user side of the circuitry to adjacent modules. A ground is automatically established when the module is inserted into the housing. This low impedance earth ground originates from the housing's backplane.

B846-001 & B846-002 Field Connections

User Input Connections

User connections are made to a standard screw terminal strip; and the rigid wiring system permits module insertion or removal, without disturbing the wiring. Refer to the following figure for terminal numbering and input connections.
Connector AS-8535-000

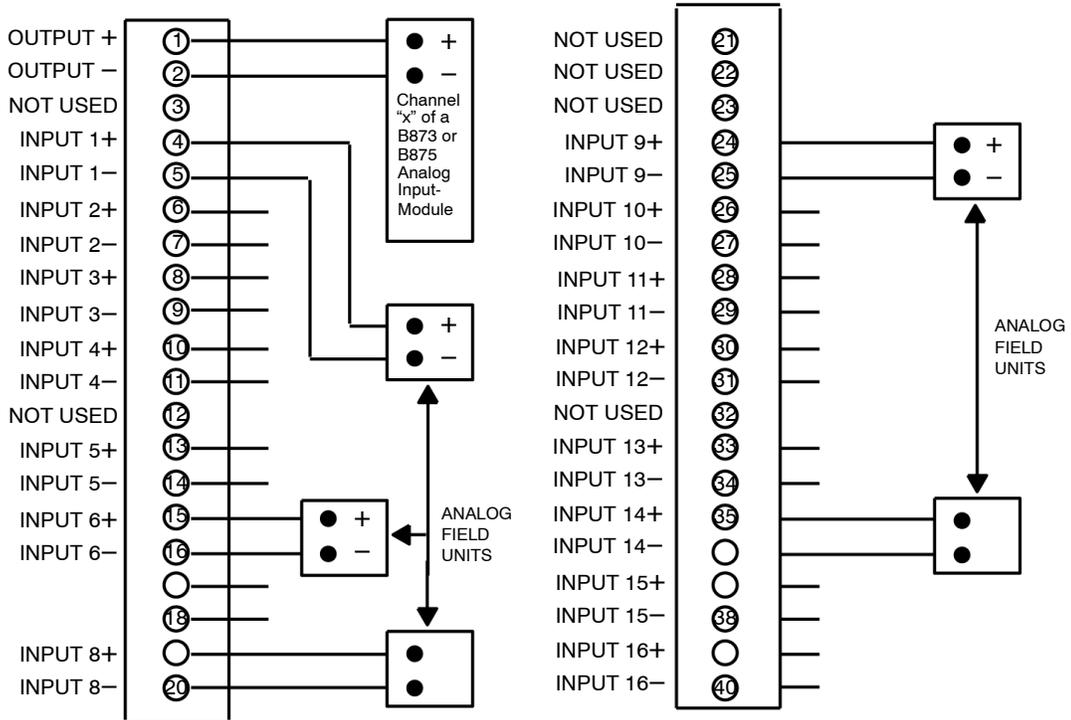

B846-001 & B846-002 Specifications

Specifications for B846 Input Multiplexers


The following table shows the specifications for the B846 Input Multiplexers.

Description		
B846-001	Voltage Input Multiplexer	
B846-002	Current Input Multiplexer	
Number of Input Points	16, potential isolated from each other	
Address Capacity	1 register data out (Binary data type)	
Ranges	(B846-001) 0-5V, 1-5V, +/- 10V (B846-002) 4-20 mA	
Input Impedance	(B846-001) Equal to B873 or B875 (B846-002) 250 ohms	
Relay Response Time	10 mS including diagnostics	
Power Required		
	+5 VDC	65 mA
	+4.3 VDC	1 mA
	-5 VDC	0 mA
Update Time		
	B846 MUX only	3 mS
	with B875	20 mS
	with B873	20 mS
Note: An over range condition on any B873/B875 channel will add approximately 200 mS per over range channel, to update time of remaining channels.		
Terminal Connector	AS-8535-000	

B846-001 Parameter Configuration

Parameter and Default Values

Parameter Configuration Window

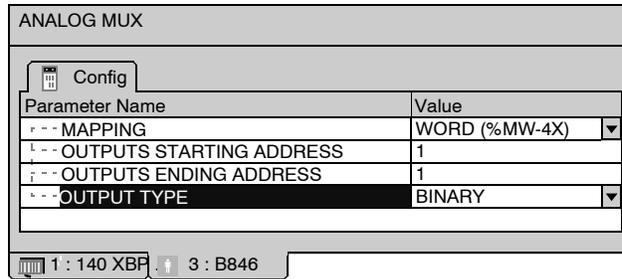

Module Configuration

Parameter Name	Value (Default)	Value (Options Available)	Description
Mapping	WORD (%MW-4X)	-	
Outputs Starting Address	1	-	
Outputs Ending Address	1	-	
Output Type	BINARY	BCD	

Mapping Parameter References

	984LL, Concept, ProWORX	Unity
Reference Type	Mapped as 1 register output 4x	Mapped as 1 word output %MWx
Output Type	BIN/BCD	BIN/BCD

B872-100 Analog Output



At a Glance

Purpose

The purpose of this chapter is to describe the features and functionality of the B872-100 Analog Output Module.

What's in this Chapter?

This chapter contains the following topics:

Topic	Page
B872-100, Analog Output	118
B872-100 Data Value to Output Conversion	119
B872-100 Field Connections	122
B872-100 - Setting Module DIP-Switch	124
Calibration	126
B872-100 Specifications	131
B872-100 Parameter Configuration	133

B872-100, Analog Output

Characteristics


The B872-100 4-Channel Analog (D/A) Output Module converts numerical data ranging from 0000 to 4095 into current ranging from 4 to 20 mA (12-bit resolution). The module is designed to allow you to control the state of each output channel when the programmable controller is reset or stopped. The output of the channel can either remain at the last value (HOLD) or go to 0.0 mA (return to default: zero: RTZ). You can select this option for each of the four isolated outputs using a four-position DIP switch. A switch is associated with each output (switch 1 for output 1, etc.). The HOLD or RTZ function is selected by you to meet your specific application. The RTZ function allows you to bring the outputs to zero as a safety feature. The HOLD function allows you to maintain the last valid output value after the loss of OURBUS communication.

Note: Module Output Alert

RTZ disables the output of the module so that output current goes to zero, not to zero scale (4 mA). Monitor voltage goes below 1V to indicate an output current loss of less than 4 mA.

The module has four isolated analog outputs, and is capable of updates to all four channels every 1 mS. The 12-bit resolution and the absolute accuracy of $\pm 0.1\%$ at 25°C provides precise control of your application.


The following figure shows the simplified schematic of the B872-100 module.

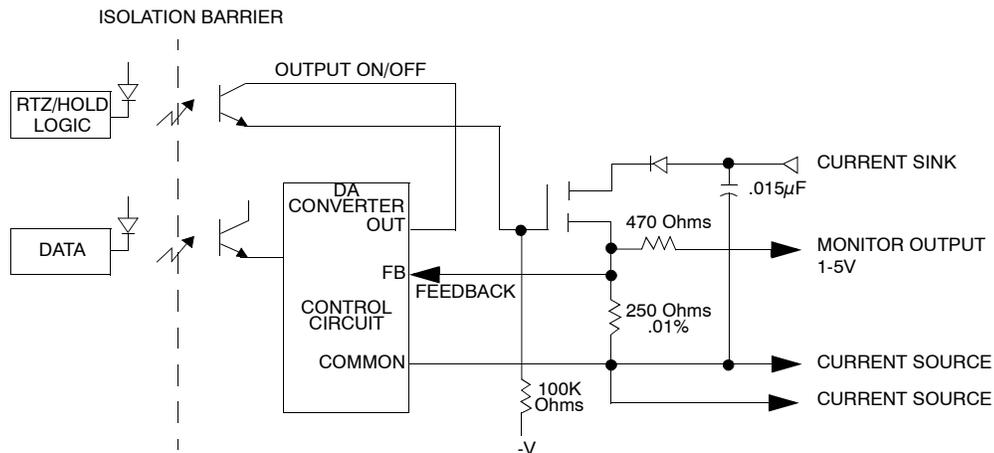

B872-100 Data Value to Output Conversion

Data Value to Output Conversion Chart

The B872 accepts data values ranging from 0000 to 4095 and converts them into output currents of 4 to 20 mA. The output current is directly proportional to the data value plus 4 mA. Refer to the figure below for a data value to output conversion chart.

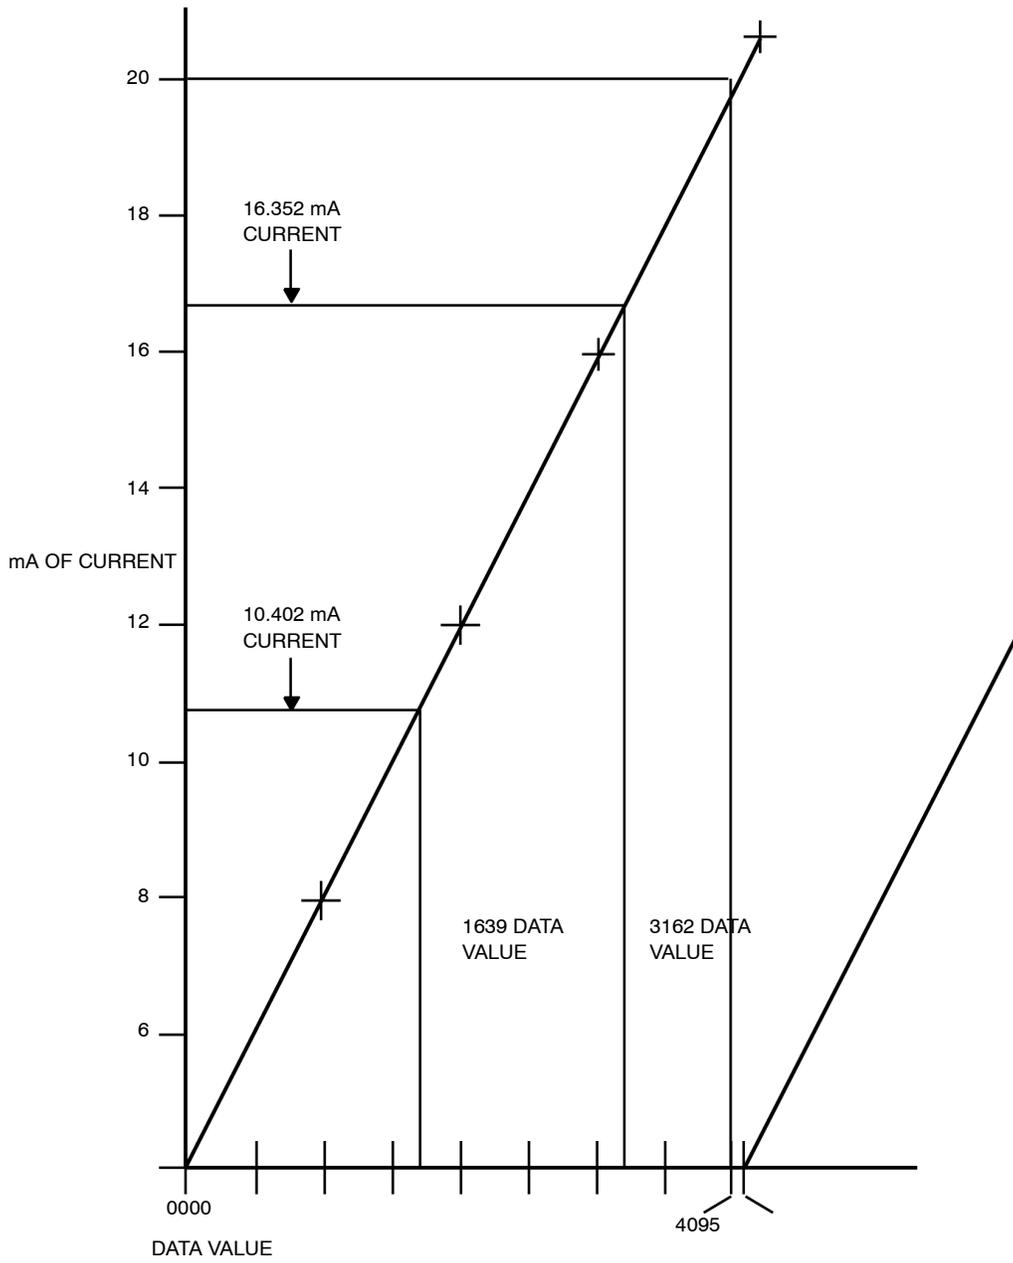

**Determining
Data value or
Output Current**

To determine either the data value or the output current, use the following calculations:

To solve for output current:

$$\text{Current} = (\text{Data Value} / 256) + 4$$

For example:

$$\text{Current} = (3162 / 256) + 4$$

$$\text{Current} = (12.35156) + 4$$

$$\text{Current} = 16.35156$$

$$\text{Current} = 16.352$$

To solve for data value:

$$\text{Data Value} = (\text{Current} - 4) \times 256$$

For example:

$$\text{Data Value} = (10.402 - 4) \times 256$$

$$\text{Data Value} = (6.402) \times 256$$

$$\text{Data Value} = 1638.912$$

$$\text{Data Value} = 1639$$

Note: Data values larger than 4095 will result in currents less than 20 mA. Refer to the in this chapter. The equations above are valid for data values of 0-4095 only. The module can output values in the range of 4096-8191 in a offset scale. If you use this offset range, be sure to subtract 4096 from the calculations provided above. *Trim-Pots Location and Voltmeter Connections, p. 127*


B872-100 Field Connections

User Connections

User connections are made to a standard screw terminal strip, and the rigid wiring system permits module insertion or removal, without disturbing the wiring.

Terminal Numbering and Functions

Terminal numbering, and their corresponding output functions, are presented in the figure below.

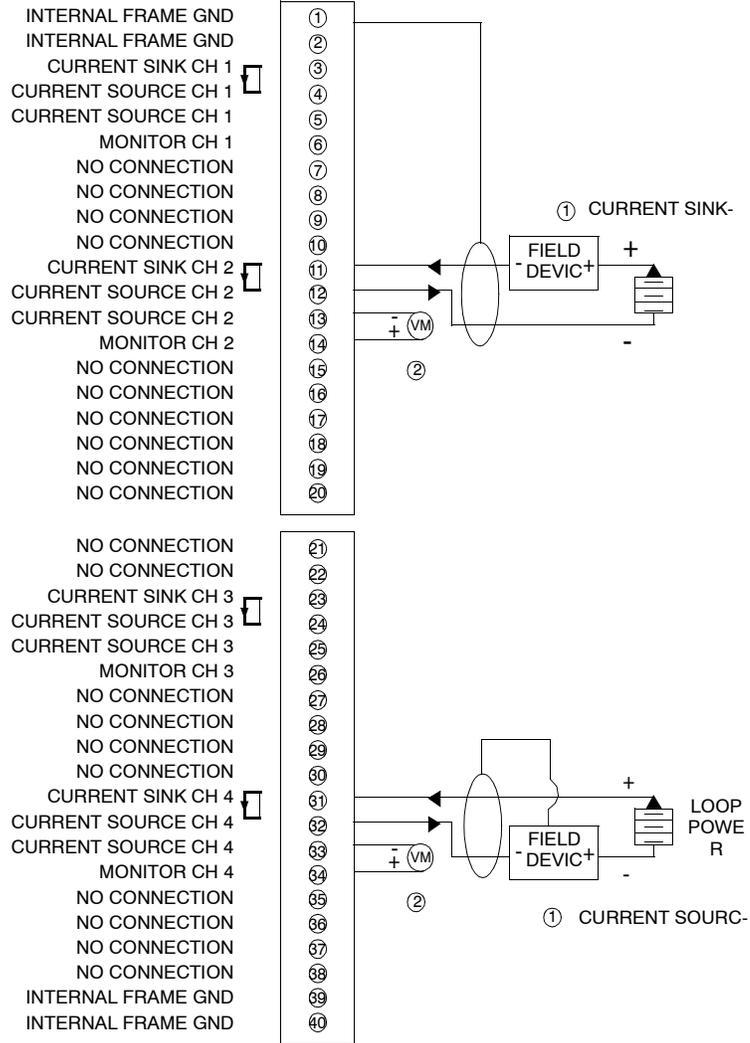

- ① FIELD DEVICES MAY BE LOCATED IN EITHER SINK OR SOURCE LEADS AS SHOW
- ② VM IS AN OPTIONAL VOLTMETER THAT READS A VOLTAGE PROPORTIONAL TO

B872-100 - Setting Module DIP-Switch

Switch location and position

The four position DIP-switch is located on the rear of the module. This switch controls the state of each channel when the system is reset or stopped. The output to the channel can either remain at the last value (Hold) or go to 0.0 mA Return-To-Zero (RTZ).


Set the switch for either hold or RTZ prior to installation of the module. Each of the four switches control the mode of operation for its associated output (i.e., switch 1 for output 1, etc.).

Switch Settings

The following figure presents DIP switch settings for the B872-100 module. Also, refer to the label located on the left side of the module itself.

4- POSITION DIP- SWITCHES

TOP OF MODULE



0	1
ON	OFF
DOWN	UP
LEFT	RIGHT
RTZ	HOLD

SWITCHES

1,2,3,4- Channel

FUNCTIONS

STATE OF OUTPUT WHEN PC RESETS OR STOPS

FOR RTZ:

SW=L

FOR HOLD:

SW=R

Set the switch to the left to select return-to-zero or to the right to select hold (viewing the rear of the module when held vertically). Channels are set independently.

Note: The output state after power-up initialization is dependent on the position of DIP-switch. Open circuit in the following table results in current 0 mA.

The following table represents the Relationship Between Power-up and DIP-Switch Settings.

Possible Event During Power-up	Switch=RTZ	Switch=HOLD
At Power-up	Open Circuit	Open Circuit
After Receiving Valid Data	Data	Data
PC Stop (After Run)	Open Circuit	Last Data
Loss of +5V	Open Circuit	Open Circuit
Loss of +4.3VIO	Open Circuit	Last Data
Loss of +5V & +4.3VIO	Open Circuit	Open Circuit

Calibration

Calibration Intervals

The Analog Output module is calibrated at the factory prior to shipment. To ensure the module's accuracy you should calibrate the trim-pots for each output regularly. Calibration is recommended at 12 month intervals for operation between 25-45 °C and at 6 month intervals between 0-60 °C.

Calibration Tools

The following tools are needed to calibrate an Analog Output module:

- 1) A programming panel
- 2) A precision voltmeter, with an accuracy of +/-0.0001 volts on a 10 volt scale
- 3) A 1/4 inch Phillips screwdriver
- 4) A 1/8 inch standard screwdriver


Calibration Procedure (Method 1)

To make the adjustments, a load and loop supply must be connected to the channel being calibrated. There are two ways to make the adjustments. One procedure requires a load and loop supply to be assembled using voltage and resistance (Method 1). Refer to the Calibration Voltage/Resistance Procedure and the Voltmeter Connections Diagram. The second procedure uses the existing field side circuit (Method 2). Refer to the Calibration Procedure, the Voltmeter Connections Diagram, and the Voltage/Resistance Chart. The following table the Calibration Voltage/Resistance Procedure (Method 1).


Step	Action
1	Use a close tolerance 250 ohm resistor (+/-0.01%) and a voltage supply of between 12 and 35 VDC. The voltage readings will be taken across the resistor. Connect as indicated in the upper part of the Voltmeter Connections diagram.
2	Remove the two screws and the label located on the front panel of the Analog Output module. This allows you access to the trim-pots. There are two trim-pots per output. The first two trim-pots are for output number one, the second set is for output two, etc. Refer to the figure below for the Location of Trim Pots.
3	Open the Analog Output module handle to expose the connectors and terminals.
4	Load the data value of 0000 into the output register for the channel under test.
5	Adjust the top (4 mA calibrate) trim-pot of the set for a voltage of +1.0000, +/-0.002 volts. This calibrates to +/-0.05% of full scale.
6	Manually program a data value of 4095 into the output register for channel one.
7	Adjust the bottom (20 mA calibrate) trim-pot of the set for a voltage reading of +4.9990, +/-0.002 volts. This calibrates to +/-0.05% of full scale.
8	Return to step 4 and repeat steps 4-8 until module is within tolerance.
9	Move connections to next channel to calibrate, and repeat steps 4 through 8 for each output channel.
10	After the calibration procedure is complete, disconnect the voltmeter, return connections to their original state, close module handle, and replace front label that covers the trim-pots. Pot locking paint, and other substances are not required.

**Trim-Pots
Location and
Voltmeter
Connections**

The following figure shows the location of the Trim-Pots on the B872 Module.

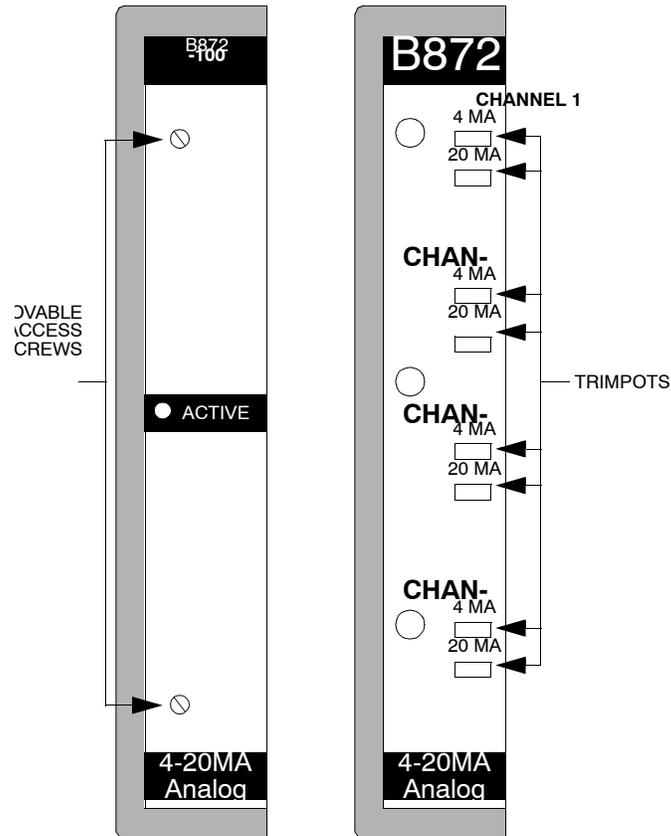


The following figure is the Voltmeter Connections diagram for the B872-100 Module.

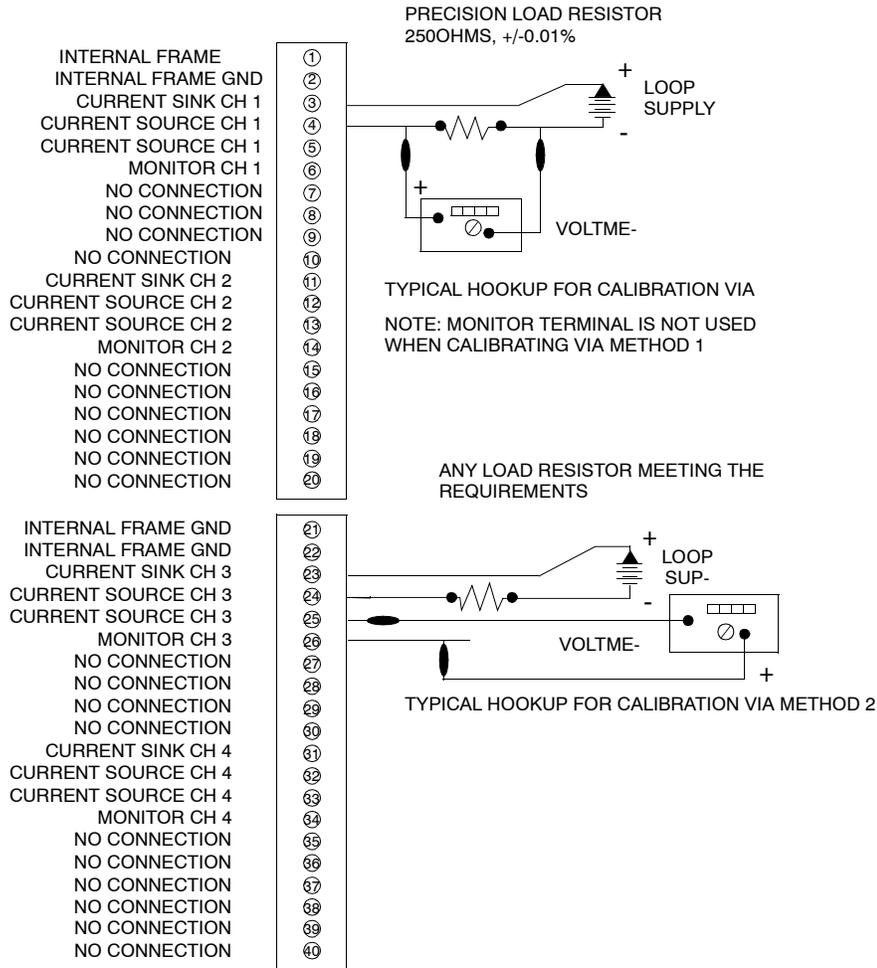

**Calibration
Procedure
(Method 2)**

The following table gives the Calibration Procedure (Method 2) for the B872-100 Module:

Step	Action
1	Connect loop supply and load resistor (if any) as indicated in the lower part of the Voltmeter Connections Diagram. Verify that resistor and loop supply are within limits as defined by the Voltage Resistance Chart.
2	Connect voltmeter to monitor terminals as indicated in the lower part of the Voltmeter Connections Diagram.
3	Load the data value of 0000 into the output register for the channel under test.
4	Adjust the top (4 mA calibrate) trim-pot of the set for a voltage of +1.0000, +/-0.002 volts. This calibrates to +/-0.05% of full scale.
5	Manually program a data value of 4095 into the output register for channel one.
6	Adjust the bottom (20 mA calibrate) trim-pot of the set for a voltage reading of +4.9990, +/-0.002 volts. This calibrates to +/-0.05% of full scale.
7	Return to step 3 and repeat steps 3-6 until module is within tolerance.
8	Move connections to next channel to calibrate, and repeat steps 3 through 7 for each output channel.

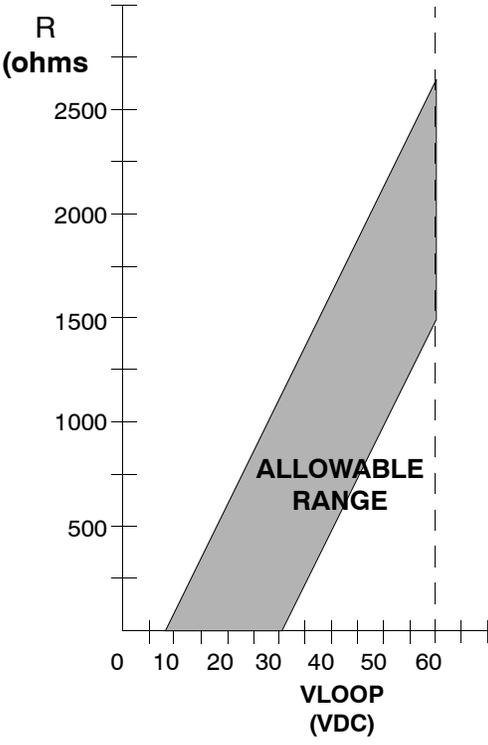Step	Action												
9	<p>After the calibration procedure is complete, disconnect the voltmeter, return connections to their original state, close module handle, and replace front label that covers the trim-pots. Pot locking paint, and other substances are not required. The following figure is the Voltage/Resistance Chart.</p>  <p>The chart displays the relationship between VLOOP (VDC) on the x-axis and Resistance (R) in ohms on the y-axis. The allowable range is defined by two parallel lines. The upper line starts at approximately 10 VDC and 0 ohms, and the lower line starts at approximately 30 VDC and 0 ohms. Both lines converge at 60 VDC, where the upper line is at approximately 2600 ohms and the lower line is at approximately 1500 ohms. A vertical dashed line is drawn at 60 VDC.</p> <table border="1"> <caption>Data points for the Allowable Range</caption> <thead> <tr> <th>VLOOP (VDC)</th> <th>Upper Bound R (ohms)</th> <th>Lower Bound R (ohms)</th> </tr> </thead> <tbody> <tr> <td>10</td> <td>0</td> <td>0</td> </tr> <tr> <td>30</td> <td>0</td> <td>0</td> </tr> <tr> <td>60</td> <td>~2600</td> <td>~1500</td> </tr> </tbody> </table>	VLOOP (VDC)	Upper Bound R (ohms)	Lower Bound R (ohms)	10	0	0	30	0	0	60	~2600	~1500
VLOOP (VDC)	Upper Bound R (ohms)	Lower Bound R (ohms)											
10	0	0											
30	0	0											
60	~2600	~1500											

B872-100 Specifications

B872-100 Specifications

The following table gives the specifications for the B872-100 Module.

Description	Analog output D/A; 4 - 20 mA	
Number of Points	4	
Operating Range	4 - 20 mA	
Maximum Loop Supply Voltage	60 VDC	
Allowable Resistance Range*		
Minimum	$R_{min} = V_{Loop}^{**} - 30V$	0.02A
and	$R_{max} = V_{Loop}^{**} - 7V$	0.02A
Maximum		
*Resistance is the sum of all components, including wiring, in the field side circuit.		
** V_{Loop} equals the voltage of the loop supply (not to exceed 60VDC). If voltage is <30VDC, then the minimum loop resistance is 0 Ohms. Refer to the <i>Calibration Procedure (Method 2)</i> , p. 129		
Voltage Drop @ 20 mA		
Minimum	7 VDC	
Maximum	30 VDC	
Response Time to Within +/- 0.1% of Full Range	35 mS, all four channels	
Valid Data Values	0 thru 4095, or offset 4096-8191	
Resolution	1 part in 4096 counts	
Monitor Output Voltage		
Range	1 to 5 VDC	
Min Load	1 Megohm	
Impedance	470 ohms, typical	
Accuracy***		
Output Errors @ 25 °C (77 °F)		
Overall	+/-0.1% @ 25 °C absolute	
Nonlinearity	+/-0.024%	
Differential Nonlinearity	+/-0.036%	
*** All percentages are of full range.		
Output Isolation		
Output to OURBUS	1500 VAC or 2500 VDC for 1 minute 500 VAC or 500 VDC continuous operation	

B872-100, Analog Output

Channel to Channel	1500 VAC or 2500 VDC for 1 minute 500 VAC or 500 VDC continuous operation
Conversion	
Resolution	12-bits (1 part in 4096)
Update Time	The module can accept new data every 1 mS for a 4 channel update)
Settling Time	Within +/-0.1%, < 350mS
Linearity	0 to 60 °C, +/- 1 LSB maximum
Differential Nonlinearity	0 to 60 °C, +/- 1.5 LSB maximum
Load Inductance	1 Henry max, with no external diode suppression
Power Required	
+5 V	475 mA
+4.3 V	5 mA
-5 V	0 mA
Terminal Connector	AS-8535-000

B872-100 Parameter Configuration

Parameter and Default Values

Parameter Configuration Window

Parameter Name	Value
MAPPING	WORD (%MW-4X)
OUTPUTS STARTING ADDRESS	2
OUTPUTS ENDING ADDRESS	5
OUTPUT TYPE	BINARY

Module Configuration

Parameter Name	Value (Default)	Value (Options Available)	Description
Mapping	WORD (%MW-4X)	-	
Outputs Starting Address	2	-	
Outputs Ending Address	5	-	
Output Type	BINARY	BCD	

Mapping Parameter References

	Modsoft, Concept, ProWORX	Unity
Reference Type	Mapped as 4 registers output 4x	Mapped as 4 words output %MWx
Output Type	BIN/BCD	BIN/BCD

B872-200 Analog Output



9

At a Glance

Purpose

The purpose of this chapter is to describe the features and functionality of the B872-200 Analog Output Module.

What's in this Chapter?

This chapter contains the following topics:

Topic	Page
B872-200 Overview	136
B872-200 Data Value to Output Conversion	138
B872-200 Field Connections	142
B872-200 - Setting Module Jumpers	144
B872-200 - Setting Module DIP-Switch	145
B872-200 Calibration	147
B872-200 Specifications	151
B872-200 Parameter Configuration	152

B872-200 Overview


Characteristics

The B872-200 4-Channel Analog (D/A) Output Module converts numerical data ranging from 0000 to 4095 into output voltage ranges (12-bit resolution). The Analog Output module allows you to drive a wide array of field devices requiring different voltages based upon your unique application. You can select from four available output voltage ranges. The ranges, which are 0 to 5V, 0 to 10V, -5 to 5V, and -10 to 10V, are selected by means of four pairs of jumpers, one pair per channel. You can operate multiple ranges simultaneously. The module is designed to allow you to control the state of each output channel when the programmable controller is reset or stopped. The output of the channel can either remain at the last value (HOLD) or go to 0.0 mV i.e., return-to-zero (RTZ). You can select this option for each of the four isolated outputs using a four-position DIP switch. A switch is associated with each output (switch 1 for output 1, etc.). The HOLD or RTZ function is selected by you to meet your specific application. The RTZ function allows you to bring the outputs to zero as a safety feature. The HOLD function allows you to maintain the last valid output value after the loss of Ourbus communication.

Note: Operative Interruption Hazard
RTZ disables the output of the module so that output voltage goes to zero, independent of range selected.

The module has four isolated analog outputs and is capable of updates to all four channels every 1 ms. The 12-bit resolution and the absolute accuracy of +0.1% at 255 C provides precise control of your application. Refer to the figure below for the simplified schematic of the module.


The following figure is the simplified schematic diagram, for the B872-200 Module.

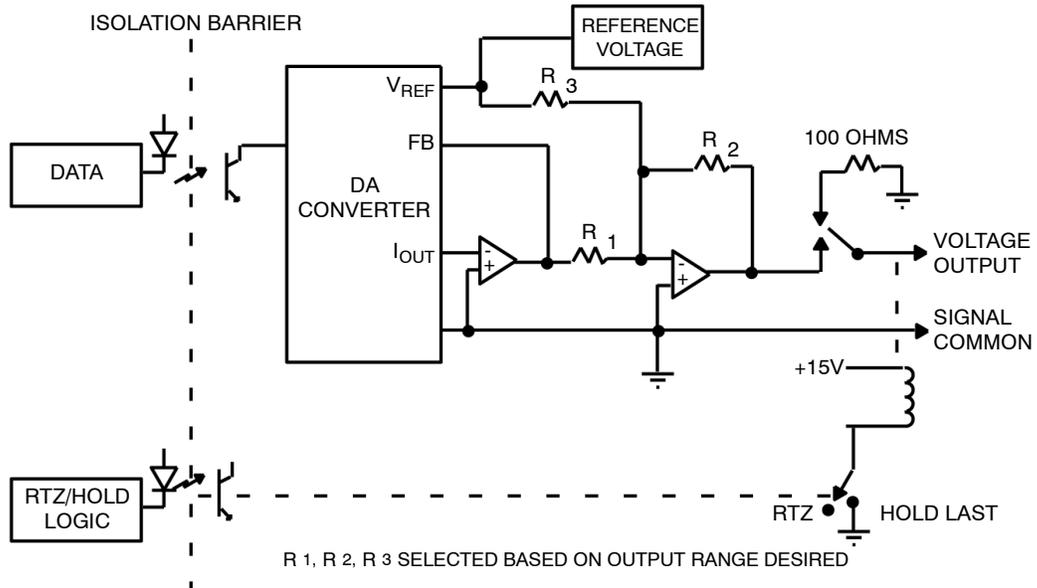

B872-200 Data Value to Output Conversion

Data Value Ranges

The B872 accepts data values ranging from 0000 to 4095 and converts them into output voltages for all four ranges. The output voltage is directly proportional to the data value. Refer to the figure below for a data value to output conversion chart. The figure below is a Data Value to Output Conversion Chart, for the B872-200 Module.

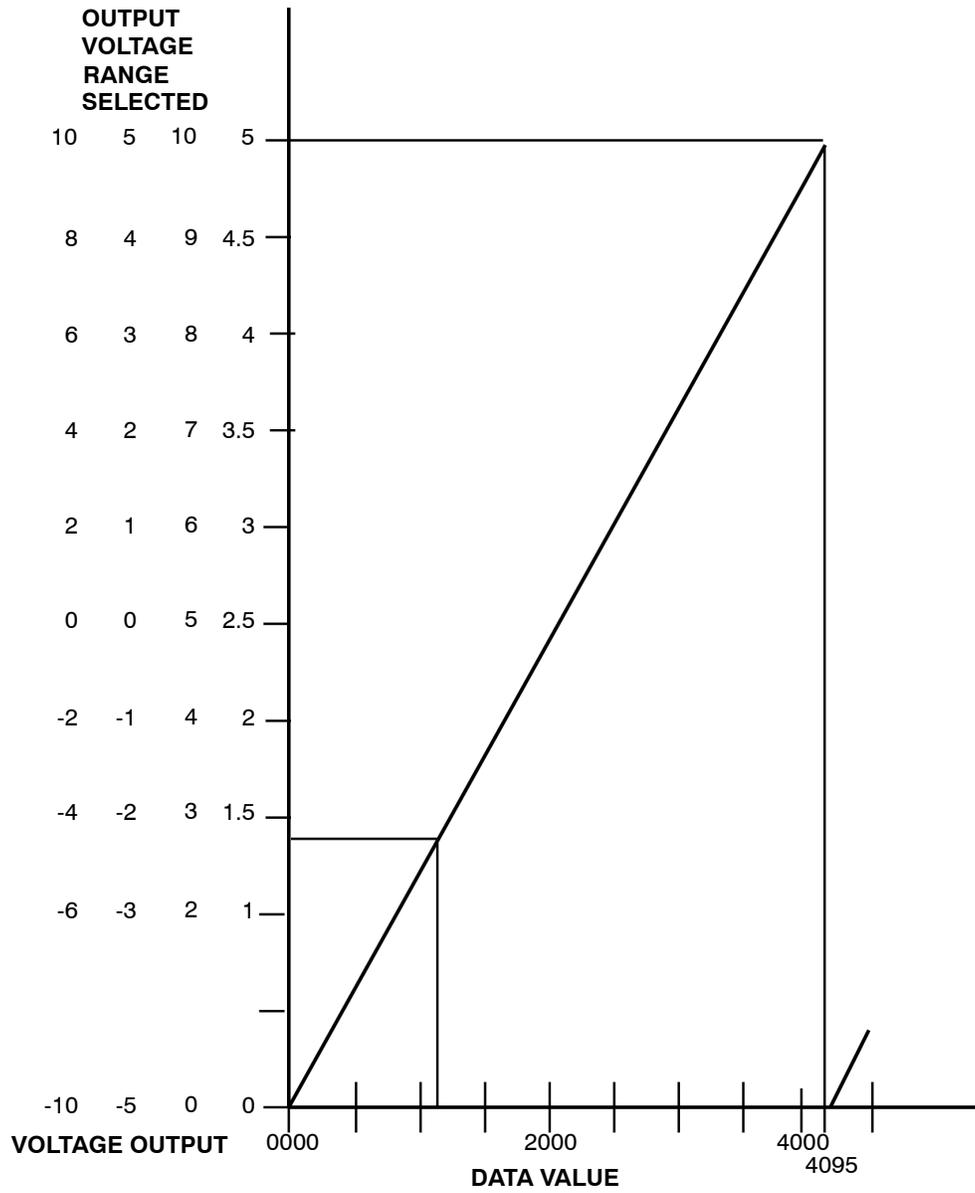

Sample Calculations

Calculations for determining voltage reading or data value for 0 to 5V or 0 to 10V Ranges:

To solve for voltage reading:

$$\text{Voltage Output} = \frac{\text{Total Voltage Span}^* \times \text{Data Value}}{4096}$$

For example:

$$\text{Voltage Output} = \frac{5 \times 1024}{4096}$$

$$\text{Voltage Output} = 1.250 \text{ VDC}$$

To solve for data value:

$$\text{Data Value} = \frac{\text{Output Volts} \times 4096}{\text{Total Volts}^*}$$

For example:

$$\text{Data Value} = \frac{3.1104 \times 4096}{5}$$

$$\text{Data Value} = 2548$$

Calculations for determining voltage reading or data value for -5 to 5V or -10 to 10V Ranges:

To solve for voltage output:

$$\text{Voltage Output} = \frac{\text{Total Volts}^* \times \text{Data Value} + \text{Offset Voltage}^{**}}{4096}$$

For example:

$$\text{Voltage Output} = \frac{10 \times 1024 + (-5)}{4096}$$

$$\text{Voltage Output} = -2.500 \text{ VDC}$$

To solve for data value:

$$\text{Data Value} = \frac{(\text{Voltage Output} - \text{Offset Voltage}^{**}) \times 4096}{\text{Total Volts}^*}$$

For example:

$$\text{Data Value} = \frac{(1.2183 - (-5)) \times 4096}{10}$$

$$\text{Data Value} = 2547$$

*Total Volts Span = Voltage sum from lowest to highest voltage in range is selected.

Examples:

$$-100 \text{ to } 10\text{V} = 20\text{V}$$

$$-5 \text{ to } 5\text{V} = 10\text{V}$$

****Offset Voltage = The lower number of the range is selected.**

Examples:


-5 to 5V = -5V

-10 to 10V = -10V

B872-200 Field Connections

User Connections

User connections are made to a standard screw terminal strip and the rigid wiring system permits module insertion or removal without disturbing the wiring. Terminal numbering and their corresponding output functions are presented in the figure below.

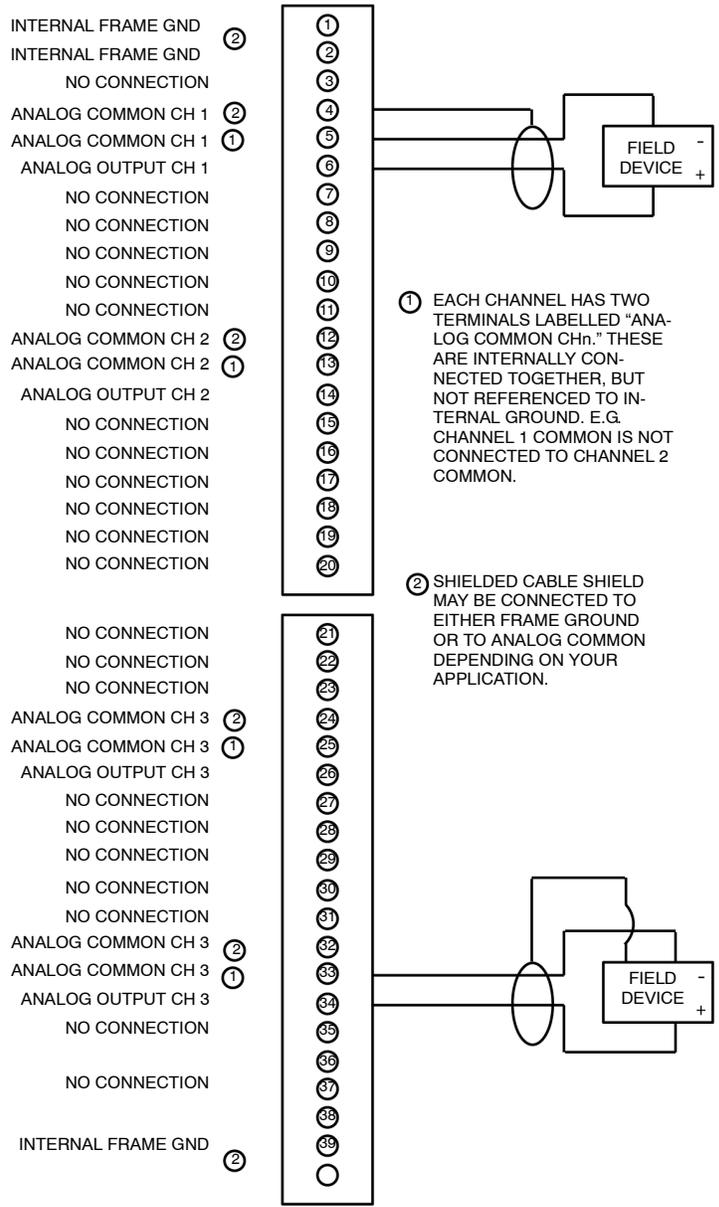





B872-200 - Setting Module Jumpers

Location and Settings

The jumpers are located on the left side of the module (look for four access holes). The holes allow access to the four pairs of jumpers which are used to select an output voltage range for the associated channel.

Set the desired voltage range for 0 to 5V, 0 to 10V, -5 to 5V, or -10 to 10V prior to installation. Refer to the figure below for the jumper settings. Also refer to the left side of the module itself. The module is shipped set for 0 to 10V.

The following figure gives the jumper settings for the B872-200 Module:

OUTPUT VOLTAGE	JUMPER SETTINGS
<p>RANGES</p> <p>0 to +10v</p>	
<p>-10 to +10v</p>	
<p>0 to +5v</p>	
	

B872-200 - Setting Module DIP-Switch


4-Position DIP-Switch

The four position DIP-switch is located on the rear of the module. This switch controls the state of each channel when the system is reset or stopped. The output to the channel can either remain at the last value (Hold) or go to 0.0 mA Return-To-Zero (RTZ).

Set the switch for either hold or RTZ prior to installation of the module. Each of the four switches control the mode of operation for its associated output (i.e., switch 1 for output 1, etc.). Refer to the figure below for switch settings. Also, refer to the label located on the left side of the module itself.

The following figure gives DIP-Switch Settings for the B872-200 Module.

4-POSITION DIP-SWITCH

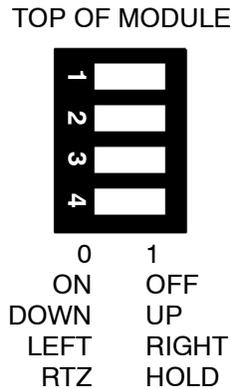

SWITCHES

1,2,3,4-Channel

FUNCTIONS

STATE OF OUTPUT WHEN PC RESETS OR STOPS

FOR RTZ:

SW=L

FOR HOLD:

SW=R

Set the switch to the left to select return-to-zero or to the right to select hold (viewing the rear of the module when held vertically). Channels are set independently.

Note: The output state after power-up initialization is dependent on the position of DIP-switch. Open circuit in the following table results in current 0 mA.

The following table shows the Relationship Between Power-up & DIP-Switch Settings.

Possible Event During Power-up	Switch=RTZ	Switch=HOLD
At Power-up	0Volts*	0Volts*
After Receiving Valid Data	Data	Data
PC Stop (After Run)	0Volts*	Last Data
Loss of +5V	0Volts*	0Volts*
Loss of +4.3VIO	0Volts*	Last Data
Loss of +5V & +4.3VIO	0Volts*	0Volts*
*Active circuits of module are disconnected from the output terminals, the output terminals are connected to an internal 100 Ohm resistor.		

B872-200 Calibration

Principle

The Analog Output Module is calibrated at the factory prior to shipment. To ensure the module's accuracy, you should calibrate the trim-pots for each output regularly. Calibration is recommended at 12 month intervals for operation between 25-45 °C, and at 6 month intervals between 0-60 °C.

Required Tools

The following tools are needed to calibrate an Analog Output Module:

- 1) A programming panel
- 2) A precision voltmeter, with an accuracy of +/-0.0001 volts on a 10 volt scale
- 3) A 1/4 inch Phillips screwdriver
- 4) A 1/8 inch standard screwdriver


Calibration Procedure

The following table shows the steps to calibrate the B872-200 Module:

Step	Action
1	Remove the two screws and the label located on the front panel of the Analog Output module. This allows you access to the trim-pots. There is one trim-pot per output. The first trim-pot is for output number one, the second set is for output two, etc. The trim-pots adjust the range's total magnitude (full scale). Refer to the figure below. Note The 0.1% tolerance is the maximum FSR accuracy achievable thru calibration for any volt range. Calibrating any range to the 0.1% tolerance throws the other slightly off; i.e., tolerances for the remaining ranges available to that channel cannot be assumed better than +/- 0.25% FSR.
2	Open the Analog Output module handle to expose the connectors and terminals.
3	Connect the voltmeter minus lead (-) to the channel 1 (Analog Common CH1) and the plus lead (+) to the channel 1 (Analog Output CH1) terminal. Refer to the Voltmeter Connections Diagram below. Note Field wiring may remain connected during calibration.
4	With the desired voltage range already selected. Manually program a data value of 4095 into the output register for channel two. Compare channel output voltage with anticipated voltmeter reading given in the table below.
5	Adjust the (full scale calibrate) trim-pot for corresponding channel to get desired voltmeter reading.
6	Repeat steps 3 through 5 for remaining channels.
7	After the calibration procedure is complete, disconnect the voltmeter, return all connections to their original state, close the module handle, and replace the front label that covers the trim-pots. END OF PROCEDURE


Location of Trim-Pots

The following figure shows the location of the Trim-Pots on the B872-200 Module.

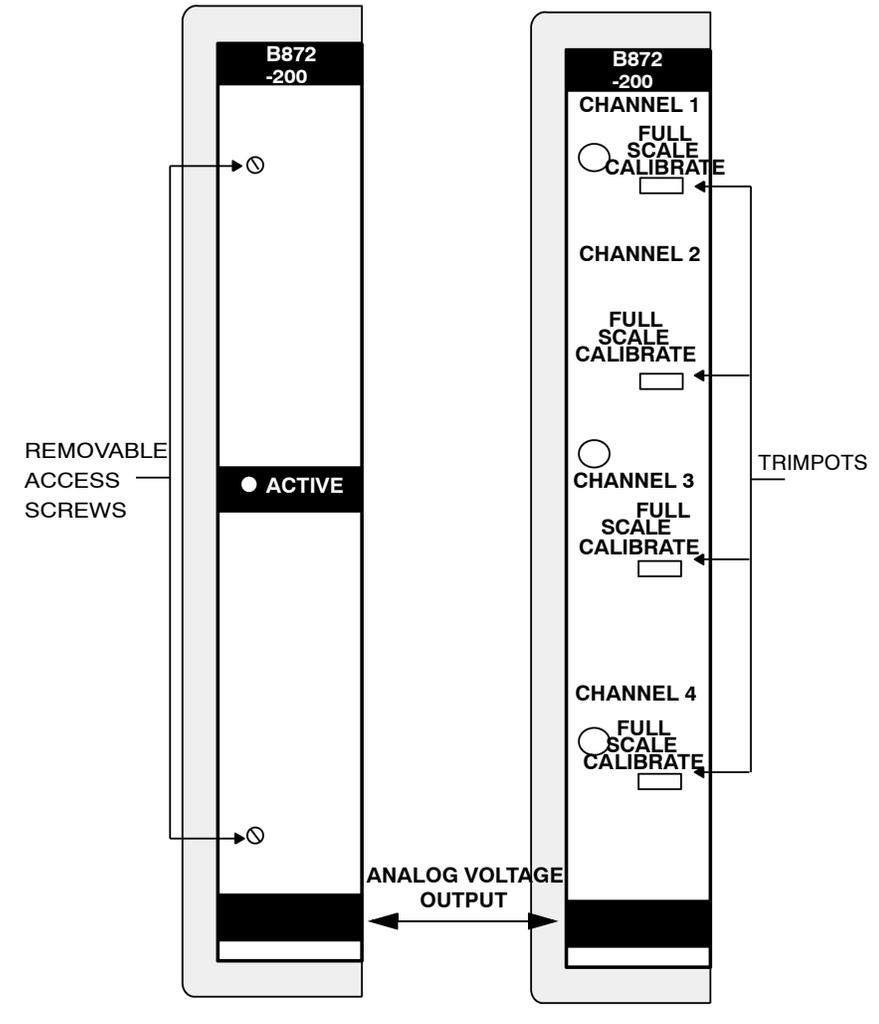

Voltmeter Connections

The following figure is the Voltmeter Connections Diagram for the B872-200 Module.

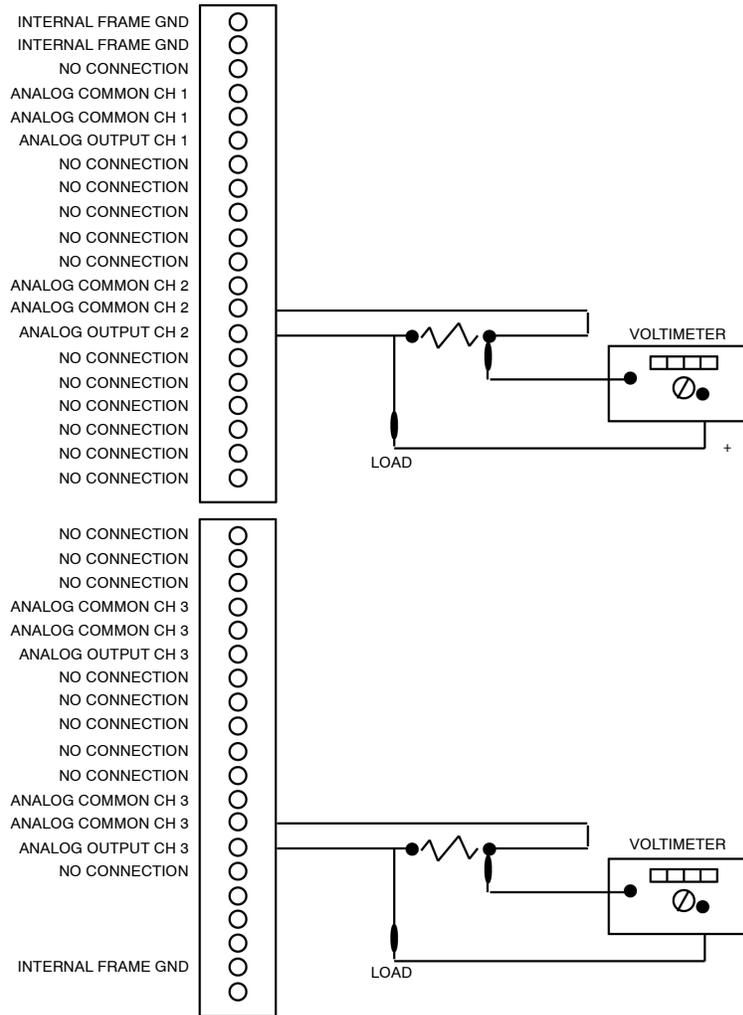

**Data Value to
Output Channel**

The following table gives Data Value to Output Channel, for the B872-200 Module.

Selected Voltage Range	Data Value	Voltmeter Reading
-5 to 5V	4095	4.9976
-10 to 10V	4095	9.99951
0 to 5V	4095	4.9988
0 to 10V	4095	9.9976

B872-200 Specifications

B872-200 Specifications


The following table gives the Specifications for the B872-200 Module:

Description	Analog output, D/A
Number of Points	4
Operating Range Voltage	0 - 5 VDC, 0 - 10 VDC, -5 to 5 VDC, -10 to 10 VDC; selectable per channel
Maximum Output Current	10 mA
Minimum Load	0-5V= 500Ω 0-10V= 1kΩ -5to+5V= 500Ω -10to+10V=1kΩ
Response Time to Within +/-0.1% of Full Range	35 mS, all four channels
Valid Data Values	0 thru 4095
Resolution	1 part in 4096 counts
Accuracy*** Output Errors @ 25 °C (77 °F) Overall Nonlinearity Differential Nonlinearity *** All percentages are of full range.	+/-0.1% @ 25 °C absolute +/-0.024% +/-0.036%
Output Isolation Output to OURBUS Channel to Channel	1500 VAC or 2500 VDC for 1 minute 500 VAC or 500 VDC continuous operation 1500 VAC or 2500 VDC for 1 minute 500 VAC or 500 VDC continuous operation
Conversion Resolution Update Time Settling Time Linearity Differential Nonlinearity Crosstalk	12-bits (1 part in 4096) The module can accept new data every 1 mS for a 4 channel update Within +/-0.1%, < 350mS 0 to 60 °C, +/- 1 LSB maximum 0 to 60 °C, +/- 1.5 LSB maximum -92 dB
Load Inductance	1 Henry max, with no external diode suppression
Power Required +5 V +4.3 V -5 V	750 mA 5 mA 0 mA
Terminal Connector	AS-8535-000

B872-200 Parameter Configuration

Parameter and Default Values

Parameter Configuration Window

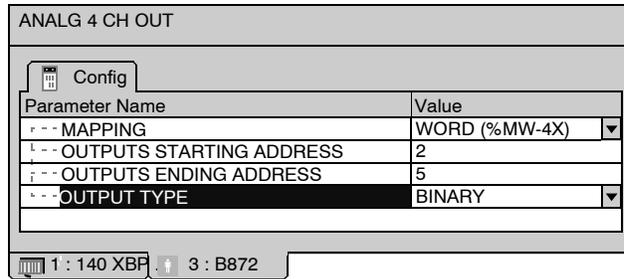

Module Configuration

Parameter Name	Value (Default)	Value (Options Available)	Description
Mapping	WORD (%MW-4X)	-	
Outputs Starting Address	2	-	
Outputs Ending Address	5	-	
Output Type	BINARY	BCD	

Mapping Parameter References

	Modsoft, Concept, ProWORX	Unity
Reference Type	Mapped as 4 registers output 4x	Mapped as 4 words output %MWx
Output Type	BIN/BCD	BIN/BCD

B873-002 & B875-002 Analog Input

10

At a Glance

Purpose

The purpose of this chapter is to describe the B873-002 and B875-002 Analog Input Modules.

What's in this Chapter?

This chapter contains the following topics:

Topic	Page
B873-002 & B875-002 Overview	154
B873-002 & B875-002 Switch Settings and Indicators	155
B873-002 & B875-002 Installation	156
B873-002 & B875-002 Calibration	159
B873-002 & B875-002 Throughput Rate	163
B873-002 & B875-002 Field Connections	164
B873-002 & B875-002 Specifications	166
B873-002 Parameter Configuration	167
B875-002 Parameter Configuration	168

B873-002 & B875-002 Overview

B873-002 & B875-002 Modules

The B873-002 and B875-002 are analog input modules that can be used with 984 Programmable Controllers. The only difference between the two modules is that the B873-002 has four input channels and the B875-002 has eight input channels. The module can be set to produce a data value in the Standard Range (0000 to 4096) or the Elevated Range (4095 to 8192). It accepts inputs of 1.0 to 5.0 volts or 4 to 20 milliamperes. (Refer to *B873-002 & B875-002 Field Connections*, p. 164). The input is converted to a numerical value, ranging from 0001 to 4095 (Standard) or 4096 to 8191 (Elevated). Values of 0000, 4095, 4096, or 8192 indicate invalid data and a possible problem. (Refer to the *Data Value Reference Chart*, p. 162). The value is directly proportional to the input signal. For example, an input voltage of 3.0V causes the module to send a value of 2048 (Standard). Or the input could be 12mA, which would produce a value of 6144 (Elevated). (Refer to *Input to Data Value Conversion*, p. 161).


Note: Not having voltage or current on an input channel produces a data value of 0000 (Standard) or 4095 (Elevated).

The PC polls the module and places the values into input registers (30XXX) designated by the programmer. Each time the module is powered up, it performs diagnostic tests, resets the input latches, and, for each channel, presents a value of 0000 to the controller. The value is present for approximately three seconds after power up. The module will then start converting the inputs according to the schedule found in the *B873-002 & B875-002 Throughput Rate*, p. 163.

B873-002 & B875-002 Switch Settings and Indicators

Switch Settings

There is a DIP switch located at the rear of the module. Switches 1 and 2 are not used. Switch 3 can be set to either Module Reset or Module Run. It must set to the Module Run position for the module to operate. Switch 4 is used to set which data value range the module will produce. Select either Normal Range or Elevated Range. Make sure you set Switch 3 and 4 before inserting the module into the housing. Refer to the figure below for a key to setting the DIP switch.

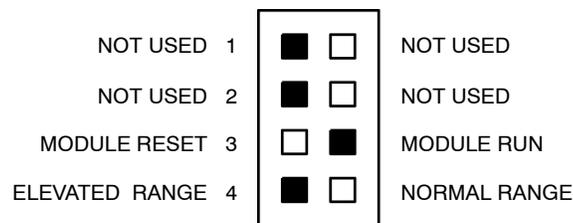

BLACK BOX INDICATES SWITCH IN DOWN POSITION

Indicators

The ACTIVE, OVER RANGE, UNDER RANGE indicators are located on the front panel of the module. The OVER RANGE and UNDER RANGE indicators are shared by all of the module's input channels. The module's status can be determined by referring to the table below.

The following table gives the Indicator readings for the B873-002 & B875-002 Modules:

Indicator	State	Condition
Active	ON	The module is communicating properly and PC is running
	BLINKING	The module failed the powerup reference test
	OFF	The module failed the internal diagnostic test/PLC is not in Run mode/communication from PLC to module has failed
Over Range	OFF	All input are within the valid input range
	ON or FLICKERING	One or more inputs have exceeded the valid input range
Under Range	OFF	All input are within the valid input range
	ON or FLICKERING	One or more inputs have dropped below the valid input range

B873-002 & B875-002 Installation


Installing the Module

Remove the module from the box and check for damage. If damage is found, contact your salesman or distributor for correct return procedure.

Set switch three to the Module Run position, and Switch four to the data range selected for input - either Standard or Elevated - before inserting the module into the housing. (Refer to *Switch Settings*, p. 155).

Module Characteristics

The following figure shows the 873 / 875 Module, at pre-installation.

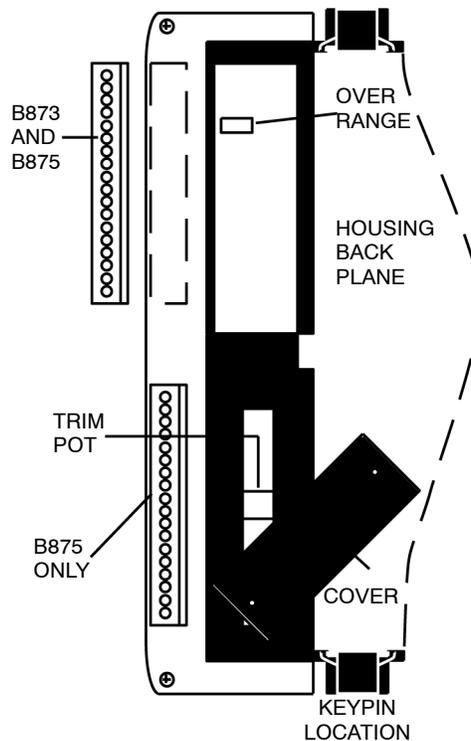

Included with the module is an Analog Connector Set (Part# AS-8533-001 for B873-002 and Part# AS-8533-002 for B875-002).


The Connector Set consists of two mounting screws, a wire duct, and either one (B873-002) or two (B875-002) field wiring connectors. Each connector has eighteen recessed slotted screw terminals and can accept various wire gauges, but 16 to 20 gauge is recommended for the field side wiring.

Note: The wiring connections can only be made with an 1/8 inch blade screwdriver.

The connector plugs into the module with the field wiring to the left. The removable connector permits module removal and replacement without disturbing the wiring. Refer to the diagram for the Terminal Numbering for the terminal functions. The wire duct protects the connections to the Analog Input Module from being damaged or loosened when the module to its immediate left is removed.

Installing the Wire Duct

The following is the Wire Duct Installation Diagram, for the B873/B875 Module.

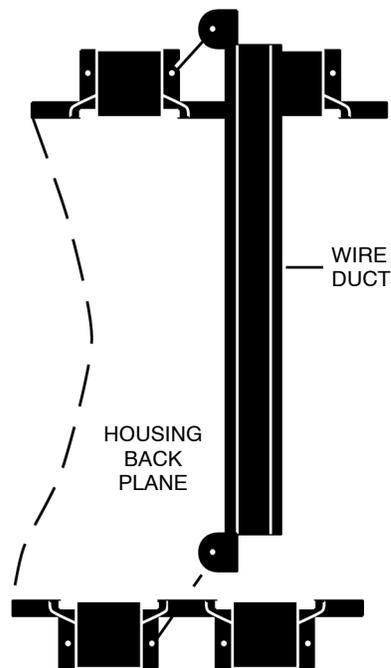

Steps to Installation

The following table lists the steps for installing the B873/B875 Module:

Step	Action
1	Turn off the power to the housing.
2	Determine which slot will be used for the Analog Module.* If there is a duct present, and it is different from the one provided in the connector set, then it must be removed. This is accomplished by removing the two screws located on the top and bottom of the housing and then pulling the duct out.
3	If there is a module to the left of this slot, it must be removed until installation of the duct is complete.
4	Insert the wire duct between the two slots with the screw holes to the left. (Refer to the Installation Diagram.)
5	Using the two 1/4 inch slotted screws provided in the package, secure the wire duct to the housing.
6	Re-install the module(s) and complete the wiring connections. *The wire duct can not be installed for the left-most slot of the housing. Therefore the use of this slot for the Analog Module is not recommended.

B873-002 & B875-002 Calibration

Required Tools

Calibration is recommended at 12 month intervals for operation at or below 405 C (1045 F) and at 6 month intervals between 405 and 605 C (1045 and 1405 F). The following tools are needed to calibrate a B873-002 or B875-002 module in a running system:

1.	A programmer
2.	A precision voltmeter
3.	An Analog DC Voltage/Current
4.	A 1/4 inch Phillips screwdriver
5.	A 1/8 inch standard screwdriver
6.	An adhesive for the trim pot adjusting screw (e.g. Loctight Glyptol)

Calibration Adjustments

To achieve full accuracy of the module, allow it to warm up for one hour with a valid input present at the channel to be used for the calibration. Without warm up, the accuracy of the data values will be +/-%2 counts.


Steps to Calibration

The adjustments can be made using a voltage or current source. Use steps 5a through 10a for voltage or steps 5b through 10b for current.

1.	Remove trim pot access cover, located on the front panel.
2.	Open module handle to expose connector(s) and terminal(s).
3.	Unplug field wiring connector(s).
4.	Set up Programmer to monitor the register for the channel used for calibration.
Method using a voltage source:	
5a.	Connect the positive lead of the voltage source to the channel's input + terminal and the negative lead to the channel's input - terminal.
6a.	Set voltage source to output 1.00048 volts.
7a.	While monitoring the register, adjust the top trim pot until the value toggles between 0000 and 0001 (Standard) or 4095 and 4096 (Elevated).
8a.	Use an adhesive to secure the adjusting screw on the trimmer.
9a.	Set voltage source to output 4.99951 volts.
10a.	While monitoring the register, adjust the bottom trim pot until the value toggles between 4095 and 4096 (Standard) or 8191 and 8192 (Elevated).
Method using a current source:*	
5b.	Connect the positive lead of the current source to the channel's input + terminal and the negative lead to the channel's input - terminal.
6b.	Set current source to output 4.002mA.
7b.	While monitoring the register, adjust the top trim pot until the value toggles between 0000 and 0001 (Standard) or 4095 and 4096 (Elevated).
8b.	Use an adhesive to secure the adjusting screw on the trimmer.
9b.	Set current source to output 19.998mA.
10b.	While monitoring the register, adjust the bottom trim pot until the value toggles between 4095 and 4096 (Standard) or 8191 and 8192 (Elevated).
11.	Disconnect input source.
12.	Re-connect field wiring.
13.	Close module handle.
14.	Replace trim pot access cover.
* To use this method, a jumper must be connected between the Current Sense terminal and the Input + terminal of the channel to be calibrated.	

Input to Data Value Conversion

The following figure shows the Input to Data Value Conversion chart.

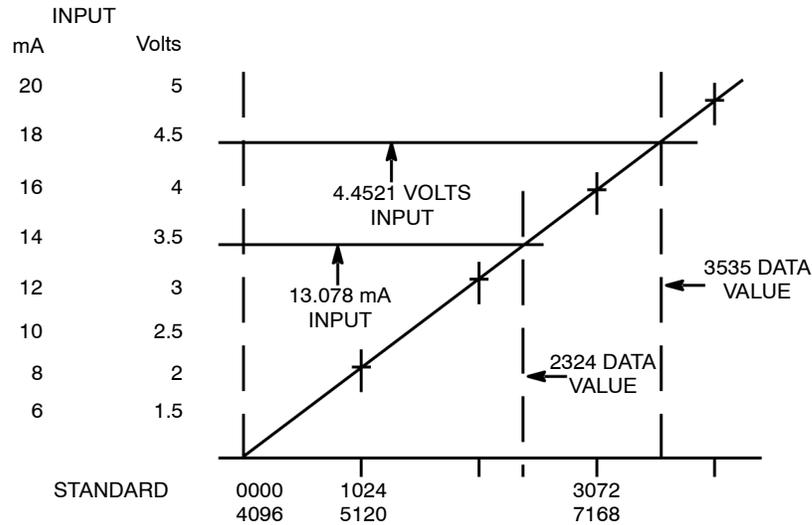

Calculation for determining Data Value (refer to the figure above and the table below):

Voltage:

$$(\text{Input Voltage} - 1) \times 1024$$

Example: (Refer to Graph)

$$(4.4521\text{V} - 1) \times 1024$$

$$3.4521 \times 1024 = 3534.9504 \text{ (Add 4096 for Elevated Value)}$$

$$\text{Data Value} = 3535 \text{ Standard } 7631 \text{ Elevated}$$

(Rounded to the nearest whole number)

Current:

$$(\text{Input Current} - 4) \times 256$$

Example: (Refer to Graph)

$$(13.078\text{mA} - 4) \times 256$$

$$9.078 \times 256 = 2323.968 \text{ (Add 4096 for Elevated Value)}$$

$$\text{Data Value} = 2324 \text{ Standard } 6420 \text{ Elevated}$$

(Rounded to the nearest whole number)

**Data Value
Reference Chart**

The following is the Data Reference Chart for the B873-200 & B875-200 Modules.

Standard	Elevated	Input Voltage, Current, or Condition
0000	0000	1. First three seconds after power up 2. During failure recovery
0000	4095	Under range
0000	OFF	1.0000V or 4mA
4095	4096	4.999V or 19.995mA
4095	8192	Over range

B873-002 & B875-002 Throughput Rate

Update Interval

Update Interval:*

B873- 4 Channels 400ms

B875- 8 Channels 710ms

Out of Range 220ms per channel

All registers are updated every 400 or 710ms, as long as the inputs on all of the channels are within the valid range. 220ms is added to the update interval for each channel either under or over range. The input is considered under range when the voltage is at -3V or below. This keeps unused channels from adding time to the Update Interval.

Note: The Over Range indicator will be on or flickering, if the input on any channel is between .999 and -2.999V or below 4mA; but the 220ms time will not be added to the Update Interval.

Update Interval Example

On an eight channel module, 2 channels are under range. All the registers assigned to the module will be updated every 1150ms, until the inputs on the out of range channels return to the valid range. When they do, the update interval will return to 710ms.

Update Interval =

$(400 \text{ or } 710) + (\text{Out of Range Channels} \times 220)$

Using the example above:

$(710) + (2 \times 220) = 1150\text{ms}$

If one channel returned to the valid range, the update interval would reduce to 930ms.

Note: As long as the channel is out of range, the register assigned to it will either have data of 0000 (4095 Elevated), under range, or 4096 (8192 Elevated), over range. (Refer to the Data Value Reference Chart)
* The Update Interval is the amount of time necessary to update the data for all the registers assigned to the module.


B873-002 & B875-002 Field Connections

User Connections

User connections are made to a standard screw terminal strip; and the rigid wiring system permits module insertion or removal without disturbing the wiring.


B873-002 Terminal Numbering and Wire Connections

B873-002 terminal numbering and corresponding input functions are presented below.

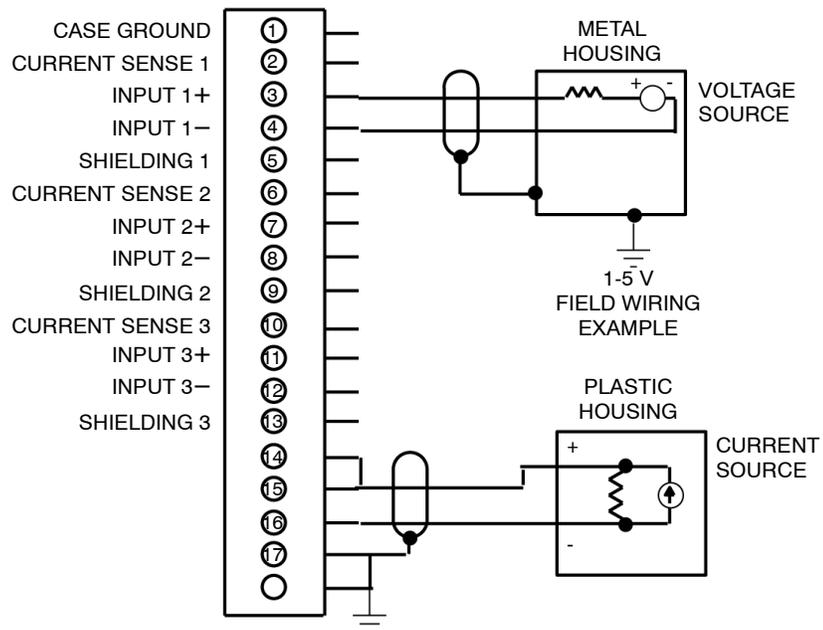

B875-002 Terminal Numbering and Wire Connections

B875-002 terminal numbering and corresponding output functions are presented below.

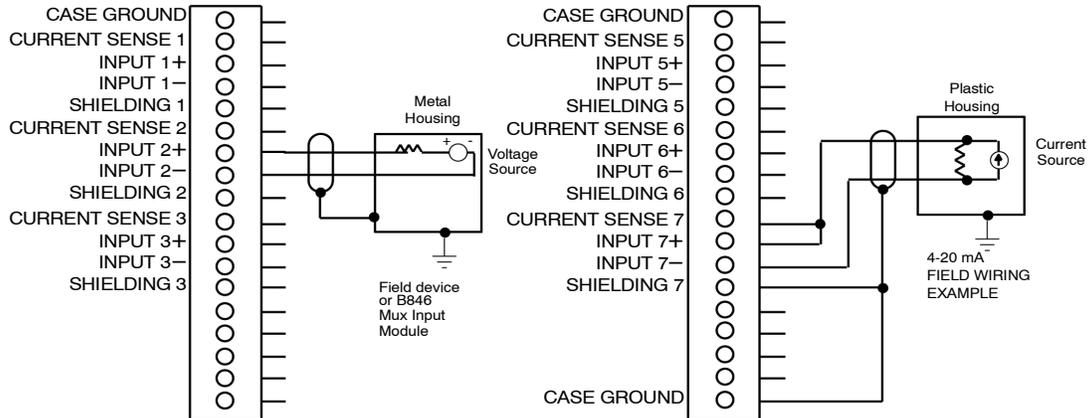

Note: If a user has a process where the Over-range or Under-range detection is immaterial, the unused voltage or current terminal, including the shields, on the field connector should be jumpered to Case ground.

If Over-range or Under-range detection is important to your process, and this detection is causing throughput problems with the unused channels (because they float or spike outside the range), then the unused voltage or current channels at the field connector, should be connected in parallel, to a valid Input channel. As long as the valid channel stays within range, the tied channels will also stay within range. For Current, 4 to 20ma operation, the valid Input is the only Input requiring the 250 Ohm resistor to be in the circuit.

Case ground is effective when the H8XX housing is connected to earth ground. The shield cannot be connected, both ends, to the device and the module. The exception to this is where the device shield is part of the device input circuit, and is not connected internally to device case ground.

Note: Any module run-time diagnostic failure will result in a 0000 value being returned to the controller, regardless of selected range.

B873-002 & B875-002 Specifications


Module Specifications The following table gives specifications for the B873-002 & B875-002 Input Modules.

Description	Analog input 4 - 20 mA, 1 - 5 VDC
Number of Channels	4, (B873-002) 8, (B875-002)
Operating Range Voltage/Current	1 - 5 VDC / 4 - 20 mA
Impedance Voltage Current	0.5 Megohm per input 1 Megohm differentially
Resolution	12 bit
Filter	-3dB @ 18Hz Rolloff -20dB per decade
Linearity	+0.05% of full scale @ 25 °C (77 °F)
Protection	240VAC RMS
Common Mode Range Rejection	0VAC to 30VAC RMS > -86dB @ 60Hz
Isolation Channel to Channel Input to Case Module	250 VAC RMS 500 VAC RMS for one minute 1500 VAC RMS for one minute 300 VAC RMS continuous
Accuracy Overall At 25 °C (77 °F) Offset Drift Gain Drift	7 mV or 19.7µA +/-0.488 mV or +/-1.95µA @ 1.2207 mV +/-30µV or +/-0.12µA per °C +/-16.7µV or +/-0.07µA per °F +/-15ppm per °C
Repeatability	Over a twenty-four hour period, with a constant voltage and at a constant operating temperature, the input data value will be within +/-2 counts.
Power Required +5 V +4.3 V -5 V	300 mA 300 mA 0 mA
Data Format 0000 4095 0000 to 4095 4096 to 8191 4096 8192	Power Up On Diagnostic Failure or during failure Recovery Under Range - Standard Under Range - Elevated Valid - Standard Range Valid - Elevated Range Over Range - Standard Over Range - Elevated
Throughput Rates Update Interval Out of Range Terminal Connector	4 Channels 400 mS 8 Channels 710 mS (Including Diagnostics) 220 mS for each channel in Under or Over Range condition (Refer to Throughput Section) AS-8533-001 (B873-002) AS-8533-002 (B875-002)

B873-002 Parameter Configuration

Parameter and Default Values

Parameter Configuration Window

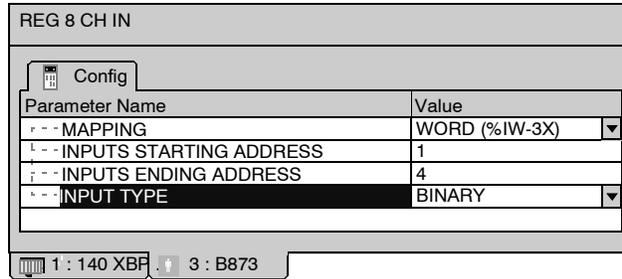

Module Configuration

Parameter Name	Value (Default)	Value (Options Available)	Description
Mapping	WORD (%IW-3X)	-	
Inputs Starting Address	1	-	
Inputs Ending Address	4	-	
Input Type	BINARY	BCD	


Mapping Parameter References

	Modsoft, Concept, ProWORX	Unity
Reference Type	Mapped as 4 registers input 3x	Mapped as 4 words input %IWx
Input Type	BIN/BCD	BIN/BCD

B875-002 Parameter Configuration

Parameter and Default Values

Parameter Configuration Window

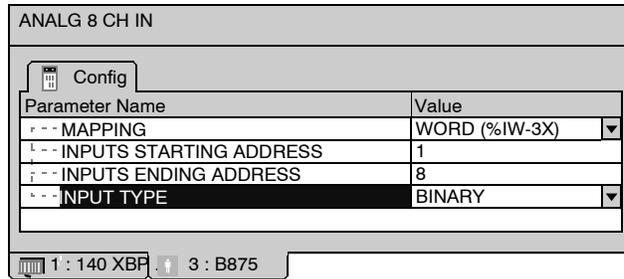

Module Configuration

Parameter Name	Value (Default)	Value (Options Available)	Description
Mapping	WORD (%IW-3X)	-	
Inputs Starting Address	1	-	
Inputs Ending Address	8	-	
Input Type	BINARY	BCD	

Mapping Parameter References

	Modsoft, Concept, ProWORX	Unity
Reference Type	Mapped as 8 registers input 3x	Mapped as 8 words input %IWx
Input Type	BIN/BCD	BIN/BCD

B873-012 & B875-012 Analog Input

11

At a Glance

Purpose

This chapter explains features and operation of the B873-012 & B875-012 Analog Input Modules.

What's in this Chapter?

This chapter contains the following topics:

Topic	Page
B873-012 & B875-012 Overview	170
B873-012 & B875-012 Switch Settings and Indicators	171
B873-012 & B875-012 Installation	172
B873-012 & B875-012 Calibration	175
B873-012 & B875-012 Throughput Rate	177
B873-012 & B875-012 Field Connections	178
B873-012 & B875-012 Specifications	180
B873-012 Parameter Configuration	181
B875-012 Parameter Configuration	182

B873-012 & B875-012 Overview

Module Features The B873-012 and B875-012 are analog input modules and can be used with 984 Programmable Controllers. The only difference between the two modules is that the B873-012 has four input channels and the B875-012 has eight input channels. Both modules accept inputs of -10 to +10 volt analog signals. The input is converted to a numerical value, ranging from 0001 to 8191. Values of 0000 or 8192 indicate invalid data. (Refer to the Data Value Reference Chart.) The value is directly proportional to the input signal. For example, an input voltage of -5V causes the module to send a value of 2048. If the input signal goes to 5V, the module sends a value of 6144. (Refer to Input to Output Data Conversion Chart.)


Note: 0.0V or no voltage on an input channel produces a value of 4096.

The PC polls the module and places the values into input registers (30XXX) designated by the programmer. Each time the module is powered up, it performs diagnostic tests, resets the input latches, and, for each channel, presents a value of 0000 to the controller. The value is present for approximately three seconds after power up. The module will then start converting the inputs according to the schedule found in the Throughput Rate Section.

B873-012 & B875-012 Switch Settings and Indicators

Switch Settings

There is a DIP switch located at the rear of the module. Switches 1, 2 and 4 are not used. Switch 3 can be set to either Module Reset or Module Run. It must be set to the Module Run position for the module to operate. Make sure you set Switch 3 before inserting the module into the housing. Refer to the figure below for DIP switch settings.

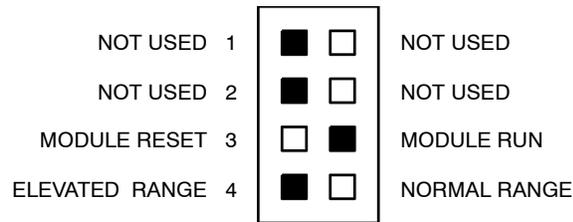

BLACK BOX INDICATES SWITCH IN DOWN POSITION

Indicators

The ACTIVE and OVER RANGE indicators are located on the front panel of the module. The OVER RANGE indicator is shared by all of the module's input channels. The module's status can be determined by referring to the table below.

Indicator	State	Condition
ACTIVE	ON	The module is communicating properly and the PC is running
	BLINKING	The module failed the powerup reference test
	OFF	The module failed the internal diagnostic test/PLC is not in Run mode/communication from PLC to module has failed
OVER RANGE	OFF	All input are within valid input range
	ON or BLINKING	One or more inputs have exceeded the valid input range

B873-012 & B875-012 Installation


Installing the Module

Remove the module from the box and check for damage. If damage is found, contact your salesman or distributor for correct return procedure.

Set Switch three to the Module Run position and Switch four to the data range selected for input - either Standard or Elevated - before inserting the module into the housing. (Refer to *Switch Settings*, p. 171.)

Module Characteristics

The following figure shows the B873-012 / B875-012 Module at pre-installation.

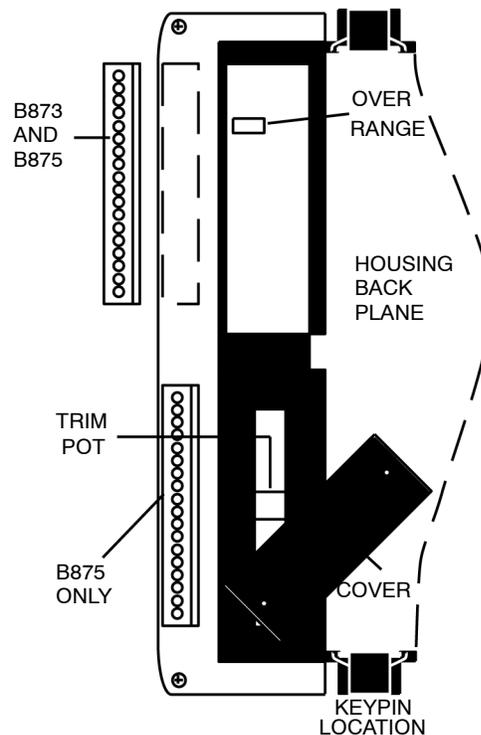

Included with the module is an Analog Connector Set (Part# AS-8533-001 for B873-012 and Part# AS-8533-002 for B875-012).

The Connector Set consists of two mounting screws, a wire duct, and either one (B873-012) or two (B875-012) field wiring connectors. Each connector has eighteen recessed slotted screw terminals and can accept various wire gauges, but 16 to 20 gauge is recommended for the field side wiring.


Note: The wiring connections can only be made with a 1/8 inch blade screwdriver.

The connector plugs into the module with the field wiring to the left. The removable connector permits module removal and replacement without disturbing the wiring. Refer to diagram for Terminal Numbering, for terminal functions.

The wire duct protects the connections to the Analog Input Module from being damaged or loosened when the module to it's immediate left is removed.

Installing the Wire Duct

The following figure is the Wire Duct Installation Diagram.

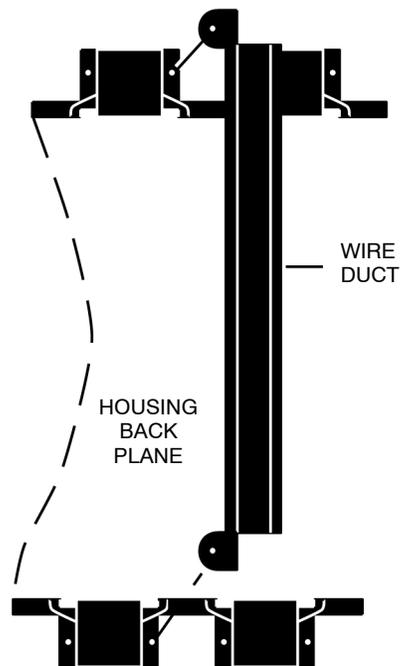

**Steps to
Installing the
Wire Duct**

The following step table describes the installation of the Wire Duct, for the B873-012 & B875-012 Modules:

Step	Action
1	Turn off the power to the housing.
2	Determine which slot will be used for the Analog Module.* If there is a duct present and it is different from the one provided in the connector set, then it must be removed. This is accomplished by removing the two screws located on the top and bottom of the housing and then pulling the duct out.
3	If there is a module to the left of this slot, it must be removed until installation of the duct is complete.
4	Insert the wire duct between the two slots with the screw holes to the left. (Refer to the Installation Diagram.)
5	Using the two 1/4 inch slotted screws provided in the package, secure the wire duct to the housing.
6	Re-install the module(s) and complete the wiring connections. * The duct cannot be installed for the left-most slot of the housing. Therefore the use of this slot for the Analog Module is not recommended.

B873-012 & B875-012 Calibration

Required Tools

Calibration is recommended at 12 month intervals for operation at or below 405 C (1045 F), and at 6 month intervals between 405 and 605 C (1045 and 1405 F). The following table indicates the tools required, to calibrate the B873-012 & B875-012 Modules:

1.	A programmer
2.	A precision voltmeter
3.	An Analog DC Voltage/Current
4.	A 1/4 inch Phillips screwdriver
5.	A 1/8 inch standard screwdriver
6.	An adhesive for the trim pot adjusting screw (e.g. Loctight Glyptol)


Gain Adjustments Procedure

To achieve full accuracy of the module, allow it to warm up for one hour, with a valid input present at the channel to be used for the calibration. Without warm up, the accuracy of the data values will be +2 counts. The following table gives the steps for Gain Adjusting the B873-012 & B875-012 Modules:

Step	Action
1	Remove trim pot access cover, located on the front panel.
2	Open module handle to expose connector(s) and terminal(s).
3	Unplug field wiring connector(s).
4	Set up Programmer to monitor the register for the channel used for calibration.
5	Connect the positive lead of the voltage source to the channel's input + terminal and the negative lead to the channel's input - terminal.
6	Set voltage source to output 9.99877 volts.
7	While monitoring the register, adjust the trimmer until the value toggles between 8191 and 8192 in binary mode.
8	Use an adhesive to secure the adjusting screw on the trimmer.
9	Disconnect input source.
10	Re-connect field wiring.
11	Close module handle.
12	Replace trim pot access cover.

Input Voltage to Output Data Conversion

The following is the Input Voltage to Output Data Conversion Chart.

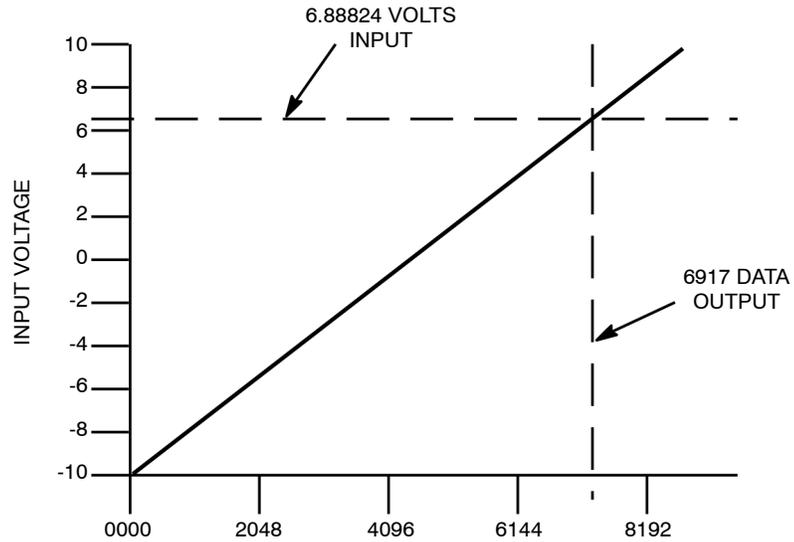

Determining Data Value from Input Voltage

Calculation for determining Data Value from Input Voltage (refer to the figure above and the table below).

$$(\text{Input Voltage} + 10) \times 409.6$$

Example: (Refer to Graph)

$$(6.88824\text{V} + 10) \times 409.6$$

$$16.88824 \times 409.6 = 6917.4231$$

Data Value = 6917 (Rounded to the nearest whole number)

Data Value Reference Chart

The following is the Data Value Reference Chart for the B873-012 & B875-012 Input Modules.

Data Value	Input Voltage, Current, or Condition
0000	1. First three seconds after powerup 2. During failure recovery 3. Under range
0001	-9.99756V
4096	1. 0.00000V 2. No voltage at input terminal
8191	9.99756V
8192	Over range

B873-012 & B875-012 Throughput Rate

Update Interval The following table provides Update Intervals for the B873-012 & B875-012 Modules.

Update Interval:*		
B873-	4 Channels	400ms
B875-	8 Channels	710ms
Out of Range		220ms per channel

All registers are updated every 400 or 710ms, as long as the inputs on all of the channels are within the valid range. 220ms is added to the update interval for each channel either under or over range.

Throughput Rate Example

On an eight channel module, 2 channels are under range. All the registers assigned to the module will be updated every 1150ms, until the inputs on the out of range channels return to the valid range. When they do, the update interval will return to 710ms.

Update Interval =
 $(400 \text{ or } 710) + (\text{Out of Range Channels} \times 220)$

Using the example above:
 $(710) + (2 \times 220) = 1150\text{ms}$

If one channel returned to the valid range, the update interval would reduce to 930ms.

Note: As long as the channel is out of range, the register assigned to it will either have data of 0000 (4095 Elevated), under range, or 4096 (8192 Elevated), over range. (Refer to *Data Value Reference Chart*, p. 176)

* The Update Interval is the amount of time necessary to update the data for all the registers assigned to the module.

Note: Any module run-time diagnostic failure will result in a 0000 value being returned to the controller, regardless of selected range.


B873-012 & B875-012 Field Connections

User Connections


User connections are made to a standard screw terminal strip, and the rigid wiring system permits module insertion or removal without disturbing the wiring.

B873-012 Terminal Numbering and Wire Connections

B873-012 terminal numbering and corresponding input functions are presented in the figure below.

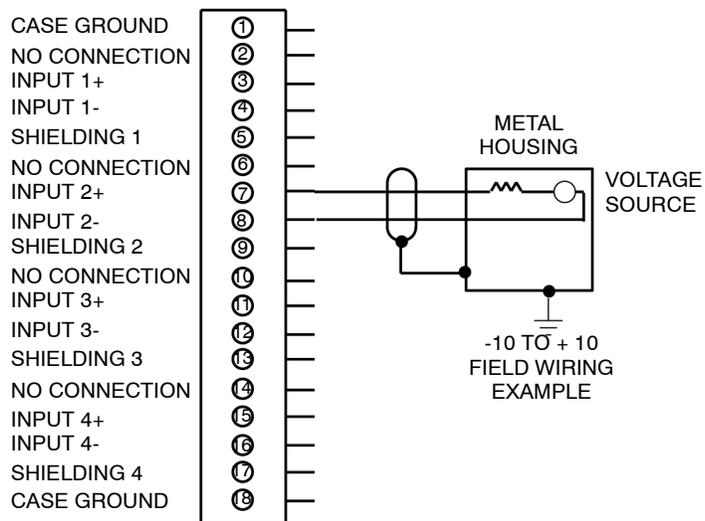

B875-012 terminal numbering and corresponding input functions are presented in the figure below.

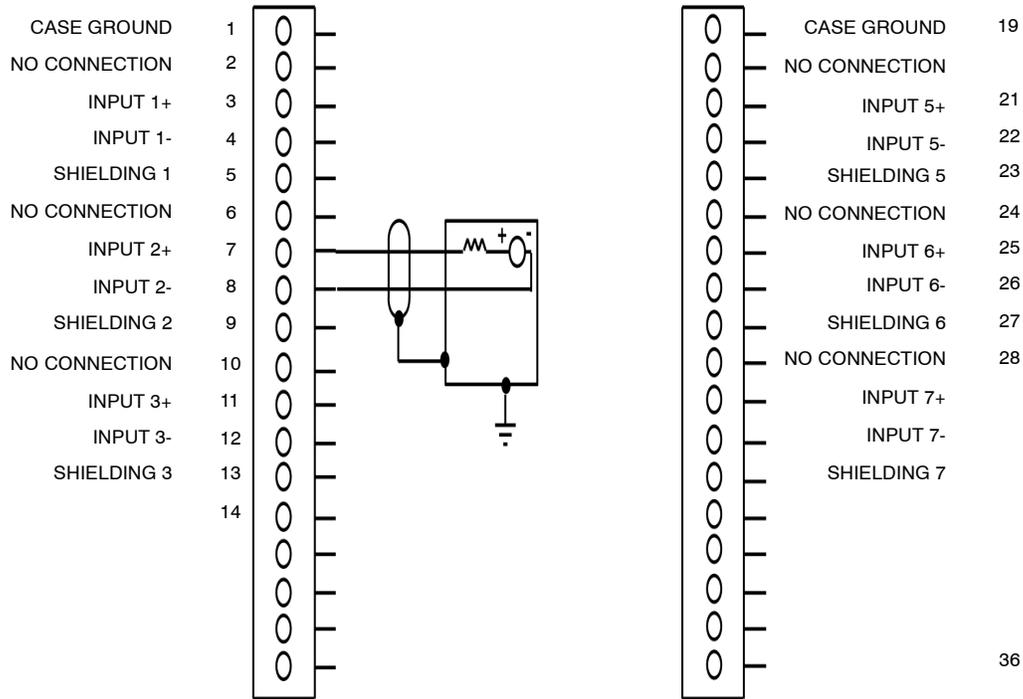

36

B873-012 & B875-012 Specifications

Module Specifications The following table gives specifications for the B873-012 & B875-012 Input Modules.

Description	Analog input -10 to +10 VDC
Number of Channels	4, (B873-012) 8, (B875-012)
Operating Range	-10 to +10 VDC
Impedance	0.5 Megohm per input 1 Megohm differentially
Resolution	13 bit
Filter	-3dB @ 18Hz Rolloff -20dB per decade
Linearity	+/-0.05% of full scale @ 25 °C (77 °F)
Protection	240VAC RMS
Common Mode Range Rejection	0VAC to 30VAC RMS > -86dB @ 60Hz
Isolation Channel to Channel Input to Case Module	250 VAC RMS 500 VAC RMS for one minute 1500 VAC RMS for one minute 300 VAC RMS continuous
Accuracy Overall At 25 °C (77 °F) Offset Drift Gain Drift	17.1mV 1.2207mV 100µV per °C 55.6µV per °F +/-15ppm per °C +/-8.3ppm per °F
Repeatability	Over a twenty-four hour period, with a constant voltage and at a constant operating temperature, the input data value will be within +/-2 counts.
Power Required +5 V +4.3 V -5 V	300 mA 300 mA 0 mA
Data Format 0000 0001 to 8191 8192	Power Up On Diagnostic Failure or during failure Recovery Under Range Valid Over Range
Throughput Rates Update Interval Out of Range	4 Channels 400 mS 8 Channels 710 mS (Including Diagnostics) 220 mS for each channel in Under or Over Range condition
Terminal Connector	AS-8533-001 (B873-012) AS-8533-002 (B875-012)

B873-012 Parameter Configuration

Parameter and Default Values

Parameter Configuration Window

Parameter Name	Value
MAPPING	WORD (%IW-3X)
INPUTS STARTING ADDRESS	1
INPUTS ENDING ADDRESS	4
INPUT TYPE	BINARY

Module Configuration

Parameter Name	Value (Default)	Value (Options Available)	Description
Mapping	WORD (%IW-3X)	-	
Inputs Starting Address	1	-	
Inputs Ending Address	4	-	
Input Type	BINARY	BCD	


Mapping Parameter References

	Modsoft, Concept, ProWORX	Unity
Reference Type	Mapped as 4 registers input 3x	Mapped as 4 words input %IWx
Input Type	BIN/BCD	BIN/BCD

B875-012 Parameter Configuration

Parameter and Default Values

Parameter Configuration Window

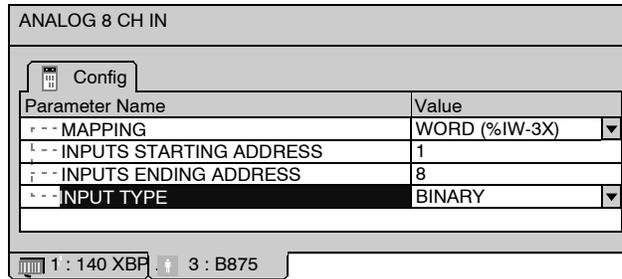

Module Configuration

Parameter Name	Value (Default)	Value (Options Available)	Description
Mapping	WORD (%IW-3X)	-	
Inputs Starting Address	1	-	
Inputs Ending Address	8	-	
Input Type	BINARY	BCD	

Mapping Parameter References

	984LL, Concept, ProWORX	Unity
Reference Type	Mapped as 8 registers input 3x	Mapped as 8 words input %IWx
Input Type	BIN/BCD	BIN/BCD

B875–102 High Speed Analog Input

12

At a Glance

Purpose

This chapter describes the functional and physical characteristics of the B875–102 High Speed Analog Input module.

What's in this Chapter?

This chapter contains the following topics:

Topic	Page
B875–102 High Speed Analog Input, Inputs	184
B875–102 High Speed Analog Input, Performance Considerations	187
B875–102 High Speed Analog Input, Communications with the PLC	191
B875–102 High Speed Analog Input, Typical Circuit and Ground Connections	193
B875–102 High Speed Analog Input, Switch Settings	194
B875–102 High Speed Analog Input, Indicators	203
B875–102 High Speed Analog Input, Recalibration	204
B875–102 High Speed Analog Input, Installation	207
B875–102 High Speed Analog Input, Specifications	210
B875–102 Parameter Configuration	212

B875–102 High Speed Analog Input, Inputs

Configuration

Module inputs are configurable in two groups by means of DIP switches. The following table shows input switch group assignments for the four or eight input circuit configurations.

Configuration	Input Group A	Input Group B
Eight Input circuits	1, 2, 3, 4	5, 6, 7, 8
Four input circuits	1, 2	3, 4

Input Ranges


The following table shows the five input ranges acceptable to each input range group. The module will accept an input as much as 2% FSR above its specified range without going into an over-range condition, but nothing below range.

Voltage range (V)	Corresponding Current Range (mA)
0—5	0—20
0—10	0—40
1—5	4—20
-10—+10	-40—+40
-5—+5	-20—+20

For purposes of determining load and protection considerations for the inputting of field circuits, The following figure is a schematic diagram of the input circuit's front end. Note the built-in 250 Ω resistor connected to the current input terminal. When the current sense terminal is externally jumpered to the positive input terminal, current input becomes possible for that input regardless of the voltage range selected.

Note: The current sense function has been provided specifically for the 4—20 mA current loop applications (1—5 V input range). However, current mode is operable on all ranges.

B875-102 High Speed Analog Input, Input Circuit Front End.

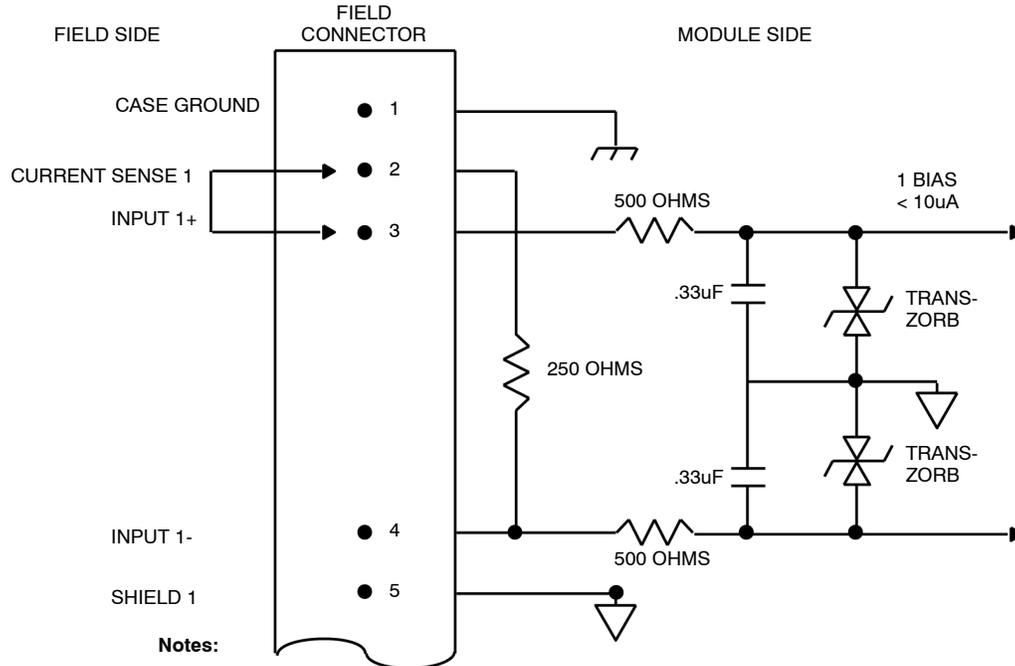

B875–102 High Speed Analog Input, Performance Considerations

Data Update Period

The data update period is the time taken by the module to present fresh data for each channel. With four input circuits, this period is no more than 2.4 ms; for an eight input circuit configuration, this period is no more than 3.0 ms.

Autocalibration

An internal autocalibration process is executed at appropriate times (if necessary) to compensate signal processing for front end drift. The autocalibration function employs feedback mechanisms to adjust the reference voltage to offset gain in the analog to digital converter. Calibration is monitored continuously in the background and adjusted if and when necessary. The following figure shows autocalibration points for all five input ranges. Autocalibration points are indicated by heavy dots on slope line.

The autocalibration process uses the 10 V reference to calibrate the module. The reference voltage is factory preset to exactly 10 volts (zeroed to four places). It should be readjusted in the field once per year.

Input Data Conversion


The input module performs an analog-to-digital conversion of an input analog signal with 12 bit resolution (i.e., 1 part in 4096). This implies that the least significant bit of the output code corresponds to slightly more than 0.024% of full scale.

The following illustration is a coarse grain conversion chart for plotting analog input against the equivalent numerical value output to the PC in raw binary format. The example illustrated shows an input voltage of 1.25 V (25% of 5 V FSR) and a numerical count of 1024 (25% of 4200) as projected through the 455 slope line.


Calculate exact values using the following proportional equation:

Where FSR is full scale range for analog input (including bipolar) and FCR is full count range (4200) in a raw binary format.

B875-102 High Speed Analog Input Autocalibration Points—All Ranges

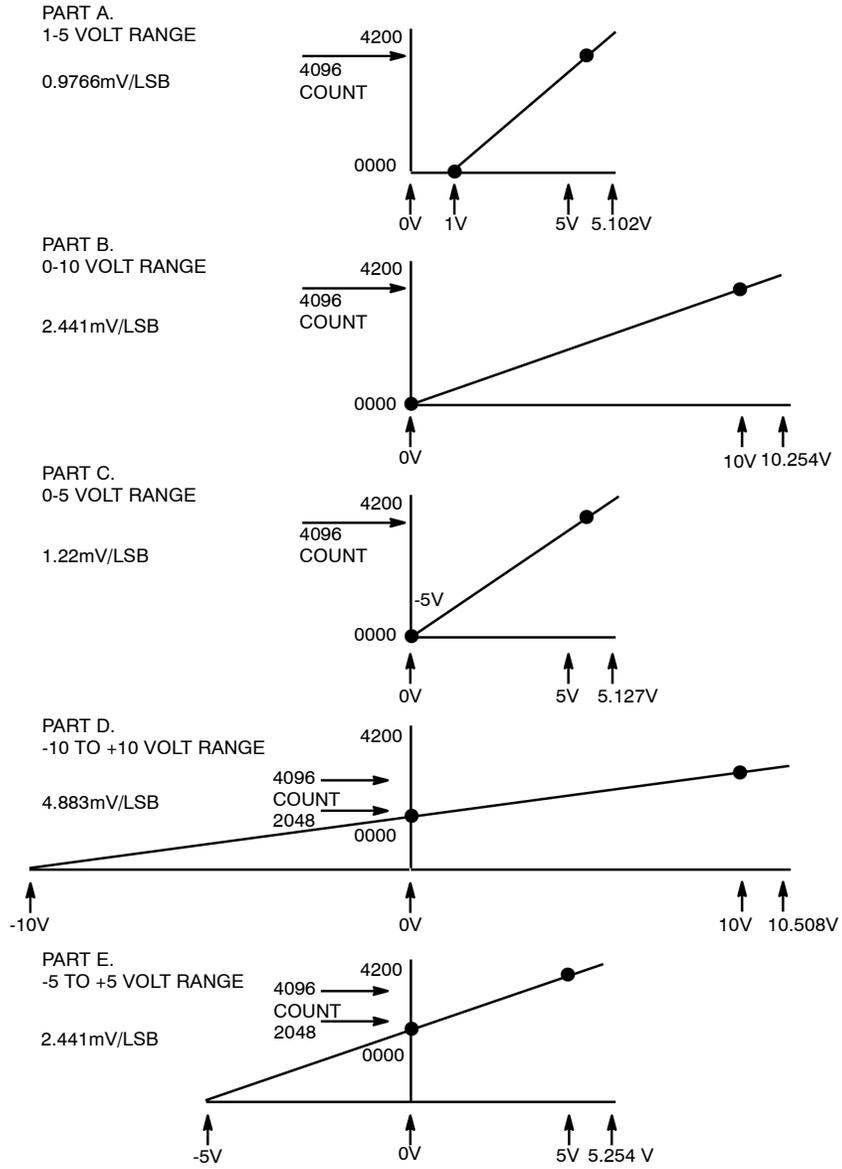

B875-102 Input Signal vs. Output Data (Raw Binary Format)

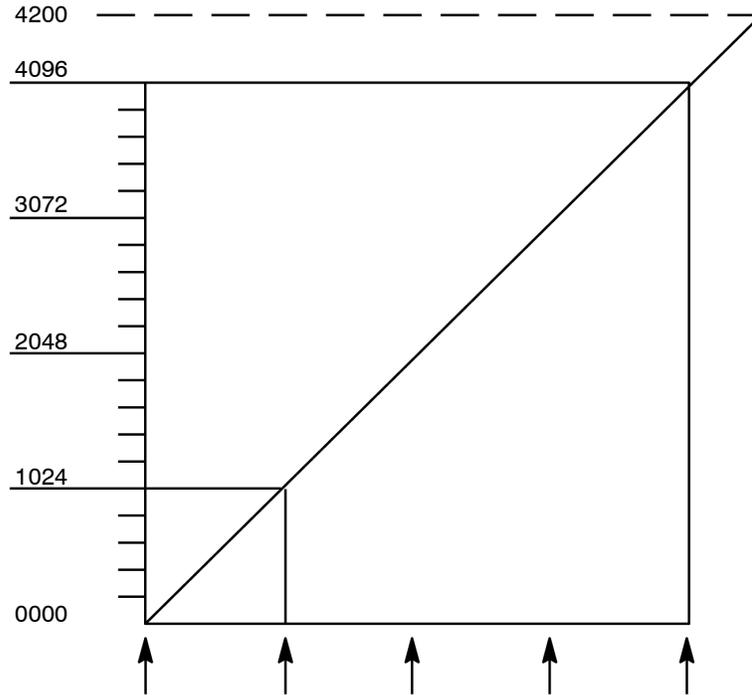

V. Range 0 to 5V	0.0	1.25	2.5	3.75	5.0	5.127
I. Range 0 to 20 mA	0.0	5.0	10.0	15.0	20.0	20.500
	▲	▲	▲	▲	▲	▲
V. Range 0 to 10V	0.0	2.5	5.0V	7.5	10.0	10.254
I. Range 0 to 40 mA	0.0	10.0	20.0	30.0	40.0	41.016
	▲	▲	▲	▲	▲	▲
V. Range -5 to +5V	-5.0	-2.5	0.0	2.5	5.0	5.254
I. Range -20 to 20 mA	-20.0	-10.0	0.0	10.0	20.0	21.016
	▲	▲	▲	▲	▲	▲
V. Range -10 to +10V	-10.0	-5.0	0.0	5.0	10.0	10.508
I. Range -40 to 40 mA	-40.0	-20.0	0.0	20.0	40.0	42.032
	▲	▲	▲	▲	▲	▲
V. Range 1 to 5V	1.0	2.0	3.0	4.0	5.0	5.102
I. Range 4 to 20 mA	4.0	8.0	12.0	16.0	20.0	20.400

Format Conversion

The module is capable of presenting the digitized data to the PC in either raw binary (RB) or converted binary (CB) format. The bit pattern in each case is different. The format is switch selectable and need not be the same for each group of input circuits. A Modicon programmer will display either type of data in one of three different ways: binary, hexadecimal, or decimal form.

Conversion Accuracy

Conversion linearity for this module is 0.05% of full scale—referenced to a straight line drawn through the measured full-scale value and the measured zero point—over the module's operating temperature range.

Raw Binary (RB) Format After digitizing the input signal, the input module presents data in RB format. In decimal representation, data in RB format must be within the 0 to 4200 range. Normally, a 12--bit device would have an upper data limit of 4095. This analog module has the means of allowing the input to be up to 2% over-range at the same resolution (i.e., the count in raw binary may go up to 4200). In RB format, the data range is the same regardless of the voltage range.

Converted Binary (CB) Format CB is obtained by transforming the RB format within the module. When CB data is viewed by the PC or programmer in decimal mode, it looks like a 4-digit voltmeter (DVM) with no sign or decimal point. In CB format, upper and lower data limits are voltage range dependent. Because of the missing sign, CB format is used only for unipolar voltage ranges.

The following figure shows an example of raw binary output. When a 5 V signal is digitized by the module set for 0 to 10 V range, it produces a converted binary code 0800 hex or 2048 decimal.

Raw Binary Word Format

15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0
0	0	0	0	1	0	0	0	0	0	0	0	0	0	0	0

The following figure shows the conditions in converted binary format which produce 1388 hex or 5000 decimal.

Converted Binary Word Format

15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0
0	0	0	1	0	0	1	1	1	0	0	0	1	0	0	0

B875–102 High Speed Analog Input, Communications with the PLC

Input Ranges and Output Data Limits

As shown in the following table, data can be in either raw binary or converted binary format. Within the 2% maximum over-range margin allowed, no error code is reported to the PLC.

Input Ranges and Output Data limits

Voltage range	Input Voltage	Raw Binary	Converted Binary
0—5 V	0.000	0000	0000
	5.000	4096	5000
	5.127 (max)	4200	5127
1—5 V	1.000	0000	1000
	5.000	4096	5000
	5.127 (max)	4200	5102
0—10 V	0.000	0000	0000
	9.999	4095	9999
	10.000	4096	N/A
	10.254 (max)	4200	N/A
-5—+5 V	-5.000	0000	Disallowed
	0.0000	2048	N/A
	5.000	4096	N/A
	5.254 (max)	4200	N/A
-10—+10 V	-10.000	0000	Disallowed
	0.000	2048	N/A
	10.000	4096	N/A
	10.508 (max)	4200	N/A

Diagnostic Communications

Diagnostic procedures are executed during the five second initialization period following power--up. Diagnostic routines are also run during wait states concurrent with executing A/D conversions. System diagnostics are: RAM checks, ROM checks, UART checks, as well as checking the legality of configuration switch settings and monitoring the ability to autocalibrate.

If the module fails to pass an internal diagnostic, two retries are made. If either one succeeds, the temporary failure is considered a soft failure and is not reported to the PC but the module system continues processing uninterrupted. If the module fails the diagnostic three times, the system goes into a power--up reset condition. switch settings and monitor

Note: While power-up diagnostics are running, or following detection of a hard failure, data is not available to the PLC.

Good Data. The following illustration shows status flags and data word format for good data to the plc. When sending good data, status flag bits 14 and 15 are reset to 0.

Good Data Word Output to PLC

15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0
0	0	0	RAW BINARY DATA												
0	0	CONVERTED BINARY DATA													

Out-of-range Data. The following figure shows status flags and data word format of out-of-range data output to the PLC. When sending out-of-range data, status bit 14 will be reset to 0, bit 15 will be reset to 1, and the OUT-OF-RANGE indicator will illuminate.

Out-of-range Data Word Output to PLC

15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0
1	0	0	RAW BINARY DATA												
1	0	CONVERTED BINARY DATA													


Out-of-Range requires careful examination. Since the module receives instantaneous data from the field but sends averaged data to the PC, instantaneous data less than 0 or greater than 4200 in RB format is considered out-of-range. Such data will be forced (clamped) to 0000 for under-range and 4200 for over-range values. However, the averaged data will not necessarily be out-of-range if the condition existed for less time than the total averaging period.

In this case, the format indicates at least one of the instantaneous data samples in the average is out of range. Its value for averaging purposes is the clamped value; the average may or may not be out of range. The red OUT-OF-RANGE light will remain ON as long as an out-of-range data sample is included in the average.

B875–102 High Speed Analog Input, Typical Circuit and Ground Connections

Field Connections

The following illustration shows typical field circuitry connected to the field connector.

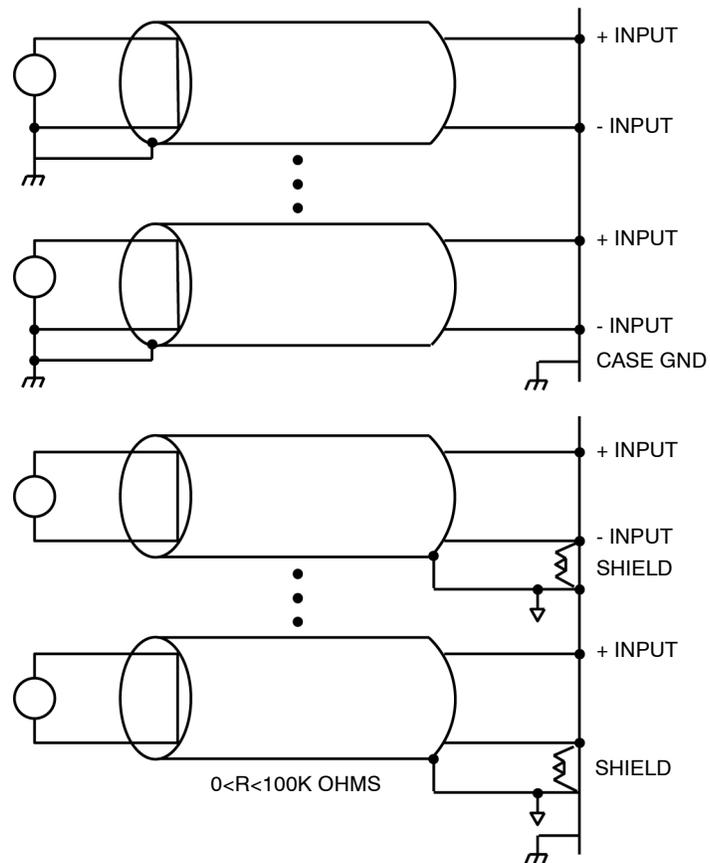

Note: Shields 1—8 are tied together internally and also to field side ground within the module. For grounded sources, a jumper to case ground must be externally supplied by the user.

B875–102 High Speed Analog Input, Switch Settings


Dip Switch Bank A

The high speed analog input module can be set for any of the five input voltage or current ranges by means of DIP switches. You can also select from seven periods of digital filtering; a feature which allows an instantaneous voltage sample to become part of a moving average. The DIP switches also set the module for 4 or 8 circuit mode and binary or decimal output.

For discussion purposes, we will designate the upper DIP switch bank, A (DIP Sw-A) and lower bank, B (DIP Sw-B). These switches are accessed through ports at the rear of the module.


The following illustration shows DIP Sw-A as seen from the rear of the module. Dip Sw-A is used for selecting an input range.

Dip Switch Bank A-Normal Operation

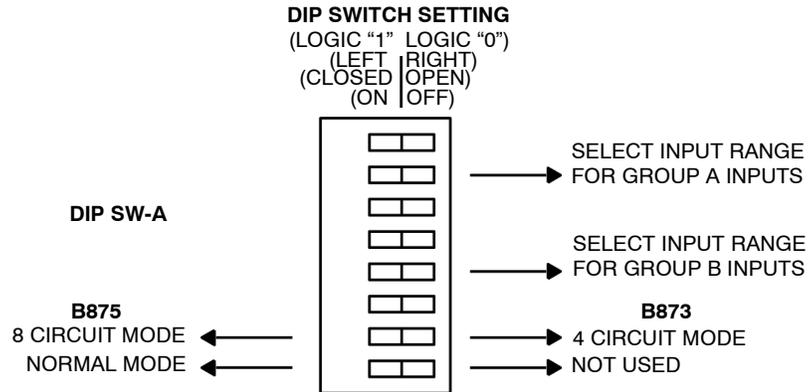

Dip Switch Bank B

The following illustration shows Sw-B. It is used to select input averaging.
DIP Switch Bank B-Normal Operation

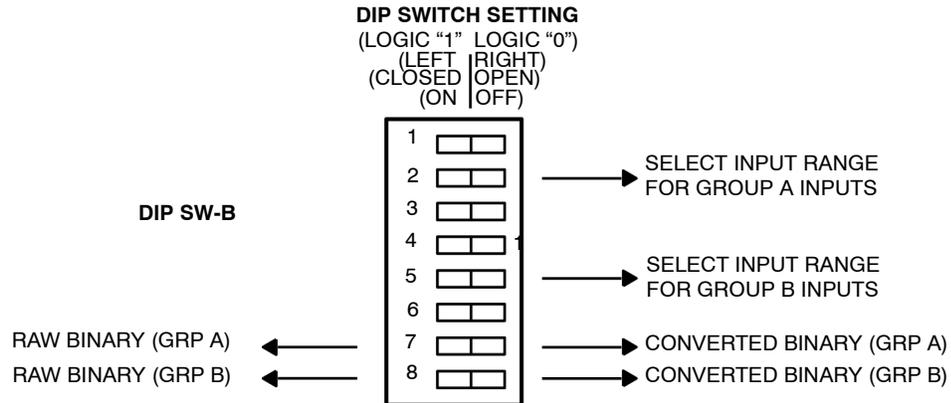

Note: Both Sw-A and Sw-B follow the same switch setting conventions:

- ON, CLOSED, LEFT, and logic "1" all mean the same.
- OFF, OPEN, RIGHT, and "logic 0" all mean the same.
- The switch bank views shown are looking at the back of the module.

Setting Input Range

SW-A settings for all input ranges for both 8 and 4 input configurations, respectively, are shown in the following tables. SW-A has two functions in addition to input range setting

- Switch A7 is ON for an 8-circuit configuration and OFF for a 4-circuit configuration
- Switch A8 must be ON for normal operation

**Inputs Group A
(8 Circuit Mode)**

The following table describes the input ranges for group A (Inputs 1 - 4):

Input Range	Switch	On	Off
1 - 5 V 4 - 20 mA	A-1	X	
	A-2	X	
	A-3	X	
0 - 10 V	A-1		X
	A-2	X	
	A-3	X	
0 - 5 V	A-1	X	
	A-2		X
	A-3	X	
+/- 10 V	A-1		X
	A-2		X
	A-3	X	
+/- 5 V	A-1	X	
	A-2	X	
	A-3		X

**Inputs Group B
(8 Circuit Mode)**

The following table describes the input ranges for group B (Inputs 5 - 8):

Input Range	Switch	On	Off
1 - 5 V 4 - 20 mA	A-4	X	
	A-5	X	
	A-6	X	
0 - 10 V	A-4		X
	A-5	X	
	A-6	X	
0 - 5 V	A-4	X	
	A-5		X
	A-6	X	
+/- 10 V	A-4		X
	A-5		X
	A-6	X	
+/- 5 V	A-4	X	
	A-5	X	
	A-6		X

**Inputs Group A
(4 Circuit Mode)**

The following table describes the input ranges for group A (Inputs 1 - 2):

Input Range	Switch	On	Off
1 - 5 V 4 - 20 mA	A-1	X	
	A-2	X	
	A-3	X	
0 - 10 V	A-1		X
	A-2	X	
	A-3	X	
0 - 5 V	A-1	X	
	A-2		X
	A-3	X	
+/- 10 V	A-1		X
	A-2		X
	A-3	X	
+/- 5 V	A-1	X	
	A-2	X	
	A-3		X

**Inputs Group B
(4 Circuit Mode)**

The following table describes the input ranges for group B (Inputs 3 - 4):

Input Range	Switch	On	Off
1 - 5 V 4 - 20 mA	A-4	X	
	A-5	X	
	A-6	X	
0 - 10 V	A-4		X
	A-5	X	
	A-6	X	
0 - 5 V	A-4	X	
	A-5		X
	A-6	X	
+/- 10 V	A-4		X
	A-5		X
	A-6	X	
+/- 5 V	A-4	X	
	A-5	X	
	A-6		X

**Setting Input
Averaging**

It is possible to compensate for spurious noise and other forms of amplitude modulation coming through the analog input filter by making the latest input sample part of a moving average—a form of digital filtering. This moving average technique has no affect upon the update interval.

The following tables show Sw-B setting for selecting among seven input average sample periods for both 8 and 4 circuit configurations.

Sw-B has other functions in addition to average sampling; Switch B7 is set to ON for binary code output or OFF for decimal code output for Group A (inputs 1-4 in the 8 circuit mode and inputs 1-2 in the 4 circuit mode). Switch B8 does the same for Group B.

**SW-B Settings
Group A
(8 Circuit Mode)**

The following table describes SW-B Settings for all periods of input averaging (Eight Circuits) for group A (Inputs 1 - 4):

No. of samples averaged	Switch	On	Off
1	B-1	X	
	B-2	X	
	B-3	X	
2	B-1		X
	B-2	X	
	B-3	X	
4	B-1	X	
	B-2		X
	B-3	X	
8	B-1		X
	B-2		X
	B-3	X	
16	B-1	X	
	B-2	X	
	B-3		X
32	B-1		X
	B-2	X	
	B-3		X
64	B-1	X	
	B-2		X
	B-3		X

**SW-B Settings
Group B
(8 Circuit Mode)**

The following table describes SW-B Settings for all periods of input averaging (Eight Circuits) for group B (Inputs 5 - 8):

No. of samples averaged	Switch	On	Off
1	B-4	X	
	B-5	X	
	B-6	X	
2	B-4		X
	B-5	X	
	B-6	X	
4	B-4	X	
	B-5		X
	B-6	X	
8	B-4		X
	B-5		X
	B-6	X	
16	B-4	X	
	B-5	X	
	B-6		X
32	B-4		X
	B-5	X	
	B-6		X
64	B-4	X	
	B-5		X
	B-6		X

**SW-B Settings
Group A
(8 Circuit Mode)**

The following table describes SW–B Settings for all periods of input averaging (Eight Circuits) for group A (Inputs 1 - 2):

No. of samples averaged	Switch	On	Off
1	B-1	X	
	B-2	X	
	B-3	X	
2	B-1		X
	B-2	X	
	B-3	X	
4	B-1	X	
	B-2		X
	B-3	X	
8	B-1		X
	B-2		X
	B-3	X	
16	B-1	X	
	B-2	X	
	B-3		X
32	B-1		X
	B-2	X	
	B-3		X
64	B-1	X	
	B-2		X
	B-3		X

**SW-B Settings
Group B
(8 Circuit Mode)**

The following table describes SW-B Settings for all periods of input averaging (Eight Circuits) for group B (Inputs 3 - 4):

No. of samples averaged	Switch	On	Off
1	B-4	X	
	B-5	X	
	B-6	X	
2	B-4		X
	B-5	X	
	B-6	X	
4	B-4	X	
	B-5		X
	B-6	X	
8	B-4		X
	B-5		X
	B-6	X	
16	B-4	X	
	B-5	X	
	B-6		X
32	B-4		X
	B-5	X	
	B-6		X
64	B-4	X	
	B-5		X
	B-6		X

B875–102 High Speed Analog Input, Indicators

Overview

The following standard front-panel indicators reflect module communication status with the controller and provide an indication of field-side signal status.

Indicator Status Summary Table

Indicator	State	Condition
Active	ON	The module is communicating properly with the PLC
	OFF	The module failed the internal diagnostic test, which determines if valid communication is possible.
Out of Range	OFF	All inputs are within the valid input range.
	BLINKING	One or more inputs are outside the valid input range.

The I/O Map for an eight-circuit configuration (B875) and four-circuit configuration (B873) looks alike.

B875–102 High Speed Analog Input, Recalibration

Overview

Since the module is shipped factory-calibrated, it is the designer's intention that the 10 V reference voltage adjustment will be good for one year. It should be recalibrated annually thereafter.

The following tools are needed to adjust the module's reference voltage:

- A precision digital readout voltmeter with an accuracy of 0.0001 V on a 10 V scale: 6-1/2 digits, to guarantee 4 bit count accuracy.
- A 1/8-inch bit, thin-blade screwdriver.
- A small-bit Phillips-head screwdriver.
- An adhesive (such as Loctite or Glyptol) to secure trim-pot adjustment screws.

Note: Field wiring may remain connected during the recalibration procedure, as the module's working state is not interactive with the reference voltage adjustment. Also, the module does not require warmup to attain temperature.


Recalibration Procedure

Use the following table to recalibrate the module.

Step	Action
1	Refer to illustration of reference voltage cover removal, below. Remove reference voltage adjustment cover to gain access to trim pot.
2	Connect DVM as shown in reference voltage adjustment circuit illustration, below.
3	Adjust reference voltage trim pot for exactly 10.0000 V.
4	Secure trim pot with adhesive.
5	Disconnect voltmeter and secure trim pot access cover.
6	Remove power from equipment housing.


**Reference
Voltage Cover
Removal**

Module Cover Removal

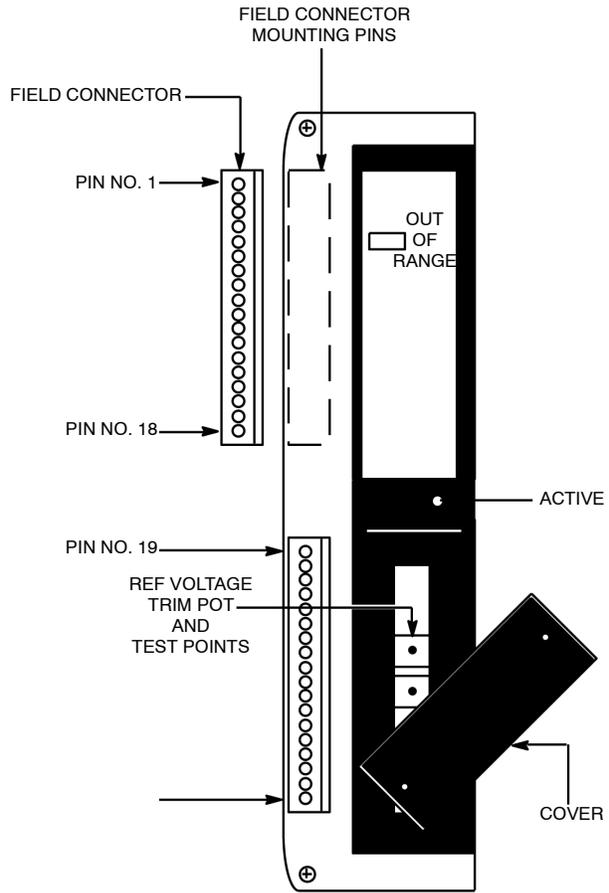

**Reference
Voltage
Adjustment
Circuit**

Reference Voltage Adjustment Circuit

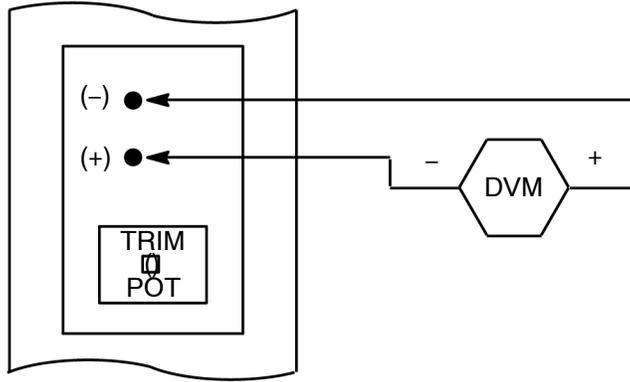


B875-102 High Speed Analog Input, Installation

Overview Module installation involves the following: unpacking the module; setting up the configuration switches; installing key pins in the housing; mounting the module in the housing; wiring the connector.


Installation Procedure Use the following table to install the module.

Step	Action
1	Remove module from shipping box and check for damage. If damage found, contact distributor (or sales person) for correct return procedure.
2	Ensure that power is removed from housing.
3	Configure switch bank A as follows: <ul style="list-style-type: none"> ● A-1 through A-6 for desired input voltage ranges appropriate to the intended eight- or four-circuit configuration ● A7 to select eight- or four-circuit input mode. ● A8 to ON for normal operation.
4	Configure switch bank B as follows: <ul style="list-style-type: none"> ● B-1 through B-6 for desired number of input averaging samples appropriate to eight- or four-circuit configuration designated above. ● B7 to select output code format
5	If using key pins (provided with housing shipment), install them above and below housing slot selected for this module's installation.
6	Open handle and insert module into housing, firmly seating edge connector in backplane.
7	Secure module using captive mounting screws at top and bottom of module's front panel.
8	Refer to field connector/input circuit pinout diagram, below. Connect field side wiring to double field connector (located on left side, front edge), laying in cable fan-out as desired. NOTE: Use field connector wiring sizes AWG—20 inclusive (solid or stranded).
9	If current sense input circuit(s) is being used, jumper appropriate current sense terminal on field connector to corresponding hot input (+) as shown in field connector/input circuit pinout diagram, below. NOTE: Unused inputs should be terminated to reduce electrical noise and other interference due to floating input lines. Jumper unused voltage and current terminals (including shields) to case ground. Case ground will only be effective if H8XX housing is connected to earth ground. Both ends of the shield cannot be connected to the device and module, unless the device shield is part of the device input circuit, and is not connected internally to the device case ground. NOTE: If over-range and under-range detection is required, and this detection is causing throughput problems with the unused channels (because they float or spike outside the range) then the unused voltage or current channels at the field connector should be connected in parallel to a valid input channel. As long as the valid channel stays within range, the tied channels will also stay within range. NOTE: For currents within the range of 4—20 mA, only the valid input requires the inclusion of the 250 Ω resistor.
10	Refer to field connector mounting drawing, below. Mount two wired field connectors on analog module with pin 1 positioned at top and field wiring to left.
11	Close module handle.
12	Turn on power to housing if desired. NOTE: If an open circuit occurs when operating in the voltage mode, the input may take several seconds to decay to zero, due to the front-end RC network. If open-circuit detection is required, the module should be operated in the current mode. The addition of the 250 Ω resistor forces the RC network to discharge rapidly.

Field Connector/ Field Connector/Input Circuit Pinout Diagram.
Input Circuit
Pinout Diagram

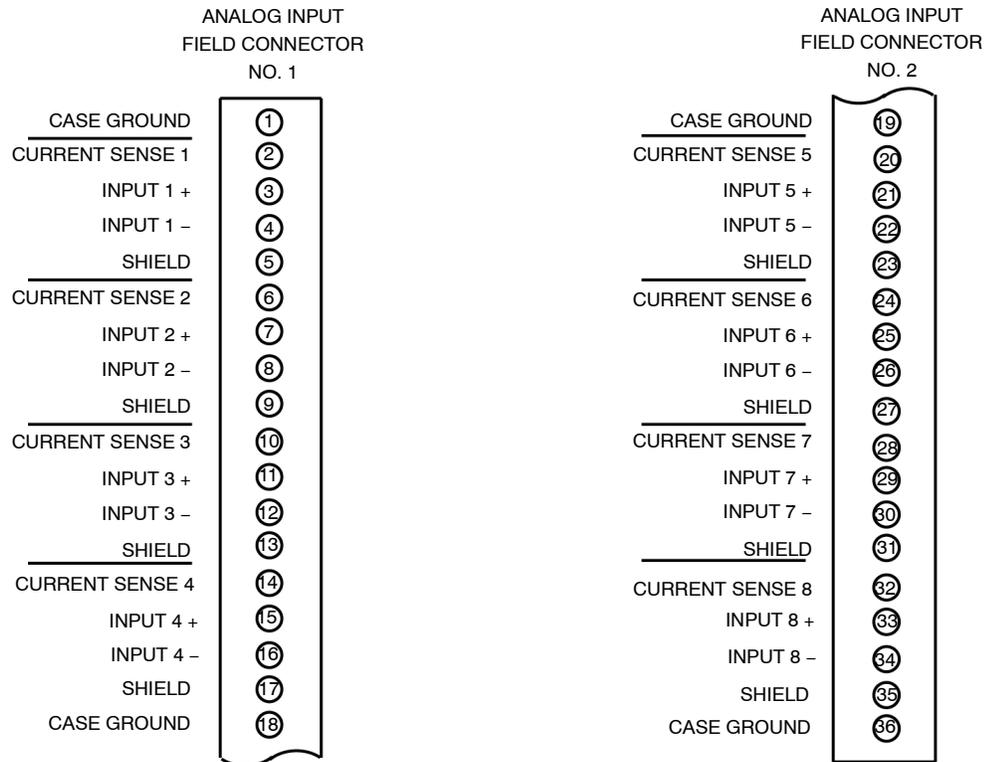

Field Connector Mounting Diagram

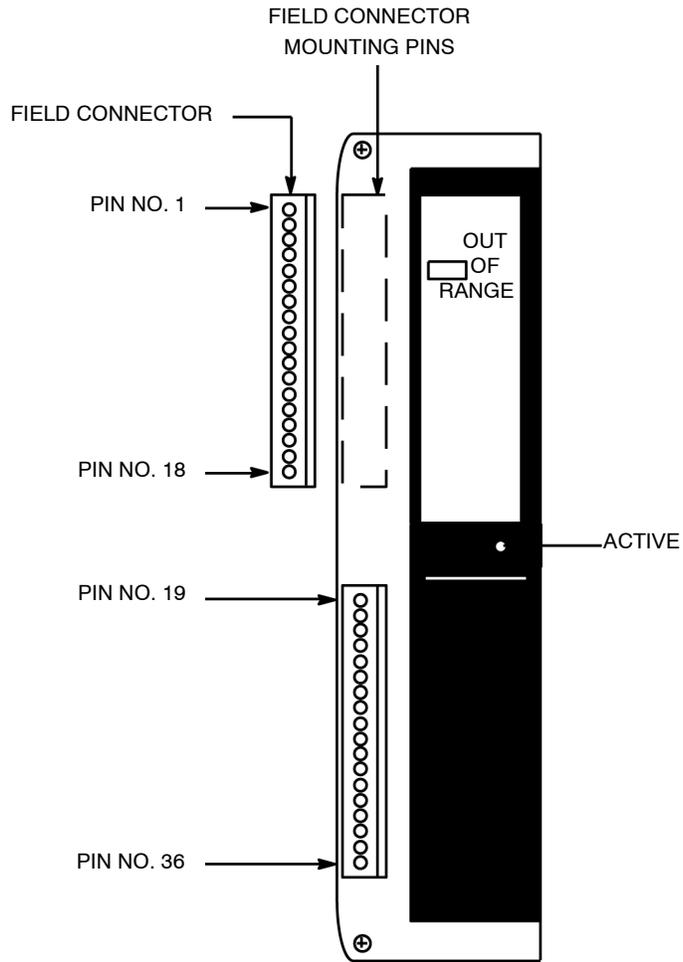

B875–102 High Speed Analog Input, Specifications

Specification Table The following table provides the specifications for the unit.

B875-102 Specifications		
Description		Fast A/D voltage or current input
Number of Channels	B873/B875	Four or eight isolated inputs
Operating Range	Voltage	1—5 Vdc
		0—5 Vdc
		0—10 V
		-5—+5 V
		-10—+10 V
	Current	4—20 mA
		0—20 mA
		0—40 mA
		-20—+20 mA
		-40—+40 mA
Impedance	Voltage Mode	>10 M Ω input differentially 1.5 k Ω with power removed
	Current Mode	250 Ω /input
Resolution		12 bit
Filter		Single Pole dc to 1.0 kHz
Linearity	Error	.05% of full scale over operating temperature range
	Differential	0.0244% of full scale @ 25°C (77°F)
Protection		120 Vac differential input (voltage mode only)
Common Mode	Range	Input voltage plus common mode voltage less than 12 V
	Rejection	>-70 dB, dc to 60 Hz
Isolation	Input to Case	1500 Vac RMS for i minute
	Input to Input	30 Vdc
	Input to OURBUS	1500 Vac RMS for 1 minute
Accuracy	@25°C (77°F)	0.1% of full scale (4 counts)
	Over 0—60°C	0.25% Of full scale (10 counts)
Terminal Connector		AS-8533-004
Repeatability		0.25% of full scale (10 counts) of full scale RMS, constant temperature, no averaging

B875-102 Specifications		
Autocalibration		High/low range points recalibrated during run time
Power-up Time		5 s maximum
Warm-up Time		5 s concurrent with power-up)
Power Required	+5 V	650 mA max, 300 mA typical
	+4.3 V	975 mA max, 550 mA typical
	-5 V	0 mA
Data Format	0000	Power Up
	8000 Hex	Out of Range
	0001—4200	Valid—All Ranges
	9068 Hex	Over Range
Data Update Period Rate	Four channels	2.4 ms
	Eight channels	3.0 ms (including diagnostics). No additional time penalty for process or data for out-of-range condition.

B875-102 Parameter Configuration

Parameter and Default Values

Parameter Configuration Window

Parameter Name	Value
MAPPING	WORD (%IW-3X)
INPUTS STARTING ADDRESS	1
INPUTS ENDING ADDRESS	8
INPUT TYPE	BINARY

Module Configuration

Parameter Name	Value (Default)	Value (Options Available)	Description
Mapping	WORD (%IW-3X)	-	
Inputs Starting Address	1	-	
Inputs Ending Address	8	-	
Input Type	BINARY	BCD	

Mapping Parameter References

	Modsoft, Concept, ProWORX	Unity
Reference Type	Mapped as 8 registers input 3x	Mapped as 8 words input %IWx
Input Type	BIN/BCD	BIN/BCD

B875-111 & B877-111 Analog Input

13

At a Glance

Purpose

This chapter describes the functional and physical characteristics of the B875-111 and B877-111 Analog Input modules.

What's in this Chapter?

This chapter contains the following topics:

Topic	Page
B875-111 Analog Input, Overview	214
B875-111 Analog Input, Module Configuration	216
B875-111 Analog Input, Field Connections	220
B875-111 Analog Input, Application Example	227
B875-111 Analog Input, Calibration	233
B875-111 Analog Input, Quick Reference	236
B875-111 Analog Input, Specifications	237
B875-111 Parameter Configuration	239
B877-111 Parameter Configuration	240
B877-111, Terminal Numbering and Output Connections	241

B875–111 Analog Input, Overview

General Characteristics

The B875–111 Analog analog-to-digital (A/D) Input Module (B875) converts input voltage and/or input current ranges into binary data. This module can be configured to accept 8 differential or 16 single ended inputs. When selected for 8 differential inputs, the card is called a B875–111. When selected for 16 single ended inputs, the card is called a B877–111. Refer to the simplified schematic below.

The B875 Analog Input module allows the polling of a wide array of field devices requiring different voltages and different currents based upon a unique application. One can select from five available input voltage ranges on a module-wide basis. The ranges, which are 0 to 5V, 1 to 5V, -5 to 5V, 0 to 10V, and -10 to 10V, are selected by means of four DIP switches on the module configuration switch.

One can select from three available input current ranges, which are 0 to 20 mA, 4 to 20 mA, and -20 to +20 mA.

One can select from four available output formats. The formats, which are standard, elevated, full resolution, and decimal, are selected by means of two DIP switches on the module configuration switch.


One can select either no averaging, or 8, 16, or 32 sample inputs to be averaged to generate each output by means of two DIP switches on the module configuration switch.

The module has eight/sixteen analog inputs and is capable of updates to all channels every 10–20 msec. The greater than 12-bit resolution and the absolute accuracy of 0.1% at 0–60° C provides precise control of the application.

Simplified Block Diagram

The following illustration represents the simplified schematic diagram for the B875-111 module.

B875-111 Analog Input Module, Simplified Schematic Diagram

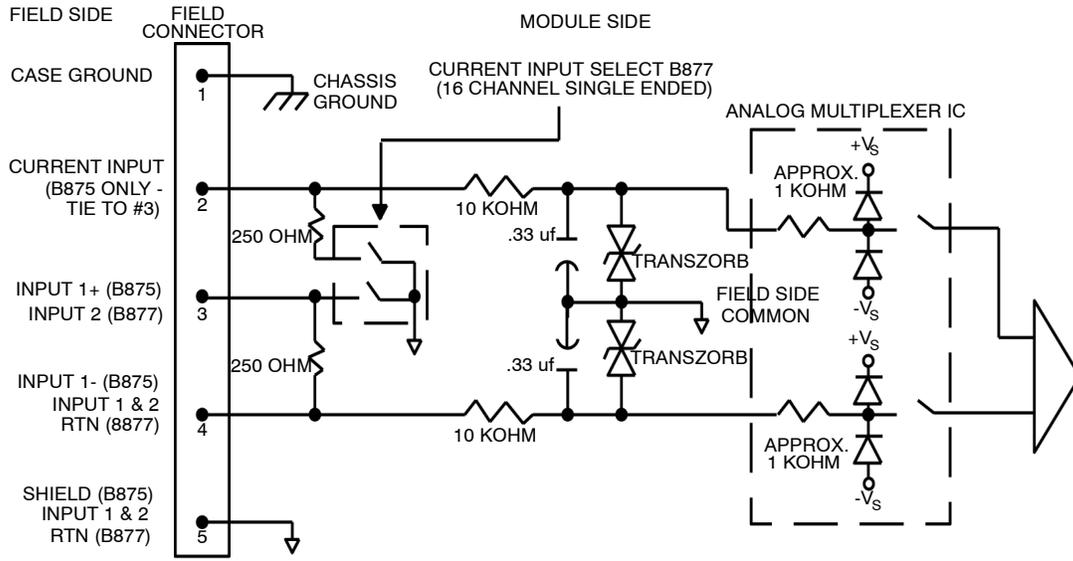

B875–111 Analog Input, Module Configuration


Overview

The B875-111 module is shipped from the factory with the 1—5 V range with 0—4095 output format (standard), one sample averaged, and voltage inputs, 8 channel (B875-111)—i.e., all DIP switches to the right. If necessary, reset the module configuration switch and the five-position DIP switch based upon the application requirements prior to installation. Refer to the illustration of the module configuration switch, below.

Module Configuration Switch with DIP Switches

The following illustration shows the module configuration switch and DIP switch settings for the B875–111 module.
 B875–111 Analog Input Module, Module Configuration Switch and DIP Switch Settings

MODULE CONFIGURATION SWITCH
 8-POSITION DIP-SWITCH
 TOP OF MODULE

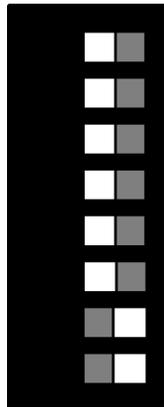

1 0
 ON OFF
 LEFT RIGHT
 DOWN UP

SWITCH TO
 FUNCTION
 RELATIONSHIP

- SW1 = BIPOLAR/UNIPOLAR
- SW2 = ALL OTHER RANGES/1-5v & 4-20MA
- SW3 = OUTPUT FORMAT
- SW4 = OUTPUT FORMAT
- SW5 = NO. OF SAMPLES AVERAGED
- SW6 = NO. OF SAMPLES AVERAGED
- SW7 = 16/8 CHANNELS
- SW8 = 10V/5V

Use the following table to determine the functions for each switch.

Switches	Functions
SW1	Input Range
	For Bipolar (10 V, 5 V 20 mA):SW1=L
	For Unipolar (0—10 V, 0—5 V, 0—20 mA, 1—5 V, 4—20 mA): SW1=R
SW2	Input Range
	For Offset (1—5 V or 4—20 mA): SW2=R
	For No Offset (All other Ranges): SW2=L
SW3 & SW4	Output Formats (refer to the following table for resolutions)
	For Standard (0000—4095): both SW3 and SW4=R
	For Elevated (4096—8191): SW3=L and SW4=R
	For Full Resolution (Raw Binary): SW3=R and SW4=L
	For Decimal (0001—9999): both SW3 and SW4=L
SW5 & SW6	Samples to Averaged
	For 1 Sample: SW5 and SW6 both R
	For 8 Samples: SW5=L and SW6=R
	For 16 Samples: SW5=R and SW6=L
	For 32 Samples: SW5 and SW6 both L
SW7	Input Types
	For 8 Differential (B875):SW7=R
	For 16 Single Ended (B877): SW7=L
SW8	Input Ranges
	For 10 V (10 V or 0—10 V): SW8=L
	For 5 V (All Others): SW8=R

Output Format Selection The following table provides the output formats and their resolution relationships:

Output Format	Under Range	Normal Range	Over Range	Resolution	Actual Format
Standard	0000	0000—4095	4096	12 bits	Raw binary, unsigned
Elevated	4095	4096—8191	8192	12 bits	Raw binary, unsigned
Full Resolution	Bit 16=1 Bit 15=1	Bit 16=0 Bit 15=0 1—7499	Bit 16=1 Bit 15=0	Bipolar=1/15000 counts Unipolar=1/7500 counts Offset=1/6000 counts	*Raw binary and two flags
Decimal	Bit 16=1 Bit 15=1	Bit 16=0 Bit 15=0 1—9999	Bit 16=1 Bit 15=0	Bipolar=1/1000 counts Unipolar=1/7500 counts Offset=1/6000 counts	Raw binary and two flags 1—9999 counts 1—9999 counts

*When an under or over range condition exists, the output word contains the applicable flag and the under or out-of-range value.

Standard output format is raw binary output, 0—4095 counts. Under range is 0000 and over range is 4096.

Elevated output format is raw binary output, 4096—8191 counts. Under range is 4095 and over range is 8192.

Full resolution output format provides the true resolution of the module which depends on the input range.

- Bipolar inputs produce an output of 0001—14,999 counts
- Unipolar inputs produce an output of 0001—7499 counts
- Unipolar and offset inputs produce an output of 0001—5999 counts

In the full resolution format, out-of-range values of 2.4% may be read to the specified accuracy of the module. They can be read in this manner. When an out-of-range condition occurs which is over range the MSB (bit 16) is set to 1. If an under range occurs the second MSB (bit 15) is also set to 1. The remaining 14 bits give the absolute value of the amount over or under range. For example, for a unipolar input of 5.120 volts the output would have bit 16 set to 1. The remaining output bits equaling the raw binary representation of 120 millivolts. Any input above the 0.120 volts in this range will not be within the specified accuracy of the module.

Decimal output format allows scaled outputs to provide 0001—9999 counts full scale. This format does not indicate the true resolution of the module. For bipolar inputs the output is scaled down and for unipolar inputs the output is scaled up. This format also reports out-of-range values in the same manner as the full resolution mode.

Note: For unipolar and unipolar with offset image ranges, the process of scaling the lower resolution output values to the 1—9999 output format creates the possibility of missing codes due to rounding off of numbers in the micro controller.

Note: When applying power to the equipment, or after a reset, the module transfers 4000 Hexadecimal during its internal reset, and initialization time until valid data is ready to be transferred. (4000 Hexadecimal corresponds to the second MSB=1, all other bits=0).

Input Selection

First, locate the four access holes on the left side of the module. These holes allow access to three four-position and one five-position DIP switch. Next, set switch position 5 (SW5) of the five-position DIP switch found in the bottom access hole on the left side of the module, to select the input range. This switch must correspond to switch position 8 (SW8) of the eight-position module configuration DIP switch. SW5 and SW8 settings must be identical.

Note: For switch SW5, the input ranges are as follows:

- For 10 V (10 V or 0—10 V) place SW5 to the left.
- For 5 V (all others) place SW5 to the right.

B875–111 Analog Input, Field Connections

Overview


There are two ways to configure the module to accept current inputs. With eight differential current/voltage inputs the module is called the B875-111. With sixteen single-ended current/voltage inputs the module is called the B877-111.

B875-111 field connections

When configuring the B875-111 for eight differential current inputs, note the channels that will receive these inputs. Current inputs are selected by placing a jumper on the field connector between the positive voltage input and the current input terminal for the appropriate channel. For example, if channel 2 is to receive a current input, a jumper must be made between terminal #7 (CH2+) and terminal #6 (Current Input CH2), as shown on the following illustration.

The following illustration represents the simplified schematic diagram for the B875–111 module.

B875–111 Analog Input Module, Current Input Example Drawing

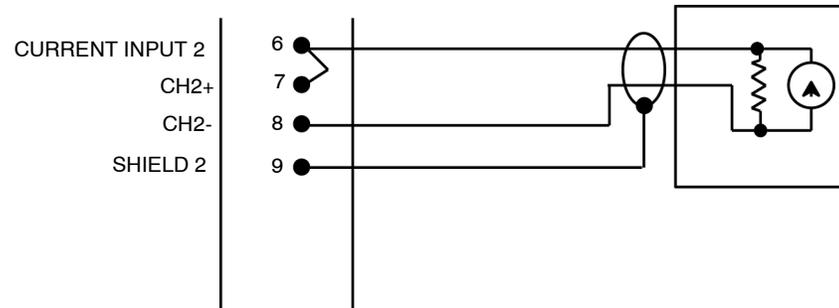

Note: DIP switch accessibility

DIP switches accessible through the side cover are not used in differential mode and should be left in the factory-installed voltage input positions.



Note: Simultaneous current and voltage inputs can exist under the following conditions:

- 1—5 V and 4—20 mA
- 0—5 V and 0—20 mA
- 5 and 20 mA

Connect field-side wiring to proper pins on the field connector. Voltage inputs do not require a jumper on the field connector. Refer to the illustration showing the typical field circuit connections, below.

Note: Open-circuit voltage inputs may drift either positive or negatively. If open-circuit detection is required, a current input should be used. When using voltage inputs, an open circuit can be detected if a large-value resistor (2 M Ω or greater) is placed at the field connector across the positive (+) and negative (-) inputs. The resistor clamps the channel to a small offset voltage (<100 mV) if the field connections are broken.

Typical Field Circuit Connections with Eight Differential Inputs

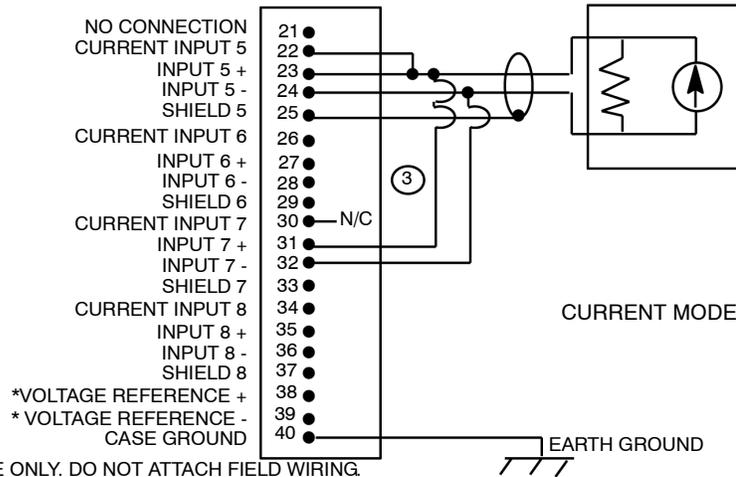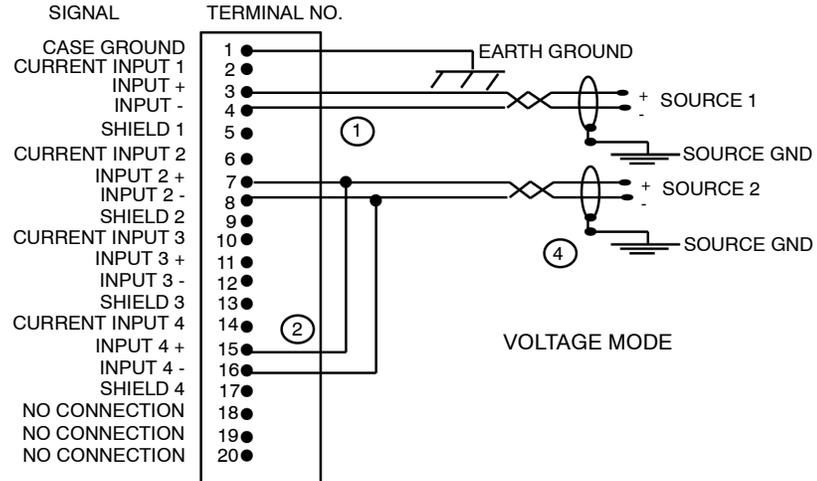

*FOR REFERENCE ONLY. DO NOT ATTACH FIELD WIRING.

- ① SHIELDS 1-8 ARE COMMON AND TIED TO FIELD SIDE GROUND.
- ② JUMPER UNUSED CHANNELS IN PARALLEL WITH A VALID INPUT TO AVOID OUT OF RANGE ERRORS.
- ③ WHEN TERMINATING UNUSED CHANNELS IN CURRENT MODE, DO NOT JUMPER THE "CURRENT INPUT" PIN OF THE UNUSED CHANNEL.
- ④ WHEN USING SHIELDED FIELD CIRCUIT WIRES, GROUND SHIELD AT ONE END ONLY.


B877-111 Field Connections

Current inputs are selected by setting the DIP switches accessible through the side cover for each channel to receive an input. The DIP switch places a 250 Ω precision resistor between the positive input and analog returns.

The fifth switch (SW5) on switch bank 4, located on the left side selects the voltage range. The position of this switch must be the same as for module configuration switch SW8, located at the rear of the module. Refer to the label located on the left side of the module, and to the illustration showing the current settings for single-ended inputs (B877) below.

Current Settings for Single-Ended Inputs, Diagram (B877)

3 4- POSITION DIP SWITCHES AND 1 5-POSITION DIP SWITCH

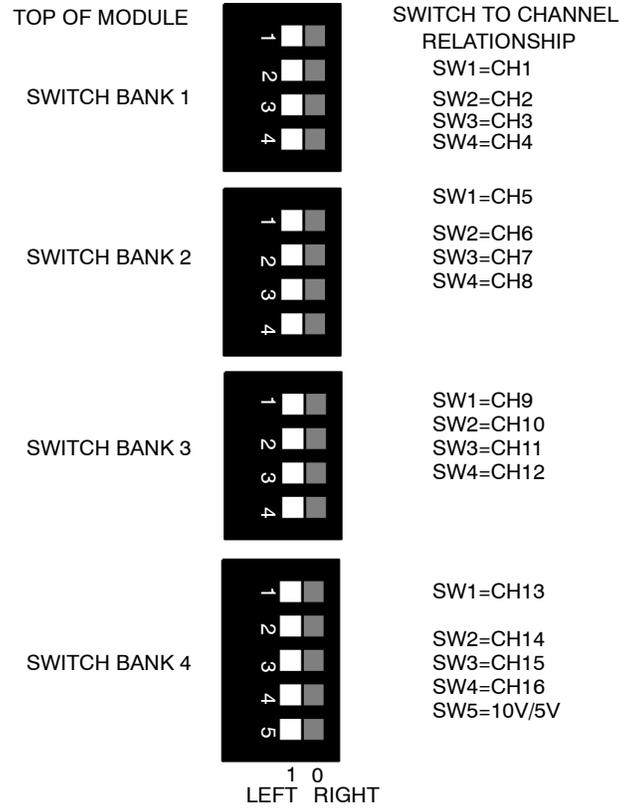

Use the following table to determine the functions for each switch.


Switches	Functions
Switch Bank 1	Current Inputs
	For Channels 1—4
	SW1—4=Right Side Down
Switch Bank 2	Current Inputs
	For Channels 5—8
	SW1—4=Right Side Down
Switch Bank 3	Current Inputs)
	For Channels 9-12
	Sw1—4=Right Side Down
Switch Bank 4	Current Input
	For Channels 13—16
	SW1—4=Right Side Down
Switch Bank 5	Input Ranges
	For 10 V (V or 0—10V): SW5=Left Side Down
	For 5 V (All Others): SW5=Right Side Down

Note: DIP switch accessibility
 DIP switches accessible through the side cover are not used in differential mode and should be left in the factory-installed voltage input positions.

Use the following table to field connect the B77-111 module. Refer to typical field circuit connections, single-ended inputs (B877) diagram, below.

Step	Action
1	Connect field-side wiring to proper pins on field connector when module is configured for sixteen single-ended inputs. Note: Open-circuit voltage inputs may drift either positive or negatively. If open-circuit detection is required, a current input should be used. When using voltage inputs, an open circuit can be detected if a large-value resistor (2 M Ω or greater) is placed at the field connector across the positive (+) and negative (-) inputs. The resistor clamps the channel to a small offset voltage (<100 mV) if the field connections are broken.
2	Reinstall any module temporarily removed.
3	When using key pins (provided with housing shipment), install them above and below housing slot selected for this module's installation.
4	Insert module into housing firmly but carefully, seating edge connector in backplane.
5	Secure module to housing using captive slotted mounting screws at top and bottom of module front panel.

Typical Field Circuit Connections, Single-Ended Inputs (B877) Diagram

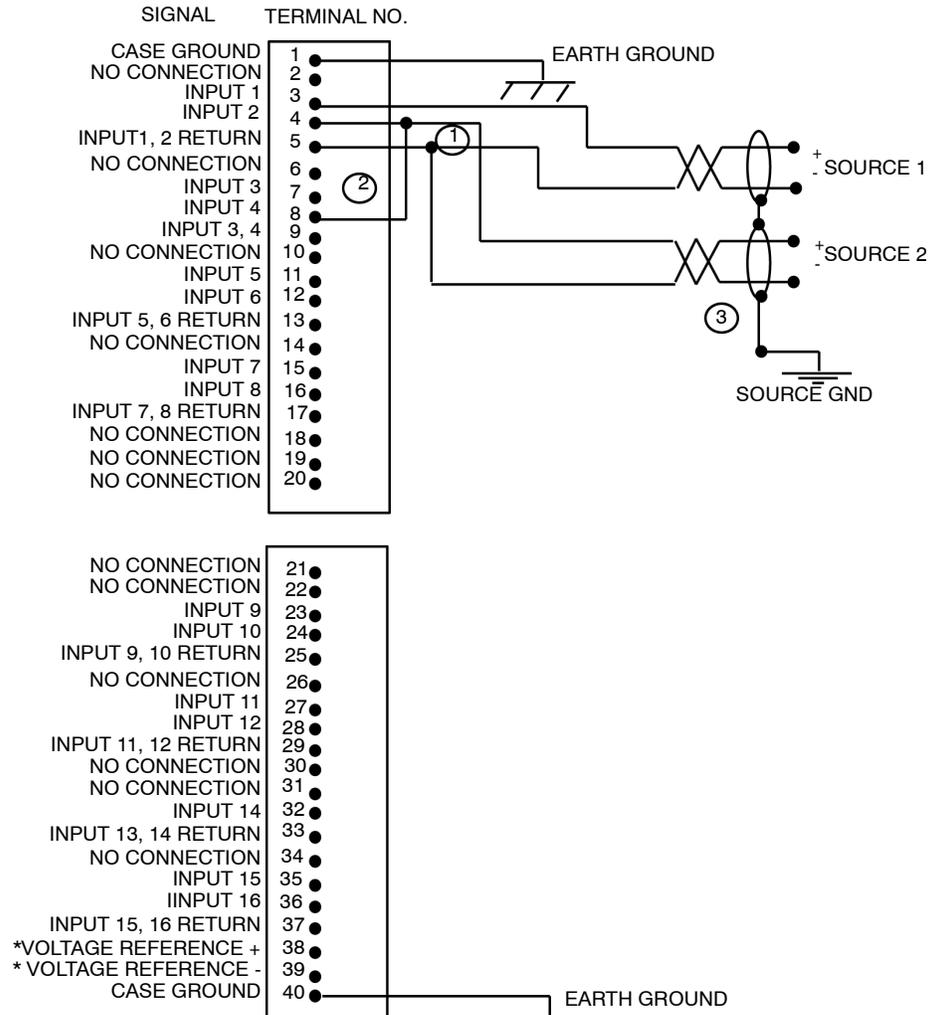

- * FOR REFERENCE ONLY. DO NOT ATTACH FIELD WIRING.
- ① ALL RETURNS ARE ELECTRICALLY TIED TOGETHER INSIDE THE MODULE.
- ② JUMPER UNUSED CHANNELS IN PARALLEL WITH A "VALID" INPUT TO AVOID OUT OF RANGE ERRORS. YOU MUST SELECT VOLTAGE MODE FOR THE UNUSED CHANNEL.
- ③ WHEN USING SHIELDING FIELD CIRCUIT WIRES, GROUND SHIELD AT ONE END ONLY.

B875–111 Analog Input, Application Example

Setup

Configuration Switch Pack

The B875–111 can be configured to accept 8 differential or 16 single ended inputs. When selected for 8 differential inputs, the card is called a B875–111. When selected for 16 single ended inputs, the card is called a B877–111.

This selection is made by switch 7 on the configuration switch pack found at the rear of the module. SW7 in the left position is equal to 16 inputs, in the right position it is equal to 8 inputs.

In addition to selecting the number of inputs, you also select voltage range, output format, polarity, offset and number of samples. Refer to the Installation Instructions and the DIP-switch chart on the left side of the module for details.

For a quick start setup, use the following settings to interface a 0 to +10V input signal. For the following input parameters:


- 0—10 V input
- 0 to full scale output format
- One sample
- Eight differential inputs

Set the switch settings as follows:

- SW1, SW3, SW5, SW7=right
- SW2, SW4, SW6, SW8=left

Input Type Selection (Voltage or Current)

If configured as a B875 (8 differential inputs), current inputs (4—20mA) are selected by placing a jumper at the field connector between the positive voltage input and the current input terminal for the appropriate channel. Refer to the following illustration. Field Connector Jumper Diagram

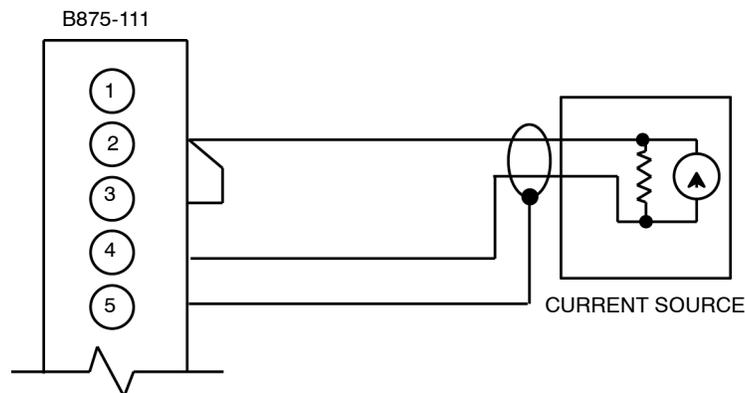

If configured as a B877 (16 single ended current inputs), input type is selected by the switches on the left side of the module. There is one switch for each of the 16 inputs. This switch places a 250 ohm precision resistor between the plus input and analog return. External jumpers are not used and must be removed. The left position is equal to voltage input, and the right position is equal to current input.

The fifth switch on switch bank 4 (left side) selects the voltage range for both B875 and B877 operations. This switch must correspond to switch 8 of the configuration switch bank (at rear of module). The left position of SW5 is equal to 10 volts, and the right position is equal to 5 volts. SW8 must be in the same position as SW5.

For the 0—10V input signal example, set all the input switches to the left (down or towards the numbers).

I/O Mapping


If setup for 8 differential inputs, the module type will be a B875 and requires 8 consecutive 3xxx binary registers. If setup for 16 single ended inputs, the module type will be a B877 and require 16 consecutive 3xxx binary registers.

Note: Upon power-up the module's active indicator flashes rapidly showing that communication with the programmable controller has been established but, that the input data being returned is not valid. (4000 Hexadecimal is sent to the controller during the initialization time). When module initialization is complete, and valid input data is being transferred, the indicator is either steady on, or flashing slowly when any input is out-of-range.

Wire Inputs

The B875-111 and B877-111 require a high-density connector, part number AS-8535-000. Refer to the left side of the module for pinouts. Refer to the following illustration.

0—10 V Input Example, Diagram.

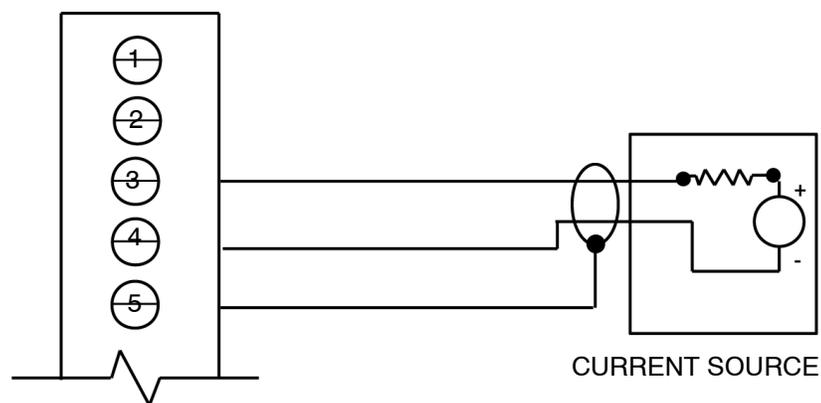

**Module
Checkout**

The B875–111 and B877–111 will perform an analog to digital conversion on the inputs. The resolution of the analog to digital conversion is dependent upon the input range and output format selected with the configuration switch bank.

Using a Modicon programmer, call up the appropriate registers assigned in the I/O Map. Vary the input signal and check that the register content varies correctly. Refer to the following table for the quick-start example.

Voltage	Value
@ 0 V	3xxx=001 (decimal)
@ 5 V	3xxx=3750
@ 10 V	3xxx=7500
@ 11 V	3xxx > 9999 (decimal)* *The active light indicator should be flashing, indicating the input is out of range.

**Sample
Averaging Input
Data**

The output data can be processed by a low-pass digital filter in the module to average out and remove any low-frequency noise in the converted input analog data. The digital filter algorithm is:

$$Y_n = Y_{n-1} + \frac{X_n - Y_{n-1}}{2N}$$

where

X_n = Current input data sample

Y_n = New output filter data value

Y_{n-1} = Previous output filter data value.

The digital filter algorithm approximates a classical exponential response characteristic with both the cut-off frequency, F_c, and the time constant, T_c, related to the number of samples to be averaged, N, and the throughput time, T. The "N" is user selected (8,16,32) with DIP-switches. Throughput time, "T", equals 10ms for the B875–111, and 20ms, for the B877–111.)

$$T_c = 2 \times N \times T \quad (\text{s})$$

$$F_c = \frac{1}{2 \times \text{Pi} \times T_c} = \frac{.08}{N \times T} \quad (\text{Hz})$$

where Pi = 3.141

As with any filter, the user must establish what time constant and cut-off frequency is suitable for the specific application. Below is a reference table that approximates the digital filter characteristics for various user settings.

Digital Filter Approximates (B875-111)

Throughput Time (T)	Number of Samples (N)	Cut-off Frequency (F_c)	Time Constant (T_c)
10 ms	8	1 Hz	160 ms
10 ms	16	0.5 Hz	320 ms
10 ms	32	0.25 Hz	1640 ms

Digital Filter Approximates (B877-111)

Throughput Time (T)	Number of Samples (N)	Cut-off Frequency (F_c)	Time Constant (T_c)
20 ms	8	0.5 Hz	320 ms
20 ms	16	0.25 Hz	640 ms
20 ms	32	0.125 Hz	1280 ms

Approx. step settling-time to 63% of final value = $1 \times T_c$

Approx. step settling-time to 99% of final value = $4.5 \times T_c$


Approx. step settling-time to 99.9% of final value = $6.8 \times T_c$

Note: As the scan time increases, the average response time may decrease as viewed in ladder logic.

Application


In many applications, analog signals are provided to operators in units (points, gallons per second, degrees C, feet per minute, etc.) via LED displays, CRT monitors or report printouts. An analog input can be scaled to engineering units. To illustrate the technique, assume that the 0—10 V signal in the quick-start example represents a temperature from -40—+140°F. Refer to the following illustration showing the signal to temperature relationship.

Signal to Temperature Relationship Diagram

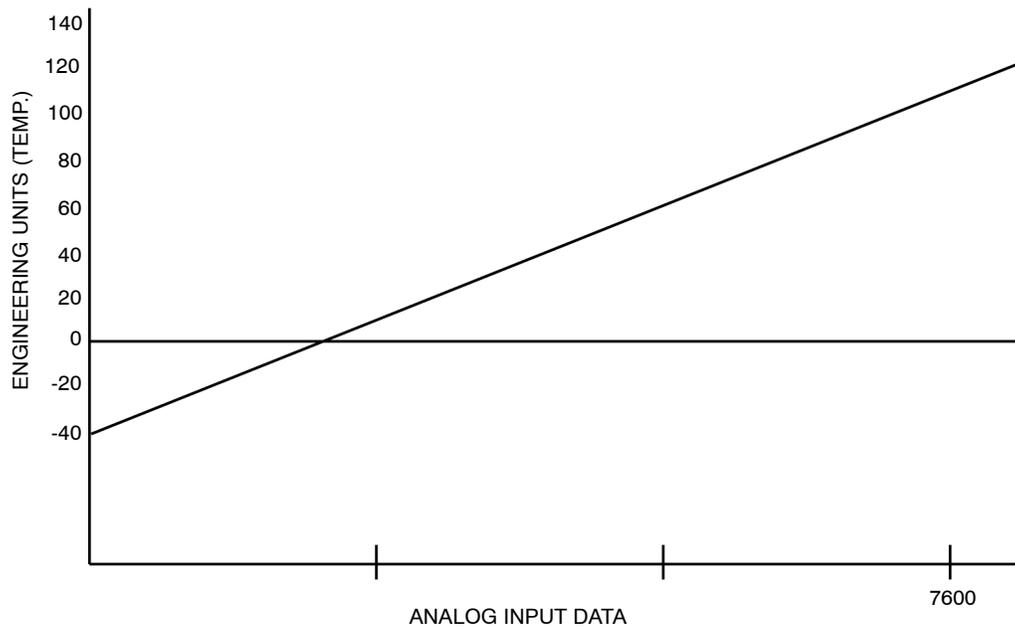

- What is the engineering unit range? In this example it is $140 - (-40) = 180$
- Divide this number by 7500 using a calculator. $180/7500 = .024$
- Multiply this number by 10,000 to obtain the multiply block constant of 240.
- Multiply the analog input by 240. The high-order result register will contain the range.
- Add or subtract the Y intercept (-40 in this example) to obtain the answer.

Scaled Value from Analog Signal, Diagram

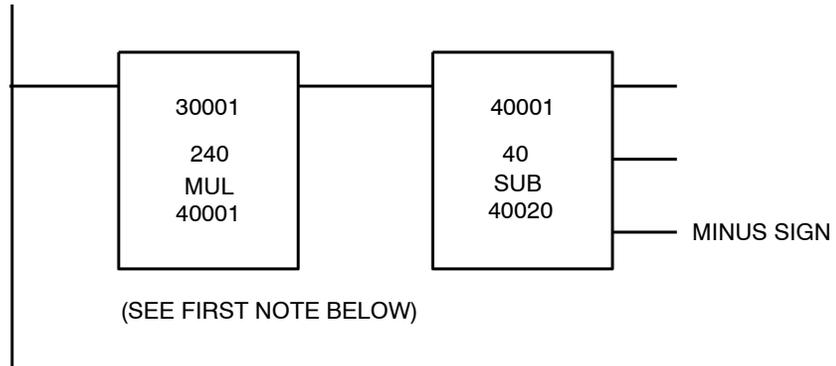

Note: The logic shown is used to generate the scaled value in register 40020 from the analog signal in 3001. For example: 30001 = 3800; 40020 = 0051°F

Note: Only the high-order result of the multiplication is used, and no compensation for round-off is used in this example.

B875–111 Analog Input, Calibration

Calibration Tools The analog input module is calibrated at the factory prior to shipment. To ensure the module's accuracy, the trim-pot should be calibrated regularly on a yearly interval. The following tools and materials are needed to calibrate an analog input module:

- A precision digital readout voltmeter with an accuracy of 0.0001 V on a 10 V scale.
- A 1/8-inch bit, thin-blade screwdriver.
- A 1/4-inch Phillips-head screwdriver.
- An adhesive (such as Loctite or Glyptol) to secure trim-pot adjustment screws.


Calibration Procedure

Use the following table to calibrate the module.

Step	Action
1	Remove two screws and label located on front-panel of analog input module to allow access to trim pot. Note: The trim pot adjusts the total magnitude of the range (full scale). Refer to trim-pot location diagram, below.
2	Open analog input module handle to expose connectors and terminals.
3	Connect digital voltmeter (DVM) minus lead to voltage reference - (terminal number 38) and plus lead to voltage reference + (terminal number 39). Refer to voltmeter connection diagram, below. Note: Field wiring may remain connected during calibration. Five minutes of warm-up is sufficient to attain temperature stability.
4	Adjust reference voltage trim pot for an indication of 4.500 V 0.0001 V.
5	Secure trim pot in place with adhesive.
6	Disconnect voltmeter, return connections to their pre-calibration state, close module handle. Replace front label removed in step 1, above.


**Trim Pot
Location
Diagram**

Trim Pot Location Diagram.

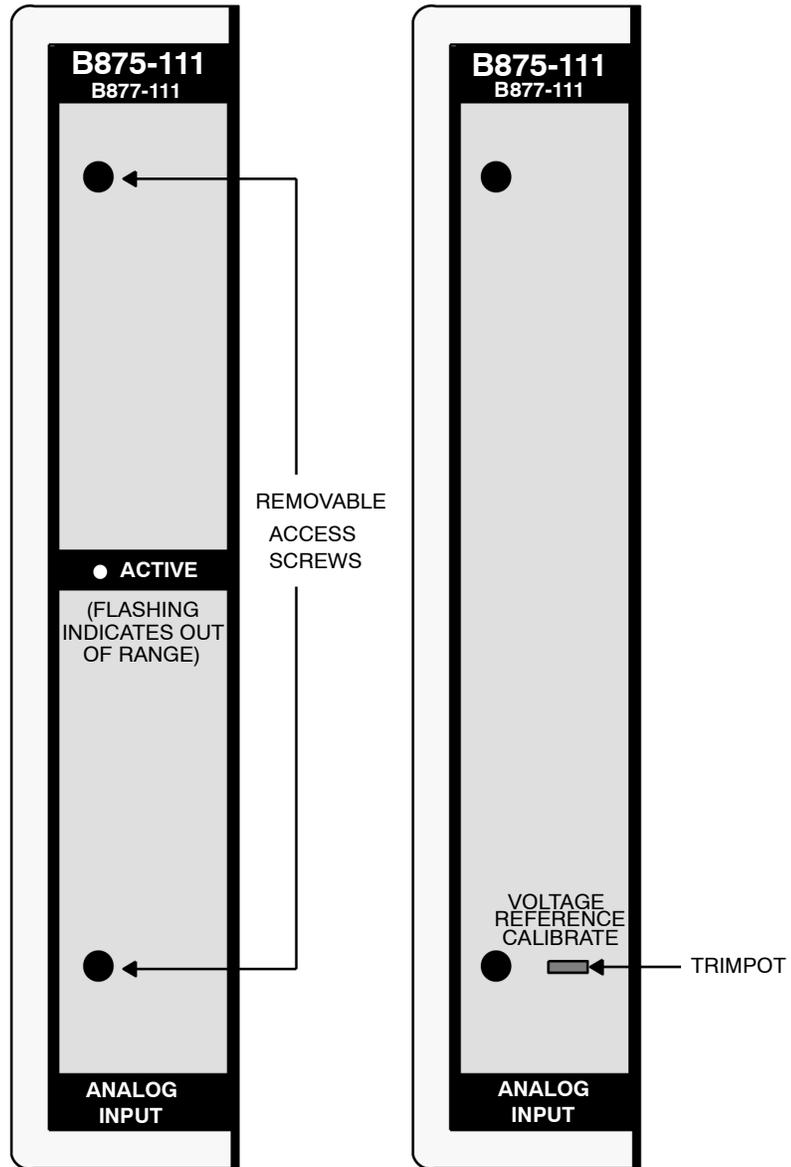

**Voltmeter
Connection
Diagram.**

Voltmeter Connection Diagram.

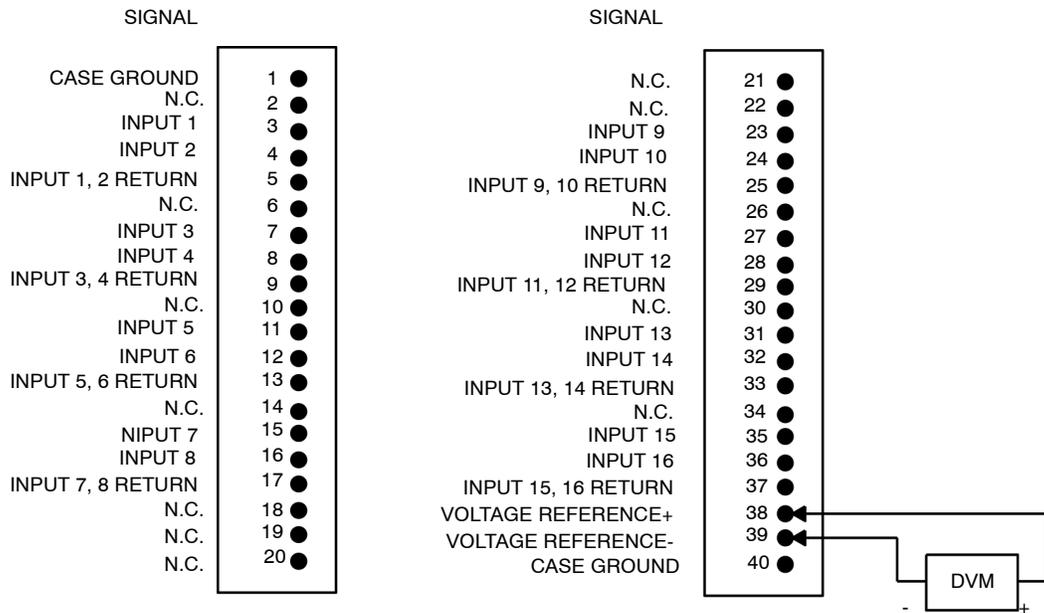

B875–111 Analog Input, Quick Reference

Overview

To set up the analog input module properly, an eight-position DIP-switch must be set together with SW5 of a five-position DIP switch located on the left side of the module. These switches determines the input range, output format, number of samples to be averaged, and the types of inputs.

DIP-Switch Configuration Parameters, Table

DIP-Switch Configuration Parameters		Eight-Position Switch			Five-Position Switch
Input Range		SW1	SW2	SW8	SW5
	5 V, 20 mA	L	L	R	R
	0–5 V, 0–20 mA	R	L	R	R
	1–V, 4–20 mA	R	R	R	R
	10 V	L	L	L	L
	0–10 V	R	L	L	L
Output Format		SW3	SW4		
	Standard (0–4096)	R	R		
	Elevated (4096–8192)	L	R		
	Variable (0 to full resolution)	R	:		
Decimal (0–10,000)	L	L			
Samples to be Averaged		SW5	SW6		
	1 or no averaging	R	R		
	8	L	R		
	16	R	L		
32	L	L			
Types of Inputs		SW7			
	8 Differential	R			
	16 Single-ended	L			

For example, assume that the following values are desired: 5 V input; 0–10,000 counts output; no averaging; differential inputs. Set the switches as follows:

Module Configuration Switch

SW1–4 = L

SW5–8 = 8

Switch Bank 4

SW5 = R

B875–111 Analog Input, Specifications

Specification Table

The following table provides the specifications for the unit.

B875-111 Specifications		
Analog Inputs/ Module	I/O mapped as B875-111	Eight differential
	I/O mapped as B877-111	16 Single-ended
Input Ranges	Voltage	1—5 Vdc
		0—5 Vdc
		0—10 V
		-5—+5 V
		-10—+10 V
	Current	4—20 mA
0—20 mA		
-20—+20 mA		
Input Analog Filter		Single pole low pass, with -3 dB cut-off frequency at 48 Hz 10%
Input Resistance	Current Mode	250 Ω , 0.05%
	Voltage Mode	Within range > 10 MW, outside range 10,000 Ω
Input Resistance (No power)	Differential Inputs	20k Ω /channel
	Single-ended Inputs	10 k Ω /channel
Input Protection	Normal Mode	120 V RMS differential input
	Common Mode	120 V RMS
Throughput (T)	eight channels	10 ms without input sampling
	16 channels	20 ms without input sampling
Over Current Protection		Up to 30 mA
Common Mode Range		2 V for 10 V, 7 V for 5 V
Rejection		-40 dB typical, dc to 60 Hz
Input Isolation	Input to OURBUS	1500 Vac RMS for 1 minute
	Input to Case	1500 Vac RMS for 1 minute
	Input to Input	25 Vac
Accuracy		0.1% absolute accuracy over temperature range

B875-111 Specifications		
Conversion Resolution	All ranges	>12 bits
	Bipolar	1 part in 15,000
	Unipolar	1 part in 7,500
	Unipolar with offset	1 part in 6,000
Linearity Error		0.05% of full scale over the operating range
Differential	Nonlinearity	0.006% of full scale over the operating range
	Repeatability	0.025% of full scale RMS, constant temperature, no averaging
Output Range		Four selectable output formats
Output Averaging		Options are: N = 8, 16, and 32 samples to be averaged
Output Digital Filter, F_c		Single pole low pass with cut-off frequency dependent upon the number of averaged samples, N and T
Out-of-range Data		2.4% above and below range
Power Required	+5 V	500 mA
	+4.3 V	900 mA
	-5 V	0 mA
Terminal Connector		AS-8535-000

B875-111 Parameter Configuration

Parameter and Default Values

Parameter Configuration Window

Parameter Name	Value
MAPPING	WORD (%IW-3X)
INPUTS STARTING ADDRESS	1
INPUTS ENDING ADDRESS	8
INPUT TYPE	BINARY

1 : 140 XBF 3 : B875

Module Configuration

Parameter Name	Value (Default)	Value (Options Available)	Description
Mapping	WORD (%IW-3X)	-	
Inputs Starting Address	1	-	
Inputs Ending Address	8	-	
Input Type	BINARY	BCD	


Mapping Parameter References

	Modsoft, Concept, ProWORX	Unity
Reference Type	Mapped as 8 registers input 3x	Mapped as 8 words input %IWx
Input Type	BIN/BCD	BIN/BCD

B877-111 Parameter Configuration

Parameter and Default Values

Parameter Configuration Window

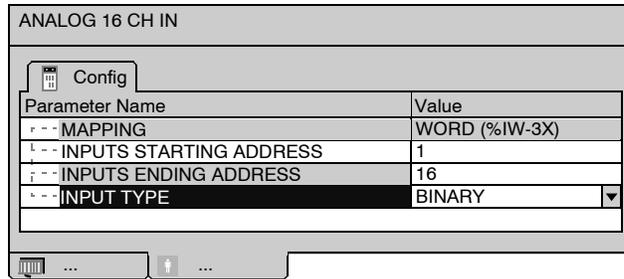

Module Configuration

Parameter Name	Value (Default)	Value (Options Available)	Description
Mapping	WORD (%IW-3X)	-	
Inputs Starting Address	1	-	
Inputs Ending Address	16	-	
Input Type	BINARY	BCD	

Mapping Parameter References

	Modsoft, Concept, ProWORX	Unity
Reference Type	Mapped as 16 registers input 3x	Mapped as 16 words input %IWx
Input Type	BIN/BCD	BIN/BCD

B877-111, Terminal Numbering and Output Connections

Terminal Numbering and Output Connections

The following diagram shows terminal numbering and output connections for the the B877-111 module.

Case GND	1	21	NC
NC	2	22	NC
I/P 1+	3	23	I/P 9+
I/P 2+	4	24	I/P 10+
I/P 1,2-	5	25	I/P 9,10-
NC	6	26	NC
I/P 3+	7	27	I/P 11+
I/P 4+	8	28	I/P 12+
I/P 3,4-	9	29	I/P 11,12-
NC	10	30	NC
I/P 5+	11	31	I/P 13+
I/P 6+	12	32	I/P 14+
I/P 5,6-	13	33	I/P 13,14-
NC	14	34	NC
I/P 7+	15	35	I/P 15+
I/P 8+	16	36	I/P 16+
I/P 7,8-	17	37	I/P 15,16-
NC	18	38	V Ref +
NC	19	39	V Ref -
NC	20	40	Case GND

B875–200 Configurable A/D Input

14

At a Glance

Purpose

This chapter describes the functional and physical characteristics of the B875–200 Configurable A/D Input module.

What's in this Chapter?

This chapter contains the following topics:

Topic	Page
B875–200 Configurable A/D Input, Overview	244
B875–200 Configurable A/D Input, Input Pack Insertion	246
B875–200 Configurable A/D Input, Module Configuration	247
B875–200 Configurable A/D Input, Field Connections	250
B875–200 Configurable A/D Input, Calibration	258
B875–200 Configurable A/D Input, Available Input Packs	261
B875–200 Configurable A/D Input, Input Pack Simplified Schematics	265
B875–200 Configurable A/D Input, Specifications	271
B875-200 Parameter Configuration	273

B875–200 Configurable A/D Input, Overview

General

The B875–200 Configurable A/D Input Module converts a variety of signal sources: thermocouple, RTD, strain gauge/load cell, voltage and current input ranges into binary data. When selected for eight channels, the module is displayed in the I/O map as a B875–200; when selected for four channels, it is displayed in the I/O map as a B873-200.

The module provides the capability to poll a wide array of field devices requiring different signal sources based upon the application selected. Selection may be made from more than 48 available input packs, with any mix per module being acceptable.

Note: Third-party Input Packs

Performance is not guaranteed with third-party 5B type packs. When using third-party packs, contact the manufacturer for support.

An eight-position DIP switch is used to select from one to eight input channels per module. In addition, a two-position jumper is used to select either 0, 2, or 4 samples to be averaged per input. Averaging helps reduce the impact of spurious noise on the input.


Some application examples include food processing, press operating, chemical processing, painting, and foundry casting.

The module has four/eight analog inputs and is capable of updates to all eight channels every 4 ms. The 12-bit resolution for all ranges, and the absolute accuracy is dependent on the input pack type. This allows for fast and precise control of the application.

Note: This module requires two slots.

Simplified Schematic Diagram

Refer to the following simplified schematic diagram for the module.

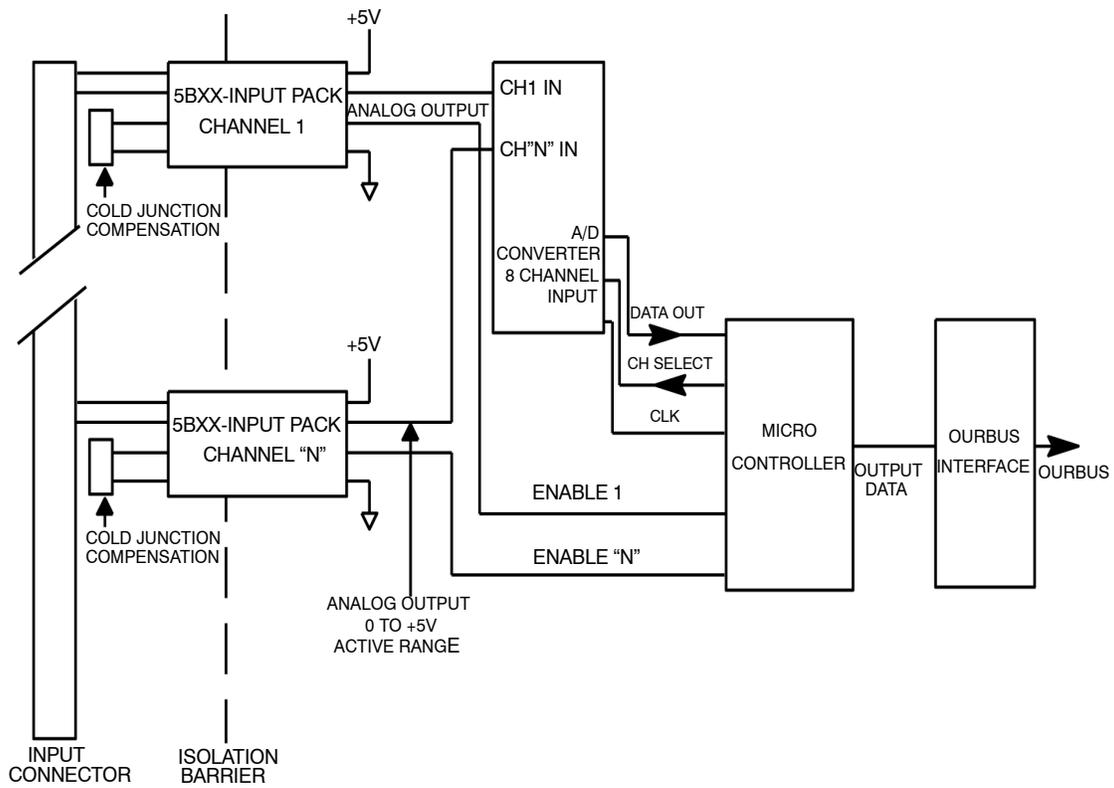

B875–200 Configurable A/D Input, Input Pack Insertion

Input Pack Insertion Procedure

Use the following procedure to insert the required input pack.

Step	Action
1	Remove channel pull-off tabs that correspond with desired input pack placement.
2	Insert input packs into right side of module corresponding to desired channels. Align input pack so that Phillips-head screw is on top and 14 leads are at bottom.
3	Tighten Phillips-head screw. Note: When using either a AS–5B32001A or AS–5B32002A current input pack, a fusible resistor must also be inserted into the board. The proper fusible resistor (Modicon part # AS–0418–000) comes with the current input pack. Note: Always insert the fusible resistor before inserting the input pack. If the fusible resistor is rectangular, ensure that the side with two leads is next to the input pack. Note: Never place the fusible resistor between adjacent channels. This can be detected when the fusible resistor hides the CH on the CHANNEL label on the board.
4	Locate write-on label plate (Modicon part # AS–157A–000) shipped with module. Ensure that input pack catalog numbers and input register numbers for each input pack installed are clearly identified on label.

B875–200 Configurable A/D Input, Module Configuration

Setting the DIP Switch


Use the following procedure to set the eight-position DIP switch.

Step	Action
1	Locate eight-position DIP switch on rear of module. Note: These DIP switches are used to select the desired number of channels, from 1—8.
2	Set DIP switches based upon intended application prior to installation. Refer to module configuration DIP switch settings diagram, below, and to label located on left side of analog input module. Note: The analog input module is shipped with channel 1 ON, B873), DIP switch (SW1) set to ON. The module is I/O mapped as a B873 when only channels 1—4 are in use. The module is I/O mapped as a B875 when more than 4 channels are in use.
3	Ensure all unused DIP switches are kept to the right.

Configuring Settings

Module Configuration DIP Switch Settings, Diagram

MODULE CONFIGURATION SWITCH
8-POSITION DIP-SWITCH
TOP OF MODULE

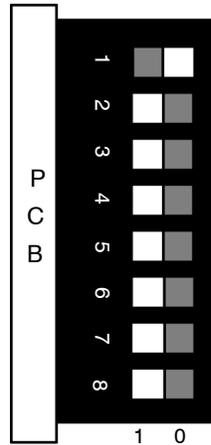

SWITCH TO
FUNCTION
RELATIONSHIP

SW1 = CHANNEL 1
SW2 = CHANNEL 2
SW3 = CHANNEL 3
SW4 = CHANNEL 4
SW5 = CHANNEL 5
SW6 = CHANNEL 6
SW7 = CHANNEL 7
SW8 = CHANNEL 8

SWITCHES

SW1-8

FUNCTIONS

SELECTION OF INPUT CHANNELS
FOR CHANNELS 1-8: (B875)
SW1-8 = L

FOR CHANNELS 1-4: (B873)
SW1-4 = L

CHANNELS/SWITCHES NOT USED. KEEP
TO RIGHT

Note: The B873 mode provides a faster throughput. Ensure that the placement of the input packs correspond with the DIP switch settings.

Sample Averaging Selection

Use the following table to determine the sample averaging selection.


Step	Action
1	Locate access hole on left side of module. Note: This hole allows access to three leads and a two-position jumper, that selects the number of samples to be averaged per input channel: 0, 2, 4 samples to be averaged.
2	Select either 0, 2 or 4 samples to be averaged.
3	Set desired averaging prior to installation. Refer to jumper settings diagram, below, and label located on left side of module. Note: The module is shipped with the jumper set for four samples. Module Configuration DIP Switch Settings, Diagram Jumper located below side access hole determines number of samples to average no average  2 samples  4 samples  Jumper on one leg only Note: Sample averaging helps reduce the impact of serious noise on the input.

B875–200 Configurable A/D Input, Field Connections

General

The module may be wired to accept the following types of packs: current input type; voltage input type; RTD input type; linear thermocouple input type; strain gauge/load cell input type. These input types and their connections are discussed below. Refer to the diagram showing the typical field circuit connections for current inputs, below.

Typical Field Circuit Connections for Current Inputs, Diagram

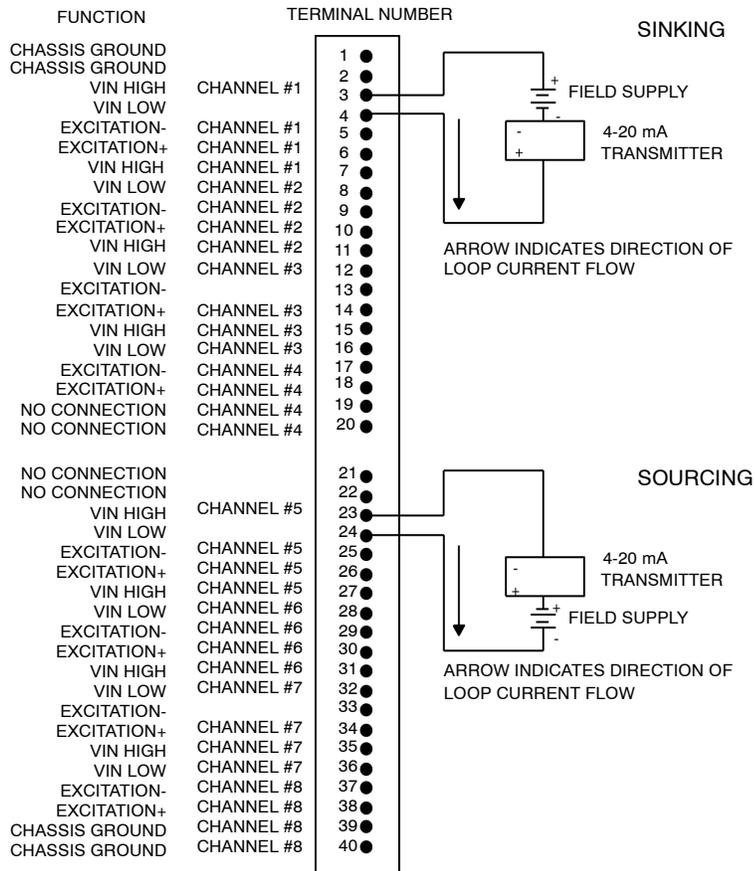

Note: A precision 20 Ω fusible resistor must be installed in each current input channel. The fusible resistor is supplied with each 4 - 20 mA or 0 - 20 mA input pack. The B875-200 may be installed in either the sinking or sourcing configuration.

Each channel is floating. Should you need a ground, you may tie one side of field wiring to chassis ground or use shield wiring with shield tied to chassis ground. Refer to note

**Low Bandwidth
Current Inputs
(AS-5B32)**

Select the channels to be used for current input packs. Current inputs are selected by inserting the input pack, together with a fusible resistor beside the pack, for the appropriate channel. Refer to the typical field circuit connections for current inputs diagram, above, while connecting the field-side wiring to the proper pins on the field connector.

Note: All input packs provide 1500 Vac/2500 Vdc isolation from bus to field wiring. Since any floating inputs may be exposed to static charges as high as 15 kV, connect one of the signal input leads to chassis ground either directly or through a resistor in the range of 1kW—10MW. Use the chassis ground at terminals 1, 2, 39 or 40. If the signal source used with an input has a dc signal path to chassis ground, no additional path is required at the B875 end of the field wiring.

Note: Channels are set independently. Any of the pack types identified above can be intermixed.

**Low and Wide
Bandwidths
(AS-5B30/31 and
AS-5B40/41)
Voltage Inputs**

Note the channels to receive the voltage inputs. Voltage inputs are selected by inserting the input pack for the appropriate channel. Refer to the following drawing, and connect field-side wiring to the proper pins on the field connector.
Typical Field Circuit Connections for Voltage Inputs, Diagram

FUNCTION		TERMINAL NUMBER	
CHASSIS GROUND		1	
CHASSIS GROUND	CHANNEL #1	2	
VIN HIGH		3	VOLTAGE
VIN LOW	CHANNEL #1	4	SIGNAL
EXCITATION -	CHANNEL #1	5	SOURCE
EXCITATION +	CHANNEL #1	6	


NOTE: VOLTAGE WIDE BANDWIDTH INPUT PACKS ARE SIGNIFICANTLY MORE SENSITIVE TO NOISE ON INPUT LINES. LOW BANDWIDTH PACKS ARE RECOMMENDED FOR GENERAL PURPOSE INPUT VOLTAGE USAGE.

Note: The shield-type shown is recommended. One side of the signal source may be connected to chassis ground when using twisted pair wiring.

Note: Channels are set independently. Any mixture of current, voltage, RTD, linear thermocouple, or strain gauge/load cell may be used as inputs.

**RTD (AS-5B34)
Inputs**

Note the channels designated to receive RTD inputs. RTD inputs are selected by inserting the input pack for the appropriate channel. Refer to the diagram below and connect the field-side wiring to the proper pins on the field connector.
Typical Field Circuit connections for RTD Inputs, Diagram

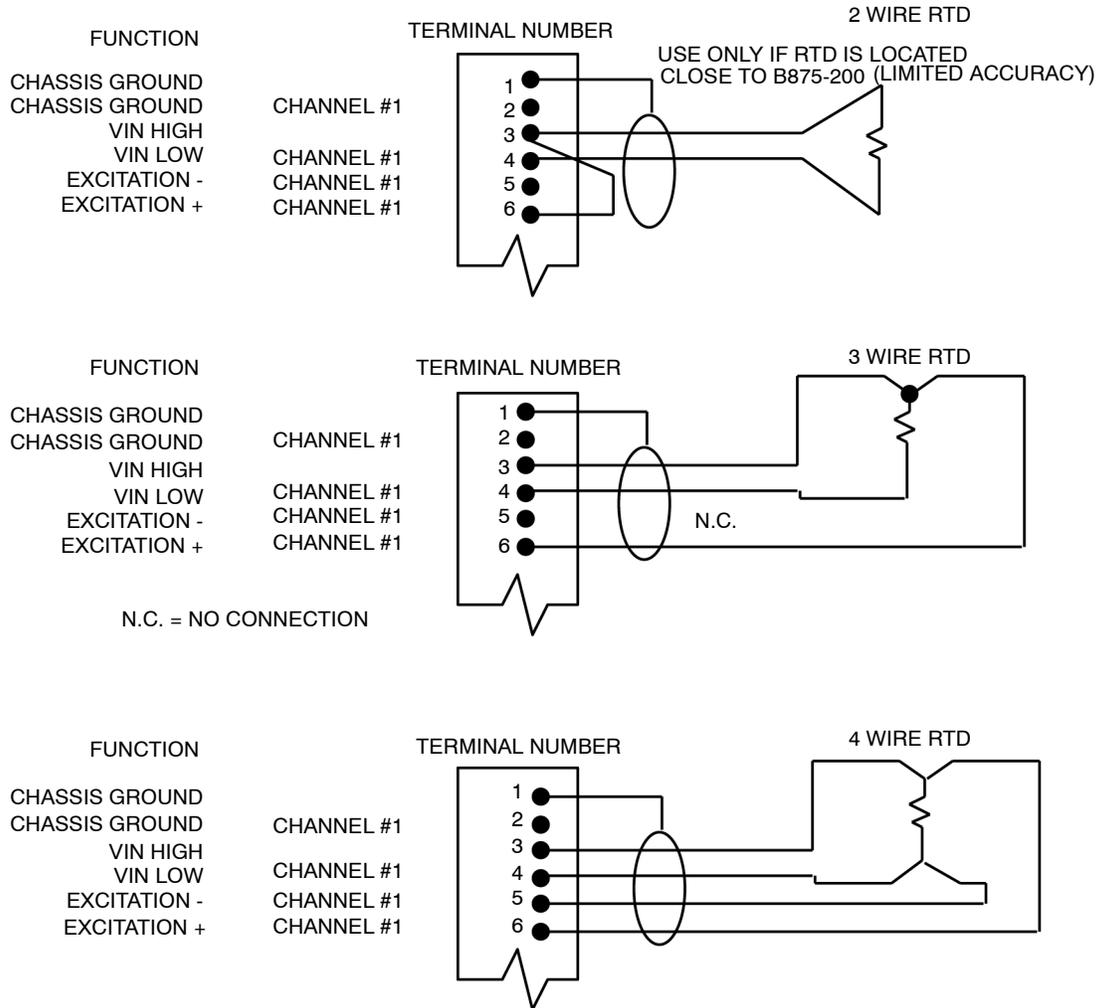


Note: The shield-type shown is recommended. One side of the signal source may be connected to chassis ground when using twisted pair wiring.

Note: Channels are set independently. Any mixture of current, voltage, RTD, linear thermocouple, or strain gauge/load cell may be used as inputs.

Linear Thermocouple (AS-5B47)

Note the channels designated to receive linear thermocouple inputs. Linear thermocouple inputs are selected by inserting the input pack for the appropriate channel. Refer to the diagram below and connect the field-side wiring to the proper pins on the field connector.

Typical Field Circuit Connections for Linear Thermocouple Inputs, Diagram

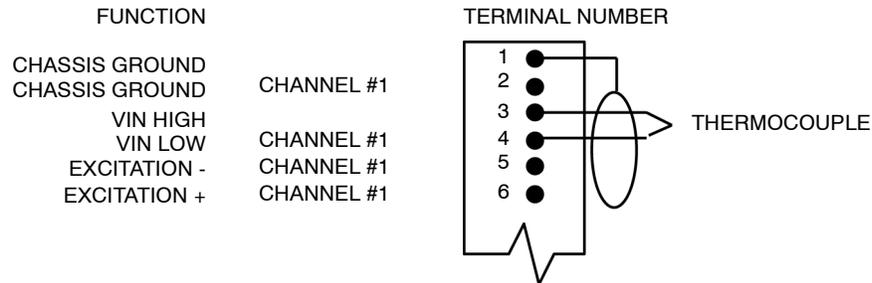

NOTE: THERMOCOUPLE MUST BE OF THE TYPE DESIGNATED BY THE DASH NUMBER OF THE AS-5B47 INPUT PACK IN USE. COLD JUNCTION COMPENSATION IS DONE BY A TEMPERATURE SENSOR LOCATED IMMEDIATELY BEHIND THE CONNECTOR BLOCK.


Note: The shield-type shown is recommended. One side of the signal source may be connected to chassis ground when using twisted pair wiring.

Note: Channels are set independently. Any mixture of current, voltage, RTD, linear thermocouple, or strain gauge/load cell may be used as inputs.

**Strain Gauge/
Load Cell, 0—+5
V Output (AS-
5B38)**

Note the channels designated to receive strain gauge/load cell inputs. Strain gauge/load cell inputs are selected by inserting the input pack for the appropriate channel. Refer to the diagram below and connect the field-side wiring to the proper pins on the field connector.

Typical Field Circuit Connections for Strain Gauge/Load cell Inputs

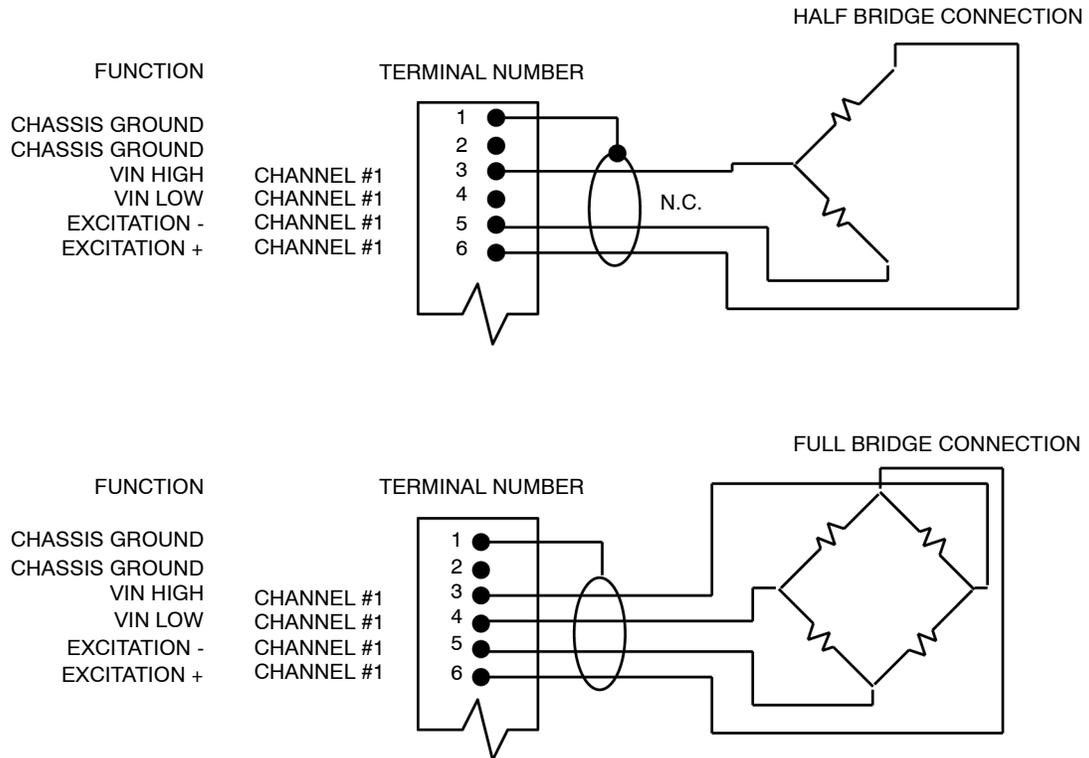

NOTE: CONNECTION MUST BE SUCH THAT STRAIN IN NORMAL DIRECTION OF APPLICATION RESULTS IN A POSITIVE OUTPUT VOLTAGE APPLIED TO VIN HIGH. WIRING TO PINS 5 AND 6 MAY BE REVERSED IF OUTPUT IS NEGATIVE.

Note: The shield-type shown is recommended. One side of the signal source may be connected to chassis ground when using twisted pair wiring.


Note: Channels are set independently. Any mixture of current, voltage, RTD, linear thermocouple, or strain gauge/load cell may be used as inputs.

Securing the Module

Use the following procedure to secure the module.

Step	Action
1	Reinstall any module temporarily removed
2	When using key pins (provided with housing shipment), install them above and below housing slot selected.
3	Carefully insert module into housing firmly, seating edge connector in backplane.
4	Secure module to housing using captive slotted mounting screws at top and bottom of module's front panel.
5	Locate write-on label plate (Modicon Part No. AS-157A-000). Write input pack catalog numbers and input register numbers for each installed input pack.
6	Insert write-on label plate on right side of installed module. Using two standard screws supplied, tighten them into upper and lower portions of housing slot as shown in following diagram.

Write-on label Plate Placement, Diagram

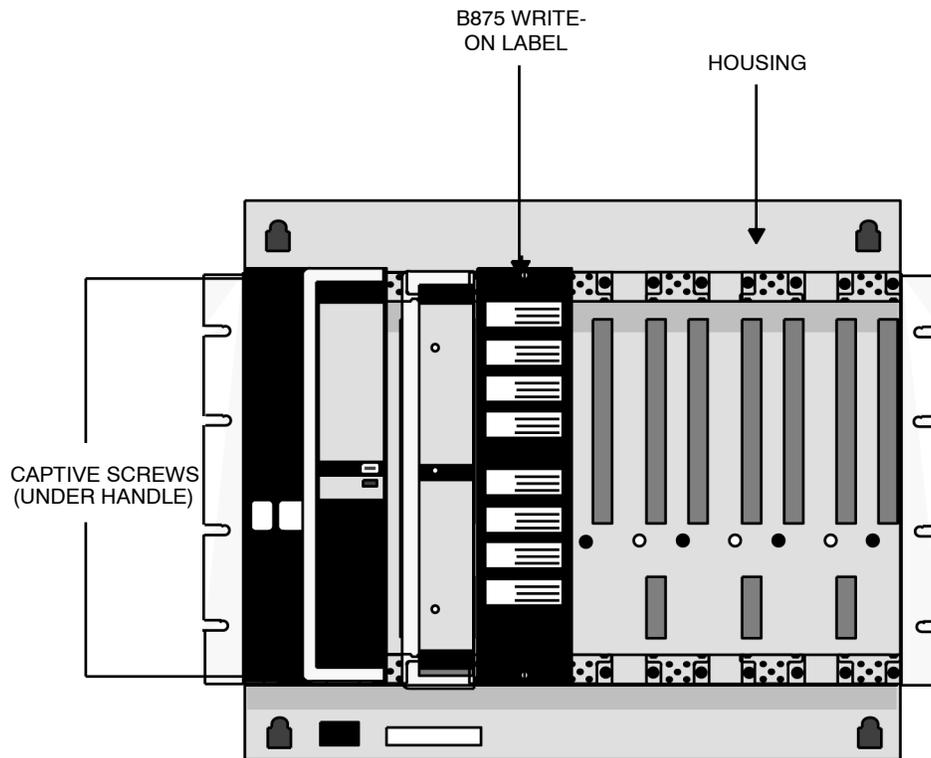

Note: Ensure that all input packs are removed prior to returning module to Modicon for repair.

B875–200 Configurable A/D Input, Calibration

General

The analog input module is calibrated at the factory prior to shipment. To ensure the module's accuracy, the trim-pot should be calibrated regularly on a yearly interval. The following tools and materials are needed to calibrate a configurable A/D input module:

- A precision digital readout voltmeter with an accuracy of 0.0001 V on a 10 V scale.
- A 1/8-inch bit, thin-blade screwdriver.
- A 1/4-inch Phillips-head screwdriver.


Note: Calibration is not recommended for Analog Current, Low Bandwidth, 4–20 mA (AS–5B32001A) type input packs because of their reduced accuracy

Calibration of a given channel involves calibration of all eight channels of this module. There is no provision to calibrate a particular channel. Therefore, calibration can be performed with any one channel with any type of input pack. Calibration does require the calibration signals to pass through an input pack.

Note: Improper Calibration

If the particular input pack used in calibration is out of calibration, then all B875 modules calibrated with this input pack will be improperly calibrated.


Location of Trim Pot, Diagram

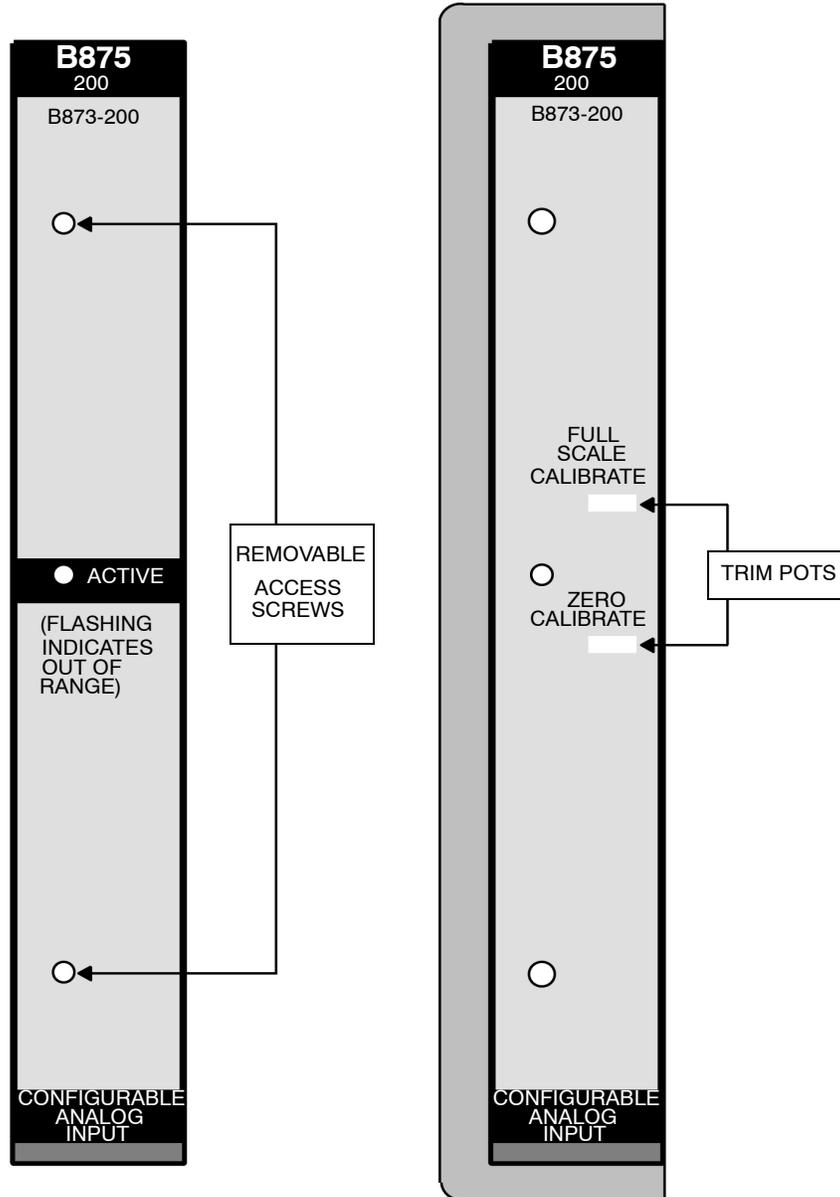

Use the following procedure to calibrate the module. The input pack used in this procedure is used only as an example. A five-minute warm-up time is recommended prior to calibration.

Step	Action
1	To access both trim pots, remove two screws and label located on front panel of module, as shown on location of trim-pot diagram, above. Note: The top trim-pot adjusts the total magnitude of the range (full scale). The bottom trim-pot adjusts the zero offset scale.
2	Open module handle to expose connectors and terminals.
3	Install an input pack in any channel, and connect an appropriate signal source to that channel. Refer to voltmeter connections diagram, below.
4	Apply input signal to selected channel which represents zero signal (zero volts when using Analog, V input pack, Low Bandwidth, 0 to +10V (AS--5B31003A)). On programming panel observe input from B875 for selected channel. Adjust zero cal control (R29) as required to read 0000.
5	Apply input signal that results in output between 80 to 90% of full scale. Use 9.375 V if calibrating with an Analog, V input pack, Low Bandwidth, 0 to +10V (AS--5B31003A). Resultant reading should be set for 0F00 Hex, or 3840 decimal with full scale calibration control (R57).
6	Repeat previous two steps until readings are correct at both zero and near-full-scale points.
7	After calibration is complete, disconnect voltmeter, return connections to their original state, close module handle, and replace front label that covers trim-pot.

Voltmeter Connections Diagram

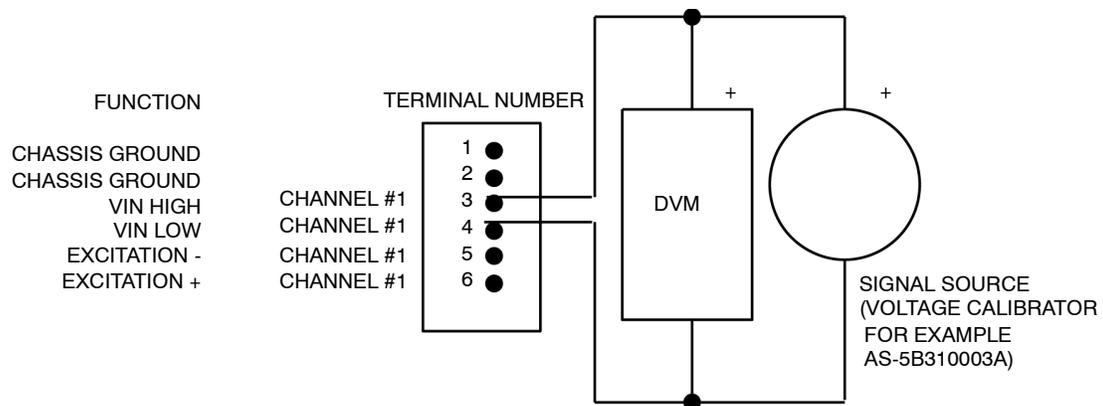

B875–200 Configurable A/D Input, Available Input Packs

General

The module accepts up to eight input packs of any mix. Six categories are available

- Voltage, low bandwidth
- Current, low bandwidth
- RTD
- Strain gauge
- Voltage, wide bandwidth
- Linear thermocouple

Refer to the following tables for the desired input range, output range, and part number required for the intended application.

Note: 5B type third party packs

When using third party packs, contact the manufacturer for support.

Note: Input packs are issued as revision level A's, denoted by the last item of the part number, for example, (AS–5B30001A). Changes will be noted by higher revision levels.

Note: The usable output range for all AS–5BXX input packs is 0—+5 V when used with this module.

**Low Bandwidth
(4 kHz) Analog
Voltage Input
Packs**

The following table presents the part numbers and input ranges for the available low bandwidth analog voltage input packs.

Part Number	Input Range
AS-5B30001A	0—10 mV
AS-5B30002A	0—50 mV
AS-5B30003A	0—100 mV
AS-5B30004A	-10—+10 mV
AS-5B30005A	-50—+50 mV
AS-5B30006A	-100—+100 mV
AS-5B31001A	0—1 V
AS-5B31002A	0—5 V
AS-5B31003A	0— +10 V
AS-5B31004A	-1— +1 V
AS-5B31005A	-5— +5 V
AS-5B31006A	-10— +10 V

**Low Bandwidth
(4 kHz) Analog
Current Input
Packs**

The following table presents the part numbers and input ranges for the available low bandwidth analog current input packs.

Part Number	Input Range
AS-5B32001A	4—20 mA
AS-5B32002A	0—20 mA

Note: Each current input pack (4—20 mA) comes with a fusible resistor that must be inserted in addition to the input pack.

**Low bandwidth
(4k Hz) RTD Input
Packs**

The following table presents the part numbers, types, and input ranges for the available low bandwidth RTD input packs.

Part Number	Type	Input Range
AS-5B34P01A	100 Ω Pt	-100— +100°C (-148— +212°F)
AS-5B34P02A	100 Ω Pt	0—100°C (32—212°F)
AS-5B34P03A	100 Ω Pt	0—200°C (32—392°F)
AS-5B34P04A	100 Ω Pt	0—600°C (32—1112°F)
AS-5B34C01A	100 Ω Cu @ 0°C	0—120°C (32—248°F)
AS-5B34C02A	100 Ω Cu @ 25°C	0—120°C (32—248°F)
AS-5B34N01A	120 Ω Ni	0—300°C (32—572°F)

**Wide Bandwidth
(10 kHz) Strain
Gauge/Load Cell
Input Packs**

The following table presents the part numbers and input ranges for the available wide bandwidth strain gauge/load cell input packs.

Part Number	Input Range
AS-5B38002A	3 mV/V, Full Bridge
AS-5B38004A	3 mV/V, Half Bridge
AS-5B38005A	2 mV/V, Full Bridge

Note: Isolated strain gauge input to 10 kHz bandwidth, all have 10.0 V excitation for bridges with resistance range of 300W to 10kW.

Wide Bandwidth (10 kHz) Analog Voltage Input Packs

The following table presents the part numbers and input ranges for the available wide bandwidth analog voltage input packs.

Part Number	Input Range
AS-5B40001A	0—10 mV
AS-5B40002A	0—50 mV
AS-5B40003A	0—100 mV
AS-5B40004A	-10— +10 mV
AS-5B40005A	-50— +50 mV
AS-5B40006A	-100— +100 mV
AS-5B41001A	0—1 V
AS-5B41002A	0—5 V
AS-5B41003A	0—10 V
AS-5B41004A	-1— +1 V
AS-5B41005A	-5— +5 V
AS-5B41006A	-10— +10 V

Note: Wide bandwidth input packs are only used for high-speed applications. They are more susceptible to external noise levels, and require careful routing and shielding of input signal leads.

Linear Thermocouple Input Packs


The following table presents the part numbers, types, and input ranges for the available linear thermocouple input packs.

Part Number	Type	Input Range
AS-5B47J01A	J	0—760°C (32—1400°F)
AS-5B47J02A	J	-100— +300°C (-148—572°F)
AS-5B47J03A	J	0—500°C (32—932°F)
AS-5B47K04A	K	0—1000°C (32—1832°F)
AS-5B47K05A	K	0—500°C (32—932°F)
AS-5B47T06A	T	-100— +400°C (-148—752°F)
AS-5B47T07A	T	0—200°C (32—392°F)
AS-5B47E08A	E	0—1000°C (32—1832°F)
AS-5B47R09A	R	500—1750°C (932—3182°F)
AS-5B47S10A	S	500—1750°C (932—3182°F)
AS-5B47B11A	B	500—1800°C (932—3272°F)

B875–200 Configurable A/D Input, Input Pack Simplified Schematics


Typical Analog mV (5B30) Simplified Schematic

Simplified schematic diagrams for all types of input packs are shown below.
The typical analog mV (5B30) schematic diagram is shown below.

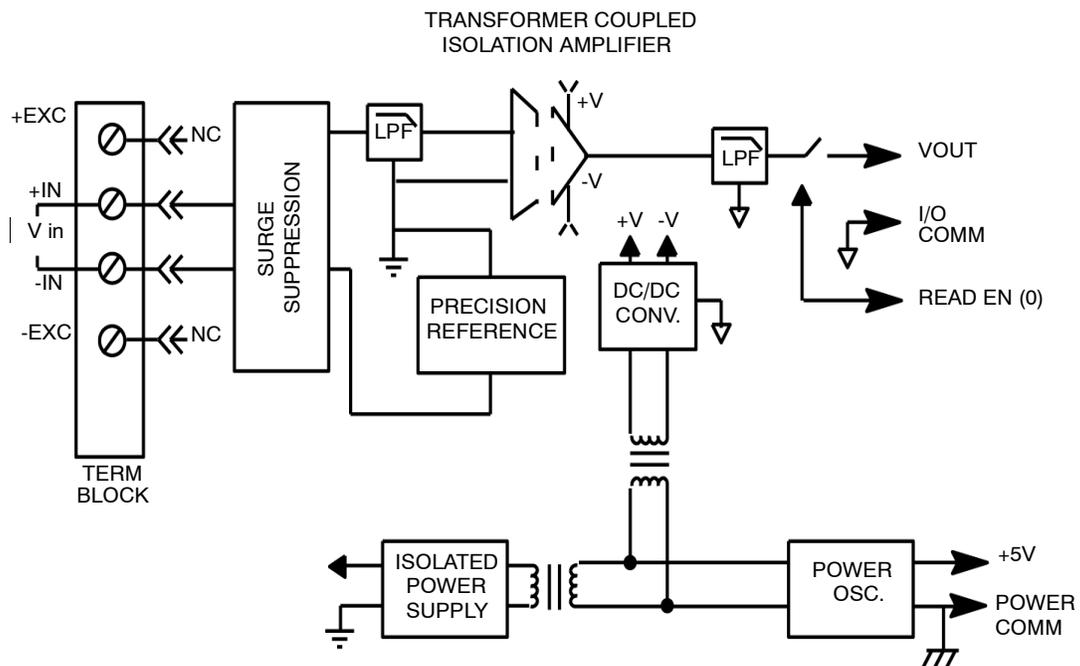


Typical Analog Current (5B32) Simplified Schematic Diagram

The typical analog current (5B32) schematic diagram is shown below.

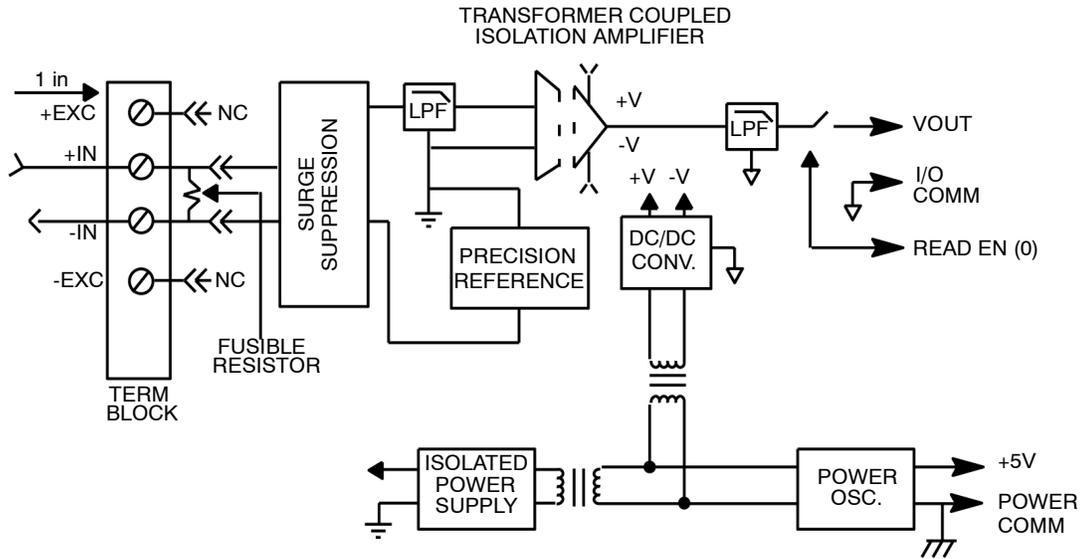


**Typical RTD
(5B34) Simplified
Schematic
Diagram**

The typical RTD (5B34) schematic diagram is shown below.

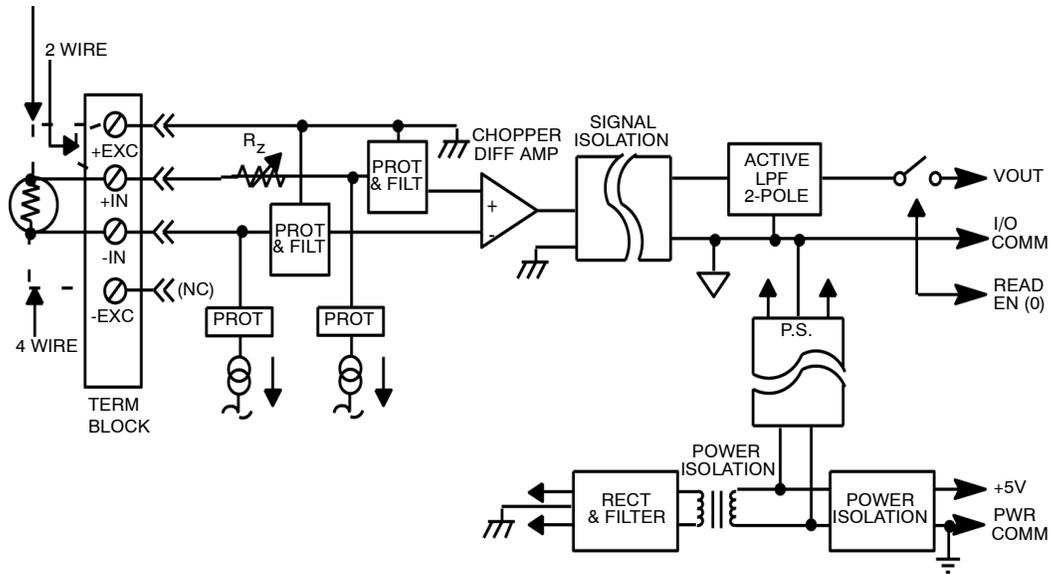


Typical Strain gauge/Load Cell (5B38) Simplified Schematic Diagram

The typical strain gauge/load cell (5B38) schematic diagram is shown below.

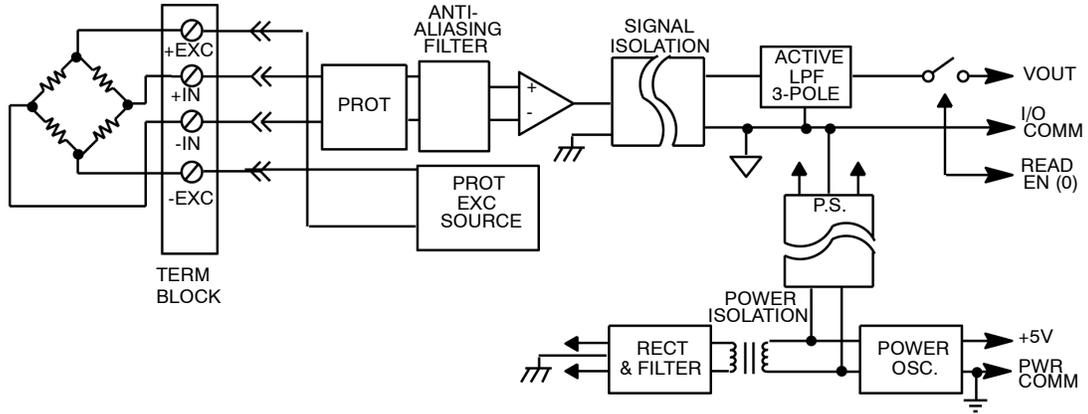


**Typical Analog
Voltage (5B40
and 5B41)
Simplified
Schematic
Diagram**

The typical analog voltage (5B40 and 5B41) schematic diagram is shown below.

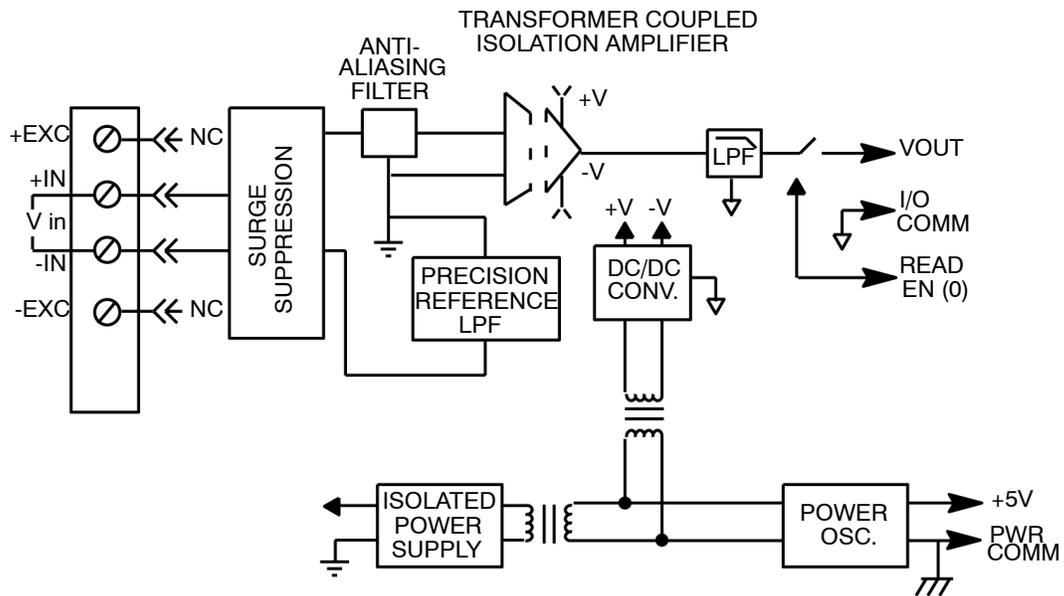


Typical Linear Thermocouple (5B47) Simplified Schematic Diagram

The typical linear thermocouple (5B47) schematic diagram is shown below.

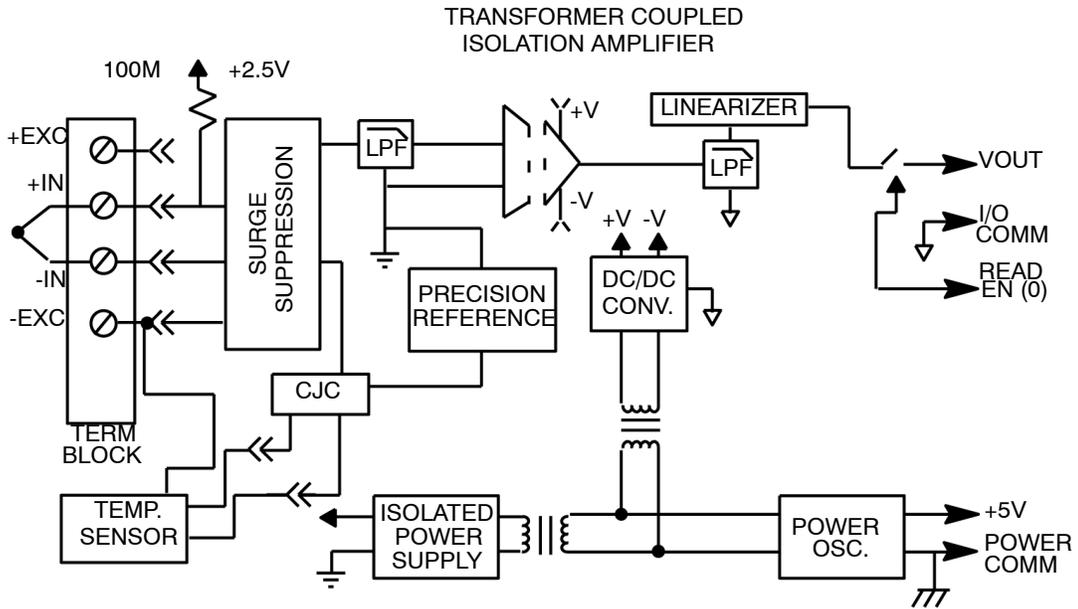

B875–200 Configurable A/D Input, Specifications

Specification Table The following tables provides the specifications for the unit.

B875-200 Specifications		
Analog Channels	B873-200 in I/O Map	Four
	B875-200 in I/O Map	Eight
Voltage Range	Varies with selected input pack	
Current Range		
Thermocouple Types		
RTD Types		
Strain Gauge/Load Cell Types		
Input Filter	Three pole or more low pass, with -3dB cut-off frequency of 4 Hz, 10% on low-band units, 10 kHz 10% on wide bandwidth units	
Input Resistance	Current Mode	20 Ω
	Voltage Mode	Refer to voltage mode table, below
Input Protection Normal Mode	All input packs can withstand 240 V RMS without damage, however, the fusible resistor used with the current input packs will be destroyed by overcurrent conditions	
Note: Input over range or under range on an input pack will not produce reading errors on adjacent channels in excess of 1 count.		
Common Mode	Each input pack can withstand 1500 V RMS	
Rejection	In excess of 140 dB for all input packs except AS–5B40 and AS–5B41 which are 80 dB	
Input Isolation	Input to OURBUS	1500 Vac RMS or 2500 Vdc for 1 minute
	Input to Case	1500 Vac RMS or 2500 Vdc for 1 minute
	Input to Input	1500 Vac RMS or 2500 Vdc for 1 minute
Conversion Resolution	12 bits all ranges	
Out of Range Data	Four counts above and below range	
Out of Range Error (flags)	Refer to out-of-range error table, below.	
Out of Range Error (Flags)	<div style="text-align: center;"> MSB LSB  Bit 15 14 0 Bits 15 and 14 = Out of range </div>	
Input Averaging	Options are 0, 2, or 4 samples	
Throughput	1.7 ms typical for 4 channels, 4 ms for eight channels maximum	
Power Required	+5 V	550 mA
	+4.3 V	10 mA
	-5 V	0 mA
Terminal Connector	AS-8535-000	

The following table provides the resistance values for the voltage mode for the indicated input pack numbers.

Pack Number	In Range	Power Off and/or Over Range
AS-5B30	5 M Ω	40 k Ω
AS-5B31	650 k Ω	650 k Ω
AS-5B40	200 M Ω	40 k Ω
AS-5B41	650 k Ω	650 k Ω

The following table provides data on out-of-range errors (flags)

Data Flagged	Description
Not Ready	Bit 14 set high (4000 Hex)
Over Range	Bit 15 set high (800x Hex, x=1—4 bits over range)
Under Range	Bits 14 and 15 set high (c00xHex, x=1—4 bits under range)
Normal Data	Bits 14 and 15 are low, normal data range is 0—4095 (0—1FFF Hex)

The following table provides data on the accuracy of the input packs.

Input Pack	Calibration Accuracy at 25°C	*Accuracy Over Temp 0—60°C	Nonlinearity	Gain Drift***	Offset Drift***
AS-5B30 AS-5B40 Unipolar	0.15	0.73	0.05	.007%/°C	.008%/°C
Bipolar	0.20	0.78	0.05	.007%/°C	.008%/°C
AS-5B31 AS-5B41 Unipolar	0.15	0.62	0.05	.01%/°C	.002%/°C
Bipolar	0.20	0.67	0.05	.01%/°C	.002%/°C
AS-5B32	0.25	0.70	0.05	.01%/°C	.001%/°C
AS-5B47	0.1 1°C**	0.4 2°C	0.05	.007%/°C	1 V%/°C typ
AS-5B38	0.15	0.80	0.05	.010%/°C	1 V%/°C typ
AS-5B34	0.15	2.0	0.05	.01%/°C	.04%/°C
Unless noted all entries are% of full scale.					
*Accuracy = Calibration + gain drift + offset + non linearity for the range 0—60°C ambient.					
**Calibration accuracy for types J, K, T. For types R & S = 4°C. For type B = 6°C.					
***Both gain and offset drift are from 25°C.					

B875-200 Parameter Configuration

Parameter and Default Values

Parameter Configuration Window

Parameter Name	Value
MAPPING	WORD (%IW-3X)
INPUTS STARTING ADDRESS	1
INPUTS ENDING ADDRESS	8
INPUT TYPE	BINARY


Module Configuration

Parameter Name	Value (Default)	Value (Options Available)	Description
Mapping	WORD (%IW-3X)	-	
Inputs Starting Address	1	-	
Inputs Ending Address	8	-	
Input Type	BINARY	BCD	

Mapping Parameter References

	Modsoft, Concept, ProWORX	Unity
Reference Type	Mapped as 8 registers input 3x	Mapped as 8 words input %IWx
Input Type	BIN/BCD	BIN/BCD

800 Series Discrete I/O Modules



IV

Introduction

At a Glance

This part provides a detailed description of the 800 Series discrete I/O modules. It includes technical data and wiring information for each module.

What's in this Part? This part contains the following chapters:

Chapter	Chapter Name	Page
15	B802–008 115 Vac Output	279
16	B803–008 115 Vac Input	285
17	B804–116 115 Vac Output	291
18	B804–148 48 Vac Output	297
19	B805–016 115 Vac Input	303
20	B806–032 115 Vac Output	309
21	B806–124 24 Vac Output	317
22	B807–132 115 Vac Input	323
23	B808–016 230 Vac Output	331
24	B809–016 230 Vac Input	337
25	B810–008 115 Vac Isolated Output	343
26	B814–108 Relay Output	349
27	B816 Isolated Output	355
28	B817–116 and B817–216 115/230 Vac Isolated Input	357
29	B818 24 Vac Output	365
30	B819–232 230 Vac Input	371
31	B820–008 10–60 Vdc Output	377
32	B821–108 10–60 Vdc Input (True High)	383
33	B824–016 24 Vdc Output (True High)	389
34	B825–016 24 Vdc Input (True High)	395
35	B826–032 24 Vdc Output (True High)	401
36	B827–032 24 Vdc Input (True High)	403
37	B828–016 5 V TTL Output	409
38	B829–116 Fast Response 5 V TTL Input	415
39	B832–016 24 Vdc Output (True Low)	421
40	B833–016 24 Vdc Input (True Low)	427
41	B836–016 12–250 Vdc Isolated Output	433
42	B837–016 24 Vac/Vdc Input (True High)	439
43	B838–032 24 Vdc Output (True High)	445
44	B840–108 Relay Output	451
45	B842–008 Reed Relay Output	457
46	B849–016 48 Vac/Vdc Input (True High)	463

Chapter	Chapter Name	Page
47	B853-016 115 Vac/125 Vdc Input (True High)	469
48	855-016 Intrinsically Safe Input	475
49	B862-001 Register Output	485
50	B863-032 Monitored 24 Vdc Input	493
51	B863-132 24 Vdc Input	499
52	B864-001 Register Output	507
53	B865-001 Register Input	515
54	B868-001 Register Output	525
55	B869-002 Register Input	535
56	B881-001 Latched 24 Vdc Input	545
57	B881-508 125 Vdc Output	553
58	B882-032 24 Vdc Diagnostic Output and B818 20-28 Vac Discrete Output	559
59	B882-116 24 Vdc Output	571

B802–008 115 Vac Output

15

At a Glance

Purpose

This chapter describes the functional and physical characteristics of the B802–008 115 Vac Output module.

What's in this Chapter?

This chapter contains the following topics:

Topic	Page
B802–008 115 Vac Output, Overview	280
B802–008 115 Vac Output, Field Connections	281
B802–008 48 Vac Output, Specifications	282
B802–008 Parameter Configuration	283

B802-008 115 Vac Output, Overview

General Characteristics


The B802-008 115 Vac Output Module converts logic signals used within the PLC into eight independent 115 Vac outputs. Each output is capable of driving a relay, pilot lamp, motor starter, solenoid, or any other load up to 2.0 A.

The B802-008 is capable of handling a total continuous current of 12 A. The module uses triac switches to control loads connected to an external power source. These switches are designed to withstand the high surge currents typical of industrial loads.

Simplified Schematic

The module's eight outputs are separated into four groups of two outputs each. An LED indicator lights when an output is ON.

Following is a simplified schematic of the B802-008 115 Vac output module.

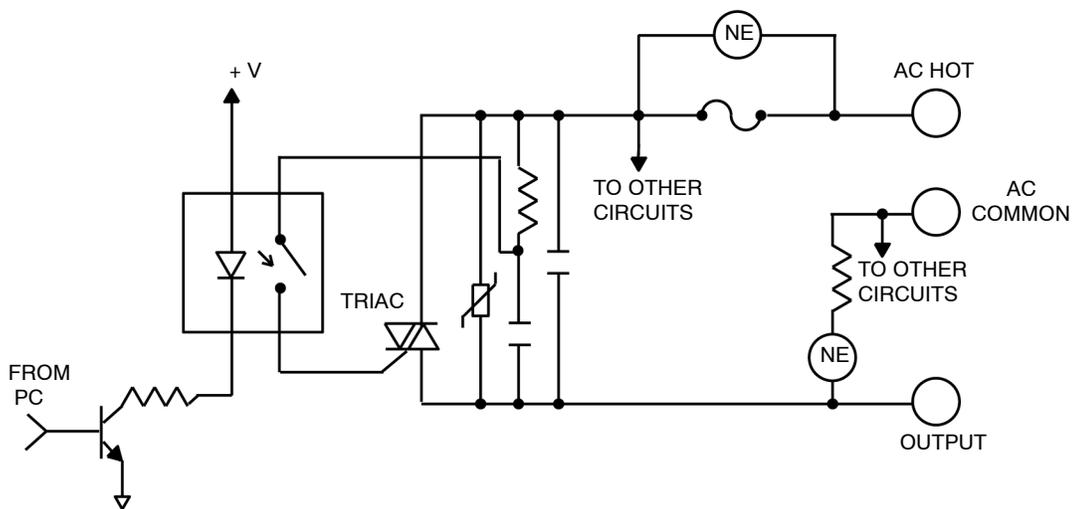


B802-008 115 Vac Output, Field Connections

Overview

User connections are made to a standard screw terminal strip. The rigid wiring system permits module insertion or removal without disturbing the wiring.

Terminal Numbering and Output Connections

The following diagram shows terminal numbering and output connections for the the B802-008 module.

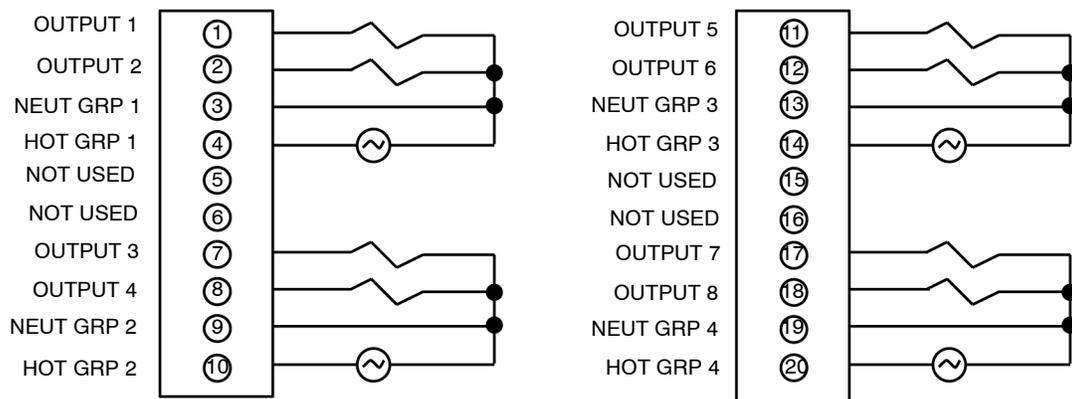

B802-008 48 Vac Output, Specifications

Specification Table

The following table provides the specifications for the unit.

B802-008 Specifications		
Description		115 Vac Output
Number of Points		8
Operating Voltage		80—130 Vac continuous /47—63 Hz
Number of Groups		4
Outputs/group		2
ON Current	Maximum/point	2 A continuous
	Maximum/module	12.0 A
Surge Current		50 A (max)1 cycle/circuit
ON Voltage Drop		1.3 V @ 2.0 A
Maximum OFF	Leakage Current	3 mA @ 115 Vac
	Maximum ON Current	50 mA @ 115 Vac
Maximum Response Time	OFF→ON	8.3 ms @ 60 Hz
	ON→OFF	8.3 ms @ 60 Hz
dv/dt		100 V/s
	Commutating	5 V/s
Power Required	+5 V	76 mA
	+4.3 V	240 mA
	-5 V	0 mA
Terminal Connector		AS-8534-000
Fusing		One/group, Type 3 AG, 6 A (normal blow)

B802-008 Parameter Configuration

Parameter and Default Values

Parameter Configuration Window

Parameter Name	Value
MAPPING	BIT (%M-0X)
OUTPUTS STARTING ADDRESS	1
OUTPUTS ENDING ADDRESS	8
OUTPUT TYPE	BINARY

1 : 140 XBF 3 : B802

Module Configuration

Parameter Name	Value (Default)	Value (Options Available)	Description
Mapping	BIT (%M-0X)	WORD (%MW-4X)	
Outputs Starting Address	1	1	
Outputs Ending Address	8	1	
Output Type	BINARY	BCD	

Mapping Parameter References

	Modsoft, Concept, ProWORX	Unity
Reference Type	Mapped as 8 bits output 0x or Mapped as 1 register output 4x	Mapped as 8 bits output %M or Mapped as 1 word output %MWx
Output Type	BIN/BCD	BIN/BCD

B803–008 115 Vac Input

16

At a Glance

Purpose

This chapter describes the functional and physical characteristics of the B803–008 115 Vac Input module.

What's in this Chapter?

This chapter contains the following topics:

Topic	Page
B803–008 115 Vac Input, Overview	286
B803–008 115 Vac Input, Field Connections	287
B803–008 115 Vac Input, Specifications	288
B803–008 Parameter Configuration	289


B803-008 115 Vac Input, Overview

General Characteristics

The B803-008 115 Vac Input Module senses and converts switched input signals into logic voltage levels used by the PLC into 8 independent 115 Vac outputs. The module allows for up to eight independently sensed inputs. These inputs can be received from push buttons, limit and proximity switches, as well as other 115 Vac sources.

Simplified Schematic

Following is a simplified schematic of the B803-008 115 Vac Input Module.

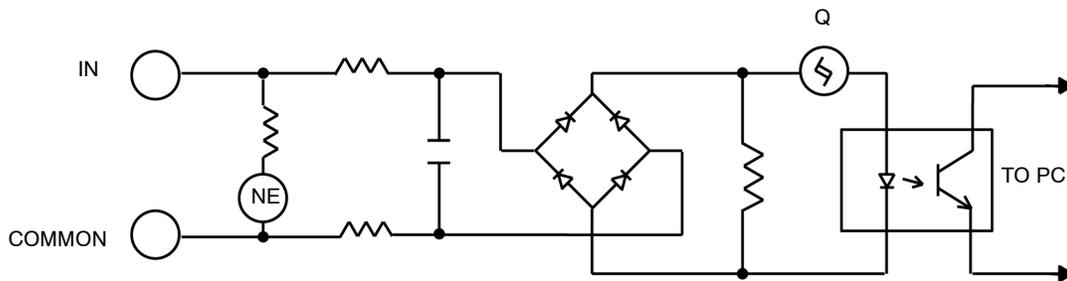


B803–008 115 Vac Input, Field Connections

Overview

User connections are made to a standard screw terminal strip. The rigid wiring system permits module insertion or removal without disturbing the wiring.

Terminal Numbering and Input Connections

The following diagram shows terminal numbering and input connections for the B803–008 module.

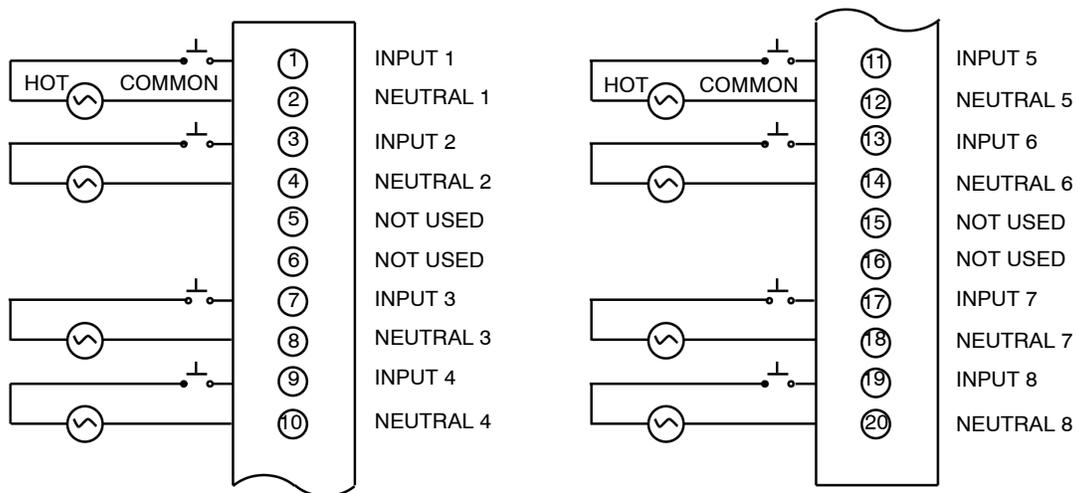

B803–008 115 Vac Input, Specifications

Specification Table

The following table provides the specifications for the unit.

B803-008 Specifications		
Description		115 Vac Isolated Input
Number of Points		8
Operating Range Voltage		80—130 Vac/47—63 Hz
Number of Groups		8
Inputs/group		1
Maximum Input Voltage	Continuous	130 Vac
	Surge	220 Vac for 1 cycle
ON Condition		80—130 Vac (source impedance < 1 k Ω)
Threshold Voltage		60 15 V RMS
OFF Condition		0—35 Vac (source impedance)=0 Ω 0—130 Vac (source impedance \geq 40 k Ω)
Maximum/Module		
ON Current		7 mA (typical @ 115 Vac)
Maximum Response Time	OFF→ON	6 ms (4 ms typical)
	ON→OFF	18 ms (12 ms typical)
Power Required	+5 V	27 mA
	+4.3 V	1 mA
	-5 V	2 mA
Terminal Connector		AS-8534-000

B803-008 Parameter Configuration

Parameter and Default Values

Parameter Configuration Window

Parameter Name	Value
MAPPING	BIT (%I-1X)
INPUTS STARTING ADDRESS	1
INPUTS ENDING ADDRESS	8
INPUT TYPE	BINARY

1 : 140 XBF 3 : B803

Module Configuration

Parameter Name	Value (Default)	Value (Options Available)	Description
Mapping	BIT (%I-1X)	WORD (%IW-3X)	
Inputs Starting Address	1	1	
Inputs Ending Address	8	1	
Input Type	BINARY	BCD	

Mapping Parameter References

	Modsoft, Concept, ProWORX	Unity
Reference Type	Mapped as 8 bits input 1x or Mapped as 1 register input 3x	Mapped as 8 bits input %Ix or Mapped as 1 word input %IWx
Input Type	BIN/BCD	BIN/BCD

B804–116 115 Vac Output

17

At a Glance

Purpose

This chapter describes the functional and physical characteristics of the B804–116 115 Vac Output Module.

What's in this Chapter?

This chapter contains the following topics:

Topic	Page
B804–116 115 Vac Output, Overview	292
B804–116 115 Vac Output, Field Connections	293
B804–116 48 Vac Output, Specifications	294
B804–116 Parameter Configuration	295

B804-116 115 Vac Output, Overview


General Characteristics

The B804-116 115 Vac Output Module converts logic signals used in the PLC into 16 independent 115 Vac outputs. Each output is capable of driving a relay, pilot lamp, motor starter, solenoid, or any other load up to 2.0 A.

The B804-116 is capable of handling a total continuous current of 6 A/group of eight points and 12 A/module. The module uses triac switches to control loads connected to an external power source. These switches are designed to withstand the high surge currents typical of industrial loads.

Simplified Schematic

Following is a simplified schematic of the B804-116 115 Vac Output Module.

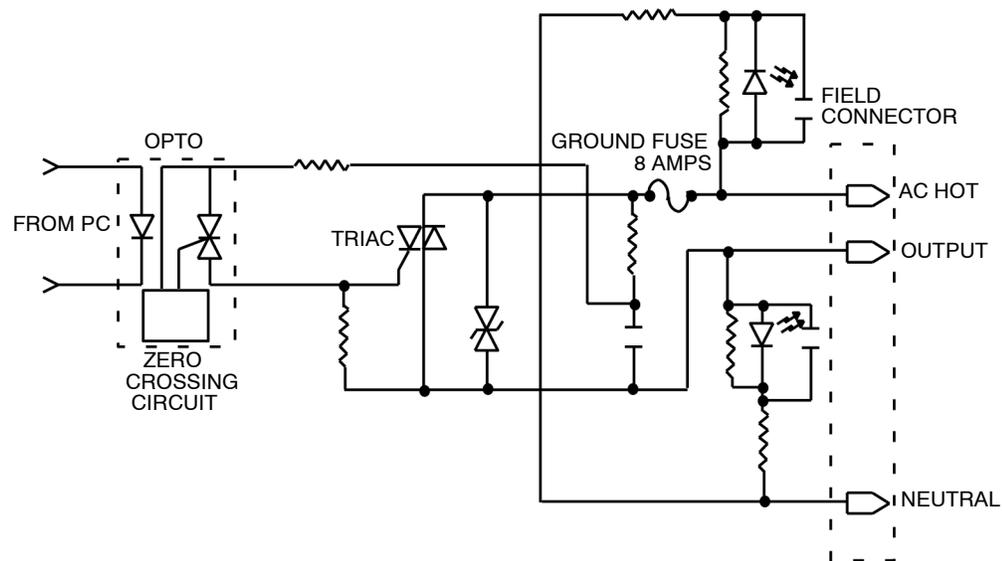

The module's 16 outputs are separated into two groups of eight outputs each.


B804-116 115 Vac Output, Field Connections

Overview

User connections are made to a standard screw terminal strip. The rigid wiring system permits module insertion or removal without disturbing the wiring.

Terminal Numbering and Output Connections

The following diagram shows terminal numbering and output connections for the the B804-116 module.

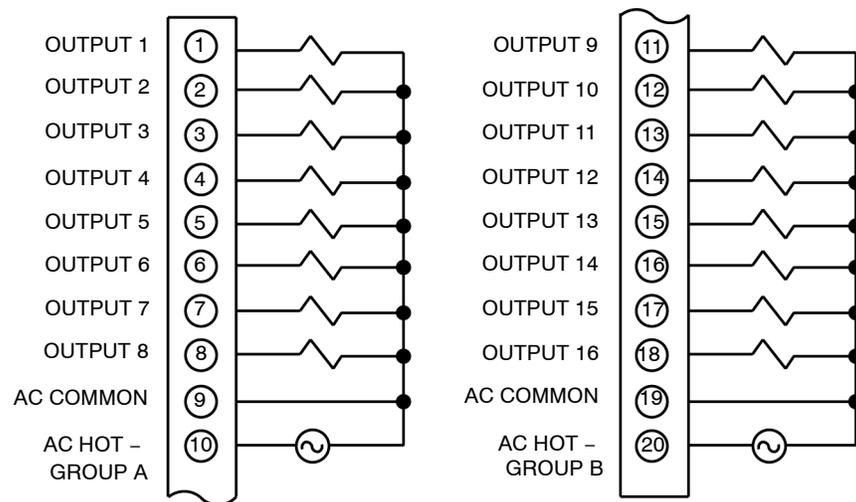

B804-116 48 Vac Output, Specifications

Specification Table

The following table provides the specifications for the unit.

B804-116 Specifications		
Description		115 Vac Output
Number of Points		16
Operating Voltage		80—130 Vac continuous /47—63 Hz
Number of Groups		2
Outputs/group		8
ON Current	Maximum/point	2 A continuous
	Surge Current	50 A 1 cycle
	Maximum/group	6 A
	Maximum/module	12.0 A
	Minimum Load Current	25 mA (B804-116)
	Minimum Load Current	50 mA (B804-016)
Voltage Drop		1.5 V @ 2 A)
Maximum OFF	Leakage Current	3 mA @ 115 Vac
Maximum Response Time	OFF→ON	8.3 ms @ 60 Hz
	ON→OFF	8.3 ms @ 60 Hz
dv/dt		100 V/s
Power Required	+5 V	76 mA
	+4.3 V	480 mA
	-5 V	0 mA
Terminal Connector		AS-8534-000
Fusing		Type 3AB, 8 A (normal blow)

B804-116 Parameter Configuration

Parameter and Default Values

Parameter Configuration Window

Parameter Name	Value
MAPPING	BIT (%M-0X)
OUTPUTS STARTING ADDRESS	1
OUTPUTS ENDING ADDRESS	16
OUTPUT TYPE	BINARY

1 : 140 XBF 3 : B804

Module Configuration

Parameter Name	Value (Default)	Value (Options Available)	Description
Mapping	BIT (%M-0X)	WORD (%MW-4X)	
Outputs Starting Address	1	1	
Outputs Ending Address	16	1	
Output Type	BINARY	BCD	

Mapping Parameter References

	Modsoft, Concept, ProWORX	Unity
Reference Type	Mapped as 16 bits output 1x or Mapped as 1 register output 4x	Mapped as 16 bits output %Mx or Mapped as 1 word output %MWx
Output Type	BIN/BCD	BIN/BCD

B804–148 48 Vac Output

18

At a Glance

Purpose

This chapter describes the functional and physical characteristics of the B804–148 48 Vac Output Module.

What's in this Chapter?

This chapter contains the following topics:

Topic	Page
B804–148 48 Vac Output, Overview	298
B804–148 48 Vac Output, Field Connections	299
B804–148 48 Vac Output, Specifications	300
B804–148 Parameter Configuration	301


B804-148 48 Vac Output, Overview

General Characteristics

The B804-148 48 Vac Output Module converts logic signals used within the PLC into 16 independent 48 Vac outputs. Each output is capable of driving a relay, pilot lamp, motor starter, solenoid, or any other load up to 2.0 A. The module has 16 outputs, divided into two groups of eight discrete points.

Simplified Schematic

Following is a simplified schematic of the B804-148 48 Vac Output Module.

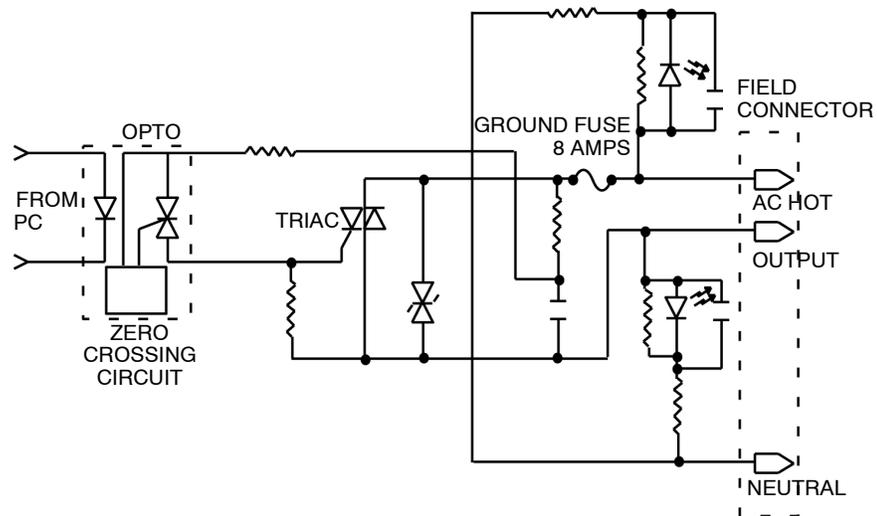


B804–148 48 Vac Output, Field Connections

Overview

User connections are made to a standard screw terminal strip. The rigid wiring system permits module insertion or removal without disturbing the wiring.

Terminal Numbering and Output Connections

The following diagram shows terminal numbering and output connections for the the B804–148 module.

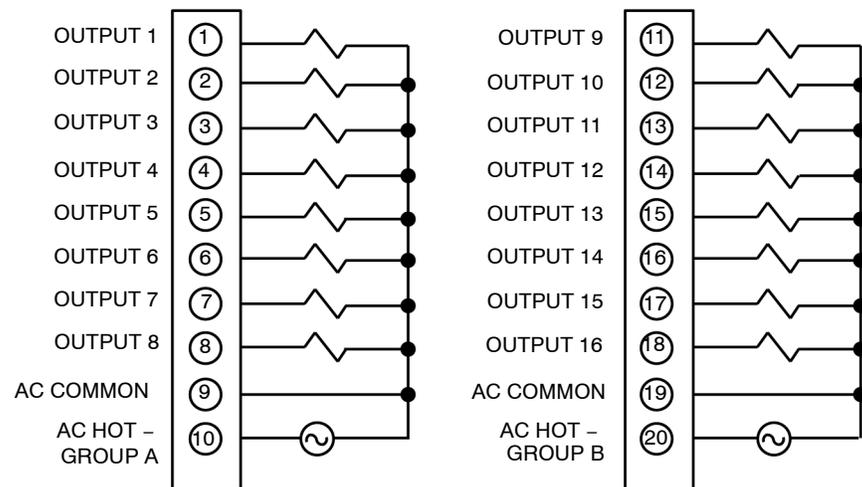

B804–148 48 Vac Output, Specifications

Specification Table

The following table provides the specifications for the unit.

B804-148 Specifications		
Description		48 Vac Output
Number of Points		16
Operating Voltage		40–56 Vac continuous /47–63 Hz
Number of Groups		2
Outputs/group		8
ON Current	Maximum/point	2 A continuous
	Surge Current	50 A 1 cycle
	Maximum/group	6 A
	Maximum/module	12.0 A
Voltage Drop		1.5 V @ 2 A)
Leakage Current		3 mA
Maximum OFF		3 mA
Minimum Load Current		25 mA RMS
Maximum Response Time	OFF→ON	8.3 ms @ 60 Hz
	ON→OFF	8.3 ms @ 60 Hz
dv/dt		100 V/s
	Commutating	5 V/s
Power Required	+5 V	76 mA
	+4.3 V	480 mA
	-5 V	0 mA
Terminal Connector		AS-8534-000
Fusing		One/group, 8 A replaceable

B804–148 Parameter Configuration

Parameter and Default Values

Parameter Configuration Window

Parameter Name	Value
MAPPING	BIT (%M-0X)
OUTPUTS STARTING ADDRESS	1
OUTPUTS ENDING ADDRESS	16
OUTPUT TYPE	BINARY

1 : 140 XBF 3 : B804

Module Configuration

Parameter Name	Value (Default)	Value (Options Available)	Description
Mapping	BIT (%M-0X)	WORD (%MW-4X)	
Outputs Starting Address	1	1	
Outputs Ending Address	16	1	
Output Type	BINARY	BCD	

Mapping Parameter References

	Modsoft, Concept, ProWORX	Unity
Reference Type	Mapped as 16 bits output 1x or Mapped as 1 register output 4x	Mapped as 16 bits output %Mx or Mapped as 1 word output %MWx
Output Type	BIN/BCD	BIN/BCD

B805–016 115 Vac Input

19

At a Glance

Purpose

This chapter describes the functional and physical characteristics of the B805–016 115 Vac Input Module.

What's in this Chapter?

This chapter contains the following topics:

Topic	Page
B805–016 115 Vac Input, Overview	304
B805–016 115 Vac Input, Field Connections	305
B805–016 115 Vac Input, Specifications	306
B805–016 Parameter Configuration	307


B805-016 115 Vac Input, Overview

General Characteristics

The B805-016 115 Vac Input Module senses and converts switched input signals into logic voltage levels used by the PLC. The module allows for up to 16 inputs in 2 groups of 8. These inputs can be received from push buttons, limit and proximity switches, as well as other 115 Vac sources.

Simplified Schematic

Following is a simplified schematic of the B805-016 115 Vac Input Module.

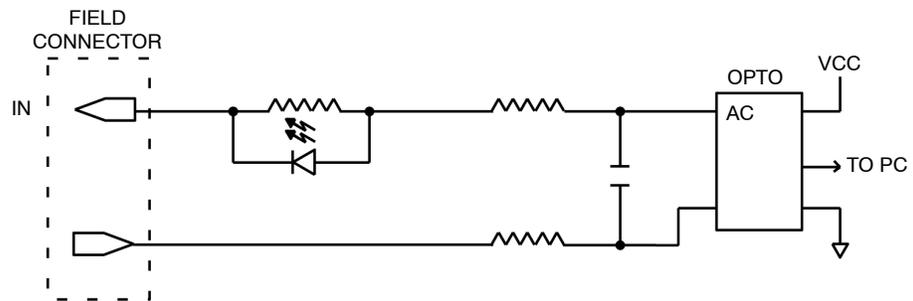


B805–016 115 Vac Input, Field Connections

Overview

User connections are made to a standard screw terminal strip. The rigid wiring system permits module insertion or removal without disturbing the wiring.

Terminal Numbering and Input Connections

The following diagram shows terminal numbering and input connections for the B805–016 module.

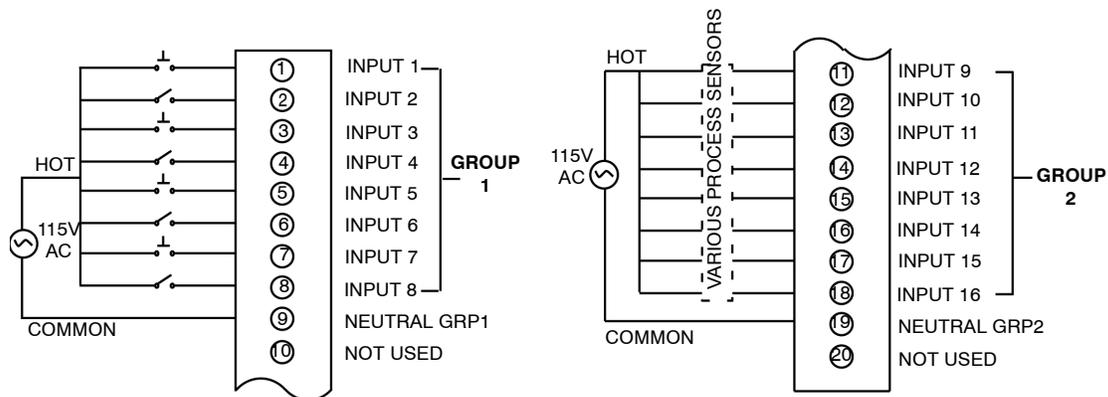

B805–016 115 Vac Input, Specifications

Specification Table

The following table provides the specifications for the unit.

B805–016 Specifications		
Description		115 Vac Input
Number of Points		16
Operating Voltage		80—130 Vac continuous /47—63 Hz
Number of Groups		2
Inputs/group		8
Maximum Input Voltage	Continuous	130 Vac
	Surge	220 Vac for 1 cycle
ON Conditions	80—130 Vac (source impedance) < 1 k Ω	
	Threshold Voltage	60 15 V RMS
OFF Condition	0—35 Vac (source impedance) = 1k Ω	
	0—130 Vac (source impedance) \geq 40 k Ω	
ON Current		6 mA (typical) @ 115 Vac
OFF Current	1.8 mA (max) @ 35 Vac RMS leakage for input sensors	
	3.0 mA (typical) @ 60 Vac RMS	
Maximum Response Time	OFF→ON	6 ms (4 ms typical)
	ON→OFF	18 ms (11 ms typical)
Power Required	+5 V	40 mA
	+4.3 V	1 mA
	-5 V	14 mA
Terminal Connector		AS-8534-000

B805–016 Parameter Configuration

Parameter and Default Values

Parameter Configuration Window

Parameter Name	Value
MAPPING	BIT (%I-1X)
INPUTS STARTING ADDRESS	1
INPUTS ENDING ADDRESS	16
INPUT TYPE	BINARY

1 : 140 XBF 3 : B805

Module Configuration

Parameter Name	Value (Default)	Value (Options Available)	Description
Mapping	BIT (%I-1X)	WORD (%IW-3X)	
Inputs Starting Address	1	1	
Inputs Ending Address	16	1	
Input Type	BINARY	BCD	

Mapping Parameter References

	Modsoft, Concept, ProWORX	Unity
Reference Type	Mapped as 16 bits input 1x or Mapped as 1 word input 3x	Mapped as 16 bits input %Ix or Mapped as 1 word input %IWx
Input Type	BIN/BCD	BIN/BCD

B806–032 115 Vac Output

20

At a Glance

Purpose

This chapter describes the functional and physical characteristics of the B806–032 115 Vac Output Module.

What's in this Chapter?

This chapter contains the following topics:

Topic	Page
B806–032 115 Vac Output, Overview	310
B806–032 115 Vac Output, Field Connections	312
B806–032 115 Vac Output, Fusing Guidelines	313
B806–032 115 Vac Output, Specifications	314
B806–032 Parameter Configuration	315


B806–032 115 Vac Output, Overview

**General
Characteristics**

The B806–032 115 Vac Output Module has 32 outputs. The outputs can serve 120 Vac voltage relays, motor starters, solenoids, pilot lamps, valves, and other loads rated up to 1.0 A. The outputs are divided into two groups of 16 discrete points.

Simplified Schematic

Following is a simplified schematic of the B806-032 115 Vac Output Module.

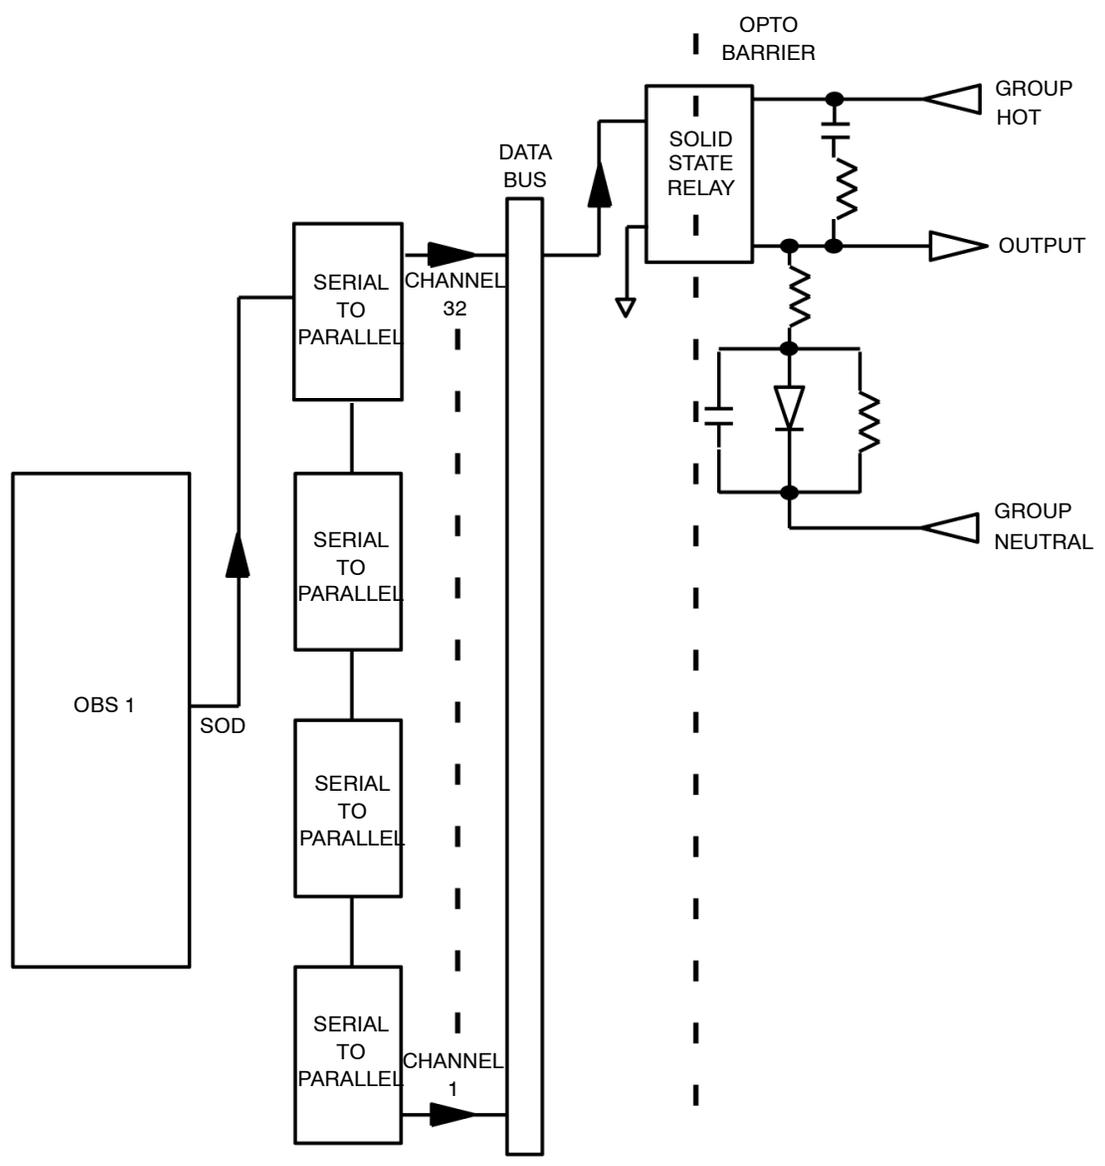


B806-032 115 Vac Output, Field Connections

Overview

User connections are made to a standard screw terminal strip. The rigid wiring system permits module insertion or removal without disturbing the wiring.

Terminal Numbering and Output Connections

The following diagram shows terminal numbering and output connections for the B806-032 module.

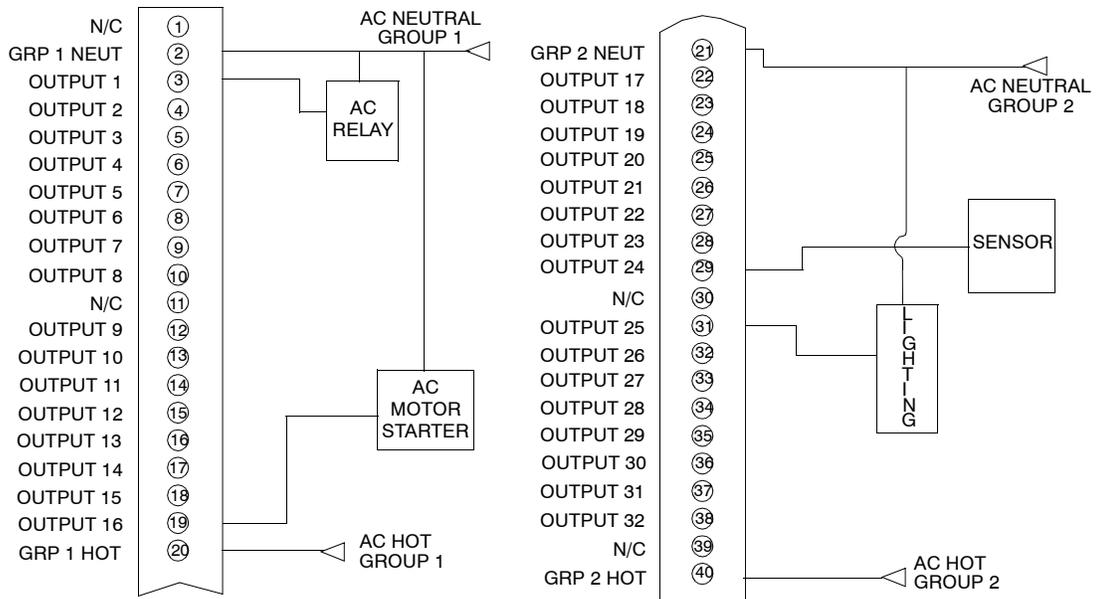

B806–032 115 Vac Output, Fusing Guidelines

Fuse Ratings

For reasons of safety and equipment performance, Schneider Electric recommends external fusing on each individual output point according to the following rating:

Fuse Rating	Fuse Value	Example Type
Very Fast Acting	2 A	Littelfuse 3 AB

Note: A minimum voltage rating of 250 V is required for safe fuse operation. Voltage ratings can be found along with current ratings on the fuse end cap.

Note: Observe fusing guidelines
Failure either to fuse these output modules or to follow the recommended fuse ratings could cause unpredictable results in module performance.

B806–032 115 Vac Output, Specifications

Specification Table

The following table provides the specifications for the unit.

B806–032 Specifications		
Description		115 Vac Output
Number of Points		32
Operating Voltage		80—130 Vac continuous /47—63 Hz
Number of Groups		2
Outputs/group		16
ON Current	Maximum/point	1 A continuous
	Surge Current	15 A 1 cycle
	Maximum/group	8 A
	Maximum/module	16 A
	Minimum Load Current	5 mA
Voltage Drop		1.5 V RMS (maximum)
Maximum OFF	Leakage Current	2 mA @ 115 Vac
Maximum Response Time	OFF→ON	8.3 ms @ 60 Hz
	ON→OFF	8.3 ms @ 60 Hz
dv/dt		600 V/s
	Commutating	5 V/s
Power Required	+5 V	210 mA
	+4.3 V	1 mA
	-5 V	0 mA
Terminal Connector		AS-8535-000

Note: The B806–032 is powered by a standard 24 Vac field power supply.

B806–032 Parameter Configuration

Parameter and Default Values

Parameter Configuration Window

Parameter Name	Value
MAPPING	BIT (%M-0X)
OUTPUTS STARTING ADDRESS	1
OUTPUTS ENDING ADDRESS	32
OUTPUT TYPE	BINARY

1 : 140 XBF 3 : B806

Module Configuration

Parameter Name	Value (Default)	Value (Options Available)	Description
Mapping	BIT (%M-0X)	WORD (%MW-4X)	
Outputs Starting Address	1	1	
Outputs Ending Address	32	2	
Output Type	BINARY	BCD	

Mapping Parameter References

	Modsoft, Concept, ProWORX	Unity
Reference Type	Mapped as 32 bits output 1x or Mapped as 2 registers output 4x	Mapped as 32 bits output %Mx or Mapped as 2 words output %MWx
Output Type	BIN/BCD	BIN/BCD

B806–124 24 Vac Output

21

At a Glance

Purpose

This chapter describes the functional and physical characteristics of the B806–124 24 Vac Output Module.

What's in this Chapter?

This chapter contains the following topics:

Topic	Page
B806–124 24 Vac Output, Overview	318
B806–124 24 Vac Output, Field Connections	320
B806–124 24 Vac Output, Specifications	321
B806–124 Parameter Configuration	322


B806–124 24 Vac Output, Overview

General Characteristics

The B806–124 Output Module has 32 outputs. The outputs can serve 24 Vac voltage relays, motor starters, solenoids, pilot lamps, valves, and other loads rated up to 1.0 A. The outputs are divided into two groups of 16 discrete points.

Simplified Schematic

Following is a simplified schematic of the B806-124 24 Vac Output Module.

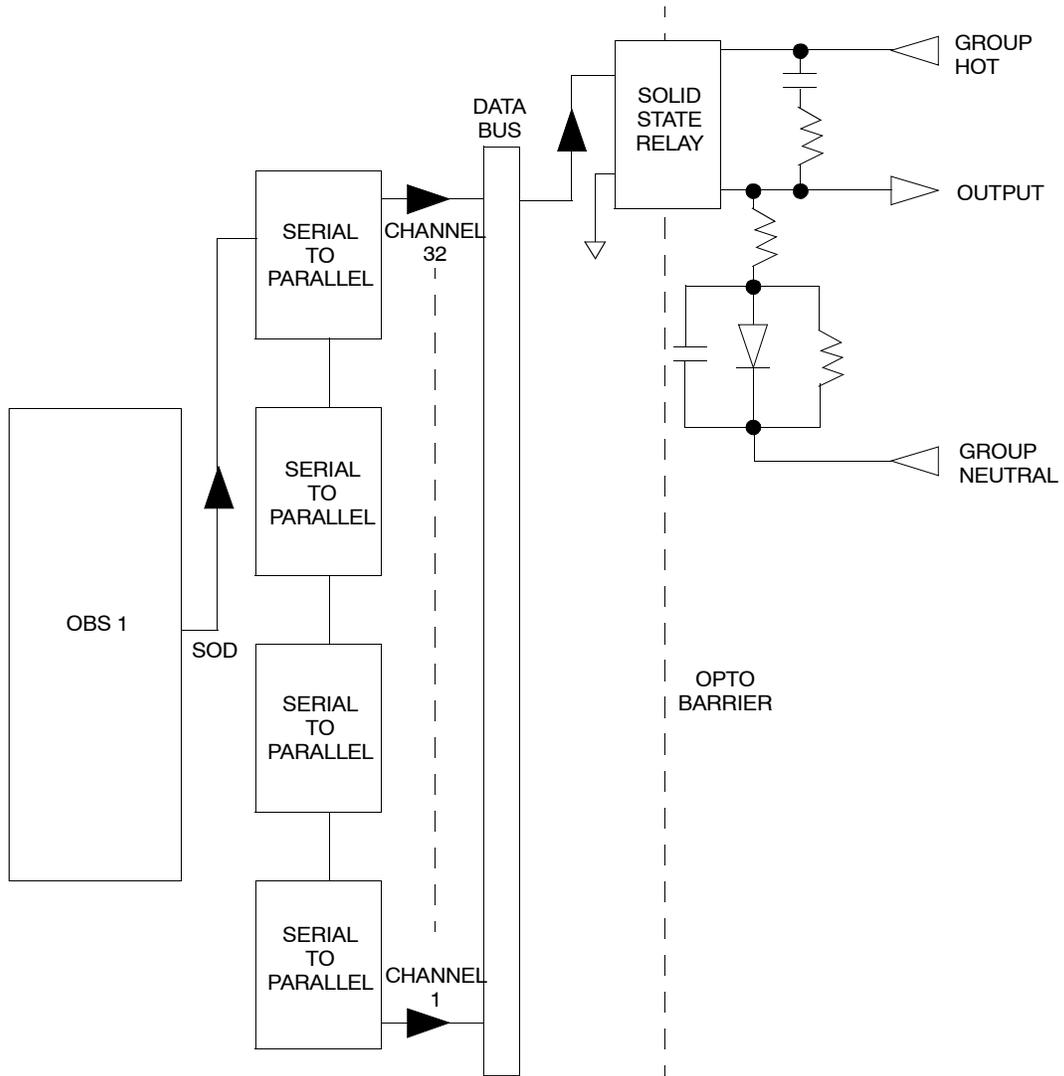


B806-124 24 Vac Output, Field Connections

Overview

User connections are made to a standard screw terminal strip. The rigid wiring system permits module insertion or removal without disturbing the wiring.

Terminal Numbering and Output Connections

The following diagram shows terminal numbering and output connections for the B806-124 module.

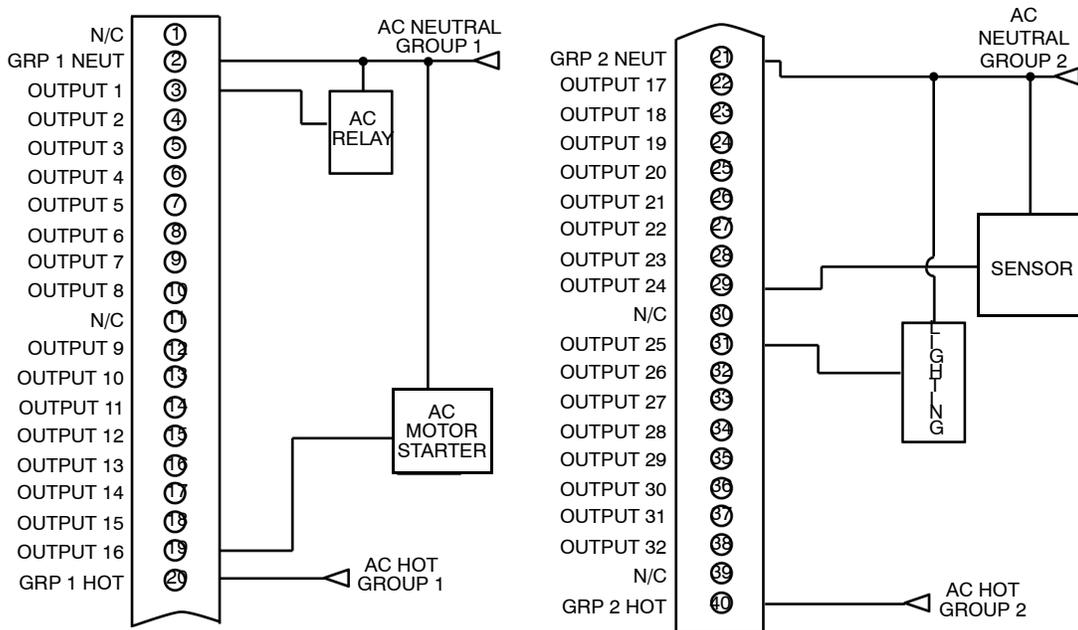

B806–124 24 Vac Output, Specifications

Specification Table

The following table provides the specifications for the unit.

B806–124 Specifications		
Description		24 Vac Output
Number of Points		32
Operating Voltage		20–28 Vac continuous /47–63 Hz
		32 Vac RMS max for 10 s
		42 Vac RMS max for 1 cycle
Number of Groups		2
Outputs/group		16
ON Current	Maximum/point	1 A continuous
	Surge Current	15 A 1 cycle
	Maximum/group	8 A
	Maximum/module	16 A
	Minimum Load Current	5 mA
Voltage Drop		1.5 V (max)
Maximum OFF	Leakage Current	2 mA
Maximum Response Time	OFF→ON	8.3 ms @ 60 Hz
	ON→OFF	8.3 ms @ 60 Hz
dv/dt		600 V/s
	Commutating	5 V/s
Power Required	+5 V	210 mA
	+4.3 V	1 mA
	-5 V	0 mA
Terminal Connector		AS-8535-000

Note: The B806–124 is powered by a standard 24 Vac field power supply.

B806–124 Parameter Configuration

Parameter and Default Values

Parameter Configuration Window

Parameter Name	Value
MAPPING	BIT (%M-0X)
OUTPUTS STARTING ADDRESS	1
OUTPUTS ENDING ADDRESS	32
OUTPUT TYPE	BINARY

Module Configuration

Parameter Name	Value (Default)	Value (Options Available)	Description
Mapping	BIT (%M-0X)	WORD (%MW-4X)	
Outputs Starting Address	1	1	
Outputs Ending Address	32	2	
Output Type	BINARY	BCD	

Mapping Parameter References

	Modsoft, Concept, ProWORX	Unity
Reference Type	Mapped as 32 bits output 1x or Mapped as 2 registers output 4x	Mapped as 32 bits output %Mx or Mapped as 2 words output % MWx
Output Type	BIN/BCD	BIN/BCD

B807–132 115 Vac Input

22

At a Glance

Purpose

This chapter describes the functional and physical characteristics of the B807–132 115 Vac Input Module.

What's in this Chapter?

This chapter contains the following topics:

Topic	Page
B807–132 115 Vac Input, Overview	324
B807–132 115 Vac Input, Field Connections	326
B807–132 115 Vac Input, Specifications	329
B807–132 Parameter Configuration	330


B807-132 115 Vac Input, Overview

General Characteristics

The B807-132 115 Vac Input Module senses and converts switched input signals into logic voltage levels used by the PLC. These inputs can be received from push buttons, limit and proximity switches, as well as other 115 Vac sources.

Simplified Schematic

Following is a simplified schematic of the B807-132 115 Vac Input Module.

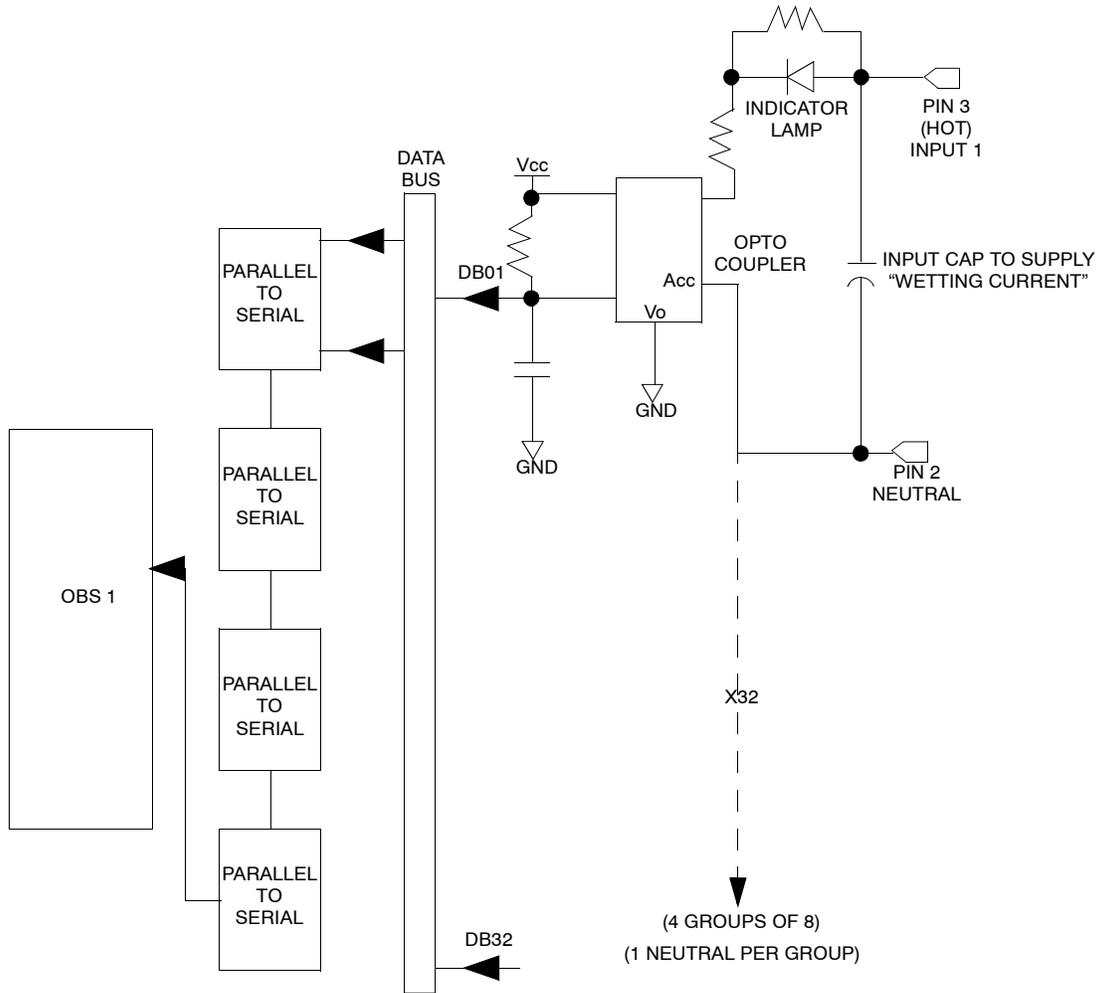

Note: When using Binary and BCD inputs remember that input 1 is the MSB and input 32 is the LSB.


B807-132 115 Vac Input, Field Connections

Overview

User connections are made to a standard screw terminal strip. The rigid wiring system permits module insertion or removal without disturbing the wiring.

Terminal Numbering and Input Connections

The following diagram shows terminal numbering and input connections for the B807-132 module.

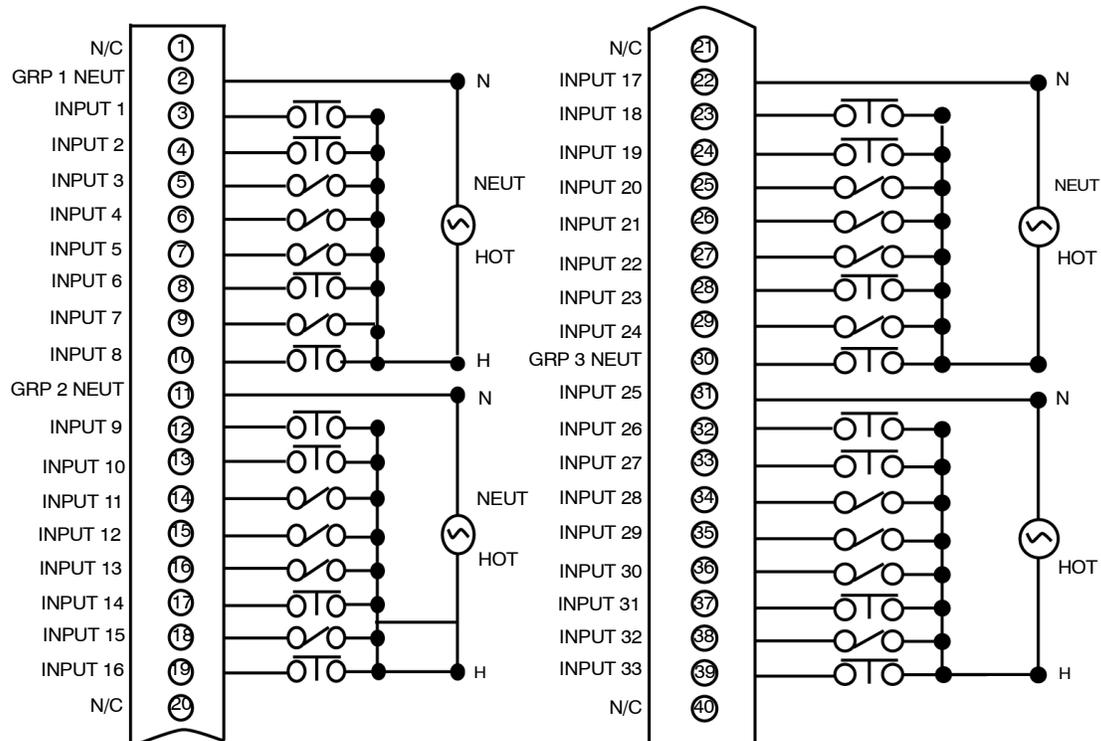


Note: Pins 1, 20, 21, and 40 have no internal connections.

Note: The module can operate from 47–63 Hz. However, its use with proximity switches is recommended only at 60 Hz nominal line frequency. Leakage current through switching devices connected to the module may cause a false ON condition.

Input Current-to-Frequency Relationship

The following illustration is a plot of the input current versus frequency.

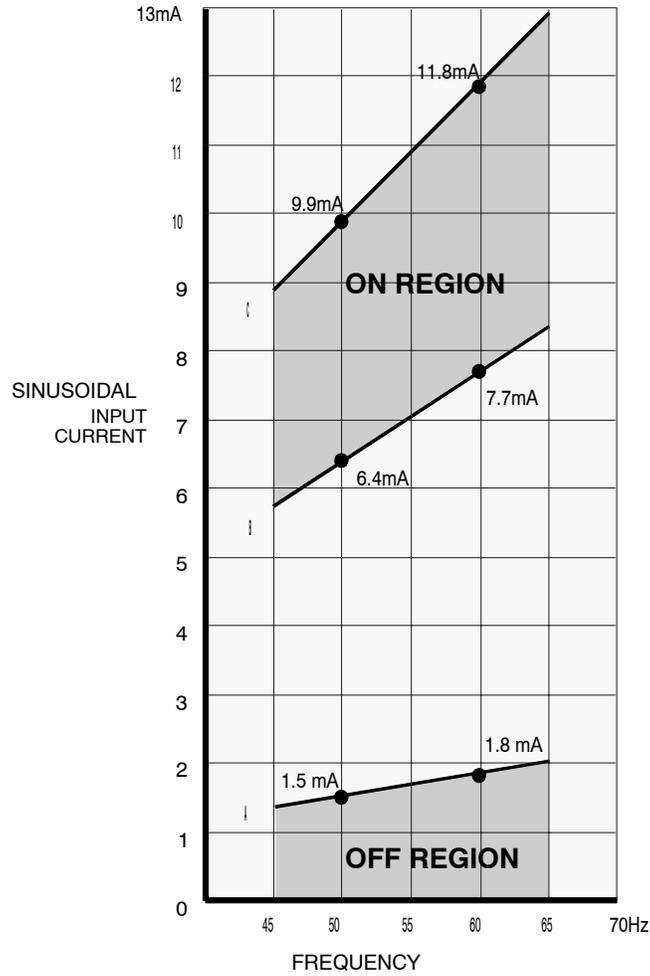

- A. MAXIMUM ALLOWABLE SINEWAVE LEAKAGE CURRENT (FROM EXTERNAL DEVICE) TO GUARANTEE AN OFF CONDITION (CALCULATED AT 35 Vac) AT B807 TERMINALS
- B. MINIMUM REQUIRED INPUT CURRENT TO GUARANTEE AN ON CONDITION NOTE: THE MODULE IS INTENDED TO BE USED WITH VOLTAGE INPUTS; VOLTAGE INPUTS GREATER THAN 80Vac RMS AT MODULE TERMINALS GUARANTEE AN ON CONDITION
- C. MAXIMUM MODULE INPUT CURRENT AT 130 Vac

B807-132 115 Vac Input, Specifications

Specification Table

The following table provides the specifications for the unit.

B807-132 Specifications		
Description	115 Vac Input	
Number of Points	32	
Operating Voltage	80—130 Vac continuous /47—63 Hz	
Number of Groups	4	
Inputs/group	8	
Maximum Input Voltage	150 Vac for 10 s	
	200 Vac for 1 cycle	
ON Condition	80—130 Vac (source impedance) <1 k Ω	
OFF Condition	0—35 Vac (source impedance) = 0 Ω	
	0—130 Vac (source impedance) \geq 90 k Ω	
ON Current	3.7 mA minimum @ 80 Vac, 50 Hz input*	
	6.4 mA minimum @ 115 Vac, 60 Hz input*	
Maximum External to Module Leakage Current	1.8 mA to guarantee an OFF condition @ 60 Hz	
Maximum Response Time	OFF→ON	6 ms
	ON→OFF	35 ms
Power Required	+5 V	80 mA
	+4.3 V	2 mA
	-5 V	0 mA
Terminal Connector	AS-8535-000	

*Minimum input on current at stated voltage and frequency with less than 10 Ω source impedance.

Note: All voltage and current specifications assume a sine waveform and are specified as RMS voltage and current.

Note: Input LED brightness is a function of line voltage applied.

B807-132 Parameter Configuration

Parameter and Default Values

Parameter Configuration Window

Parameter Name	Value
MAPPING	BIT (%I-1X)
INPUTS STARTING ADDRESS	1
INPUTS ENDING ADDRESS	32
INPUT TYPE	BINARY

Module Configuration

Parameter Name	Value (Default)	Value (Options Available)	Description
Mapping	BIT (%I-1X)	WORD (%IW-3X)	
Inputs Starting Address	1	1	
Inputs Ending Address	32	2	
Input Type	BINARY	BCD	

Mapping Parameter References

	Modsoft, Concept, ProWORX	Unity
Reference Type	Mapped as 32 bits input 1x or Mapped as 2 registers input 3x	Mapped as 32 bits input %Ix or Mapped as 2 words input %IWx
Input Type	BIN/BCD	BIN/BCD

B808–016 230 Vac Output

23

At a Glance

Purpose

This chapter describes the functional and physical characteristics of the B808–016 230 Vac Output Module.

What's in this Chapter?

This chapter contains the following topics:

Topic	Page
B808–016 230 Vac Output, Overview	332
B808–016 230 Vac Output, Field Connections	333
B808–016 230 Vac Output, Specifications	334
B808–016 Parameter Configuration	335

B808-016 230 Vac Output, Overview


General Characteristics

The B808-016 230 Vac Output Module converts logic signals used within the PLC into 16 independent 230 Vac outputs. Each output is capable of driving a relay, pilot lamp, motor starter, solenoid, or any other load up to 2.0 A. The B808 is capable of 6 A per group of eight and handling 12 A per module.

The module uses triac switches to control loads connected to an external power source. These switches are designed to withstand the high surge currents typical of industrial loads.

Simplified Schematic

Following is a simplified schematic of the B808-016 230 Vac Output Module.

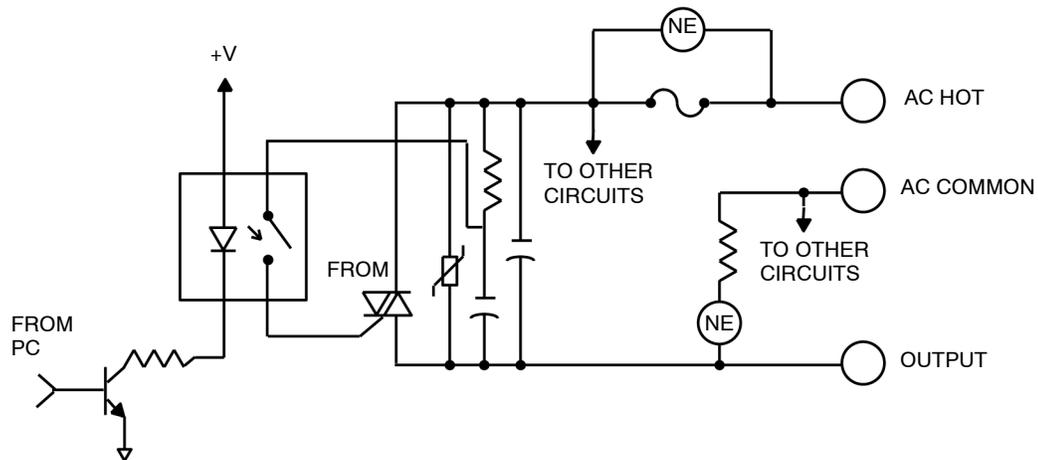


B808–016 230 Vac Output, Field Connections

Overview

User connections are made to a standard screw terminal strip. The rigid wiring system permits module insertion or removal without disturbing the wiring.

Terminal Numbering and Output Connections

The following diagram shows terminal numbering and output connections for the the B808–016 module.

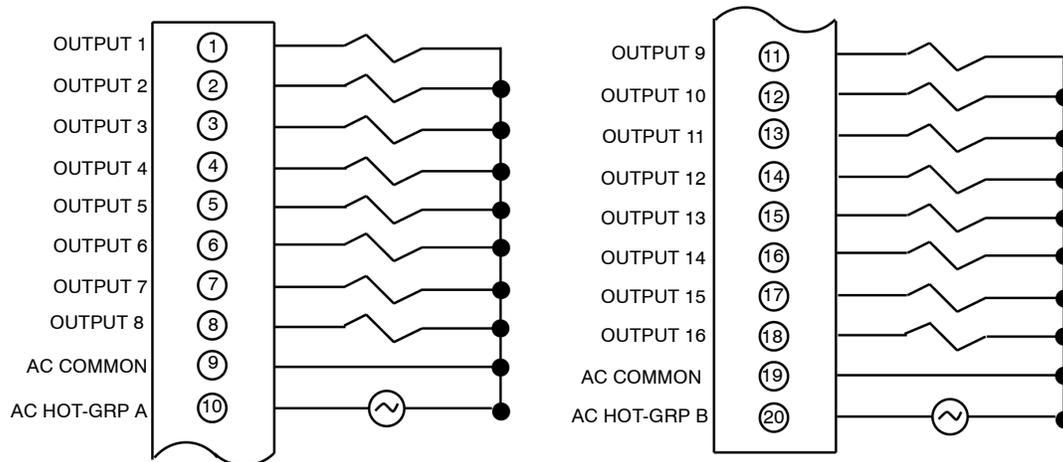

B808–016 230 Vac Output, Specifications

Specification Table

The following table provides the specifications for the unit.

B808–016 Specifications		
Description		230 Vac Output
Number of Points		16
Operating Voltage		180–260 Vac/47–63 Hz
Number of Groups		2
Outputs/group		8
ON Current	Maximum/point	2 A continuous
	Surge Current	50 A (max) 1 cycle
	Maximum/group	6 A
	Maximum/module	12 A
ON Voltage Drop		1.3 V @ 2.0 A
Maximum OFF	Leakage Current	8 mA @ 230 Vac
Maximum Response Time	OFF→ON	8.3 ms @ 60 Hz
	ON→OFF	8.3 ms @ 60 Hz
Applied dv/dt		100 V/s
Power Required	+5 V	76 mA
	+4.3 V	480 mA
	-5 V	0 mA
Terminal Connector		AS-8534-000
Fusing		1/group, Type 3 AB, 8 A (normal blow)

B808-016 Parameter Configuration

Parameter and Default Values

Parameter Configuration Window

Parameter Name	Value
MAPPING	BIT (%M-0X)
OUTPUTS STARTING ADDRESS	1
OUTPUTS ENDING ADDRESS	16
OUTPUT TYPE	BINARY

1 : 140 XBF 3 : B808

Module Configuration

Parameter Name	Value (Default)	Value (Options Available)	Description
Mapping	BIT (%M-0X)	WORD (%MW-4X)	
Outputs Starting Address	1	1	
Outputs Ending Address	16	1	
Output Type	BINARY	BCD	

Mapping Parameter References

	Modsoft, Concept, ProWORX	Unity
Reference Type	Mapped as 16 bits output 1x or Mapped as 1 register output 4x	Mapped as 16 bits output %Mx or Mapped as 1 word output %MWx
Output Type	BIN/BCD	BIN/BCD

B809–016 230 Vac Input

24

At a Glance

Purpose

This chapter describes the functional and physical characteristics of the B809–016 230 Vac Input Module.

What's in this Chapter?

This chapter contains the following topics:

Topic	Page
B809–016 230 Vac Input, Overview	338
B809–016 230 Vac Input, Field Connections	339
B809–016 230 Vac Input, Specifications	340
B809–016 Parameter Configuration	341


B809-016 230 Vac Input, Overview

General Characteristics

The B809-016 230 Vac Input Module senses and converts switched input signals into logic voltage levels used by the PLC. The module allows for up to 16 inputs in two groups of eight. These inputs can be received from push buttons, limit and proximity switches, as well as other 230 Vac sources.

Simplified Schematic

Following is a simplified schematic of the B809-016 230 Vac Input Module.

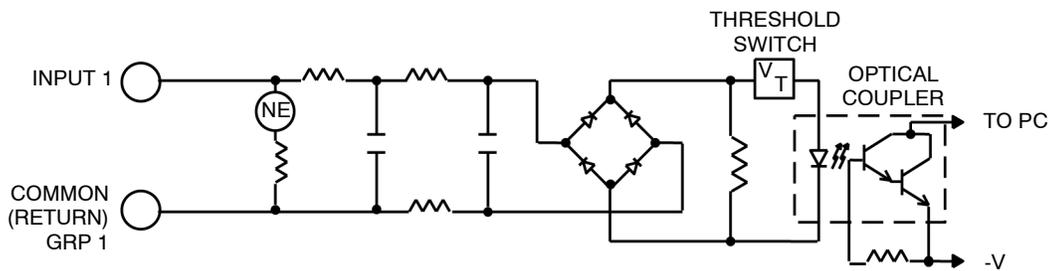


B809–016 230 Vac Input, Field Connections

Overview

User connections are made to a standard screw terminal strip. The rigid wiring system permits module insertion or removal without disturbing the wiring.

Terminal Numbering and Input Connections

The following diagram shows terminal numbering and input connections for the B809–016 module.

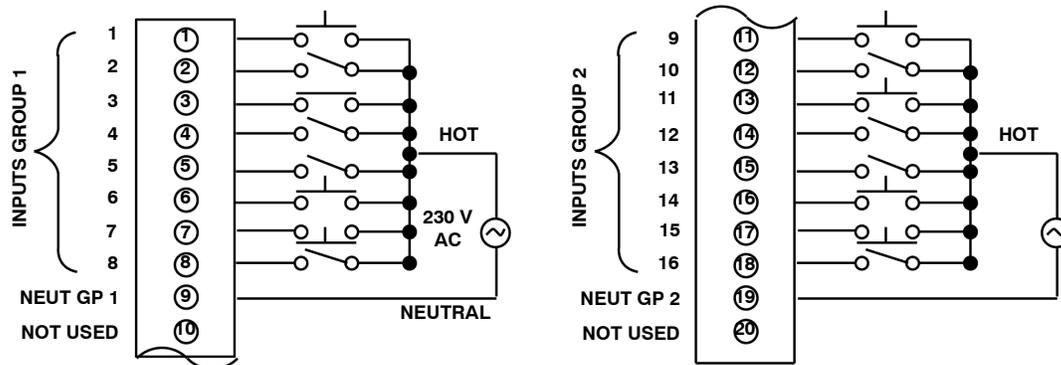

B809–016 230 Vac Input, Specifications

Specification Table

The following table provides the specifications for the unit.

B809–016 Specifications		
Description	230 Vac Input	
Number of Points	16	
Operating Voltage	160–260 Vac/47–63 Hz	
Number of Groups	2	
Outputs/group	8	
Maximum Input Voltage	Continuous	260 Vac
		300 Vac for 10 s
	Surge	400 Vac for 1 cycle
ON Conditions	160–260 Vac (source impedance)= 1 k Ω	
ON Current	8.5 mA (typical) @ 230 Vac	
OFF Conditions	0–90 Vac (source impedance)=0 Ω	
Peak inrush for 260 VRMS (Rs=0) applied @ peak	1.7 A max	
Maximum Response Time	OFF→ON	5 ms (3 ms typical)
	ON→OFF	18 ms (12 ms typical)
Power Required	+5 V	42 mA
	+4.3 V	1 mA
	-5 V	15 mA
Dimensions	Space Required	1 slot
	Weight	2.38 lbs (1.08 kg)
Terminal Connector	AS-8534-000	

Note: The B809–016 input module is electrically compatible with the B808-016 output module.

B809-016 Parameter Configuration

Parameter and Default Values

Parameter Configuration Window

Parameter Name	Value
MAPPING	BIT (%I-1X)
INPUTS STARTING ADDRESS	1
INPUTS ENDING ADDRESS	16
INPUT TYPE	BINARY

1 : 140 XBF 3 : B809

Module Configuration

Parameter Name	Value (Default)	Value (Options Available)	Description
Mapping	BIT (%I-1X)	WORD (%IW-3X)	
Inputs Starting Address	1	1	
Inputs Ending Address	16	1	
Input Type	BINARY	BCD	

Mapping Parameter References

	Modsoft, Concept, ProWORX	Unity
Reference Type	Mapped as 16 bits input 1x or Mapped as 1 register input 3x	Mapped as 16 bits input %Ix or Mapped as 1 word input %IWx
Input Type	BIN/BCD	BIN/BCD

B810–008 115 Vac Isolated Output

25

At a Glance

Purpose

This chapter describes the functional and physical characteristics of the B810–008 115 Vac Output Module.

What's in this Chapter?

This chapter contains the following topics:

Topic	Page
B810–008 115 Vac Output, Overview	344
B810–008 115 Vac Output, Field Connections	345
B810–008 115 Vac Isolated Output, Specifications	346
B810–008 Parameter Configuration	347


B810-008 115 Vac Output, Overview

General Characteristics

The B810-008 115 Vac Output Module converts logic signals used within the PLC into eight independent 115 Vac outputs. Each output is capable of driving a relay, pilot lamp, motor starter, solenoid, or any other load up to 2.0 A. The B810-008 is capable of 6 A/group of eight and handling 12 A/module. The module uses eight triac switches to control loads connected to an external power source. These switches are designed to withstand the high surge currents typical of industrial loads.

Simplified Schematic

Following is a simplified schematic of the B810-008 115 Vac Output Module.

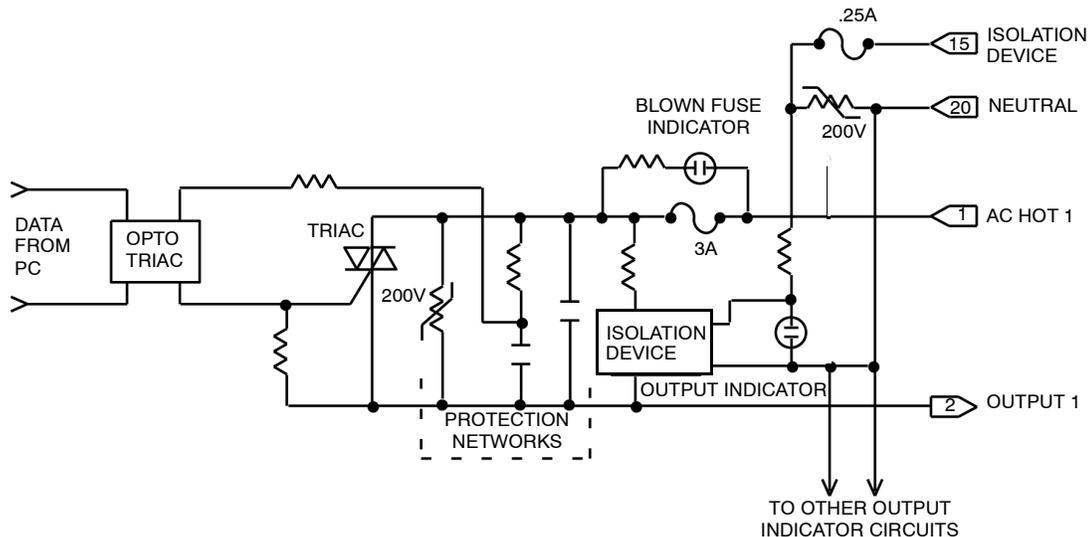

Zero-cross threshold switching is incorporated into each output circuit. Upon controller command, outputs switch ON at the first line voltage zero-crossing, and switch OFF at the first load current zero-crossing.

Output status indicators are provided for each output circuit. These neon indicators will be ON when a load is connected and the output is ON, **or when there is no connected load**. These indicators are isolated from the triac output and require a separate lamp supply which is fused at 1/4 A. Blown fuse indicators are also provided for each output circuit. These indicators light (ON) when the corresponding fuse has blown.


B810-008 115 Vac Output, Field Connections

Overview

User connections are made to a standard screw terminal strip. The rigid wiring system permits module insertion or removal without disturbing the wiring.

Terminal Numbering and Output Connections

The following diagram shows terminal numbering and output connections for the B810-008 module.

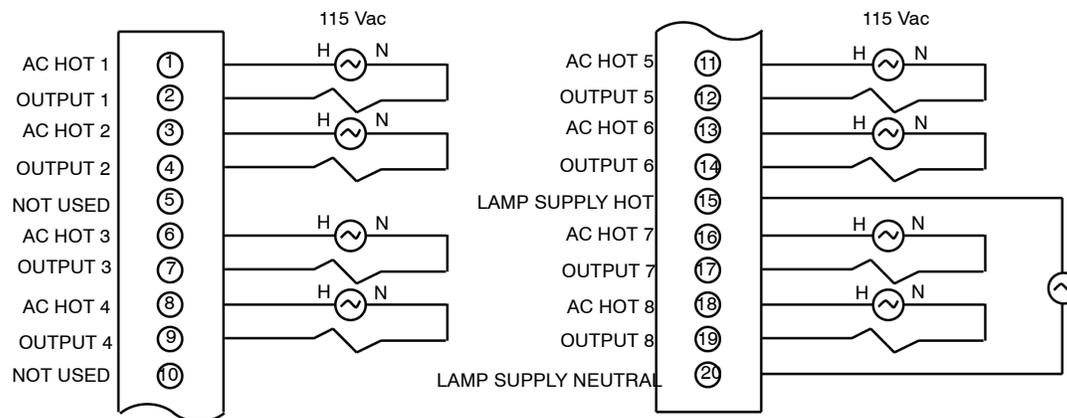

B810-008 115 Vac Isolated Output, Specifications

Specification Table

The following table provides the specifications for the unit.

B810-008 Specifications		
Description	115 Vac isolated output	
Number of Points	8	
Operating Voltage	80—130 Vac continuous/47—63 Hz	
Number of Groups	8	
Outputs/group	1	
On Current	Maximum/point	2 A continuous
	Maximum/module	12 A
	Maximum/group	2 A
	Surge Current	50 A (max) 1 cycle
	Minimum Load Current	50 mA
Maximum OFF	Leakage Current	3 mA @ 115 Vac
ON Voltage Drop	1.3 V @ 2.0A max	
Surge Voltage	150 Vac for 10 s	
	200 Vac for 1 cycle	
Maximum Response Time	OFF→ON	8.3 ms @ 60 Hz
	ON→OFF	8.3 ms @ 60 Hz)
dv/dt	100 V/s	
	Commutating	5 V/s
Power Required	+5 V	50 mA
	+4.3 V	240 mA
	-5 V	0 mA
Terminal Connector	AS-8534-000	
Fusing	One/group, Type 3 AG, 3 A (normal blow)	

B810-008 Parameter Configuration

Parameter and Default Values

Parameter Configuration Window

Parameter Name	Value
MAPPING	BIT (%M-0X)
OUTPUTS STARTING ADDRESS	1
OUTPUTS ENDING ADDRESS	8
OUTPUT TYPE	BINARY

Module Configuration

Parameter Name	Value (Default)	Value (Options Available)	Description
Mapping	BIT (%M-0X)	WORD (%MW-4X)	
Outputs Starting Address	1	1	
Outputs Ending Address	8	1	
Output Type	BINARY	BCD	

Mapping Parameter References

	Modsoft, Concept, ProWORX	Unity
Reference Type	Mapped as 8 bits output 0x or Mapped as 1 register output 4x	Mapped as 8 bits output %Mx or Mapped as 1 word output %MWx
Output Type	BIN/BCD	BIN/BCD

B814–108 Relay Output

26

At a Glance

Purpose

This chapter describes the functional and physical characteristics of the B814–108 Relay Output Module.

What's in this Chapter?

This chapter contains the following topics:

Topic	Page
B814–108 Relay Output, Overview	350
B814–108 Relay Output, Configuration	351
B814–108 Relay Output, Field Connections	352
814–108 Relay Output, Specifications	353
B814–108 Parameter Configuration	354

B814-108 Relay Output, Overview


General Characteristics

The B814-108 Relay Output Module converts signals from the PLC to eight independent relay outputs. Each output is capable of driving a relay, pilot lamp, motor starter, solenoid, or any other load up to 5.0 A. Each of the eight outputs is electrically isolated from the I/O bus and from the other seven outputs by the relay coil. The module is designed to withstand the high surge currents typical of industrial loads.

The module is user-configurable as to setting for normally-open or normally-closed operation of the relays as described below, and is compatible with other Modicon input modules. Assuming a normally-open configuration, when the relay coil is energized, the relay contacts will conduct current from output A terminal to output B terminal (see the following figure).

Simplified Schematic

Following is a simplified schematic of the B814-108 Relay Output Module.

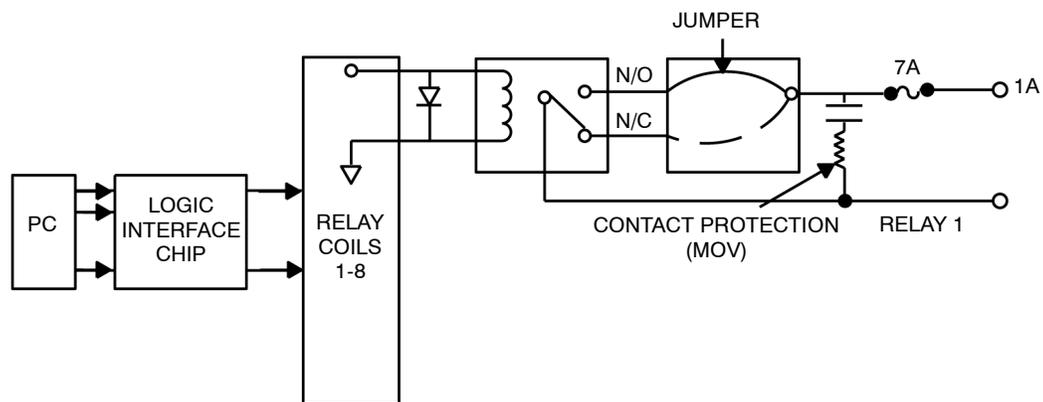

B814–108 Relay Output, Configuration

Configuration Overview

The B814 is initially shipped with all eight channels jumpered for the normally-open configuration. You may optionally wire any of the channels for normally-closed operation if desired. This is done by transferring a wire jumper from one tab to another on the printed circuit board. Refer to the label on the side of the module. The following table shows the user configuration wire/tab designations for the unit.

Channel	N.O.	N.C.	Channel	N.O.	N.C.
1	W1-E2	W1-E1	5	W5-E10	W5-E9
2	W2-E4	W2-E3	6	W6-E12	W6-E11
3	W3-E6	W3-E5	7	W7-E14	W7-E13
4	W4-E8	W4-E7	8	W8-E16	W8-E15


B814-108 Relay Output, Field Connections

Overview

User connections are made to a standard screw terminal strip. The rigid wiring system permits module insertion or removal without disturbing the wiring.

Terminal Numbering and Output Connections

The following diagram shows typical circuit connections for power applications of the B814-108 module.

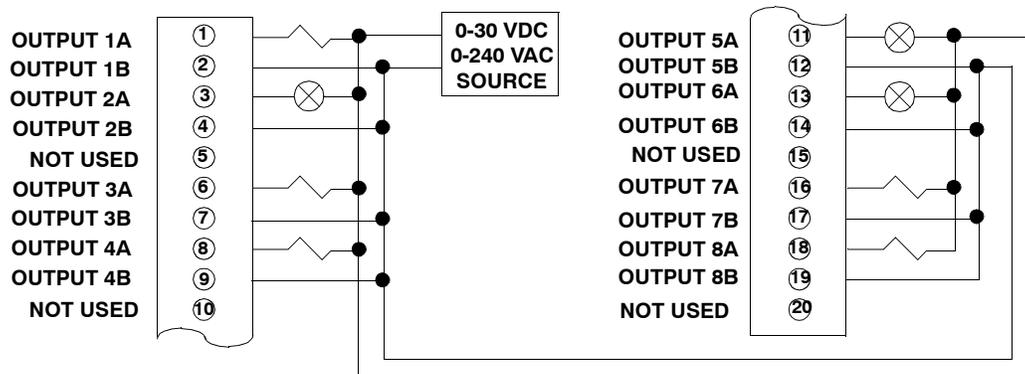

Note: Since each output is isolated from the remaining outputs, separate power sources can be used for each load. Each output can be wired for current source or current sink operations.

Note: It is possible to have the ACTIVE indicator lit with one or more output channels working improperly.

814-108 Relay Output, Specifications

Specification Table

The following table provides the specifications for the unit.

814-108 Specifications		
Description		Relay (NO/NC) output,
Number of Points		8
Operating Voltage		0-30 Vdc 0-240 Vac/47-63 Hz
Number of Groups		8
Outputs/group		1
ON Current	Maximum/point	5 A @ 30 Vdc/120 Vac 4 A @ 240 Vac
	Maximum/module	40 A @ 30 Vdc/120 Vac
Maximum Load Current	Carrying (unswitched)	3 A max)
	Switching	2.0 max (0.3 A @ 300 Vdc
Switching Capability		960 VA maximum, or 150 W dc maximum
Contact Resistance		< 300 mΩ (including fuse, wire, connectors, and contacts)
OFF State	Leakage Current	.5 mA (typical) @ 240 Vac/60 Hz
Maximum Response Time	OFF→ON	15 ms (6 ms typical)
	ON→OFF	15 ms (6 ms typical)
Power Required	+5 V	107 mA
	+4.3 V	800 mA
	-5 V	0 mA
Relay Life Rating		100,000 operations, and 50,000 operations with inductive loads @ 25°C
Terminal Connector		AS-8534-000
Fusing		1 / output, 7 A

Note: For 48 Vdc operation, the maximum load is 1A.

B814-108 Parameter Configuration

Parameter and Default Values

Parameter Configuration Window

Parameter Name	Value
MAPPING	BIT (%M-0X)
OUTPUTS STARTING ADDRESS	1
OUTPUTS ENDING ADDRESS	8
OUTPUT TYPE	BINARY

Module Configuration

Parameter Name	Value (Default)	Value (Options Available)	Description
Mapping	BIT (%M-0X)	WORD (%MW-4X)	
Outputs Starting Address	1	1	
Outputs Ending Address	8	1	
Output Type	BINARY	BCD	

Mapping Parameter References

	Modsoft, Concept, ProWORX	Unity
Reference Type	Mapped as 8 bits output 0x or Mapped as 1 register output 4x	Mapped as 8 bits output %Mx or Mapped as 1 word output %MWx
Output Type	BIN/BCD	BIN/BCD

B816 Isolated Output

27

B816 Parameter Configuration

Parameter and Default Values

Parameter Configuration Window

Parameter Name	Value
MAPPING	BIT (%M-0X)
OUTPUTS STARTING ADDRESS	1
OUTPUTS ENDING ADDRESS	16
OUTPUT TYPE	BINARY

Name	Default Value	Options	Description
Mapping	BIT (%M-0X)	WORD (%MW-4X)	
Outputs Starting Address	1	-	
Outputs Ending Address	16	-	
Output Type	BINARY	BCD	

B817–116 and B817–216 115/230 Vac Isolated Input

28

At a Glance

Purpose

This chapter describes the functional and physical characteristics of the B817–116 and B817–216 115/230 Vac Isolated Input Modules.

What's in this Chapter?

This chapter contains the following topics:

Topic	Page
B817–116 (115 Vac) and B817–216 (230 Vac) Isolated Input, Overview	358
B817–116 (115 Vac) and B817–216 (230 Vac) Isolated Input, Field Connections	359
B817–116 (115 Vac) and B817–216 (230 Vac) Isolated Input, Specifications	362
B817–116 and B817–216 Parameter Configuration	363

B817-116 (115 Vac) and B817-216 (230 Vac) Isolated Input, Overview


General Characteristics

The B817-116 (115 Vac) and B817-216 (230 Vac) Isolated Input Modules sense OFF and ON input voltages from its field circuitry, converting them to dc logic levels used in the logic program by a Modicon PLC.

The module's 16 input circuits are individually isolated from one another. As each input circuit uses a neutral return wire, none has a definite relationship to system ground unless established in the user's field circuitry. The module's logic circuitry is shielded from radiated signals or interference originating in the field, and its field inputs are optically isolated from the system logic.

Simplified Schematic

Following is a simplified schematic of the B817-116 (115 Vac) and B817-216 (230 Vac) Isolated Input Modules.

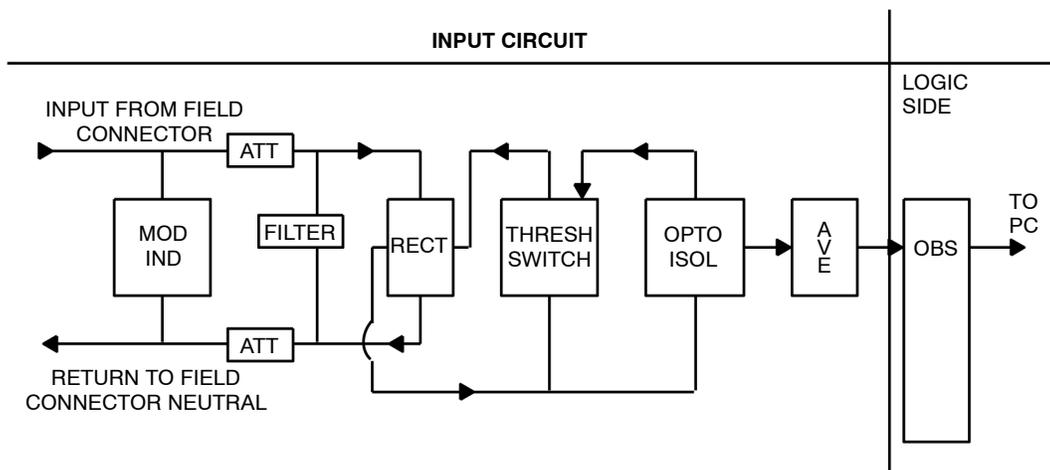

When the voltage exceeds the threshold circuits voltage requirement, current will flow through the threshold switch and opto-isolator via the precision attenuator and the bridge rectifier. The output pulses coupled through the isolator are averaged so that a steady state dc voltage representation of the inner circuit's ON-state condition is sensed by the Ourbus chip (OBS) on the logic side of the module.

The Ourbus output register is set to represent the field ON state. As long as the field input status remains true, the module will communicate this status each time it is polled by the PLC.


B817-116 (115 Vac) and B817-216 (230 Vac) Isolated Input, Field Connections

Overview


User connections are made to a standard screw terminal strip. The rigid wiring system permits module insertion or removal without disturbing the wiring.

**Terminal
Numbering and
Input
Connections**


The following diagram shows terminal numbering and input connections for the B817-116 (115 Vac) and B817-216 (230 Vac) Isolated Input Modules.

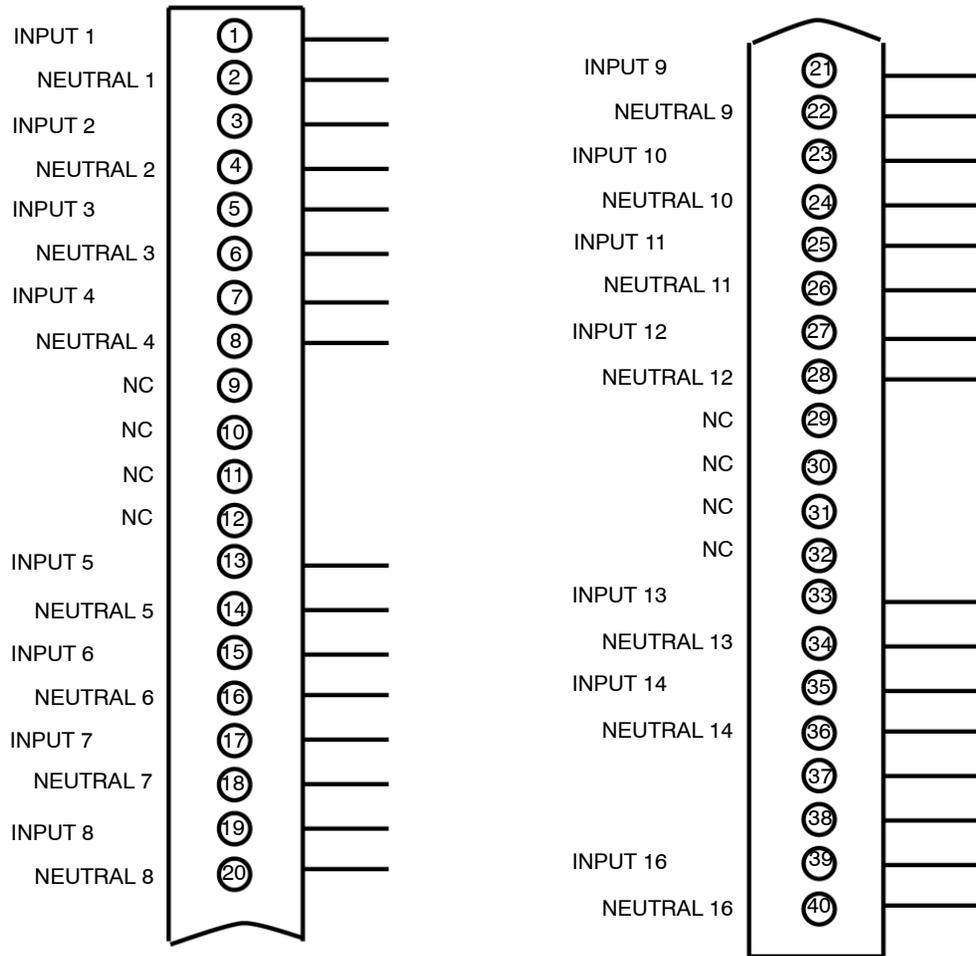

The following figure shows typical circuitry connected to the user side of the B817-116 field connector.

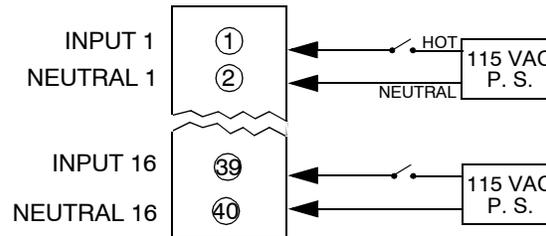

The following figure shows typical circuitry connected to the user side of the B817-216 field connector.

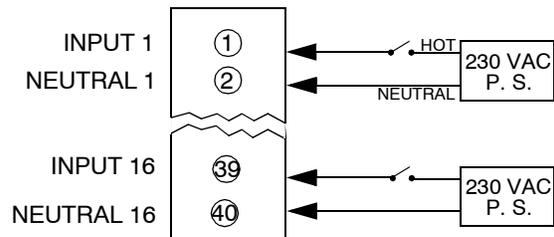

B817-116 (115 Vac) and B817-216 (230 Vac) Isolated Input, Specifications

Specification Table

The following table provides the specifications for the unit.

B817-x16 Specifications		
Description		115 Vac isolated input (B817-116)
		230 Vac isolated input (B817-216)
Number of Points		16
Number of Groups		16
Inputs/group		1
Maximum Input Voltage	Continuous	130 Vac/47—63 Hz (B817-116)
		260 Vac/47—63 Hz (B817-216)
	Surge	200 Vac for 1 cycle (B817-116)
		400 Vac for 1 cycle (B817-216)
ON Conditions	B817-116	>80 Vac (source impedance, <1 k Ω)
	B817-216	>160 Vac (source impedance, <1 k Ω)
OFF Conditions	B817-116	0—35 Vac (source impedance)=0 Ω
		0—130 Vac (source impedance)>40k Ω
	B817-216	0—90 Vac (source impedance)=0 Ω
		0—260 Vac (source impedance)>80 k Ω
Wetting Current	B817-116	0.4 mA (typical) @ 115 Vac
	B817-216	8.23 mA (typical) @ 230 Vac
Maximum Response Time	OFF→ON	6 ms
	ON→OFF	18 ms
Power Required	+5 V	25 mA
	+4.3 V	2 mA
	-5 V	8 mA
Terminal Connector		AS-8535-000

B817-116 and B817-216 Parameter Configuration

Parameter and Default Values

Parameter Configuration Window

Parameter Name	Value
MAPPING	BIT (%I-1X)
INPUTS STARTING ADDRESS	1
INPUTS ENDING ADDRESS	16
INPUT TYPE	BINARY

Module Configuration

Parameter Name	Value (Default)	Value (Options Available)	Description
Mapping	BIT (%I-1X)	WORD (%IW-3X)	
Inputs Starting Address	1	1	
Inputs Ending Address	16	1	
Input Type	BINARY	BCD	

Mapping Parameter References

	Modsoft, Concept, ProWORX	Unity
Reference Type	Mapped as 16 bits input 1x or Mapped as 1 register input 3x	Mapped as 16 bits input %Ix or Mapped as 1 word input %IWx
Input Type	BIN/BCD	BIN/BCD

B818 24 Vac Output

29

At a Glance

Purpose

This chapter describes the functional and physical characteristics of the B818 24 Vac Output Module.

What's in this Chapter?

This chapter contains the following topics:

Topic	Page
B818—Setting Module DIP Switch	366
B818 24Vdc Output, Field Connections	367
B818 24 Vdc (True High) Output, Specifications	368
B818 Parameter Configuration	369

B818—Setting Module DIP Switch

Switch location and position


The four position DIP-switch is located on the rear of the module. This switch controls the mode of the module as Bi-directional or Uni-directional.

Switch Settings

The following figure presents DIP switch settings for the B872-100 module. Also, refer to the label located on the left side of the module itself.

4- POSITION DIP- SWITCHES

TOP OF MODULE



Not used keep left

Not used keep left

left = Uni-Directional / right = Bi-Directional

Not used keep left

Note: Two types of switches may be in use. Toggle up/down or throw left/right

B818 24Vdc Output, Field Connections

Terminal Numbering and Output Functions

User connections are made to a standard screw terminal strip. The rigid wiring system permits module insertion or removal without disturbing the wiring. The following illustration shows how to field connect the unit.

Group 1	Output 1	①	②①	Output 17	Group 3
	Output 2	②	②②	Output 18	
	Output 3	③	②③	Output 19	
	Output 4	④	②④	Output 20	
	+ 24VDC	⑤	②⑤	+ 24VDC	
	GND	⑥	②⑥	GND	
	Output 5	⑦	②⑦	Output 21	
	Output 6	⑧	②⑧	Output 22	
	Output 7	⑨	②⑨	Output 23	
	Output 8	⑩	③①	Output 24	Group 4
Group 2	Output 9	⑪	③②	Output 25	
	Output 10	⑫	③③	Output 26	
	Output 11	⑬	③④	Output 27	
	Output 12	⑭	③⑤	Output 28	
	+ 24VDC	⑮	③⑥	+ 24VDC	
	GND	⑯	③⑦	GND	
	Output 13	⑰	③⑧	Output 29	
	Output 14	⑱	③⑨	Output 30	
	Output 15	⑲	④①	Output 31	
	Output 16	⑳	④②	Output 32	

B818 24 Vdc (True High) Output, Specifications

Specification Table

The following table provides the specifications for the unit.

B818 Specifications		
Description	24 Vdc output	
Type of Operation	True high	
Number of Points	32	
Operating Voltage	20—28 Vdc	
Number of Groups	4	
Outputs/group	8	
On Current	Maximum/point	1 A continuous
	Maximum/module	24 A
	Maximum/group	6 A
	ON→OFF	1 ms)
Power Required	+5 V	300 mA
	+4.3 V	10 mA
	-5 V	0 mA

B818 Parameter Configuration

Parameter and Default Values

Parameter Configuration Window

Parameter Name	Value
MAPPING	BIT (%M-0X)
OUTPUTS STARTING ADDRESS	1
OUTPUTS ENDING ADDRESS	32
OUTPUT TYPE	BINARY

Name	Default Value	Options	Description
Mapping	BIT (%M-0X)	WORD (%MW-4X)	
Outputs Starting Address	1	-	
Outputs Ending Address	32	-	
Output Type	BINARY	BCD	

B819–232 230 Vac Input

30

At a Glance

Purpose

This chapter describes the functional and physical characteristics of the B819-232 230 Vac Input Module.

What's in this Chapter?

This chapter contains the following topics:

Topic	Page
B819-232, 230 Vac Input, Keying and Wiring	372
B819-232, 32 Point Input, Specifications	374
B819-232 Parameter Configuration	375

B819-232, 230 Vac Input, Keying and Wiring

Overview

User connections are made to a standard screw terminal strip. The rigid wiring system permits module insertion or removal without disturbing the wiring.


Terminal Numbering and Output Connections

The following diagram shows terminal numbering and output connections for the the B819-232 module.

Not Used	1	2	I/P 1
I/P 2	3	4	I/P 3
I/P 4	5	6	I/P 5
I/P 6	7	8	I/P 7
I/P 8	9	10	Group A Neutral
Not Used	11	12	I/P 9
I/P 10	13	14	I/P 11
I/P 12	15	16	I/P 13
I/P 14	17	18	I/P 15
I/P 16	19	20	Group B Neutral
Not Used	21	22	I/P 17
I/P 18	23	24	I/P 19
I/P 20	25	26	I/P 21
I/P 22	27	28	I/P 23
I/P 24	29	30	Group C Neutral
Not Used	31	32	I/P 25
I/P 26	33	34	I/P 27
I/P 28	35	36	I/P 29
I/P 30	37	38	I/P 31
I/P 32	39	40	Group D Neutral

**Mechanical
Keying**

The following figure shows the keying for the the B819-232 module.



B819-232, 32 Point Input, Specifications

Specification Table

The following table provides the specifications for the unit.

B819-232 Specifications		
Description	230 Vac 32 point input module	
Number of Points	32	
Operating Voltage	170-250 Vac	
Number of Groups	4	
Inputs per group	8	
Power Required	+5 V	25 mA
	+4.3 V	1 mA
	-5 V	0 mA
Visual indicator	1 neon light per input	"on" when input is on
	1 "active" indicator	"on" when good communication with PC
Maximum input voltage	Continuous	250 Vac
	Surge	400 Vac (1cycle), 300 Vac (10 sec. max.)
Transient	5/50 ns 1kV peak	
On Level	≥ 170 Vac cont.	
Off Level	< 90 Vac with 0 Ω < 250 Vac with 70 kΩ	

B819-232 Parameter Configuration

Parameter and Default Values

Parameter Configuration Window

Parameter Name	Value
MAPPING	BIT (%I-1X)
INPUTS STARTING ADDRESS	1
INPUTS ENDING ADDRESS	32
INPUT TYPE	BINARY

Module Configuration

Parameter Name	Value (Default)	Value (Options Available)	Description
Mapping	BIT (%I-1X)	WORD (%IW-3X)	
Outputs Starting Address	1	1	
Outputs Ending Address	32	2	
Output Type	BINARY	BCD	

Mapping Parameter References

	Modsoft, Concept, ProWORX	Unity
Reference Type	Mapped as 32 bits input 1x or Mapped as 2 registers input 3x	Mapped as 32 bits input %Ix or Mapped as 2 words input %IW
Input Type	BIN/BCD	BIN/BCD

B820-008 10—60 Vdc Output

31

At a Glance

Purpose

This chapter describes the functional and physical characteristics of the B820-008 10—60 Vdc Output Module.

What's in this Chapter?

This chapter contains the following topics:

Topic	Page
B820-008 10—60 Vdc Output, Overview	378
B820-008 10—60 Vdc Output, Field Connections	379
B820-008 10—60 Vdc Output, Specifications	380
B820-008 Parameter Configuration	381

B820-008 10—60 Vdc Output, Overview


General Characteristics

The B820-008 10—60 Output Module converts logic signals used within the PLC into eight independent 10—60 Vdc outputs. Each output is capable of driving a relay, pilot lamp, motor starter, solenoid, or any other load up to 2.0 A.

The B820-008 is capable of handling a total continuous current of 12 A. The module uses transistor switches to control loads connected to an external power source. These switches are designed to withstand the high surge currents typical of industrial loads.

Simplified Schematic

Following is a simplified schematic of the B820-008 10—60 Vdc Output Module.

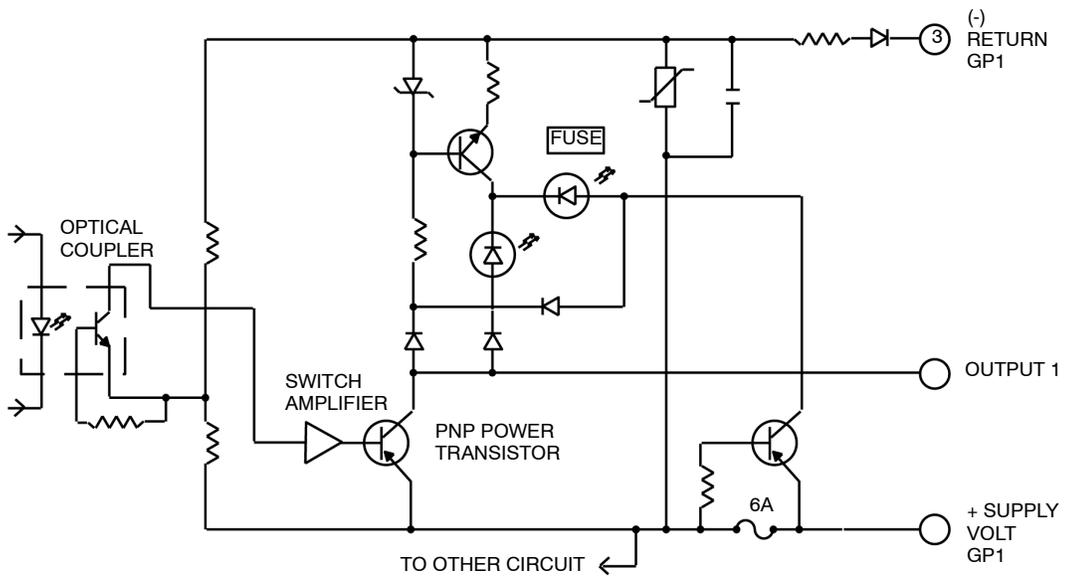

The module's eight outputs are separated into four groups of two outputs each.


B820-008 10—60 Vdc Output, Field Connections

Overview

User connections are made to a standard screw terminal strip. The rigid wiring system permits module insertion or removal without disturbing the wiring.

Terminal Numbering and Output Connections

The following diagram shows terminal numbering and output connections for the B820-008 module.

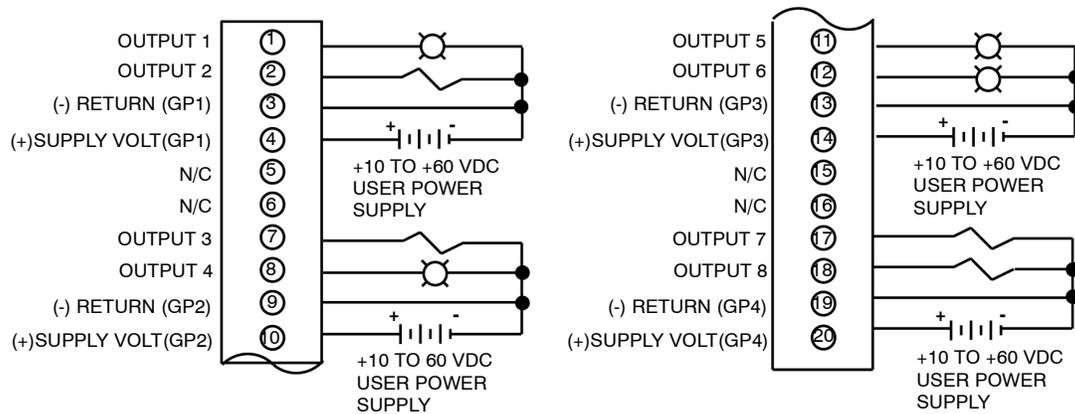

B820-008 10—60 Vdc Output, Specifications

Specification Table

The following table provides the specifications for the unit.

B820-008 Specifications		
Description	10—60 Vdc output	
Type of Operation	True high	
Number of Points	8	
Operating Voltage	10—60 Vdc	
Number of Groups	4	
Outputs/group	2	
On Current	Maximum/point	2 A
	Maximum/module	12 A
	Maximum/group	6 A
	Surge Current	10 A/channel max for 10 ms at a repetition rate of 0.05%
ON State	Voltage Drop	1.5 Vdc max @ 2 A
OFF State	Leakage Current	5 mA (max) @ 60 Vdc
Peak Voltage	80 Vdc max for 10 ms at a repetition rate of 0.05%	
Maximum Response Time	OFF→ON	1 ms (.1 ms typical)
	ON→OFF	1 ms (.1 ms typical))
dv/dt	200 V/s	
Power Required	+5 V	90 mA
	+4.3 V	80 mA
	-5 V	0 mA
External Power Supply	10—60 Vdc, 500 mA max./group (excluding field load current)	
Terminal Connector	AS-8534-000	
Fusing	One/group, 3 AG, 6 A (normal blow)	

B820-008 Parameter Configuration

Parameter and Default Values

Parameter Configuration Window

Parameter Name	Value
MAPPING	BIT (%M-0X)
OUTPUTS STARTING ADDRESS	1
OUTPUTS ENDING ADDRESS	8
OUTPUT TYPE	BINARY

1 : 140 XBF 3 : B820

Module Configuration

Parameter Name	Value (Default)	Value (Options Available)	Description
Mapping	BIT (%M-0X)	WORD (%MW-4X)	
Outputs Starting Address	1	1	
Outputs Ending Address	8	1	
Output Type	BINARY	BCD	

Mapping Parameter References

	Modsoft, Concept, ProWORX	Unity
Reference Type	Mapped as 8 bits output 0x or Mapped as 1 register output 4x	Mapped as 8 bits output %Mx or Mapped as 1 word output %MWx
Output Type	BIN/BCD	BIN/BCD

B821-108 10—60 Vdc Input (True High)

32

At a Glance

Purpose

This chapter describes the functional and physical characteristics of the B821-108 10—60 Vdc Input Module (True High).

What's in this Chapter?

This chapter contains the following topics:

Topic	Page
B821-108 10—60 Vdc Input (True High), Overview	384
B821-108 10—60 Vdc Input (True High), Field Connections	385
B821-108 10—60 Vdc Input (True High), Specifications	386
B821-108 Parameter Configuration	388


B821-108 10—60 Vdc Input (True High), Overview

General Characteristics

The B821-108 10—60 Vdc Input Module (True High) senses and converts switched input signals into logic voltage levels used by the PLC. The module allows for up to eight inputs in four groups of two. Each group shares a common reference voltage supply input. These inputs can be received from push buttons, limit and proximity switches, as well as other 10—60 Vdc sources.

Simplified Schematic

Following is a simplified schematic of the B821-108 10—60 Vdc Input Module (True High).

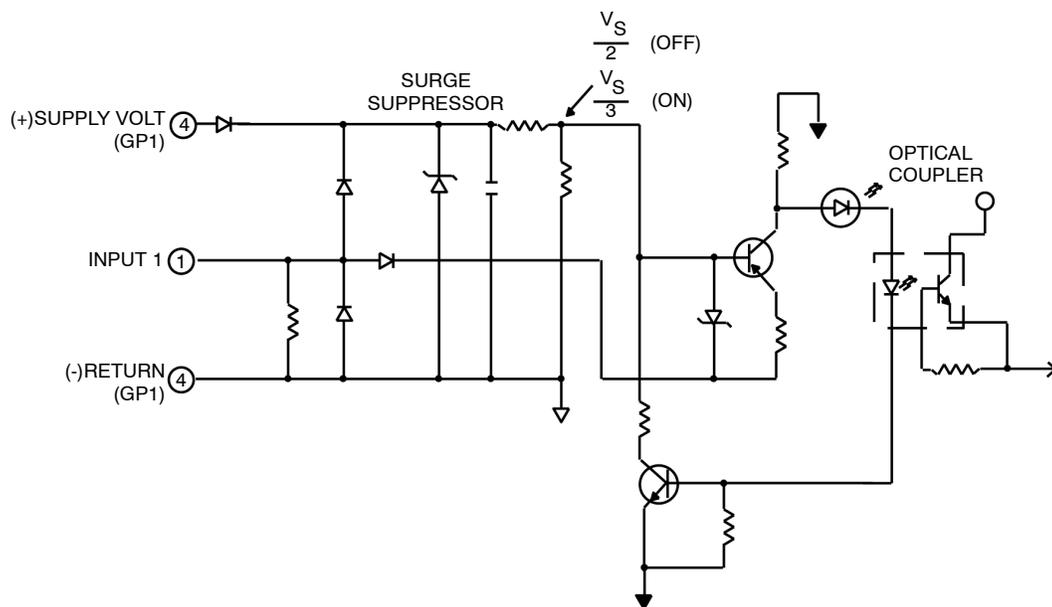


B821-108 10—60 Vdc Input (True High), Field Connections

Overview

User connections are made to a standard screw terminal strip. The rigid wiring system permits module insertion or removal without disturbing the wiring.

Terminal Numbering and Input Connections

The following diagram shows terminal numbering and input connections for the B821-108 module.

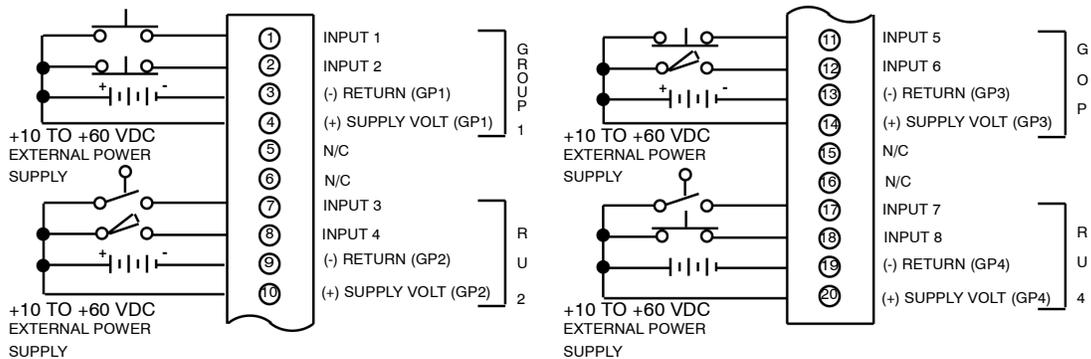

B821-108 10-60 Vdc Input (True High), Specifications

Specification Table

The following table provides the specifications for the unit.

B821-108 Specifications		
Description	10-60 Vdc input module	
Type of Operation	True high	
Number of Points	8	
Operating Voltage	10-60 Vdc	
Number of Groups	4	
Inputs/group	2	
On Level	Input Voltage	If the applied input voltage is $\geq 70\%$ of the external power supply, the input to the controller is guaranteed to be in an ON logic state. However, to achieve satisfactory margin, the input voltage should be 75% of the supply voltage. Once the input to the controller is in the ON state, it remains ON as long as the input voltage is $\geq 60\%$ of the power voltage.

Note: When designing or selecting a drive circuit for the B821-108 module, take into consideration the values listed for input currents that follow.

Specification Table, Continued

The specification table for the unit is continued below.

Input Current	Supply Volt (Vdc)	Input Volt (Vdc)	Max Input Current (mA)
	10	10	10
	24	24	15
	48	48	25
	60	60	32
OFF Level	Input Voltage	If the applied input voltage is $\leq 40\%$ of the supply voltage, the input to the controller is guaranteed to be in an OFF logic state. However, to achieve satisfactory margin, the input voltage should be $\leq 25\%$ of the supply voltage.	

Note: When designing or selecting a drive circuit for the B821, take into consideration the values listed for source resistances that follow.

**Specification
Table, Continued**

The specification table for the unit is continued below.

Source Resistance	Supply Volt (Vdc)	Input Volt (Vdc)	Max Source Resistance (W)
	10	10	200
	60	60	500
Maximum Input Voltage	Continuous	10—60 Vdc	
Maximum Response Time	OFF→ON	2.5 ms min, 11 ms max	
	ON→OFF	2.5 ms min, 11 ms max	
Power Required	+5 V	27 mA	
	+4.3 V	1 mA	
	-5 V	10 mA	
External Supply	10—60 Vdc (excluding input current)		
External Supply Current/Group	2 mA (max) @ 10 Vdc		
	5 mA (max) @ 24 Vdc		
	10 mA (max) @ 48 Vdc		
	12 mA (max) @ 60 Vdc		
Terminal Connector	AS-8534-000		

B821-108 Parameter Configuration

Parameter and Default Values

Parameter Configuration Window

Parameter Name	Value
MAPPING	BIT (%I-1X)
INPUTS STARTING ADDRESS	1
INPUTS ENDING ADDRESS	8
INPUT TYPE	BINARY

Module Configuration

Parameter Name	Value (Default)	Value (Options Available)	Description
Mapping	BIT (%I-1X)	WORD (%IW-3X)	
Inputs Starting Address	1	1	
Inputs Ending Address	8	1	
Input Type	BINARY	BCD	

Mapping Parameter References

	Modsoft, Concept, ProWORX	Unity
Reference Type	Mapped as 8 bits input 1x or Mapped as 1 register input 3x	Mapped as 8 bits input %Ix or Mapped as 1 word input %IWx
Input Type	BIN/BCD	BCD/BIN

B824–016 24 Vdc Output (True High)

33

At a Glance

Purpose

This chapter describes the functional and physical characteristics of the B824–016 24 Vdc (True High) Output Module.

What's in this Chapter?

This chapter contains the following topics:

Topic	Page
B824–016 24 Vdc Output (True High), Overview	390
B824–016 24 Vdc Output (True High), Field Connections	391
B824–016 24 Vdc Output (True High), Specifications	392
B824–016 Parameter Configuration	393

B824-016 24 Vdc Output (True High), Overview


General Characteristics

The B824-016 24 Vdc (True High) Output Module consists of sixteen independent outputs divided into two groups of eight. The B824-016 converts signals used within the PLC into 16 independent outputs. Outputs are capable of driving motor starters, relays, and a variety of other loads.

There are 16 transistor switches which are used to control loads connected to external power source. The module's 16 outputs are in two groups, eight outputs per group. Each group is fused to protect the outputs from overload currents and polarity reversal.

Simplified Schematic

Following is a simplified schematic of the B824-016 24 Vdc (True High) Output Module.

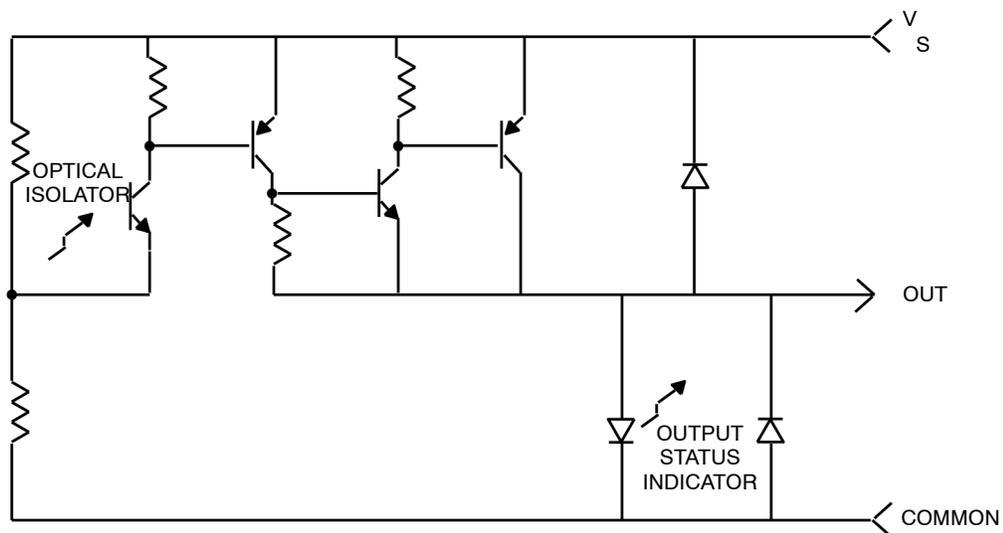


B824-016 24 Vdc Output (True High), Field Connections

Overview

User connections are made to a standard screw terminal strip. The rigid wiring system permits module insertion or removal without disturbing the wiring.

Terminal Numbering and Output Connections

The following diagram shows terminal numbering and output connections for the B824-016 module.

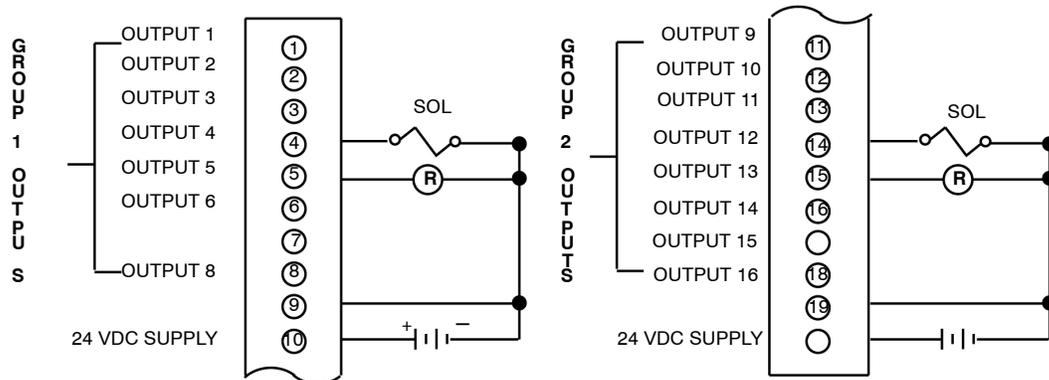

B824-016 24 Vdc Output (True High), Specifications

Specification Table

The following table provides the specifications for the unit.

B824-016 Specifications		
Description	24 Vdc output	
Type of Operation	True high	
Number of Points	16	
Operating Voltage	20–28 Vdc	
Number of Groups	2	
Outputs/group	8	
On Current	Maximum/point	2 A continuous
	Maximum/module	12 A
	Maximum/group	6 A
	Maximum Surge	5 A for 10 ms
ON State	Voltage Drop	1.8 Vdc @ 2 A
OFF State	Leakage Current	1 mA (max) @ 24 Vdc
Maximum Response Time	OFF→ON	1 ms
	ON→OFF	1 ms)
Power Required	+5 V	32 mA
	+4.3 V	260 mA
	-5 V	0 mA
External Power Supply	24 Vdc 4 V, 175 mA -polarity protected (excluding field load current)	
Terminal Connector	AS-8534-000	
Fuse	One/group, 8 A	

B824-016 Parameter Configuration

Parameter and Default Values

Parameter Configuration Window

Parameter Name	Value
MAPPING	BIT (%M-0X)
OUTPUTS STARTING ADDRESS	1
OUTPUTS ENDING ADDRESS	16
OUTPUT TYPE	BINARY

1 : 140 XBF 3 : B824

Module Configuration

Parameter Name	Value (Default)	Value (Options Available)	Description
Mapping	BIT (%M-0X)	WORD (%MW-4X)	
Outputs Starting Address	1	1	
Outputs Ending Address	16	1	
Output Type	BINARY	BCD	

Mapping Parameter References

	Modsoft, Concept, ProWORX	Unity
Reference Type	Mapped as 16 bits output 0x or Mapped as 1 register output 4x	Mapped as 16 bits output %Mx or Mapped as 1 word output %MWx
Output Type	BIN/BCD	BIN/BCD

B825–016 24 Vdc Input (True High)

34

At a Glance

Purpose

This chapter describes the functional and physical characteristics of the B825–016 24 Vdc (True High) Input Module.

What's in this Chapter?

This chapter contains the following topics:

Topic	Page
B825–016 24 Vdc Input (True High), Overview	396
B825–016 24 Vdc Input (True High), Field Connections	397
B825–016 24 Vdc Input (True High), Specifications	398
B825–016 Parameter Configuration	399

B825-016 24 Vdc Input (True High), Overview


General Characteristics

The B825-016 24 Vdc (True High) Input Module consists of a single group of 16 independent inputs. The B825-016 senses and converts switched input signals into logic voltage levels used by the PLC.

The module provides 16 inputs that share an external power supply. Inputs can be received from push buttons, limit and proximity switches, and other 24 Vdc sources. Input voltages are sensed by comparing the incoming voltage against a fixed threshold. The threshold is a function of the user-supplied field voltage.

Simplified Schematic

Following is a simplified schematic of the B825-016 24 Vdc (True High) Input Module.

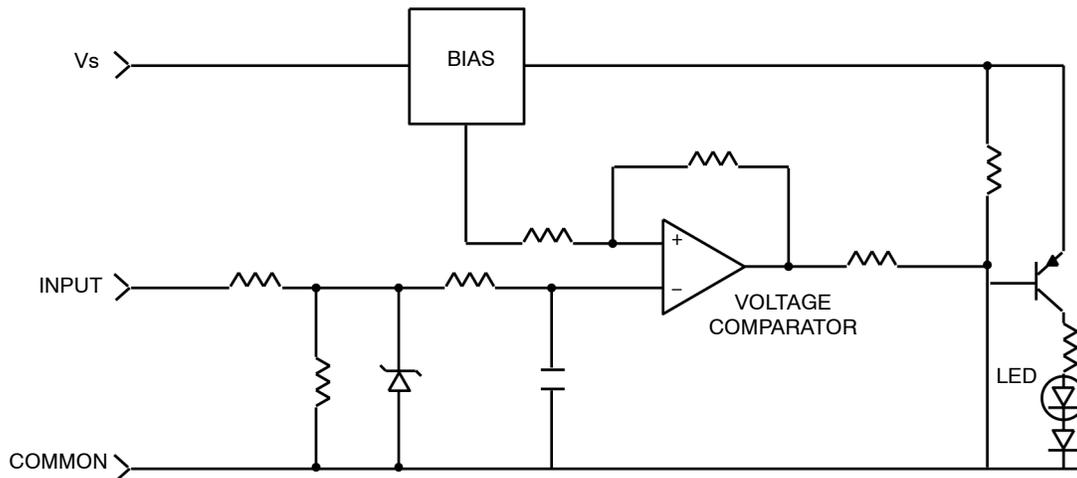


B825-016 24 Vdc Input (True High), Field Connections

Overview

User connections are made to a standard screw terminal strip. The rigid wiring system permits module insertion or removal without disturbing the wiring.

Terminal Numbering and Input Connections

The following diagram shows terminal numbering and input connections for the B825-016 module.

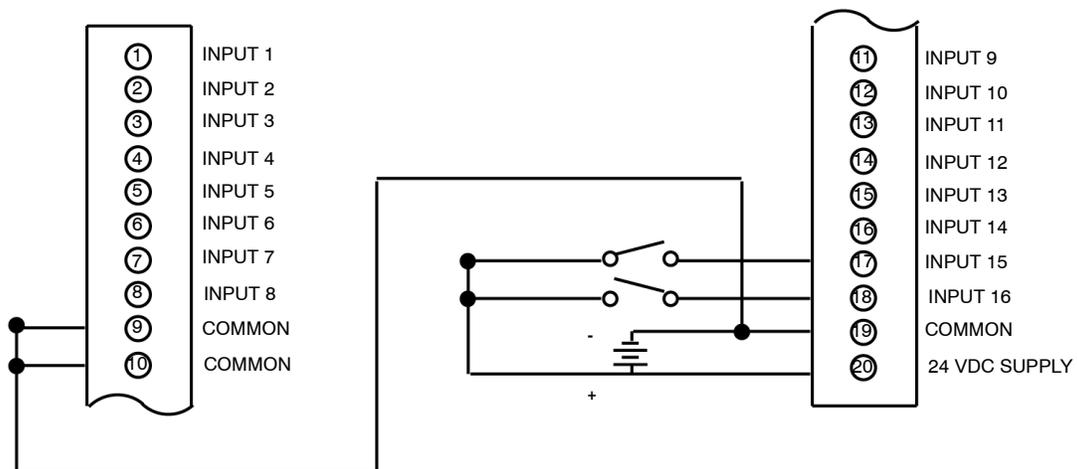

B825-016 24 Vdc Input (True High), Specifications

Specification Table

The following table provides the specifications for the unit.

B825-016 Specifications		
Description	24 Vdc input	
Type of Operation	True high	
Number of Points	16	
Operating Voltage	20–28 Vdc	
Number of Groups	1	
Inputs/group	16	
Maximum Input Voltage	Continuous	30 Vdc
	Surge	500 Vdc for 3 ms
ON Conditions	≥ 21 Vdc or .75 of Vs, whichever is less. 1000Ω max resistance to common. Input indicator ON.	
OFF Conditions	≤ 5 Vdc or .25 of Vs, whichever is greater. 25,000Ω resistance to common. Input indicator OFF.	
ON Current	6 mA (typical) @ 24 Vdc	
Maximum Response Time	OFF→ON	11 ms (2.5 ms typical)
	ON→OFF	11 ms (2.5 ms typical)
Power Required	+5 V	27 mA
	+4.3 V	1.2 mA
	-5 V	15 mA
External Power Supply	24 Vdc 4 V @ 200 mA max (Vs)	
Terminal Connector	AS-8534-000	

B825-016 Parameter Configuration

Parameter and Default Values

Parameter Configuration Window

Parameter Name	Value
MAPPING	BIT (%I-1X)
INPUTS STARTING ADDRESS	1
INPUTS ENDING ADDRESS	16
INPUT TYPE	BINARY

1 : 140 XBF 3 : B825

Module Configuration

Parameter Name	Value (Default)	Value (Options Available)	Description
Mapping	BIT (%I-1X)	WORD (%IW-3X)	
Inputs Starting Address	1	1	
Inputs Ending Address	16	1	
Input Type	BINARY	BCD	

Mapping Parameter References

	Modsoft, Concept, ProWORX	Unity
Reference Type	Mapped as 16 bits input 1x or Mapped as 1 register input 3x	Mapped as 16 bits input %Ix or Mapped as 1 word input %IWx
Input Type	BIN/BCD	BIN/BCD

B826–032 24 Vdc Output (True High)

35

B826–032 Parameter Configuration

Parameter and Default Values

Parameter Configuration Window

Parameter Name	Value
MAPPING	BIT (%M-0X)
OUTPUTS STARTING ADDRESS	1
OUTPUTS ENDING ADDRESS	32
OUTPUT TYPE	BINARY

Module Configuration

Parameter Name	Value (Default)	Value (Options Available)	Description
Mapping	BIT (%M-0X)	WORD (%MW-4X)	
Outputs Starting Address	1	1	
Outputs Ending Address	32	2	
Output Type	BINARY	BCD	

Mapping Parameter References

	Modsoft, Concept, ProWORX	Unity
Reference Type	Mapped as 32 bits output 0x or Mapped as 2 registers output 4x	Mapped as 32 bits output %Mx or Mapped as 2 words output %MWx
Output Type	BIN/BCD	BIN/BCD

B827–032 24 Vdc Input (True High)

36

At a Glance

Purpose

This chapter describes the functional and physical characteristics of the B827–032 24 Vdc (True High) Input Module.

What's in this Chapter?

This chapter contains the following topics:

Topic	Page
B827–032 24 Vdc Input (True High), Overview	404
B827–032 24 Vdc Input (True High), Field Connections	405
B827–032 24 Vdc Input (True High), Specifications	406
B827–032 Parameter Configuration	407

B827-032 24 Vdc Input (True High), Overview


General Characteristics

The B827-032 24 Vdc True High Input Module consists of a single group of 32 independent inputs. The B827 senses and converts switched input signals into logic voltage levels used by the PLC. Inputs can be received from push buttons, limit and proximity switches, and other 24 Vdc sources.

The B827-032 provides 32 inputs that share an external supply voltage. Input voltages are sensed by comparing the incoming voltage against a fixed threshold. The threshold is a function of the user-supplied field voltage.

Simplified Schematic

Following is a simplified schematic of the B827-032 24 Vdc (True High) Input Module.

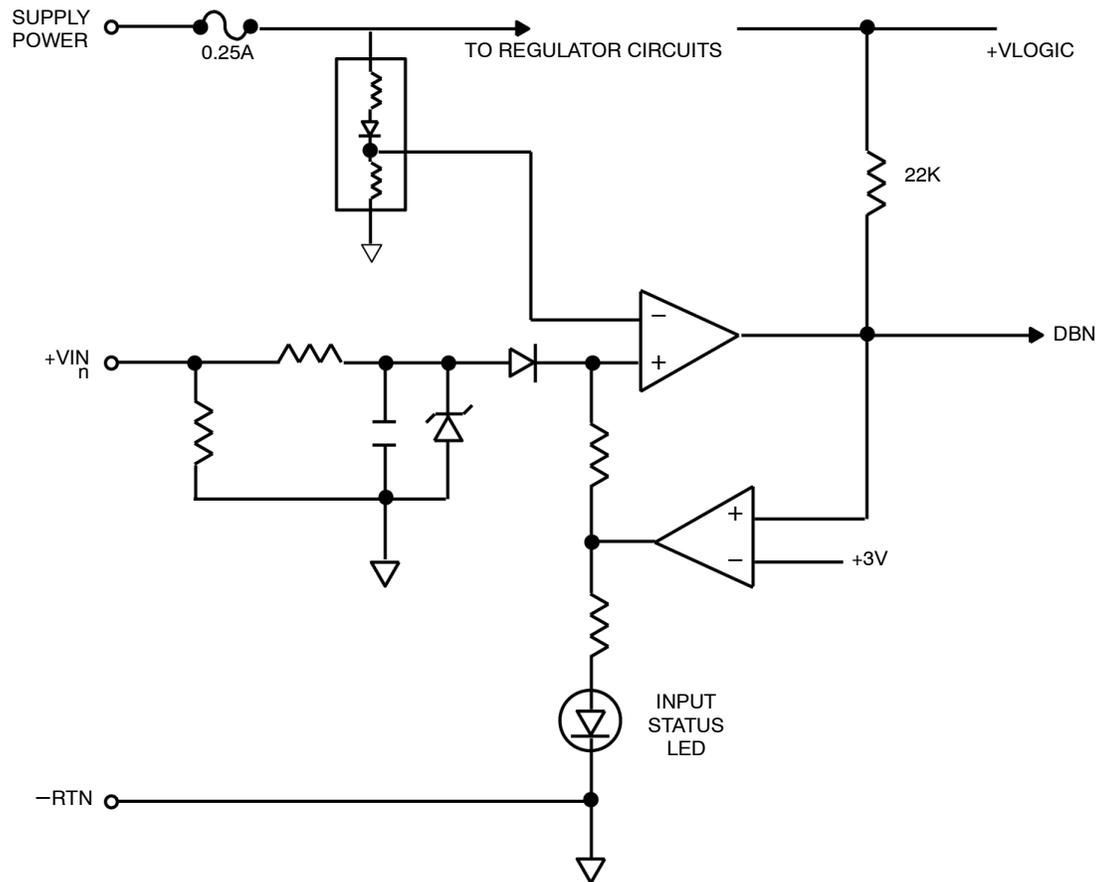


B827-032 24 Vdc Input (True High), Field Connections

Overview

User connections are made to a standard screw terminal strip. The rigid wiring system permits module insertion or removal without disturbing the wiring.

Terminal Numbering and Input Connections

The following diagram shows terminal numbering and input connections for the B827-032 module.

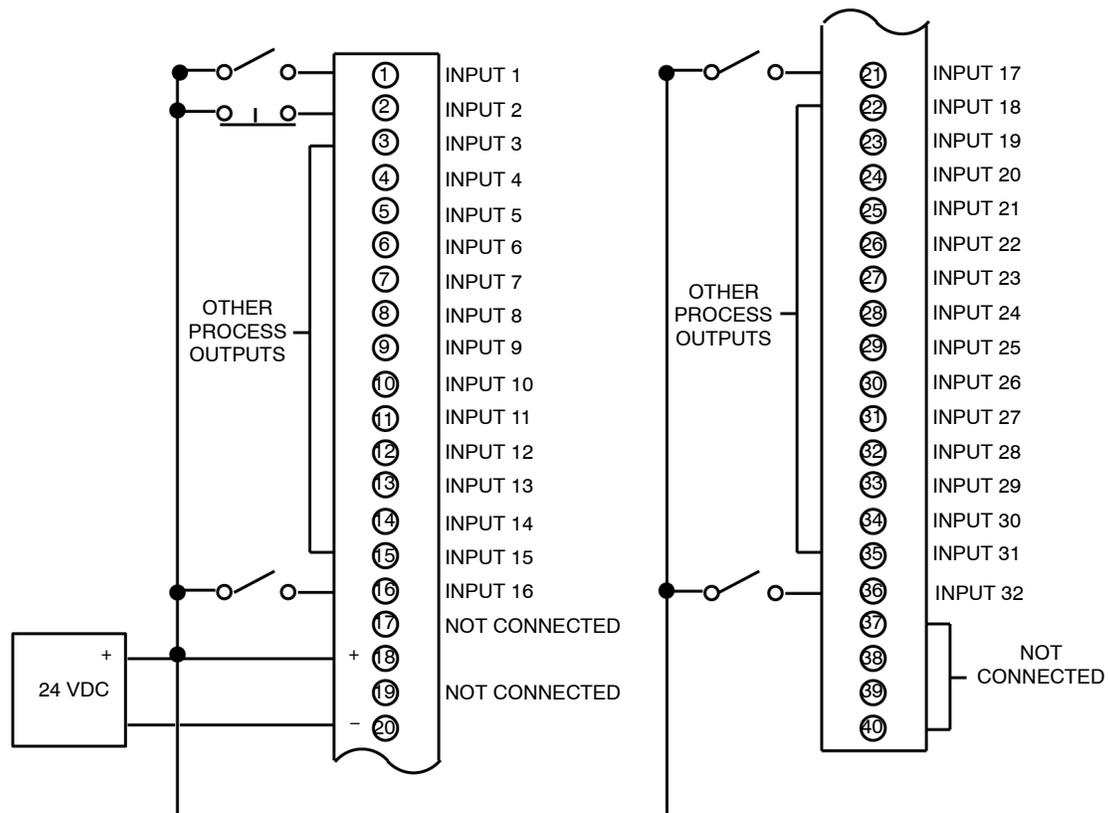

B827-032 24 Vdc Input (True High), Specifications

Specification Table

The following table provides the specifications for the unit.

B827-032 Specifications		
Description	24 Vdc high density input	
Type of Operation	True high	
Number of Points	32	
Operating Voltage	18—30 Vdc	
Number of Groups	1	
Outputs/group	32	
ON Level Input Voltage	≥22.5 Vdc or .75 of Vs, whichever is less	
OFF Level Input Voltage	≤4.5 Vdc or .25 of Vs, whichever is greater	
Input Resistance	On State	8—11 kΩ
	Off State	6—8 kΩ
Maximum Response Time	OFF→ON	0.4 ms
	ON→OFF	1 ms)
Power Required	+5 V	30 mA
	+4.3 V	1 mA
	-5 V	0 mA
External Power Supply	Supply Voltage	18—30 Vdc continuous 40 Vdc peak for 10 ms surge
	Supply Current	60 mA max over an 18—30 Vdc range
Terminal Connector	AS-8535-000	
Fuse	0.25 A	

B827-032 Parameter Configuration

Parameter and Default Values

Parameter Configuration Window

Parameter Name	Value
MAPPING	BIT (%I-1X)
INPUTS STARTING ADDRESS	1
INPUTS ENDING ADDRESS	32
INPUT TYPE	BINARY

1 : 140 XBF 3 : B827

Module Configuration

Parameter Name	Value (Default)	Value (Options Available)	Description
Mapping	BIT (%I-1X)	WORD (%IW-3X)	
Inputs Starting Address	1	1	
Inputs Ending Address	32	2	
Input Type	BINARY	BCD	

Mapping Parameter References

	Modsoft, Concept, ProWORX	Unity
Reference Type	Mapped as 32 bits input 1x or Mapped as 2 registers input 3x	Mapped as 32 bits input %Ix or Mapped as 2 words input %IWx
Input Type	BIN/BCD	BIN/BCD

B828–016 5 V TTL Output

37

At a Glance

Purpose

This chapter describes the functional and physical characteristics of the B828–016 5 V TTL Output Module.

What's in this Chapter?

This chapter contains the following topics:

Topic	Page
B828–016 5 V TTL Output, Overview	410
B828–016 5 V TTL Output, Field Connections	411
B828–016 5 V TTL Output, Specifications	412
B828–016 Parameter Configuration	413


B828-016 5 V TTL Output, Overview

General Characteristics

The B828-016 5 V TTL Output Module converts logic signals used within the controller into sixteen independent 5 V TTL outputs. These outputs are compatible with TTL and DTL logic as well as other loads such as LED displays. The module uses sixteen transistor switches which are capable of sinking load currents up to 75 mA supplied from an external 5 Vdc power source.

Simplified Schematic

Following is a simplified schematic of the B828-016 5 V TTL Output Module.

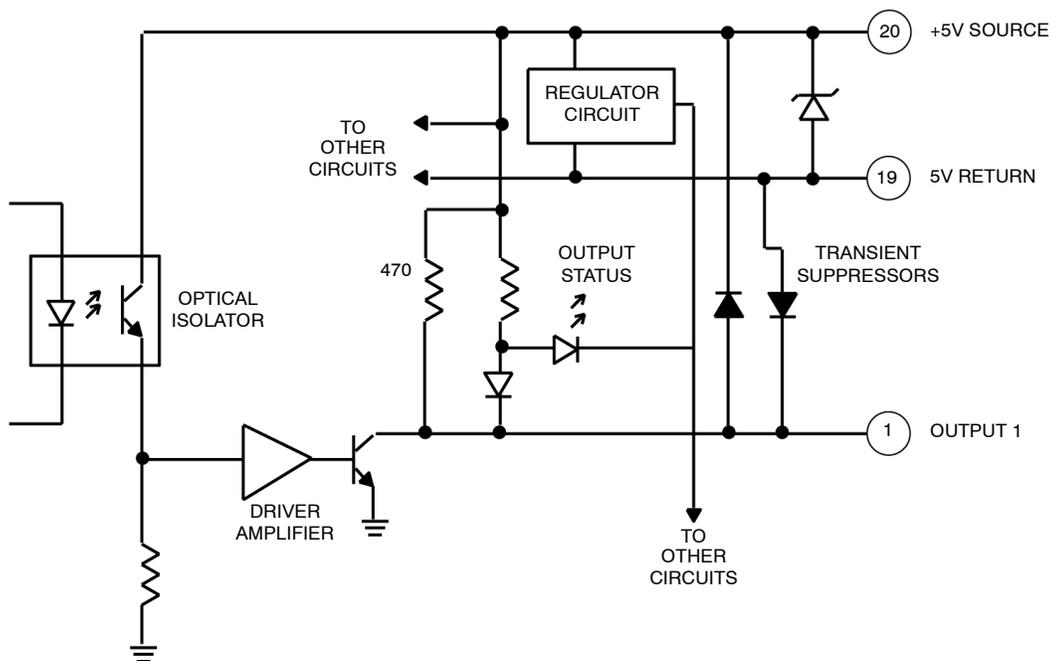


B828-016 5 V TTL Output, Field Connections

Overview

User connections are made to a standard screw terminal strip. The rigid wiring system permits module insertion or removal without disturbing the wiring.

Terminal Numbering and Output Connections

The following diagram shows terminal numbering and output connections for the B828-016 5 V TTL Output Module.

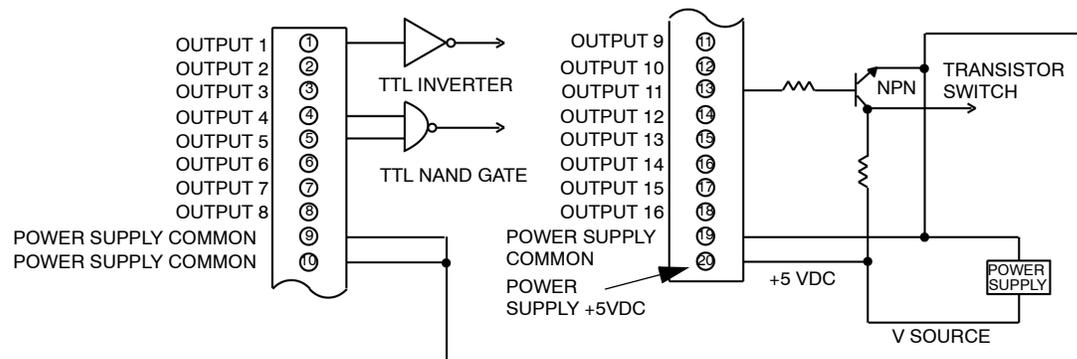

B828–016 5 V TTL Output, Specifications

Specification Table

The following table provides the specifications for the unit.

B828–016 Specifications		
Description	5 V TTL output	
Number of Points	16	
Operating Voltage	5 V TTL	
Number of Groups	1	
Outputs/group	16	
ON Level	4.0 Vdc min @ 1 mA source, 5 Vdc supply @ 4.75 Vdc	
OFF Level	0.4 Vdc max @ 75 mA rated current: sinking 75 mA max., continuous, 100 mA peak (10 ms, 20% duty cycle)	
Maximum Response Time	OFF→ON	1 ms
	ON→OFF	1 ms)
Power Required	+5 V	32 mA
	+4.3 V	220 mA
	-5 V	0 mA
External Power Supply	5.0 0.25 Vdc, 600 mA max outputs ON	
Terminal Connector	AS-8534-000	
Fusing	One/group, 1.5 A	

B828–016 Parameter Configuration

Parameter and Default Values

Parameter Configuration Window

Parameter Name	Value
MAPPING	BIT (%M-0X)
OUTPUTS STARTING ADDRESS	1
OUTPUTS ENDING ADDRESS	16
OUTPUT TYPE	BINARY

Module Configuration

Parameter Name	Value (Default)	Value (Options Available)	Description
Mapping	BIT (%M-0X)	WORD (%MW-4X)	
Outputs Starting Address	1	1	
Outputs Ending Address	16	1	
Output Type	BINARY	BCD	

Mapping Parameter References

	Modsoft, Concept, ProWORX	Unity
Reference Type	Mapped as 16 bits output 0x or Mapped as 1 register output 4x	Mapped as 16 bits output %Mx or Mapped as 1 word output %MWx
Output Type	BIN/BCD	BIN/BCD

B829–116 Fast Response 5 V TTL Input

38

At a Glance

Purpose

This chapter describes the functional and physical characteristics of the B829–116 Fast Response 5 V TTL Input Module.

What's in this Chapter?

This chapter contains the following topics:

Topic	Page
B829–116 Fast Response 5 V TTL Input, Overview	416
B829–116 Fast Response 5 V TTL Input, Field Connections	417
B829–116 Fast Response 5 V TTL Input, Specifications	418
B829–116 Parameter Configuration	419


B829–116 Fast Response 5 V TTL Input, Overview

General Characteristics

The B829–116 fast response 5 V TTL Input Module converts signals from 16 independent 5 V logic-compatible inputs into signals used by the PLC. Each input is capable of conditioning signals from TTL devices or DTL devices for use by the PLC

Simplified Schematic

Following is a simplified schematic of the B829–116 fast response 5 V TTL Input Module.

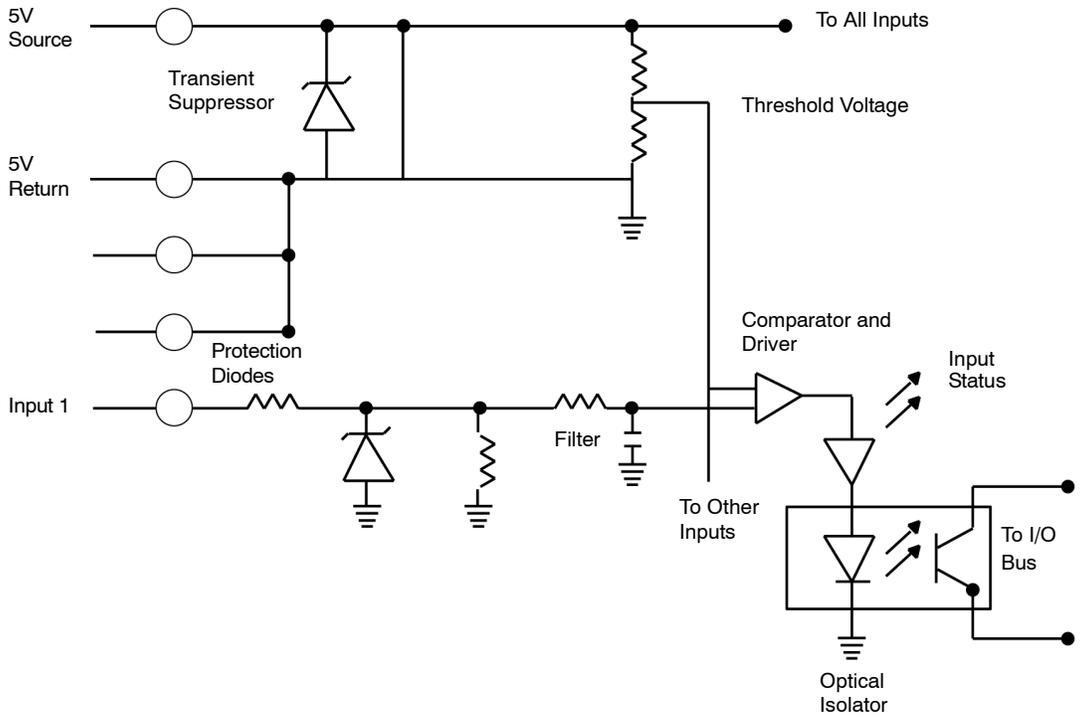


B829–116 Fast Response 5 V TTL Input, Field Connections

Overview

User connections are made to a standard screw terminal strip. The rigid wiring system permits module insertion or removal without disturbing the wiring.

Terminal Numbering and Input Connections

The following diagram shows terminal numbering and input connections for the B829–116 fast response 5 V TTL Input module

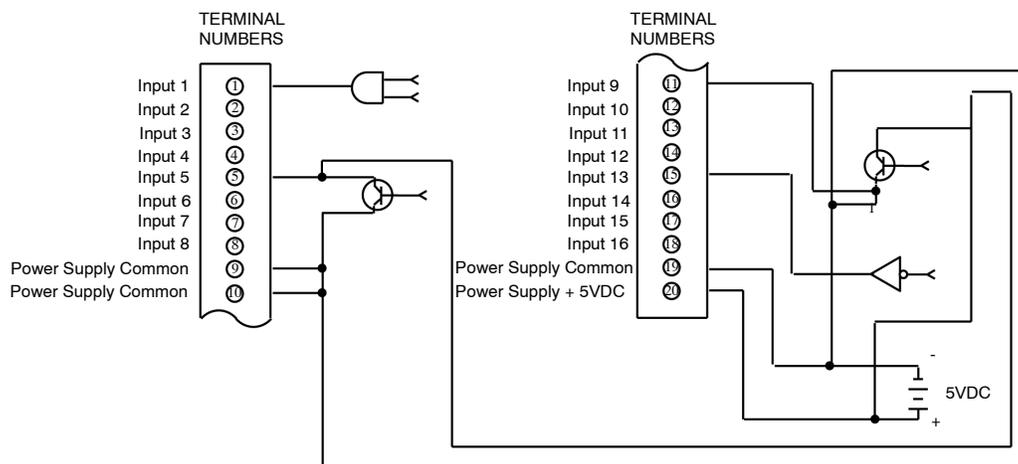

B829–116 Fast Response 5 V TTL Input, Specifications

Specification Table

The following table provides the specifications for the unit.

B829–116 Specifications		
Description	5 V TTL 16-point	
Number of Points	16	
Operating Voltage	5 V	
Number of Groups	1	
Outputs/group	16	
Input Ratings	ON Level	VIH=2.0 Vdc (minimum)
		IIL=0.1 mA (max) @ VIH=5.5 Vdc
		V (source)=5.0 Vdc
		V (max input)=8.0 V
		I (max positive clamp)=25 mA
	OFF Level	VIL=0.8 Vdc (maximum)
		IIL=1.1 mA (maximum) @ V
		(source)=5.25 Vdc and VIL=0.0 V
		V (max negative input)= -2 Vdc
		I (max negative clamp)=15 mA
Transient Voltage	100 V for 10 ms	
Maximum Response Time	OFF→ON	1 ms
	ON→OFF	1 ms
Power Required	+5 V	21 mA
	+4.3 V	1 mA
	-5 V	0 mA
External Power Supply	5.0 0.25 Vdc, 325 mA all inputs ON	
Terminal Connector	AS-8534-000	

B829–116 Parameter Configuration

Parameter and Default Values

Parameter Configuration Window

Parameter Name	Value
MAPPING	BIT (%I-1X)
INPUTS STARTING ADDRESS	1
INPUTS ENDING ADDRESS	16
INPUT TYPE	BINARY

Module Configuration

Parameter Name	Value (Default)	Value (Options Available)	Description
Mapping	BIT (%I-1X)	WORD (%IW-3X)	
Inputs Starting Address	1	1	
Inputs Ending Address	16	1	
Input Type	BINARY	BCD	

Mapping Parameter References

	Modsoft, Concept, ProWORX	Unity
Reference Type	Mapped as 16 bits input 1x or Mapped as 1 register input 3x	Mapped as 16 bits input %Ix or Mapped as 1 Word input %IWx
Input Type	BIN/BCD	BIN/BCD

B832–016 24 Vdc Output (True Low)

39

At a Glance

Purpose

This chapter describes the functional and physical characteristics of the B832–016 24 Vdc (True Low) Output Module.

What's in this Chapter?

This chapter contains the following topics:

Topic	Page
B832–016 24 Vdc Output (True Low), Overview	422
B832–016 24 Vdc Output (True Low), Field Connections	423
B832–016 24 Vdc Output (True Low), Specifications	424
B832–016 Parameter Configuration	425


B832-016 24 Vdc Output (True Low), Field Connections

Overview

User connections are made to a standard screw terminal strip. The rigid wiring system permits module insertion or removal without disturbing the wiring.

Terminal Numbering and Output Connections

The following diagram shows terminal numbering and output connections for the B832-016 24 Vdc (True Low) Output module

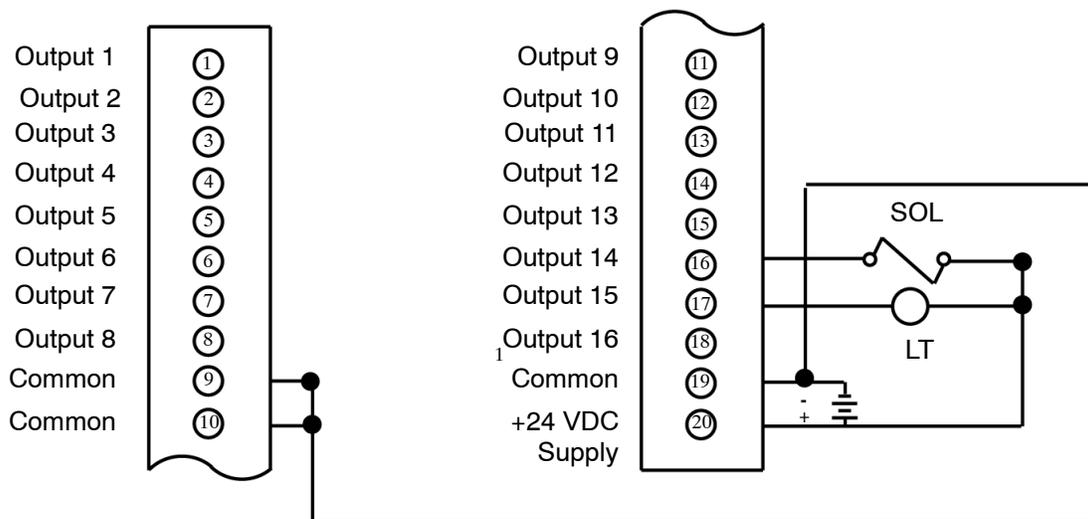

B832–016 24 Vdc Output (True Low), Specifications

Specification Table

The following table provides the specifications for the unit.

B832–016 Specifications		
Description		24 Vdc output
Type of Operation		True low
Number of Points		16
Operating Voltage		20–28 Vdc
Peak Voltage		33 Vdc for 1 s
Number of Groups		2
Outputs/group		8
On Current	Maximum/point	250 mA
	Surge Current	1 A for 10 ms
	Maximum/group	2 A
	Maximum/module	4 A
Off Current		0.5 mA maximum
On Voltage Drop		0.5 Vdc maximum/output @ 250 mA
Maximum Response Time	OFF→ON	1 ms
	ON→OFF	1 ms)
Power Required	+5 V	32 mA
	+4.3 V	235 mA
	-5 V	0 mA
External Power Supply		24 Vdc, 4 V, 600 mA (excluding field load current)
Terminal Connector		AS-8534-000
Fusing		1/module, 6 A

B832-016 Parameter Configuration

Parameter and Default Values

Parameter Configuration Window

Parameter Name	Value
MAPPING	BIT (%M-0X)
OUTPUTS STARTING ADDRESS	1
OUTPUTS ENDING ADDRESS	16
OUTPUT TYPE	BINARY

1 : 140 XBF 3 : B832

Module Configuration

Parameter Name	Value (Default)	Value (Options Available)	Description
Mapping	BIT (%M-0X)	WORD (%MW-4X)	
Outputs Starting Address	1	1	
Outputs Ending Address	16	1	
Output Type	BINARY	BCD	

Mapping Parameter References

	Modsoft, Concept, ProWORX	Unity
Reference Type	Mapped as 16 bits output 0x or Mapped as 1 register output 4x	Mapped as 16 bits output %Mx or Mapped as 1 word output %MWx
Output Type	BIN/BCD	BIN/BCD

B833–016 24 Vdc Input (True Low)

40

Overview

Purpose

This chapter describes the functional and physical characteristics of the B833–016 24 Vdc (True Low) Input Module.

What's in this Chapter?

This chapter contains the following topics:

Topic	Page
B833–016 24 Vdc Input (True Low), Overview	428
B833–016 24 Vdc Input (True Low), Field Connections	429
B833–016 24 Vdc Input (True Low), Specifications	430
B833–016 Parameter Configuration	431

B833-016 24 Vdc Input (True Low), Overview


General Characteristics

The B833-016 24 Vdc (True Low) Input Module consists of two groups of eight independent inputs. The B833-016 senses and converts switched input signals into logic voltage levels used by the PLC.

Inputs can be received from push buttons, limit and proximity switches, and other 24 Vdc sources. The module provides 16 inputs that share an external power supply. Input voltages are sensed by comparing the incoming voltage against a fixed threshold.

Simplified Schematic

Following is a simplified schematic of the B833-016 24 Vdc (True Low) Input Module.

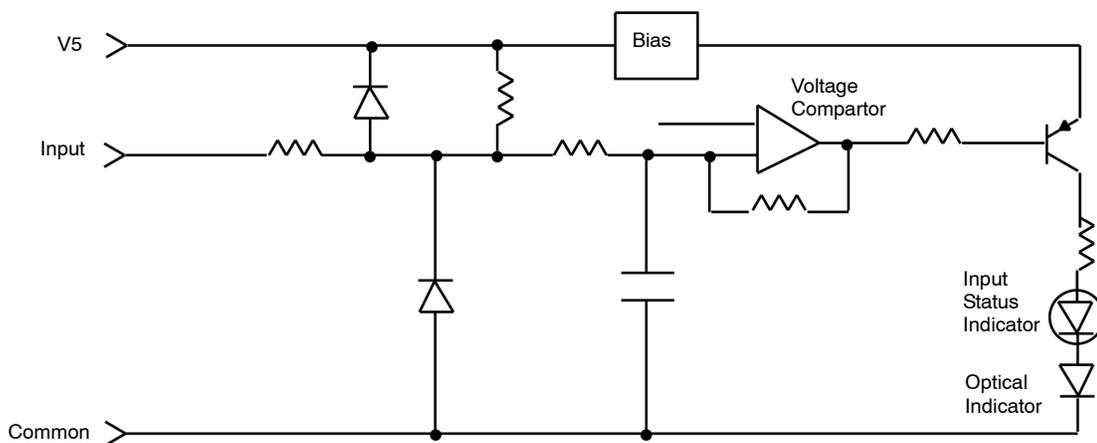


B833-016 24 Vdc Input (True Low), Field Connections

Overview

User connections are made to a standard screw terminal strip. The rigid wiring system permits module insertion or removal without disturbing the wiring.

Terminal Numbering and Input Connections

The following diagram shows terminal numbering and input connections for the B833-016 24 Vdc (True Low) Input Module.

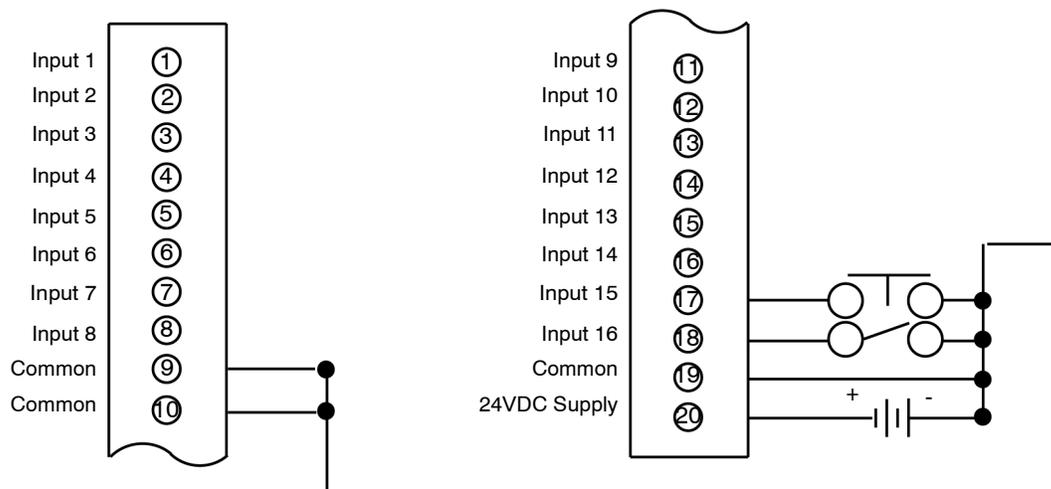

B833-016 24 Vdc Input (True Low), Specifications

Specification Table

The following table provides the specifications for the unit.

B833-016 Specifications		
Description	24 Vdc true low input	
Type of Operation	True low	
Number of Points	16	
Operating Voltage	20—28 Vdc	
Number of Groups	2	
Outputs/group	8	
Maximum Input Voltage	100 Vdc for 3 ms	
ON Conditions	≤2.6 Vdc or .13 of Vs, whichever is greater. 200Ω max resistance to common. Input indicator ON.	
OFF Conditions	≥21 Vdc or .75 of Vs, whichever is less. 10,000Ω min resistance to common. Input indicator OFF.	
Maximum Response Time	OFF→ON	11 ms
	ON→OFF	11 ms)
Power Required	+5 V	27 mA
	+4.3 V	2 mA
	-5 V	0 mA
External Power Supply	24 Vdc, 4 V, 300 mA (excluding field load current)	
Terminal Connector	AS-8534-000	

B833-016 Parameter Configuration

Parameter and Default Values

Parameter Configuration Window

Parameter Name	Value
MAPPING	BIT (%I-1X)
INPUTS STARTING ADDRESS	1
INPUTS ENDING ADDRESS	16
INPUT TYPE	BINARY

Module Configuration

Parameter Name	Value (Default)	Value (Options Available)	Description
Mapping	BIT (%I-1X)	WORD (%IW-3X)	
Inputs Starting Address	1	1	
Inputs Ending Address	16	1	
Input Type	BINARY	BCD	

Mapping Parameter References

	Modsoft, Concept, ProWORX	Unity
Reference Type	Mapped as 16 bits input 1x or Mapped as 1 register input 3x	Mapped as 16 bits input %Ix or Mapped as 1 word input %IWx
Input Type	BIN/BCD	BIN/BCD

B836-016 12—250 Vdc Isolated Output

41

At a Glance

Purpose This chapter describes the functional and physical characteristics of the B836-016 12—250 Vdc Isolated Output Module.

What's in this Chapter? This chapter contains the following topics:

Topic	Page
B836-016 12—250 Vdc Isolated Output, Overview	434
B836-016 12—250 Vdc Isolated Output, Field Connections	435
B836-016 12—250 Vdc Isolated Output, Specifications	437
B836-016 Parameter Configuration	438

B836-016 12—250 Vdc Isolated Output, Overview

General Characteristics

The B836-016 12—250 Vdc Isolated Output Module accepts up to 16 signals from a 984 PLC and converts them to independent outputs. The module's essential function is to switch one or more field circuits OFF


At any given time, one or more output channel's signals may be in a true high configuration while one or more of the remaining output channel's signals are in a true low configuration. The output signals are capable of driving displays, relays, lamps, or any load connected to a 12—250 Vdc user supplied voltage source. Finally, the module is fused against overload currents and protected from accidental polarity reversal.

Since all of the 16 circuits are the same, describing one circuit's function describes the module's function.

Data commands from the controller are shipped via OURBUS to the OBS communications chip in the B836-016 module via Modicon's standard data interface. The OBS chip directs the signal to the addressed channel which in turn feeds the transistor driver, couples through the ISOGATE and turns the field effect transistor (FET) switch on. Since the circuit is a completely floating arrangement, it is equally useful in a true high (sourcing) or true low (sinking) configuration.

Simplified Schematic Diagram

Following is a simplified block diagram of the B836-016 12—250 Vdc Isolated Output Module.

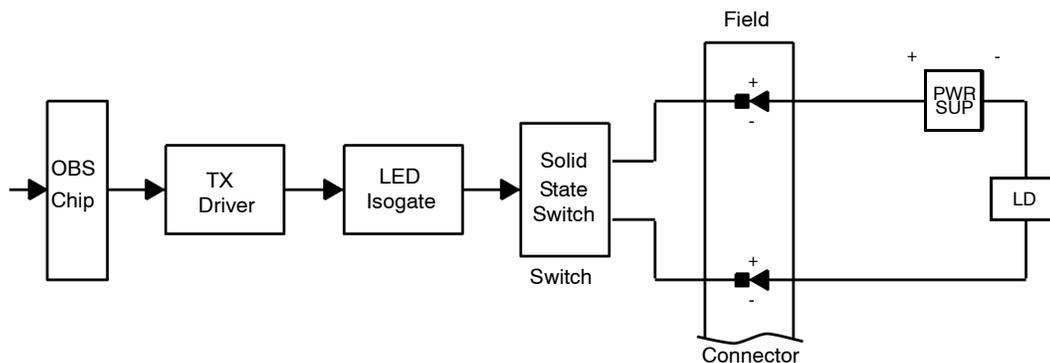

Note: Certain large inductive load conditions may require external reverse diodes placed directly across the load for complete circuit protection.


B836-016 12—250 Vdc Isolated Output, Field Connections

Overview

User connections are made to a standard screw terminal strip. The rigid wiring system permits module insertion or removal without disturbing the wiring.


Terminal Numbering and Output Connections

The following figure shows the terminal numbering and output connections required.

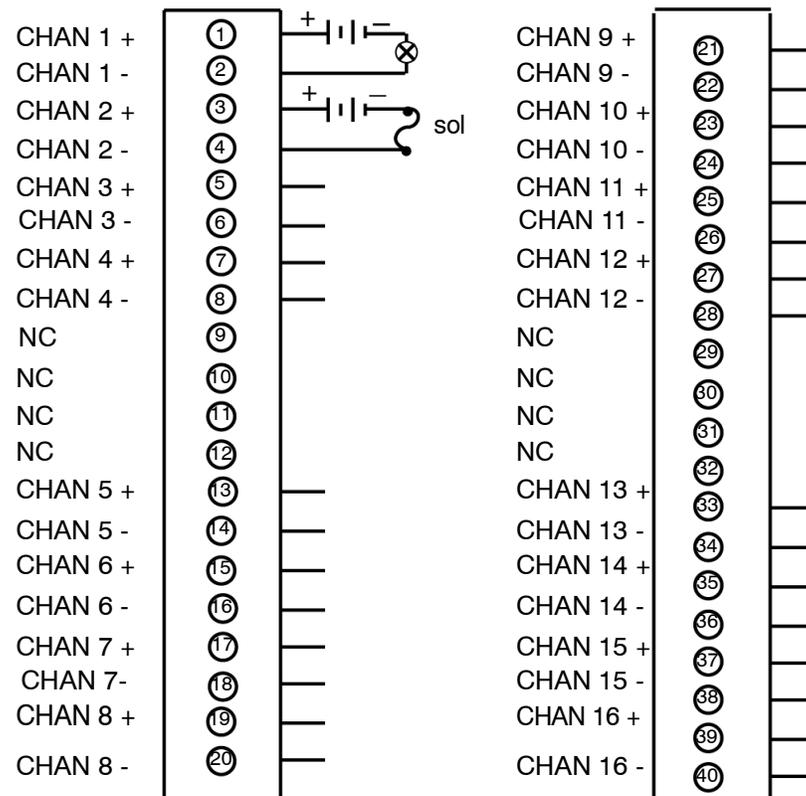

Typical User-Side Field Connector Circuitry

The following figure shows an example of typical user-side field connector circuitry.

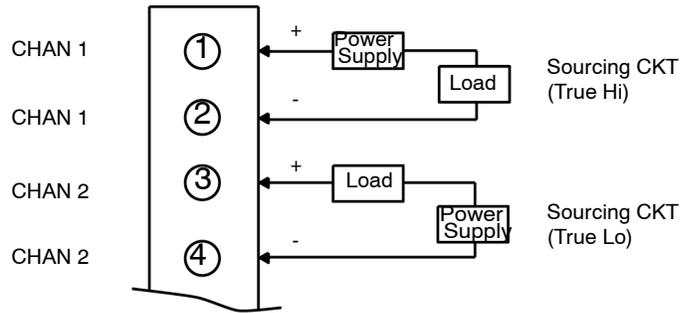

B836-016 12-250 Vdc Isolated Output, Specifications

Specifications

B836-016 Specifications

Description	12-250 Vdc isolated output	
Number of Points	16	
Operating Voltage	12-250 Vdc	
Number of Groups	16	
Outputs/group	1	
Maximum Load Current	0.75 A (typical) @ 250 Vdc	
	1 A (typical) @125 Vdc	
	1.5 A (typical) @ 48 Vdc	
Surge Current	5.0 A max (for 10 ms @ 1 s repetition rate)	
Maximum OFF Leakage Current	1 mA	
Maximum Load Current	5 mA	
ON State Voltage Drop	3. V max @ 1.50 A	
Maximum Output Current	8.0 A dc total switched current (all channels cumulative)	
Minimum Output Current	15.0 mA dc (lower current des not guarantee indicator operation)	
Maximum Response Time	OFF→ON	1 ms
	ON →OFF	5 ms
Power Required	+5 V	50 mA
	+4.3 V	603 mA
	-5 V	0 mA
Terminal Connector	AS-8535-000	
Fusing	1/group, 4 A	

B836-016 Parameter Configuration

Parameter and Default Values

Parameter Configuration Window

Parameter Name	Value
MAPPING	BIT (%M-0X)
OUTPUTS STARTING ADDRESS	1
OUTPUTS ENDING ADDRESS	16
OUTPUT TYPE	BINARY

1 : 140 XBP 3 : B836

Module Configuration

Parameter Name	Value (Default)	Value (Options Available)	Description
Mapping	BIT (%M-0X)	WORD (%MW-4X)	
Outputs Starting Address	1	1	
Outputs Ending Address	16	1	
Output Type	BINARY	BCD	

Mapping Parameter References

	Modsoft, Concept, ProWORX	Unity
Reference Type	Mapped as 16 bits output 0x or Mapped as 1 register output 4x	Mapped as 16 bits output %Mx or Mapped as 1 word output %MWx
Output Type	BIN/BCD	BIN/BCD

B837–016 24 Vac/Vdc Input (True High)

42

At a Glance

Purpose

This chapter describes the functional and physical characteristics of the B837–016 24 Vac/Vdc (True High) Input Module.

What's in this Chapter?

This chapter contains the following topics:

Topic	Page
B837–016 24 Vac/Vdc Input (True High), Overview	440
B837–016 24 Vac/Vdc Input (True High), Field Connections	441
B837–016 24 Vac/Vdc Input (True High), Specifications	442
B837–016 Parameter Configuration	443

B837-016 24 Vac/Vdc Input (True High), Overview


General Characteristics

The B837-016 24 Vac/Vdc (True High) Input module senses OFF and ON input signals from its field circuitry and converts them to logic levels used by a Modicon PLC. The module's 16 inputs are separated into two groups of eight channels, each group being totally isolated from the other.

Although both groups use common return wires, none has a definite relationship to system ground unless established in the user's field circuitry. Since both groups nominally employ independent power return sources, both ac and dc powered field circuits may input to the module at the same time.

Simplified Schematic Diagram

Following is a simplified block diagram of the B837-016 24 Vac/Vdc (True High) Input Module.

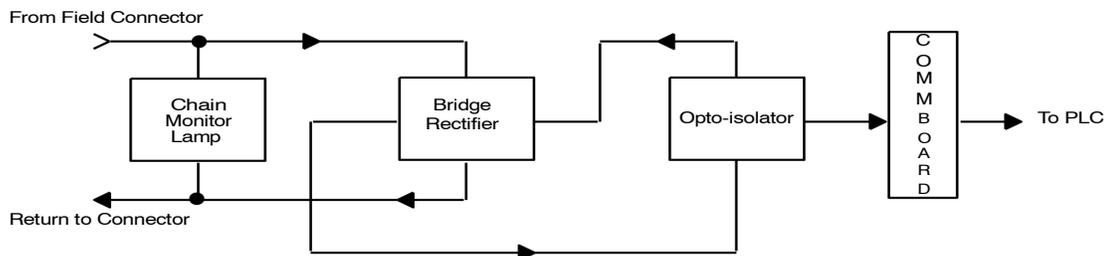

When the user's ac/dc powered field circuit goes ON - as the result of a limit switch for example - it presents the field power voltage at the module's appropriate input channel. When the input voltage meets or exceeds the module's **guaranteed ON** threshold, the resulting voltage turns the channel monitor lamp ON, current flows through the bridge rectifier and subsequently the opto-isolator (OPTO-ISOL) circuit. Given a nominal 24 V field power supply and 1000Ω maximum input source impedance, the module's channel monitor lamps will indicate ON and OFF when voltages are 20.4 Vac/19.2 Vdc for the high level ON; and 6 Vac/10 Vdc for the low level OFF respectively. The optical energy goes to the communications board (COMM BOARD) where the Orbus output register is set to represent the field circuit's ON state. As long as the field input status remains true, the module will communicate this status each time it is polled by the controller.

Note: Reversal of external signal polarity will not cause channel circuit damage as circuit design is indifferent to accidental polarity reversal.


B837-016 24 Vac/Vdc Input (True High), Field Connections

Overview

User connections are made to a standard screw terminal strip. The rigid wiring system permits module insertion or removal without disturbing the wiring.

Terminal Numbering and Input Connections

The following diagram shows terminal numbering and input connections for the B837-016 24 Vac/Vdc True High Input Module.

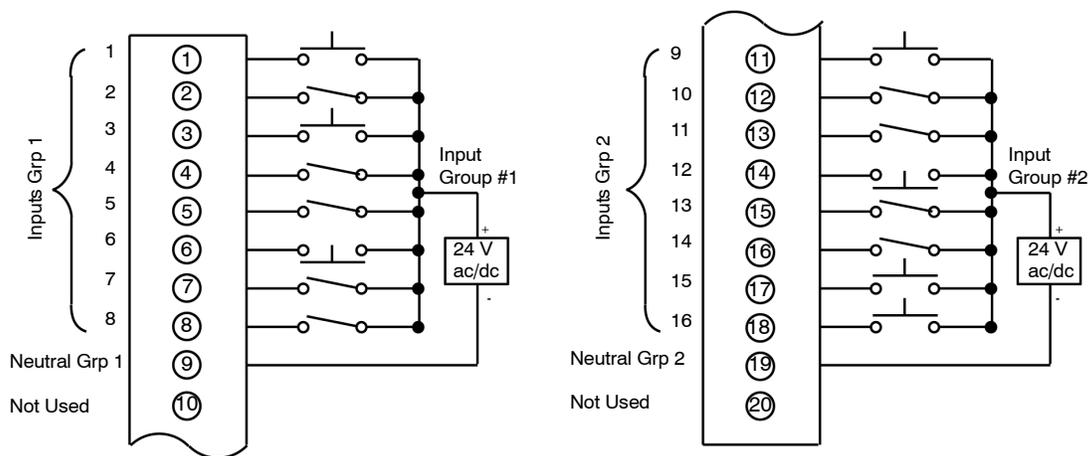

Note: To use both input groups with a single power supply, jump terminals #9 and #19.

B837-016 24 Vac/Vdc Input (True High), Specifications

Specification Table

The following table provides the specifications for the unit.

B837-016 Specifications		
Description	24 Vac/dc input	
Number of Points	16	
Operating Voltage	20.4—27 Vac/47—63 Hz; 19.2—30 Vdc	
Number of Groups	2	
Outputs/group	8	
Maximum Input Voltage	Continuous	27 Vac/30 Vdc)
	Inrush	32 Vac/36 Vdc for 10s; 58 V peak 10 ms
ON Conditions	≥ 20.4 Vac or 19.2 Vdc with input source impedance of 1 k maximum input current 10 2 mA	
OFF Conditions	< 6 Vac/10 Vdc < 27 Vac with input source impedance ≥15 k < 30 Vdc with input source Impedance ≥30 k	
Input ON Current	10 mA (max), 5 mA (minimum)	
Maximum Response Time	OFF→ON	6 ms
	ON→OFF	18 ms
Power Required	+5 V	40 mA
	+4.3 V	1 mA
	-5 V	15 mA
External Power Supply	24 Vac/dc, 300 mA	
Terminal Connector	AS-8534-000	

B837-016 Parameter Configuration

Parameter and Default Values

Parameter Configuration Window

Parameter Name	Value
MAPPING	BIT (%I-1X)
INPUTS STARTING ADDRESS	1
INPUTS ENDING ADDRESS	16
INPUT TYPE	BINARY

1 : 140 XBF 3 : B837

Module Configuration

Parameter Name	Value (Default)	Value (Options Available)	Description
Mapping	BIT (%I-1X)	WORD (%IW-3X)	
Inputs Starting Address	1	1	
Inputs Ending Address	16	1	
Input Type	BINARY	BCD	

Mapping Parameter References

	Modsoft, Concept, ProWORX	Unity
Reference Type	Mapped as 16 bits input 1x or Mapped as 1 register 3x	Mapped as 16 bits input %Ix or Mapped as 1 word input %IWx
Input Type	BIN/BCD	BIN/BCD

B838–032 24 Vdc Output (True High)

43

At a Glance

Purpose

This chapter describes the functional and physical characteristics of the B838–032 24 Vdc (True High) Output Module.

What's in this Chapter?

This chapter contains the following topics:

Topic	Page
B838–032 24 Vdc Output (True High), Overview	446
B838–032 24 Vdc Output (True High), Field Connections	447
B838–032 24 Vdc Output (True High), Specifications	448
B838–032 Parameter Configuration	449

B838-032 24 Vdc Output (True High), Overview


General Characteristics

The B838-032 24 Vdc (True High) Output Module consists of a four groups of eight outputs for a total of 32 outputs. The B838-032 converts logic signals used within the PLC into 32 24 Vdc outputs.

Outputs are capable of driving relays, pilot lamps, and other loads rated at 1/4 A. Each group of eight share an external supply voltage and is fused at 6.3 A. The outputs are designed to withstand the extreme voltage transients often encountered in an industrial environment.

Simplified Schematic Diagram

Following is a simplified schematic of the B838-032 24 Vdc (True High) Output Module.

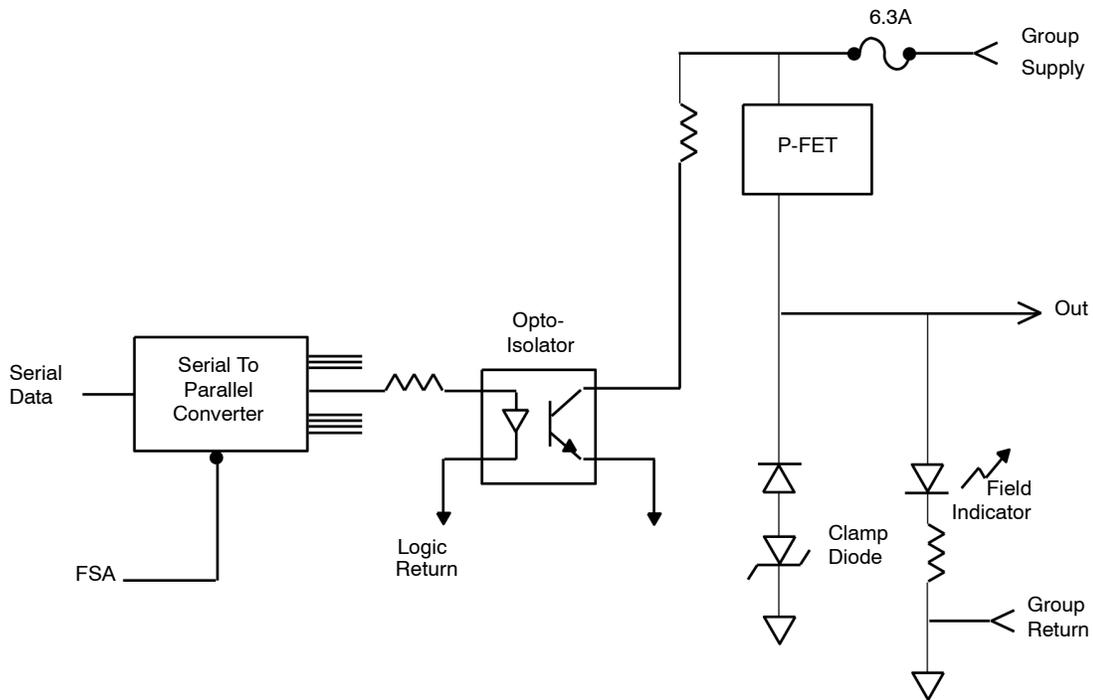


B838-032 24 Vdc Output (True High), Field Connections

Overview

User connections are made to a standard screw terminal strip. The rigid wiring system permits module insertion or removal without disturbing the wiring.

Terminal Numbering and Output Connections

The following diagram shows terminal numbering and output connections for the B838-032 24 Vdc (True High) Output Module

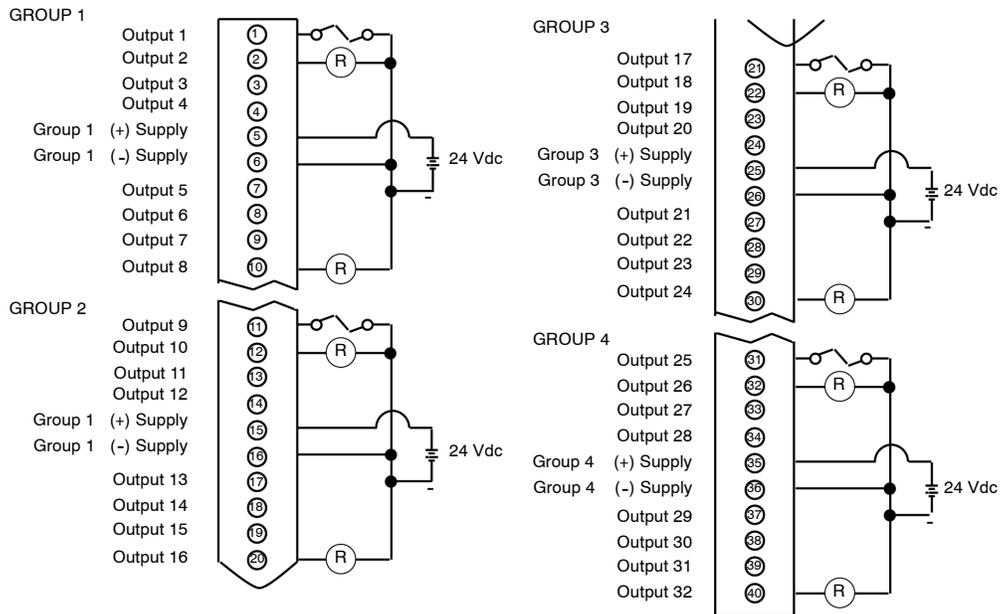

B838–032 24 Vdc Output (True High), Specifications

Specification Table The following table provides the specifications for the unit.

B838–032 Specifications		
Description		24 Vdc output
Type of Operation		True High
Number of Points		32
Operating Voltage		20—30 Vdc
Number of Groups		4
Outputs/group		8
Load Voltage	Ripple Voltage	4.0 peak to peak @ 10 kHz or less
	Peak Voltage	33 V max
	ON State Voltage Drop	1.0 Vdc @ 1/2 A @ full power
Load Current	Continuous Current	0.50 A max / output, 16 A/module maximum
	Surge Current	The surge current of the B838 is 2.5 A for 0.5 ms, and should not be exceeded. If a short circuit (momentary or sustained) exists, the FET on the output may fail prior to the group fuse blowing. Modicon recommends one of the following options to protect the outputs:1) Add external fuses to each output (1 - 1.5 A fast blow),2) Add external current limiting resistors to protect the output FET
Lamp Loads		Up to 5 W
Inductive Load Clamp Voltage		-20 V nominal
Inductive Clamp Current		1/2 A peak, 0.6 Hz up to 3.0 Hz
Fast Contactor Turn Off		<60 ms with a 3.0 Hz load
Off State Leakage Current		1 mA max @ 30 Vdc
Maximum Response Time (Resistive Load)	OFF→ON	1 ms
	ON→OFF	1 ms
Power Required	+5 V	160 mA
	+4.3 V	1 mA
Power Required (Cont.)	-5 V	0 mA
External Power Supply		24 Vdc 4 V, 125 mA (excluding field load current)
Terminal Connector		AS-8535-000

B838–032 Parameter Configuration

Parameter and Default Values

Parameter Configuration Window

Parameter Name	Value
MAPPING	BIT (%M-0X)
OUTPUTS STARTING ADDRESS	1
OUTPUTS ENDING ADDRESS	32
OUTPUT TYPE	BINARY

1 : 140 XBF 3 : B838

Module Configuration

Parameter Name	Value (Default)	Value (Options Available)	Description
Mapping	BIT (%M-0X)	WORD (%MW-4X)	
Outputs Starting Address	1	1	
Outputs Ending Address	32	2	
Output Type	BINARY	BCD	

Mapping Parameter References

	Modsoft, Concept, ProWORX	Unity
Reference Type	Mapped as 32 bits output 0x or Mapped as 2 registers output 4x	Mapped as 32 bits output %Mx or Mapped as 2 words output % MWx
Output Type	BIN/BCD	BIN/BCD

B840–108 Relay Output



At a Glance

Purpose

This chapter describes the functional and physical characteristics of the B840–108 Relay Output Module.

What's in this Chapter?

This chapter contains the following topics:

Topic	Page
B840–108 Relay Output, Overview	452
B840–108 Relay Output, Field Connections	454
840–108 Relay Output, Specifications	455
B840–108 Parameter Configuration	456

B840-108 Relay Output, Overview

General Characteristics


The B840-108 Relay Output Module converts signals from the 800 Series Ourbus to eight independent relay outputs. Each output is capable of driving relays, pilot lamps, or other loads up to 2 A.

The module utilizes eight high-reliability mercury-wetted relays to control the loads. Each of the eight outputs is electrically isolated from the I/O bus and from the other seven outputs by the relay coil. These outputs are capable of switching 100 VA maximum instantaneous power associated with ac or dc loads. Such devices may range from relays and pilot lamps to multiplexed low level analog signals.

Each output has an RC snubber to protect the mercury wetted contacts from arcing caused by rapid rate of rise of applied voltage from inductive loads upon instantaneous opening of the contacts. The output signals can withstand severe voltage transients that may be encountered in industrial environments—i.e., the voltage transients will not propagate through the relay to the Ourbus, thus protecting all other controller system components from damage. All output circuits are also fused to protect against overload currents.

Simplified Schematic Diagram

Following is a simplified schematic diagram of the B840-108 Relay Output Module.

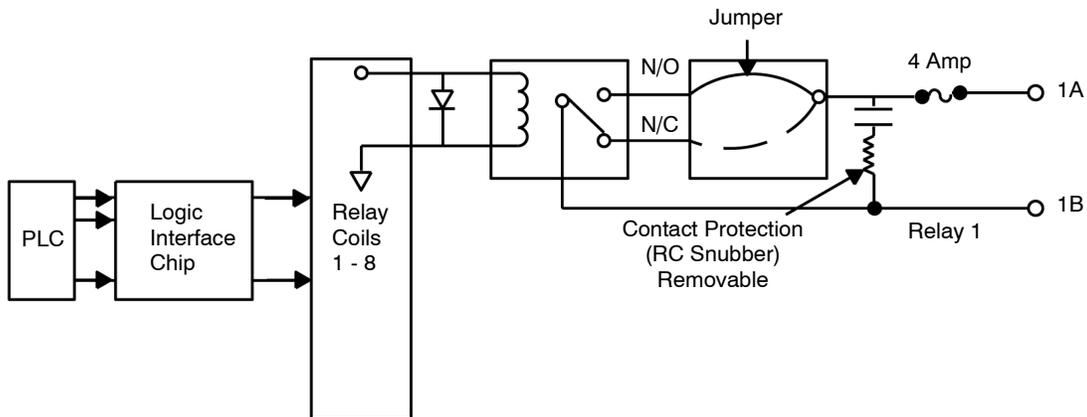

The module is user-configurable as to setting up for normally-open or normally-closed operation of the relays as described below. You can also optionally configure the RC snubber circuit to remove it when minimal leakage current applications such as data multiplexing are being used.

The logic interface chip samples the eight logic level signals simultaneously from the PLC on each scan and holds these samples to drive the appropriate reed relay coil. Assuming a normally-open jumpered configuration, when the relay coil is energized, the reed relay contacts conduct current from the output A terminal to the output B terminal.

Configuration

The B840-108 Relay Module is initially shipped with all 8 channels jumpered for the normally-open configuration with all snubber circuits connected. You may wire any of the channels for either normally-open or normally-closed operation by transferring a wire jumper from one tab to another on the printed circuit board to change from normally-open to normally-closed

The following illustration shows the user wiring configuration for the B840-108 Relay Module

CHAN	RELAY		CHAN	SNUBBER	
	N.O.	N.C.		IN	OUT
1	W1-E2	W1-E1	1	JP1	JP1
2	W2-E4	W2-E3	2	JP2	JP2
3	W3-E6	W3-E5	3	JP3	JP3
4	W4-E8	W4-E7	4	JP4	JP4
5	W5-E10	W5-E9	5	JP5	JP5
6	W6-E12	W6-E11	6	JP6	JP6
7	W7-E14	W7-E13	7	JP7	JP7
8	W8-E16	W8-E15	8	JP8	JP8

The snubber circuits are disconnected by removing the (JP1-JP8) appropriate jumper. Refer to the label on the side of the module.


B840-108 Relay Output, Field Connections

Overview

User connections are made to a standard screw terminal strip. The rigid wiring system permits module insertion or removal without disturbing the wiring.

Terminal Numbering and Output Connections

The following diagram shows terminal numbering and output connections for the B840-108 Relay Output Module.

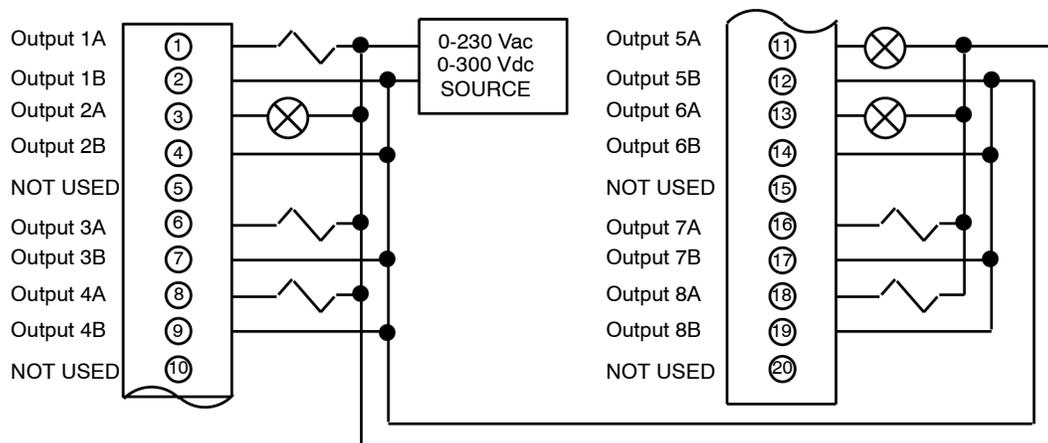

Note: Since each output is isolated from the remaining outputs, separate power sources can be used for each load. Each output can be wired for current source or current sink operation.

Note: It is possible to have the ACTIVE indicator lit when one or more output channels are working improperly

840–108 Relay Output, Specifications

Specification Table

The following table provides the specifications for the unit.

840–108 Specifications		
Description	Reed Relay (NO/NC) output, isolated circuits, sink or source current	
Number of Points	8	
Operating Voltage	0–300 Vdc max 0–230 Vac max./47–63 Hz	
Number of Groups	8	
Outputs/group	1	
Maximum Load Current	Carrying (unswitched)	3 A max)
	Switching	2.0 max (0.3 A @ 300 Vdc
Switching Capability	100 VA max	
Contact Resistance	< 150 mΩ (including fuse, pc clad, wire, connectors, and contacts)	
Open Circuit Impedance (Snubber Circuits Connected)	20 KΩ + 5 KΩ capacitive reactance @ 60 Hz	
Maximum Response Time	OFF→ON	6 ms (2 ms typical)
	ON→OFF	6 ms (2 ms typical)
Power Required	+5 V	67 mA
	+4.3 V	400 mA
	-5 V	0 mA
Relay Life Rating	1 billion operations @rated load @ 25°C	
Terminal Connector	AS-8534-000	
Fusing	1 / group, 4 A	

B840-108 Parameter Configuration

Parameter and Default Values

Parameter Configuration Window

Parameter Name	Value
MAPPING	BIT (%M-0X)
OUTPUTS STARTING ADDRESS	1
OUTPUTS ENDING ADDRESS	8
OUTPUT TYPE	BINARY

Module Configuration

Parameter Name	Value (Default)	Value (Options Available)	Description
Mapping	BIT (%M-0X)	WORD (%MW-4X)	
Outputs Starting Address	1	1	
Outputs Ending Address	8	1	
Output Type	BINARY	BCD	

Mapping Parameter References

	Modsoft, Concept, ProWORX	Unity
Reference Type	Mapped as 8 bits output 0x or Mapped as 1 register output 4x	Mapped as 8 bits output %Mx or Mapped as 1 word output %MWx
Output Type	BIN/BCD	BIN/BCD

B842–008 Reed Relay Output

45

At a Glance

Purpose

This chapter describes the functional and physical characteristics of the B842–008 Reed Relay Output Module.

What's in this Chapter?

This chapter contains the following topics:

Topic	Page
B842–008 Reed Relay Output, Overview	458
B842–008 Reed Relay Output, Field Connections	459
842–008 Reed Relay Output, Specifications	460
B842–008 Parameter Configuration	461

B842-008 Reed Relay Output, Overview

General Characteristics

The B842-008 Reed Relay Output Module, normally closed, converts the signals used on the 800 Series OURBUS to 8 independent mercury wetted Reed Relay outputs capable of driving relays, pilot lamps, or other loads up to 2.0 amperes, or low level circuits such as analog multiplexing.


The module uses eight high reliability mercury wetted Reed Relays to control loads. Each output is electrically isolated from the I/O Bus and from the other seven outputs by the coil of the relay and will withstand the severe voltage transients normally encountered in industrial environments without damage or adverse effect on the controller.

Self-contained resistor and capacitor snubber networks suppress transient voltages when inductive loads are driven and provides contact protection. The eight outputs are also fused to protect their circuitry against overload currents.

The B842-008 Reed Relay Output Module is compatible with input modules.

Simplified Schematic

Following is a simplified schematic of the B842-008 Reed Relay Output Module.

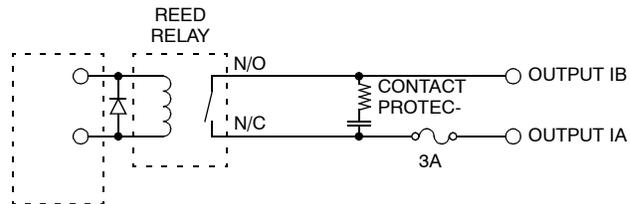

B842-008 Reed Relay Output, Field Connections

Overview


This module performs in a rigid wiring system where the user connections are made to terminal strips attached to the front of the card basket. The I/O modules slide in slots of the card basket and make contact with the terminal strips via the mating connector.

User connections are made to standard screw-type terminals capable of securing up to two AWG 14 solid or stranded wires per terminal. Terminals are numbered from one at the top to 20 at the bottom as shown in the figure.

The Data Bus connections are made via the standard OURBUS interface connector to a shielded backplane at the rear of the card basket. The module may be placed in any location in the I/O structure without interfering with any other module's operation. When the module is inserted into the card basket, it picks up a low impedance earth shield ground by connecting the module's shield to the backplane's earth shield ground.

Terminal Numbering and Output Connections

The following figure shows typical circuit connections for power applications of the B842-008 module.

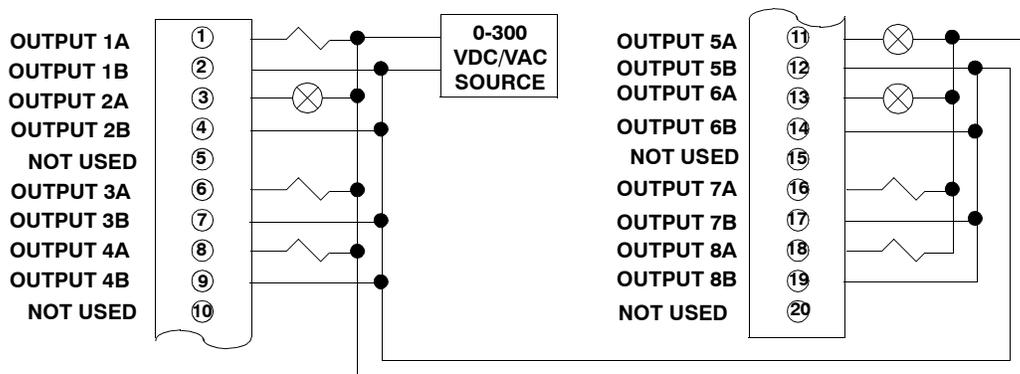

Note: Since each output is isolated from the remaining outputs, separate power sources can be used for each load. Each output can be wired for current source or current sink operations.

Note: It is possible to have the ACTIVE indicator lit with one or more output channels working improperly.

842-008 Reed Relay Output, Specifications

Specification Table

The following table provides the specifications for the unit.

842-008 Specifications		
Description		Reed Relay Output (NC)
Number of Points		8
Operating Voltage		300 V, max. VDC or Peak AC
Number of Groups		8
Outputs / group		1
Maximum Load Current	Carrying	3 A max. continuous after closure
	Switching	2 max.
Switching Capability		100 VA max. instantaneous power
Contact Resistance		< 100 mΩ
OFF State	Leakage Current	5 mA @ 120 VAC
Maximum Response Time		6 ms max. (2 ms typical)
Power Required	+5 V	5.06 +/- 0.32 VDC, 67 mA max.
	-5 V	-5.06 +/- 0.26 VDC, 0 mA
	V I/O	4.25 +/- 0.33 VDC, 400 mA max.
Terminal Connector		AS-8534-000
Fusing		1 / output, 3 A
Protection		The B842-008 output module has a resistor-capacitor snubber network to protect contacts from transients due to switching inductive loads.
Open Circuit Impedance		25 k capacitive reactance at 6 Hz
Isolation Voltage		Between outputs and I/O Bus, between outputs and case, and outputs to outputs. 1500 VAC steady state max. (at 60 Hz) for 60 sec. 2500 VDC for 60 sec.

Note: The module must be mounted in a upright position

B842-008 Parameter Configuration

Parameter and Default Values

Parameter Configuration Window

Parameter Name	Value
MAPPING	WORD (%MW-4X)
OUTPUTS STARTING ADDRESS	1
OUTPUTS ENDING ADDRESS	1
OUTPUT TYPE	BINARY

1 : 140 XBF 3 : B842

Module Configuration

Parameter Name	Value (Default)	Value (Options Available)	Description
Mapping	WORD (%MW-4X)	BIT (%M-0X)	
Outputs Starting Address	1	1	
Outputs Ending Address	1	8	
Output Type	BINARY	BCD	

Mapping Parameter References

	Modsoft, Concept, ProWORX	Unity
Reference Type	Mapped as 8 bits output 0x or Mapped as 1 register output 4x	Mapped as 8 bits output %Mx or Mapped as 1 word output %MWx
Output Type	BIN/BCD	BIN/BCD

B849–016 48 Vac/Vdc Input (True High)

46

At a Glance

Purpose

This chapter describes the functional and physical characteristics of the B849–016 48 V ac/dc (True High) Input Module.

What's in this Chapter?

This chapter contains the following topics:

Topic	Page
B849–106 48 Vac/Vdc Input (True High), Overview	464
B849–016 48 Vac/Vdc Input (True High), Field Connections	466
849–016 48 Vac/Vdc Input (True High), Specifications	467
B849–016 Parameter Configuration	468

B849–106 48 Vac/Vdc Input (True High), Overview

General Characteristics


The B849–016 48 V ac/dc input module senses OFF and ON input signals from its field circuitry, converting them to logic levels used by a PLC. The module's 16 input circuits are divided into two groups of eight channels, each group totally isolated from the other.

Although both groups use common return wires, none has a definite relationship to system ground unless established in the user's field circuitry. Since both groups nominally employ independent power return sources, both ac and dc powered field circuits may input to the module at the same time.

Note: Reversal of external signal polarity will not cause channel circuit damage as circuit design is indifferent to accidental polarity reversal.

Simplified Block Diagram

Following is a simplified block diagram of the B849–016 48 V ac/dc Input Module.

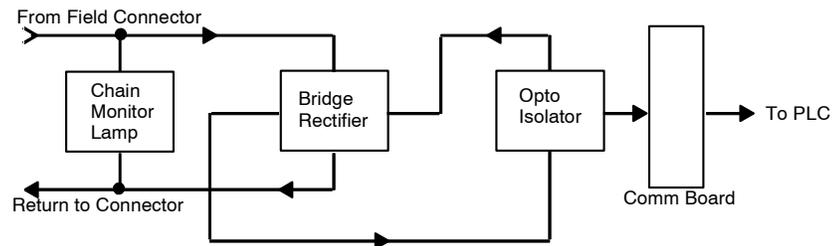

When the user's ac/dc powered field circuit goes ON — as the result of a limit for example — it presents the field power voltage at the module's appropriate input channel. When the input voltage meets or exceeds the module's guaranteed ON threshold, the resulting voltage turns the channel monitor lamp ON, current flows through the bridge rectifier and subsequently the opto-isolator (OPTO-ISOL) circuit. Given a nominal 115 Vac/125 Vdc field power supply and a $k\Omega$ maximum input source impedance, the module's channel monitor lamps will indicate ON and OFF when input voltages are 80 Vac/85 Vdc for the high level ON; and 35 Vac/40 Vdc for the low level OFF respectively.

The optical energy goes to the communications board (COMM BOARD) where the OURBUS output register is set to represent the field circuit's ON state. As long as the field input status remains true, the module will communicate this status each time it is polled by the controller. Total scan time may be as long as 250 ms. The user should not attempt to monitor events with a repetition rate greater than 1/s without analyzing his actual system, program, and scan time.

Note: It is possible to have the ACTIVE indicator lit with one or more input channels working improperly.


B849-016 48 Vac/Vdc Input (True High), Field Connections

Overview

User connections are made to a standard screw terminal strip. The rigid wiring system permits module insertion or removal without disturbing the wiring.

Terminal Numbering and Input Connections

The following diagram shows terminal numbering and input connections for the B849-016 48 V ac/dc Input Module.

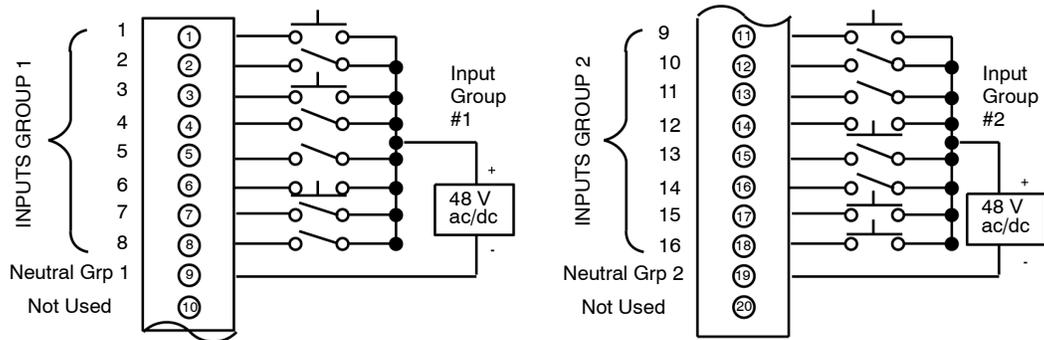

Note: To use both input groups with a single power supply, jump terminals #9 and #19.

849-016 48 Vac/Vdc Input (True High), Specifications

Specification Table

The following table provides the specifications for the unit.

849-016 Specifications		
Description	48 Vac/dc input	
Number of Points	16	
Operating Voltage	41—53 Vac / 47—63 Hz 39—58 Vdc	
Number of Groups	2	
Inputs/group	8	
Maximum Input Voltage	Continuous	53 Vac / 58 Vdc 63 Vac / 70 Vdc (for 10 s maximum) 110 Vpk (for 10 ms max)
ON Conditions	ON Conditions	≥ 41 Vac or 39 Vdc w/Input Source Impedance of 1 K maximum input current 7.5 mA 2 mA
OFF Conditions		< 15 Vac / 20 Vdc < 53 Vac w/Input Source Impedance ≥ 25 k < 58 Vdc w/Input Source Impedance ≥ 50 k
ON Current	8 mA (max), 4.5 mA (minimum)	
Maximum Response Time	OFF→ON	6 ms
	ON→OFF	18 ms
Power Required	+5 V	40 mA
	+4.3 V	1 mA
	-5 V	15 mA
External Power Supply	48 Vac/dc, 300 mA	
Terminal Connector	AS-8534-000	

B849–016 Parameter Configuration

Parameter and Default Values

Parameter Configuration Window

Parameter Name	Value
MAPPING	BIT (%I-1X)
INPUTS STARTING ADDRESS	1
INPUTS ENDING ADDRESS	16
INPUT TYPE	BINARY

Module Configuration

Parameter Name	Value (Default)	Value (Options Available)	Description
Mapping	BIT (%I-1X)	WORD (%IW-3X)	
Inputs Starting Address	1	1	
Inputs Ending Address	16	1	
Input Type	BINARY	BCD	

Mapping Parameter References

	Modsoft, Concept, ProWORX	Unity
Reference Type	Mapped as 16 bits input 1x or Mapped as 1 register input 3x	Mapped as 16 bits input %Ix or Mapped as 1 word input %IWx
Input Type	BIN/BCD	BIN/BCD

B853–016 115 Vac/125 Vdc Input (True High)

47

At a Glance

Purpose

This chapter describes the functional and physical characteristics of Input Module 853–016 115 Vac/125 Vdc.

What's in this Chapter?

This chapter contains the following topics:

Topic	Page
B853–016 115 Vac/125 Vdc Input (True High), Overview	470
B853–016 115 Vac/125 Vdc Input (True High), Field Connections	472
B853–016 115 Vac/125 Vdc Input (True High), Specifications	473
B853–016 Parameter Configuration	474

B853–016 115 Vac/125 Vdc Input (True High), Overview

General Characteristics


True High Input Module B853–016 115-Vac/125-Vdc senses OFF and ON input signals from its field circuitry, converting them to logic levels used by a Modicon PLC. The module's 16 input circuits are divided into two groups of eight channels, each group being totally isolated from the other.

Although both groups use common return wires, none has a definite relationship to system ground unless established in the user's field circuitry. Since both groups nominally employ independent power return sources, both ac and dc powered field circuits may be directed to the module at the same time.

Note: Reversal of external signal polarity will not cause channel circuit damage as the circuit design is indifferent to accidental polarity reversal.

Simplified Block Diagram

Following is a simplified schematic of the True High Input Module B853–016 115-Vac/125-Vdc

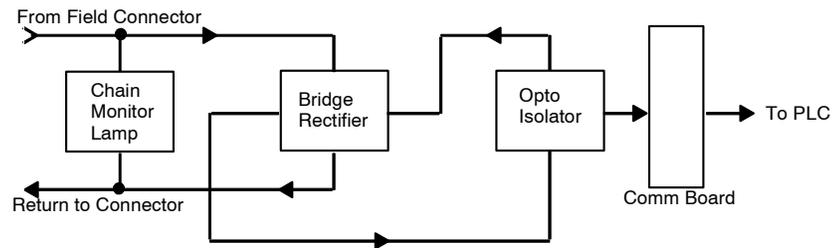

When the user's ac/dc powered field circuit goes ON—as the result of a limit switch, for example—it presents the field power voltage at the module's appropriate input channel. When the input voltage meets or exceeds the module's ON threshold, the resulting voltage turns the channel monitor lamp ON, current flows through the bridge rectifier and subsequently the opto-isolator (OPTO-ISOL) circuit.

Given a nominal 115 Vac/125 Vdc field power supply and a $k\Omega$ maximum input source impedance, the module's channel monitor lamps will indicate ON and OFF when input voltages are 80 Vac/85 Vdc for the high level ON; and 35 Vac/40 Vdc for the low level OFF respectively.

The optical energy goes to the communications board (COMM BOARD) where the OURBUS output register is set to represent the field circuit's ON state. As long as the field input status remains true, the module will communicate this status each time it is polled by the controller. Total scan time may be as long as 250 ms. The user should not attempt to monitor events with a repetition rate greater than 1/s without analyzing his actual system, program, and scan time.

Note: It is possible to have the ACTIVE indicator lit with one or more input channels working improperly.


B853-016 115 Vac/125 Vdc Input (True High), Field Connections

Overview

User connections are made to a standard screw terminal strip. The rigid wiring system permits module insertion or removal without disturbing the wiring.

Terminal Numbering and Input Connections

The following diagram shows terminal numbering and input connections for the B853-016 115 Vac/125 Vdc (True High) Input Module.

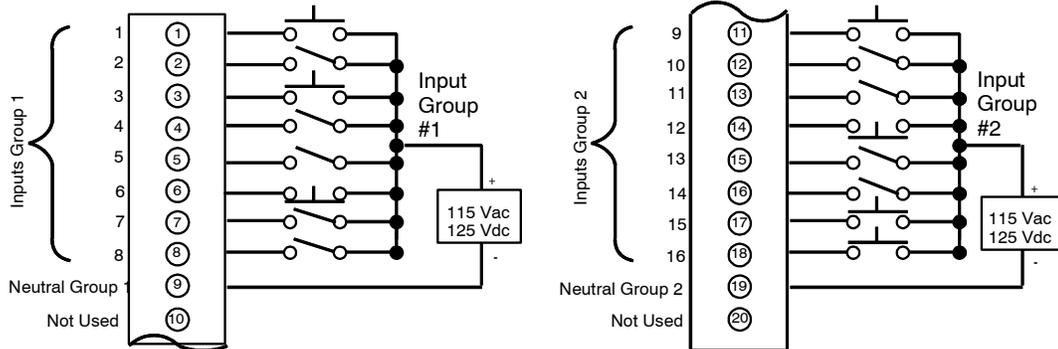

Note: To use both input groups with a single power supply, jump terminals #9 and #19.

B853–016 115 Vac/125 Vdc Input (True High), Specifications

Specification Table

The following table provides the specifications for the unit.

853-016 Specifications		
Description		115 Vac/125 Vdc input
Number of Points		16
Operating Voltage		80—130 Vac/47— 63 Hz; 85—150 Vdc
Number of Groups		2
Inputs/group		8
Maximum Input Voltage	Continuous	130 Vac/150 Vdc
	Surge	150 Vac/180 Vdc for 10 s; 280 V peak for 10 ms
ON Conditions		≥ 80 Vac or 85 Vdc; w/Input Source Impedance of 1 K maximum input current 9 mA 2 mA
OFF Conditions		< 35 Vac/40 Vdc; < 130 Vac w/Input Source Impedance ≥ 40 K; < 150 Vdc w/Input Source Impedance ≥ 80 K
ON Current		7 mA (max), 4.5 mA (min)
Maximum Response Time	OFF→ON	6 ms
	ON→OFF	18 ms
Power Required	+5 V	40 mA
	+4.3 V	1 mA
	-5 V	15 mA
Terminal Connector		AS-8534-000

B853–016 Parameter Configuration

Parameter and Default Values

Parameter Configuration Window

Parameter Name	Value
MAPPING	BIT (%I-1X)
INPUTS STARTING ADDRESS	1
INPUTS ENDING ADDRESS	16
INPUT TYPE	BINARY

Module Configuration

Parameter Name	Value (Default)	Value (Options Available)	Description
Mapping	BIT (%I-1X)	WORD (%IW-3X)	
Inputs Starting Address	1	1	
Inputs Ending Address	16	1	
Input Type	BINARY	BCD	

Mapping Parameter References

	Modsoft, Concept, ProWORX	Unity
Reference Type	Mapped as 16 bits input 1x or Mapped as 1 register input 3x	Mapped as 16 bits input %Ix or Mapped as 1 word input %IWx
Input Type	BIN/BCD	BIN/BCD

855–016 Intrinsically Safe Input

48

At a Glance

Purpose

This chapter describes the functional and physical characteristics of the 855–016 Intrinsically Safe Input Module.

What's in this Chapter?

This chapter contains the following topics:

Topic	Page
B855–016 Intrinsically Safe Input, Overview	476
B855–016 Intrinsically Safe Input, Installation	477
B855–016 Intrinsically Safe Input, Specifications	481
B855–016 Parameter Configuration	483

B855-016 Intrinsically Safe Input, Overview

General Characteristics

The B855-016 Intrinsically Safe (fully isolated) Input Module accepts 16 switch closures or low impedance discrete inputs less than 100 Ω and operates in any 800 Series I/O slot.

The B855 module monitors hazardous area contact closures. The B855 can operate in either continuously or intermittently hazardous environments containing acetylene, hydrogen, ethylene or methane gases; metal, coal or grain dust, and fibers. The B855-016 module meets Factory Mutual Standard FM 3610 for Intrinsically Safe Connections to Field Side Associated Apparatus.

The B855-016 module has 16 discrete inputs. The inputs work in the range 11.4-12.6 Vdc, True Low.


B855-016 Intrinsically Safe Input, Installation

Installation Procedure


Installation of the B855-016 module involves unpacking the module, wiring the field connector, installing key pins, and mounting the module into the housing.

Step	Procedure
1	Remove the module from its shipping box and check for damage. If damaged, contact your vendor for instructions.
2	Ensure power to housing is OFF.
3	Designate the housing slot for this module.
4	Locate required connector assembly (Modicon Part number AS-8535-000). This assembly consists of two 20-pin connectors.
5	Referring to the hazardous area and safe area wiring diagram below, connect field side wiring to proper pins on the field connector. You must wire the hazardous area connections, pins 9-40, separately from the safe area connections. Wire the dc source to the safe area connections, pins 1 and 2. Refer to Caution, below.
6	Refer to the Intrinsically Safe Barrier Strip diagram below. Remove the two Phillips head screws from the top 20-pin connector of the AS-8535-000. Take the intrinsically safe barrier strip out of the white bag attached to the handle of the module. Place the intrinsically safe barrier strip on the left side of the top 20-pin connector between pins 3, and 8. Make sure the raised edge of the intrinsically safe barrier strip is facing away from the black wiring duct. Insert this subassembly inside the black wire duct while aligning the two screw holes. Insert the two Phillips head screws and tighten them down. Note: You must use key pins (shipped with this module) to meet Factory Mutual's requirements.
7	Referring to typical field circuit connections illustration, below, connect field side wiring to proper pins on the field connector. Note: The external 12 Vdc (5%) power supply for the module should be a minimum of 1.0 A
8	Insert the module into the housing, firmly but carefully, seating the edge connector in the backplane.
9	Secure module to housing using captive slotted mounting screws at the top and bottom of the module front panel.
10	Note: To meet Factory Mutual's requirements, Schneider Electric recommends the MD-8741-000 Intrinsically Safe Barrier Strip.


The following illustration shows the B855-016 hazardous area and safe area wiring.

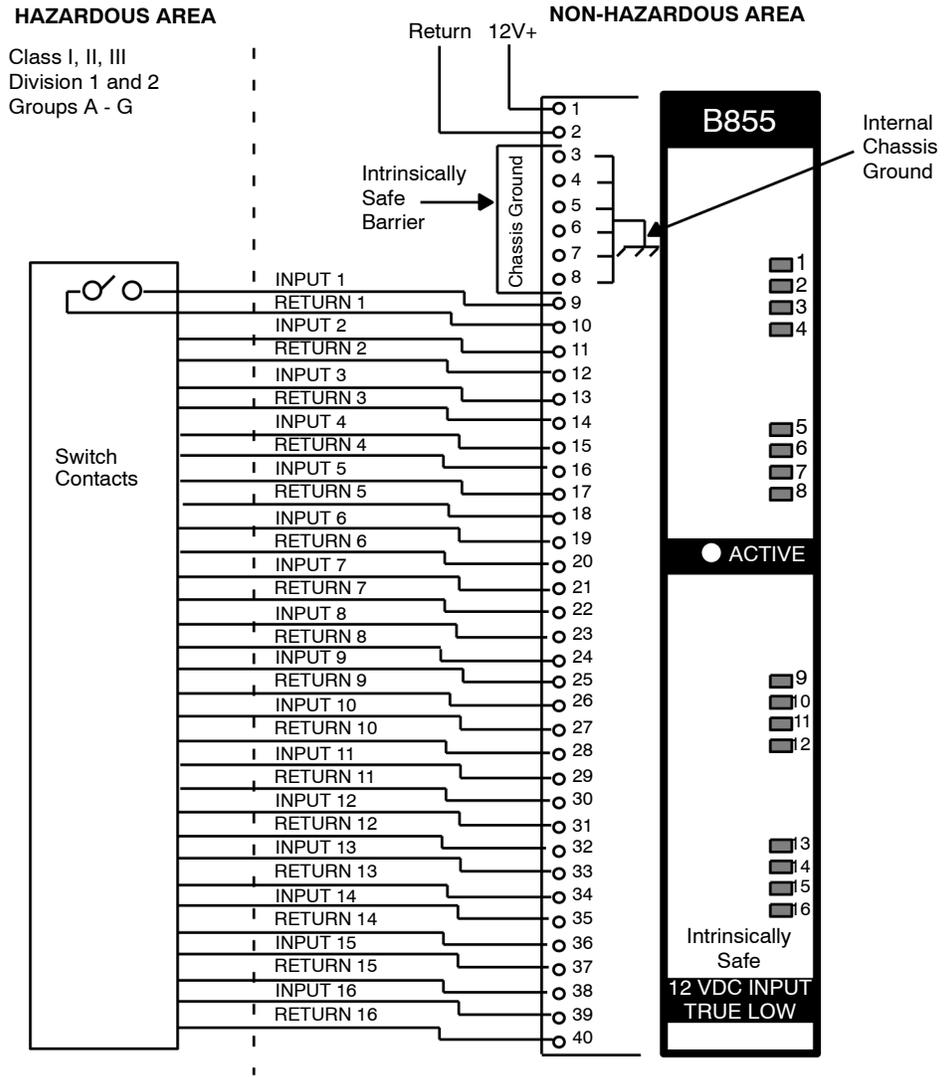

The following illustration shows the B855-016 intrinsically safe barrier strip.

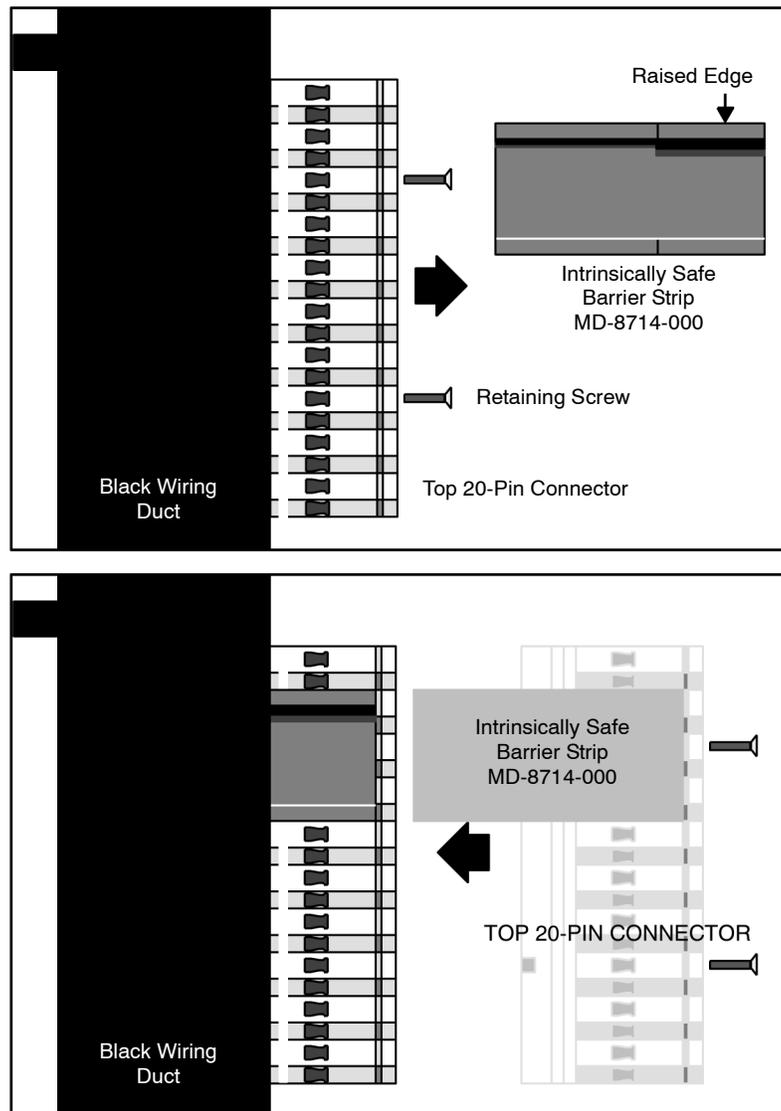

The following illustration shows the typical field circuit connections.

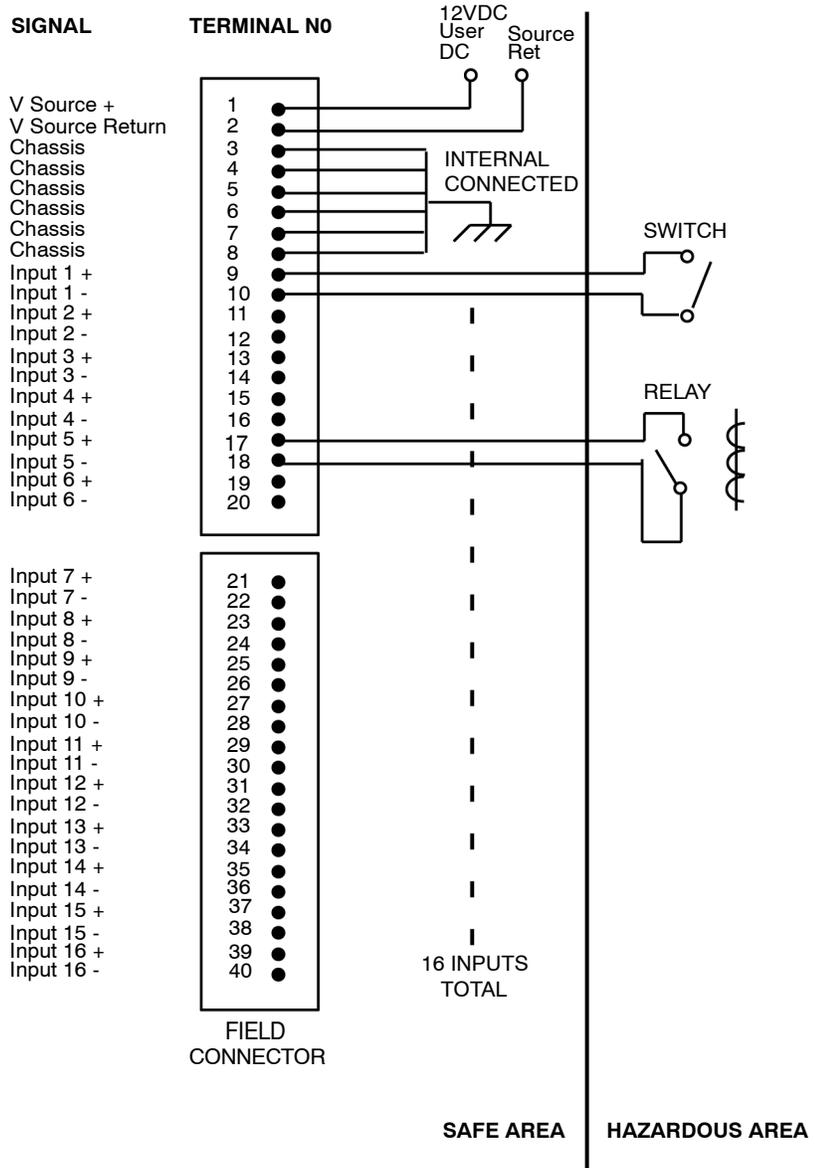

B855-016 Intrinsically Safe Input, Specifications

B855-016, Specification Table			
Description		12 Vdc intrinsically safe input (true low)	
Number of Points		16 isolated	
Operating Voltage		11-4-12.6 Vdc	
Number of Groups		1	
Inputs/group		16	
Maximum Input Voltage	Continuous	Continuous 12 Vdc 5%	
	Surge	500 Vdc for 3 ms	
ON State Conditions		100 Ω or less total impedance (3.9 mA @ 12 Vdc)	
OFF State Conditions		An open circuit, no less than 100,000 Ω (75 mA) approx. 8.95 V present on + lead	
Maximum Response Time	OFF \rightarrow ON	1 ms	
	ON \rightarrow OFF	5 ms	
Power Required	+5 V	80 mA	
	+4.3 V	1.5 mA	
	-5 V	0 mA	
Leakage Current		< 1.5 mA	
Wattage Rating on the Module		1.8 W	
Maximum Input Voltage @ Source Inputs		Not to exceed 500 Vdc for 3 ms to user source terminals	
Module Supply Voltage In		11.4 - 12.6 Vdc, 0.5 A max. load working 80 mA inrush current Minimum recommended power supply: 1.0 A	
Maximum Impedance Limitations	Group	L Inductance	C Capacitance
	A & B	80 mH	1.0 mf
	C	300 mH	3.0 mf
	D	700 mH	8.0 mf
Note: These are Factory Mutual requirements. Please consult with your vendors regarding field devices, wiring, and barriers to ensure compliance.			
Terminal Connector		AS-8535-000	
Factory Mutual FM 3610		Requires use of key pins and MD-8741-000 barrier strip included with the module	

B855-016 Parameter Configuration

Parameter and Default Values

Parameter Configuration Window

Parameter Name	Value
MAPPING	BIT (%I-1X)
INPUTS STARTING ADDRESS	1
INPUTS ENDING ADDRESS	16
INPUT TYPE	BINARY

1 : 140 XBF 3 : B855

Module Configuration

Parameter Name	Value (Default)	Value (Options Available)	Description
Mapping	BIT (%I-1X)	WORD (%IW-3X)	
Inputs Starting Address	1	1	
Inputs Ending Address	16	1	
Input Type	BINARY	BCD	

Mapping Parameter References

	Modsoft, Concept, ProWORX	Unity
Reference Type	Mapped as 16 bits input 1x or Mapped as 1 register input 3x	Mapped as 16 bits input %Ix or Mapped as 1 word input %IWx
Input Type	BIN/BCD	BIN/BCD

B862–001 Register Output

49

At a Glance

Purpose

This chapter describes the functional and physical characteristics of the B862–001 Register Output Module.

What's in this Chapter?

This chapter contains the following topics:

Topic	Page
B862–001 Register Output, Overview	486
B862–001 Register Output, Switch Settings	487
B862–001 Register Output, Field Connections	488
B862–001 Register Output, Specifications	491
B862–001 Parameter Configuration	492

B862-001 Register Output, Overview


Overview

The B862-001 register output module provides a 5 V TTL or CMOS-compatible interface between a PLC and peripheral field devices. The B862-001 register output module operates in either BCD or binary mode.

The desired mode is operator selectable, with the 16-bit output either having BCD values in the range 0000 to 9999 or binary output in the range 0000 (HEX) to FFFF (HEX).

The B862-001 is a 4-channel register output module with four 16-bit registers. A channel is defined as a 16-bit data path. The channels can be configured as 4 BCD or 4 binary registers via an appropriate switch setting.

The module is organized in a group strobe arrangement with the 16 datalines associated at a given moment with one of the 4 strobe lines. Each strobe line addresses one of the devices on the data bus and enables it to transmit data to a given peripheral device to the exclusion of the other devices. The data lines are routed to all devices. The B862-001 is operated in module-select mode. In module-select mode, all 4 data registers are transferred in a single OURBUS cycle. The following is a simplified block diagram of the unit.

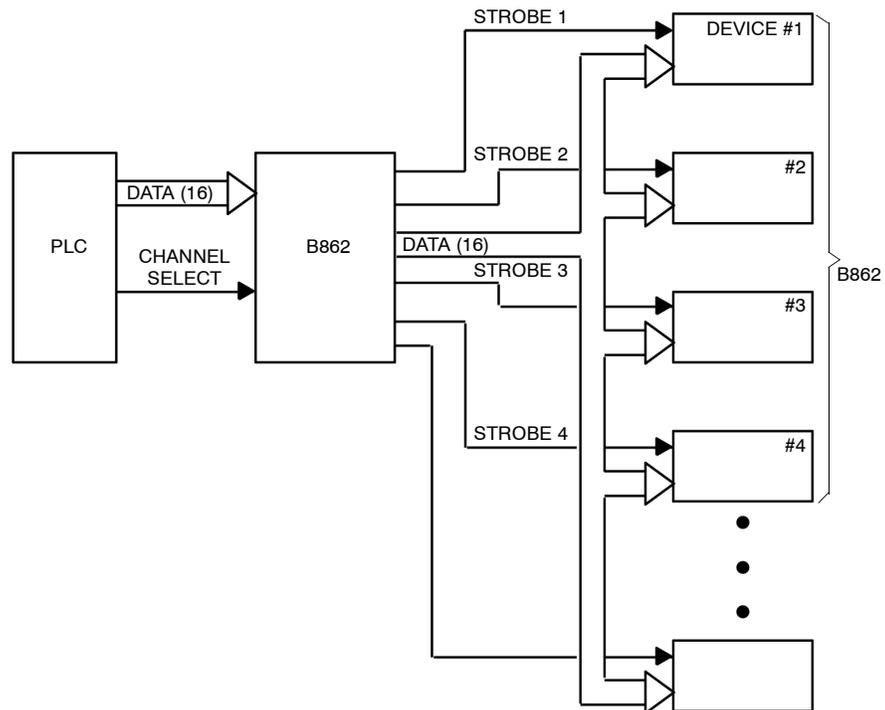

B862–001 Register Output, Switch Settings

Switch Settings Two toggle switches are located at the top left of the module and are used to determine the type of communication with external devices. Both switches are user selectable.

1. Bin/BCD Switch

This toggle switch determines whether the output data is to be interpreted by the target devices as a BCD or a binary value.

2. Strobes Active Hi/Lo Switch

This toggle switch allows selection of either true-hi or true-lo for strobing output data.

<p>Note: The relation between the I/O map selection, the BCD/binary switch setting, and the results at the output are summarized in the following table:</p>

Table


The following table identifies the relationship between the switch and I/O Map facility.

I/O Map Selection	B862 Switch Setting	Result
Binary	BCD	BCD
Binary	Binary	Binary
BCD	BCD	Erroneous
BCD	Binary	BCD

B862-001 Register Output, Field Connections

Terminal Numbering and Output Functions

User connections are made to a standard screw terminal strip. The rigid wiring system permits module insertion or removal without disturbing the wiring. The following illustration shows how to field connect the unit.

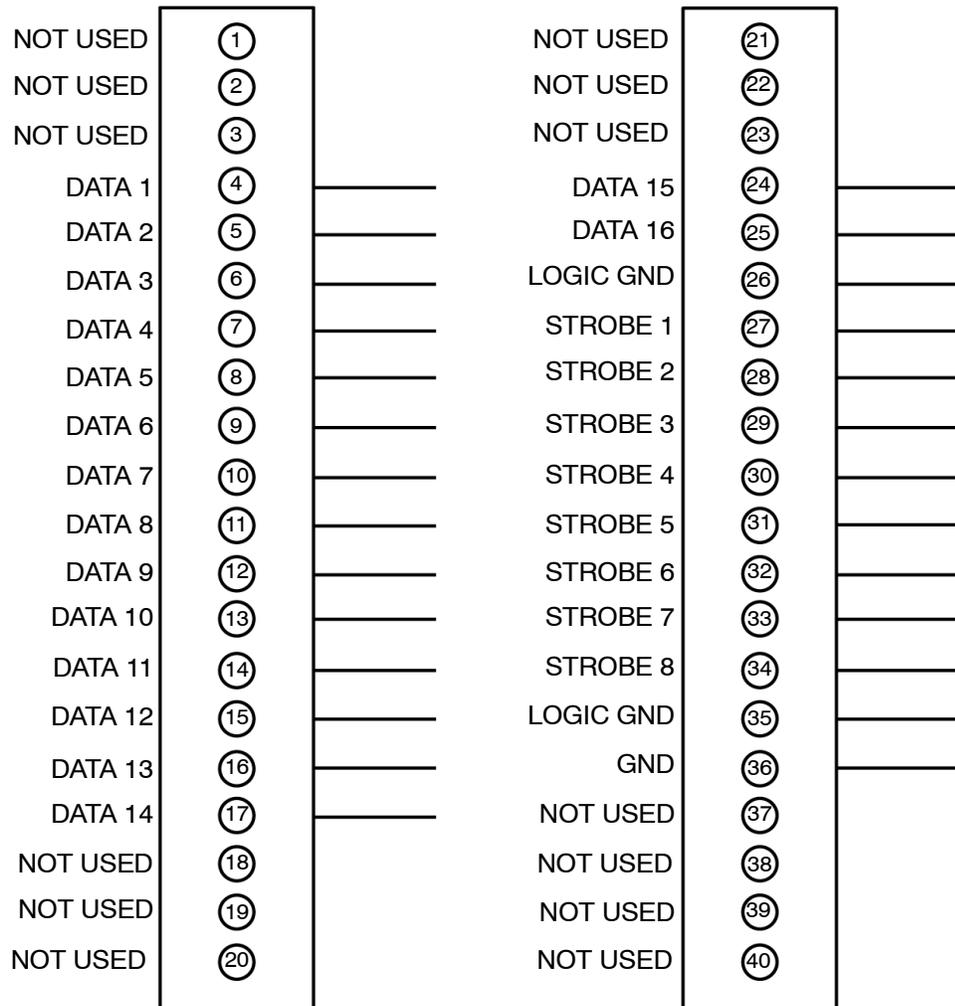


Pull-up Resistor Connection

Pull-up resistors must be installed at the active device end to use the B862 output module. The value of the pull-up resistor depends upon the number of devices that are attached to the data bus, as explained below. Each output meets 0.4 V maximum at 16 mA for a logic low and 3.3 V minimum at 16 mA for a logic high. If the current limit has been exceeded, the pull-up resistor values should be adjusted within specification; otherwise, spurious results may be obtained.

The following illustration indicates how the resistors are connected at the device end. For a single device consisting of 16 data lines, 16 1 k resistors are required, or, one 1 k resistor per data line. As additional devices are added to the data bus, the value of the pull-up resistor must be increased by 1 k. In other words, if two devices are used, the pull-up resistor must be 2 k, three devices require a 3 k pull-up, and so on, with the maximum number of 8 devices requiring 8 k of pull-up for each data line.

Pull-up Resistor Connection

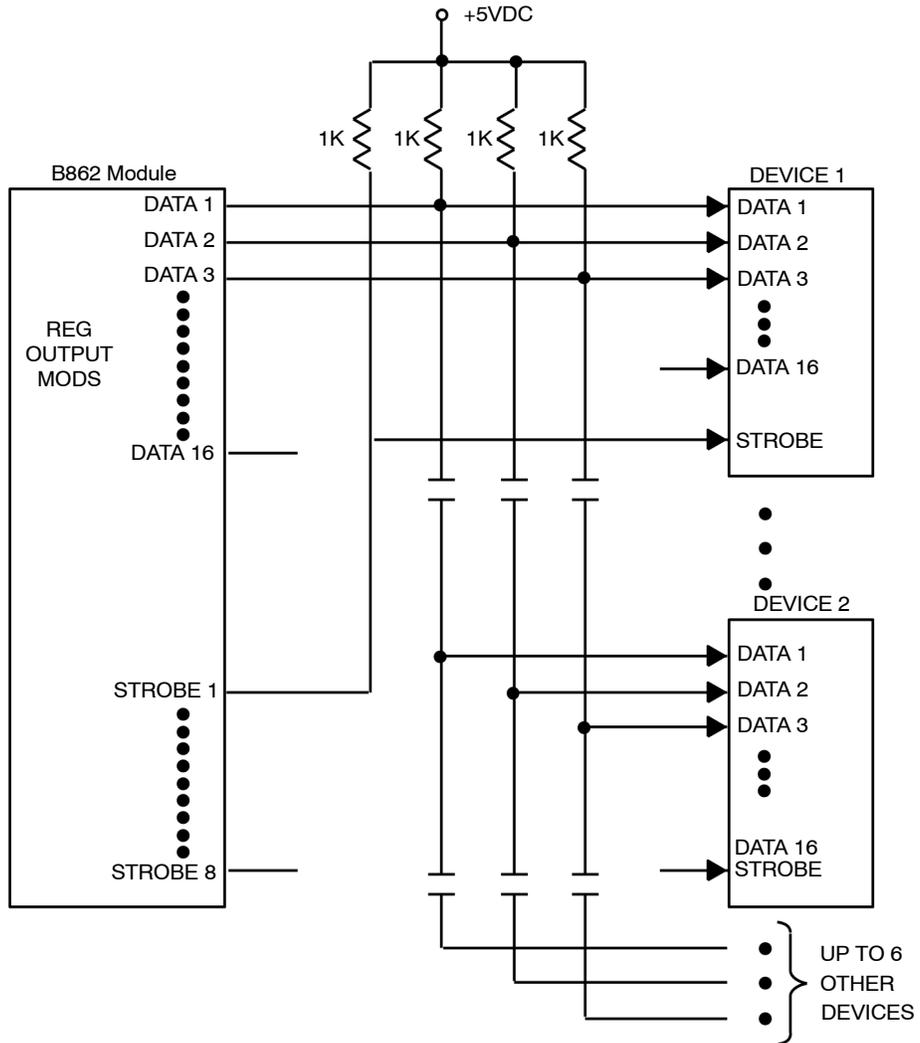

Note: Increase pull-up resistor value by 1 k for each additional device.

B862-001 Register Output, Specifications

Specification Table

The following table provides the specifications for the unit.

B862-001 Specifications		
Description	TTL register output	
Number of Points	4 channels, 16 data lines	
Operating Voltage	5 V TTL	
Number of Groups	N/A	
Outputs/group	N/A	
Guaranteed Min. Levels	High State > 3.5 VDC	
	Low State < 0.4 VDC while sinking 16 mA	
Strobe Output Power	Two TTL loads @ 5 VDC	
Strobe Width Timing	200 μ s \pm 10%	
Response Time	11.3 ms between an OURBUS write and field update	
Power Required	+5 VDC I/O	100 mA max.
	+4.3 VDC I/O	100 mA max.
External Power Supply	+5 VDC is required for pull-up resistor Vcc	
Field Device Requirements	TTL output level	Low: < 0.8 VDC @ 1.6 mA High: > 2.4 VDC @ 40 μ A
	CMOS output level	Low: < 1.6 VDC @ 0.3 μ A High: > 3.3 VDC @ 0.3 μ A
Terminal Connector	AS-8535-000	

Note: All user field devices must have outputs that feature latched, tristate, or open collector logic.

Note: The user must provide 1.0 k Ω \pm 10% pull-up resistors for each strobe line.

B862-001 Parameter Configuration

Parameter and Default Values

Parameter Configuration Window

Parameter Name	Value
MAPPING	BIT (%M-0X)
OUTPUTS STARTING ADDRESS	1
OUTPUTS ENDING ADDRESS	64
OUTPUT TYPE	BINARY

Module Configuration

Parameter Name	Value (Default)	Value (Options Available)	Description
Mapping	BIT (%M-0X)	WORD (%MW-4X)	
Outputs Starting Address	1	1	
Outputs Ending Address	64	4	
Output Type	BINARY	BCD	

Mapping Parameter References

	Modsoft, Concept, ProWORX	Unity
Reference Type	Mapped as 64 bits output 0x or Mapped as 4 registers output 4x	Mapped as 64 bits output %Mx or Mapped as 4 words output %MWx
Output Type	BIN/BCD	BIN/BCD

B863–032 Monitored 24 Vdc Input

50

At a Glance

Purpose

This chapter describes the functional and physical characteristics of the Modicon B863–032 Monitored 24 Vdc Input Module.

What's in this Chapter?

This chapter contains the following topics:

Topic	Page
B863–032 Monitored 24 Vdc Input, Overview	494
B863–032 Monitored 24 Vdc Input, Field Connections	495
B863–032 Monitored 24 Vdc Input, Specifications	496
B863–032 Parameter Configuration	497


B863-032 Monitored 24 Vdc Input, Overview

General Characteristics

The B863-032 Monitored dc Input Module (B863) is a 32 point, 24 Vdc, true high, 800 Series, module capable of determining the state of switches, relays, solenoids, lamps, proximity switches, and other 24 Vdc powered devices. In addition, the B863-032 monitors itself to insure its ability to detect high or low states at its inputs. This feature is designed to provide an extra margin of reliability in safety shutdown systems. This is accomplished with a module resident diagnostic test. The diagnostics verify the module's functionality by momentarily forcing all inputs to a low state followed by a high state. This forcing function is transparent to the input source.

Simplified Schematic

Following is a simplified schematic of the B863-032 Monitored 24 Vdc Input Module.

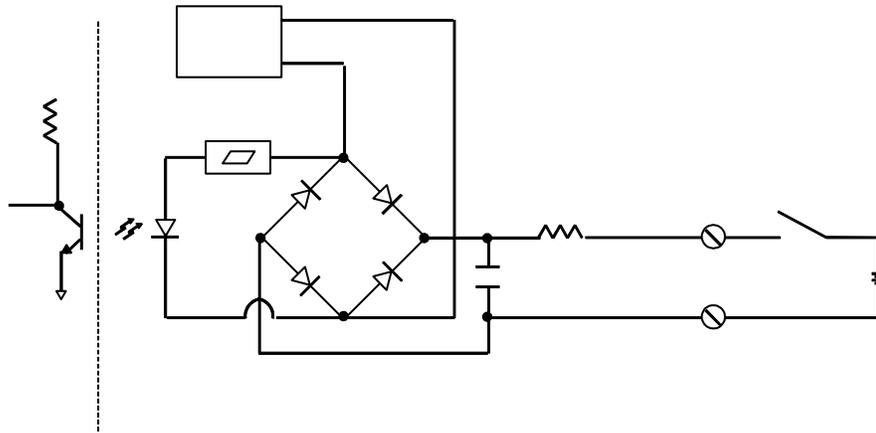

This diagnostic test is performed at a rate of 1/s, and takes less than 1 ms. The inability of an input to detect a low or high state during diagnostics, results in the reporting of a fault to the controller, and the flashing of the ACTIVE LED. Digital filtering is performed on all inputs to reduce the occurrence of nuisance faults. Communication between the module and the controller consists of four words. Two words contain the state of each input, and the other two words contain the fault status of each input. Within the state words, a high, or one indicates a ON condition. Within the fault status words, a high, or one indicates a fault at the respective input.


B863-032 Monitored 24 Vdc Input, Field Connections

Overview

User connections are made to a standard screw terminal strip. The rigid wiring system permits module insertion or removal without disturbing the wiring.

Terminal Numbering and Input Connections

The following diagram shows terminal numbering and input connections for the B863-032 Monitored 24 Vdc Input Module.

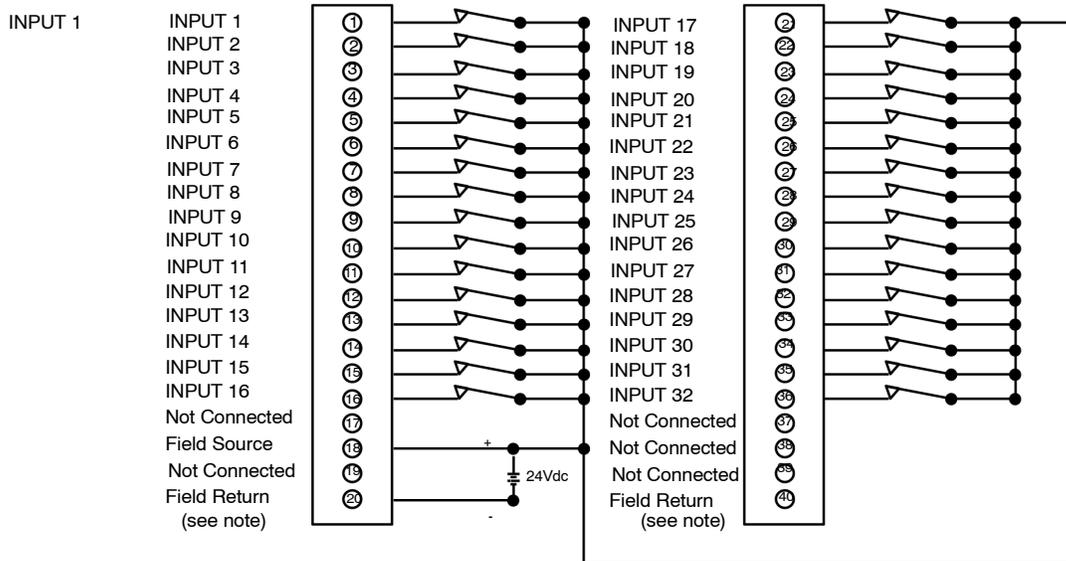

NOTE: Pins 20 and 40 are internally connected together

B863–032 Monitored 24 Vdc Input, Specifications

Specifications

B863–032, Specification Table

Description		24 Vdc high density monitored input
Type of Operation		True high
Number of Points		32
Operating Range Voltage		18-30 Vdc true high, 24 Vdc nominal
Number of Groups		2
Inputs/group		16
On State Conditions		18 Vdc minimum @ the input,
		30 Vdc maximum @ the input,
		Typical on state current: 4 mA
Off State Conditions		6 Vdc maximum @ the input,
		Typical OFF state current: 1 mA
Maximum Response Time	OFF→ON	10 ms
	ON →OFF	10 ms
Power Required	+5 V	0 mA
	+4.3 V	0 mA
	-5 V	0 mA
External Power Supply	Operating Current	20 mA of field power plus point input channel
	Operating Voltage	18-30 Vdc true high, 24 Vdc nominal
Terminal Connector		AS-8535-000

B863–032 Parameter Configuration

Parameter and Default Values

Parameter Configuration Window

Parameter Name	Value
MAPPING	BIT (%I-1X)
INPUTS STARTING ADDRESS	1
INPUTS ENDING ADDRESS	64
INPUT TYPE	BINARY

Module Configuration

Parameter Name	Value (Default)	Value (Options Available)	Description
Mapping	BIT (%I-1X)	WORD (%IW-3X)	
Inputs Starting Address	1	1	
Inputs Ending Address	64	4	
Input Type	BINARY	BCD	

Mapping Parameter References

	Modsoft, Concept, ProWORX	Unity
Reference Type	Mapped as 64 bits input 1x or Mapped as 4 registers input 3x	Mapped as 64 bits input %Ix or Mapped as 4 words input %IWx
Input Type	BIN/BCD	BIN/BCD

B863–132 24 Vdc Input

51

At a Glance

Title of overview block

This chapter describes the functional and physical characteristics of the B863–132 24 Vdc Input Module.

What's in this Chapter?

This chapter contains the following topics:

Topic	Page
B863–132 24 Vdc Input, Overview	500
B863–132 24 Vdc Input, Switch Settings	501
B863–132 24 Vdc Input, Field Connections	502
B863–132 24 Vdc Input, Configuration	503
B863–132 24 Vdc Input, Specifications	504
B863–132 Parameter Configuration	505


B863–132 24 Vdc Input, Overview

General Characteristics

The B863–132 24 Vdc Input Module senses and converts switched input signals into logic voltage levels used by the PLC. This module senses and reports broken wire faults. The module is designed for safety applications whereby it monitors essential field wiring. This module satisfies applications where connectivity diagnostics are important to the process. A logic side LED indicates the logic state that is written into the state table.

Simplified Schematic

Following is a simplified schematic of the B863–132 24 Vdc Input Module.

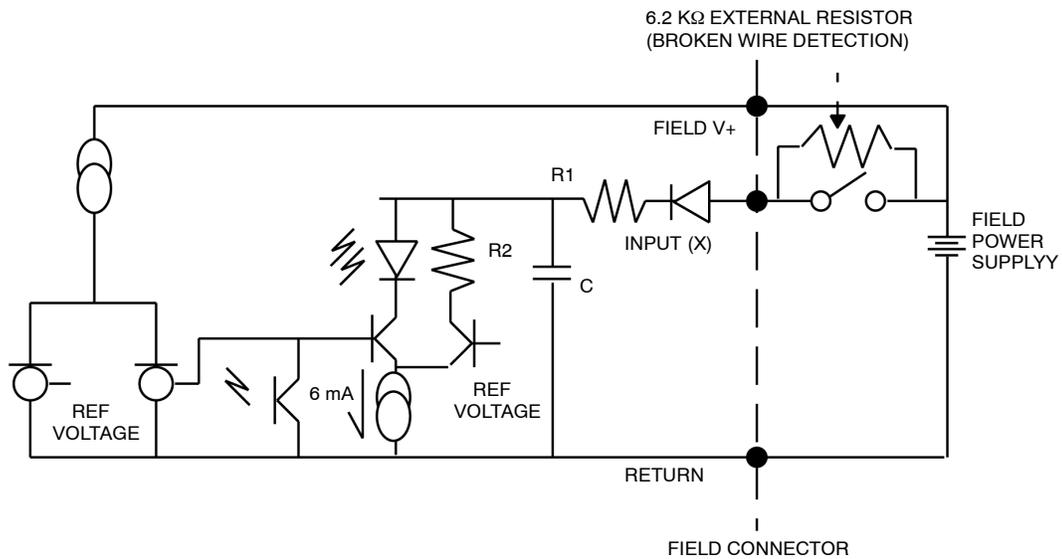

B863–132 24 Vdc Input, Switch Settings

Switch Settings


A four-position DIP switch located on the rear of the module (see diagram below) is used to select broken wire testing. Each individual switch relates to one of the four groups of eight input points.

For example, DIP-Switch position #1 when set to OFF senses for broken wire faults for group 1 and so on; when set to ON no fault is reported.

Only Binary should be used when operating module in line test mode. Do not use BCD.

The line test dip-switch settings are shown below.

LINE TEST SWITCH FOUR-POSITION DIP SWITCH
TOP OF MODULE




SWITCHES	FUNCTIONS
SW1 = 0 = 1	GROUP 1, LINE TEST GROUP 1, NO TEST
SW2 = 0 = 1	GROUP 2, LINE TEST GROUP 2, NO TEST
SW3 = 0 = 1	GROUP 3, LINE TEST GROUP 3, NO TEST
SW4 = 0 = 1	GROUP 4, LINE TEST GROUP 4, NO TEST

Note: When using binary and BCD inputs remember that input 1 is the MSB and input 32 is the LSB.

B863-132 24 Vdc Input, Field Connections

Overview User connections are made to a standard screw terminal strip. The rigid wiring system permits module insertion or removal without disturbing the wiring.

Terminal Numbering and Input Connections The following diagram shows terminal numbering and input connections for the B863-132 24 Vdc Input Module.

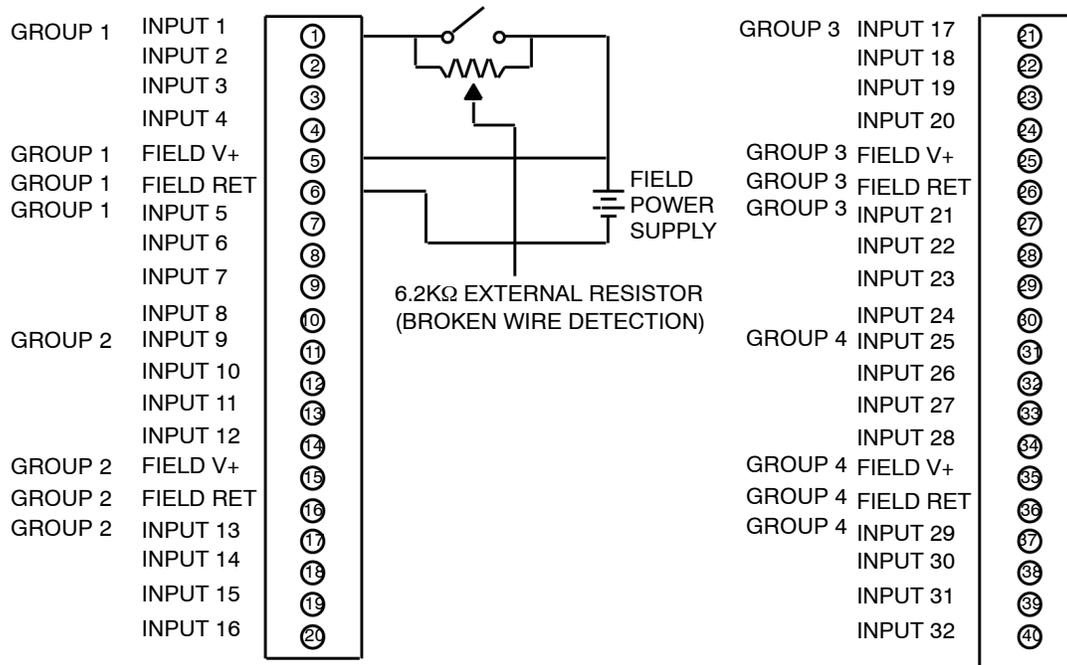

B863–132 24 Vdc Input, Configuration

Configuration Guidelines

This module appears as a B863 module when configured. This means the module requires four 16-bit words ($1x$ registers), as shown in the data registers diagram below. The first two words contains the state of the input points. The second two words contain the condition of the field wiring. If a broken wire is detected on input point, then a one is displayed in input register ($1x+32$) at its position. When the fault is fixed, a zero appears in the bit. A one indicates a detected fault, whereas, a zero indicates normal operation of that input point.

B863–132 24 Vdc Input, Specifications

The following table provides the specifications for the unit.

Description	24 Vdc input	
Number of Points	32	
Number of Groups	4	
Inputs/group	8	
Working Voltage	0-30 Vdc	
Reference Voltage	19.2-30 Vdc	
Reference Current	9-15 mA/group	
Threshold Voltage	11-15 Vdc	
External Resistor	(Broken wire detect) 6.2 k Ω +10%, 1 external resistor/input point, resistor across contactor for nominally operated 24 Vdc system	
Input Current	Low State	1.8- 3 mA
	High State	5.75-7.1 mA
Transition Time	ON	V in = 20 Vdc: 200 ms minimum
		V in = 30 Vdc: 25 ms minimum
	OFF	V in = 20 Vdc: 100 ms maximum
		V in = 30 Vdc: 250 ms maximum
Maximum Response Time	OFF \rightarrow ON	2 ms, contact opening or closing, 100 ms maximum fault detection time
	ON \rightarrow OFF	
Power Required	+5 V	350 mA
	+4.3 V	10 mA
	-5 V	0 mA (not used)
Terminal Connector	AS-8535-000	

B863–132 Parameter Configuration

Parameter and Default Values

Parameter Configuration Window

Parameter Name	Value
MAPPING	BIT (%I-1X)
INPUTS STARTING ADDRESS	1
INPUTS ENDING ADDRESS	64
INPUT TYPE	BINARY

Module Configuration

Parameter Name	Value (Default)	Value (Options Available)	Description
Mapping	BIT (%I-1X)	WORD (%IW-3X)	
Inputs Starting Address	1	1	
Inputs Ending Address	64	4	
Input Type	BINARY	BCD	

Mapping Parameter References

	Modsoft, Concept, ProWORX	Unity
Reference Type	Mapped as 64 bits input 1x or Mapped as 4 registers input 3x	Mapped as 64 bits input %Ix or Mapped as 4 words input %IWx
Input Type	BIN/BCD	BIN/BCD

B864–001 Register Output

52

At a Glance

Purpose

This chapter describes the functional and physical characteristics of the B864–001 Register Output Module.

What's in this Chapter?

This chapter contains the following topics:

Topic	Page
B864–001 Register Output, Overview	508
B864–001 Register Output, Switch Settings	509
B864–001 Register Output, Field Connections	510
B864–001 Register Output, Specifications	513
B864–001 Parameter Configuration	514


B864-001 Register Output, Overview

Overview

The B864-001 register output module provides a 5 V TTL or CMOS-compatible interface between a PLC and peripheral field devices. The B864-001 register output module operates in either BCD or binary mode. The desired mode is operator selectable, with the 16-bit output either having BCD values in the range 0000- 9999 or binary output in the range 0000- FFFF hex.

The B864-001 is an eight-channel register output module with eight 16-bit registers. A channel is defined as a 16-bit data path. The channels can be configured as eight BCD or eight binary registers via the appropriate switch setting.

The module is organized in a group strobe arrangement with the 16 datalines associated at a given moment with one of the eight strobe lines. Each strobe line addresses one of the devices on the data bus and enables it to transmit data to a given peripheral device to the exclusion of the other devices. The data lines are routed to all devices. The B864-001 is operated in module-select mode. In module-select mode, all eight data registers are transferred in a single ourbus cycle. The following is a simplified block diagram of the unit.

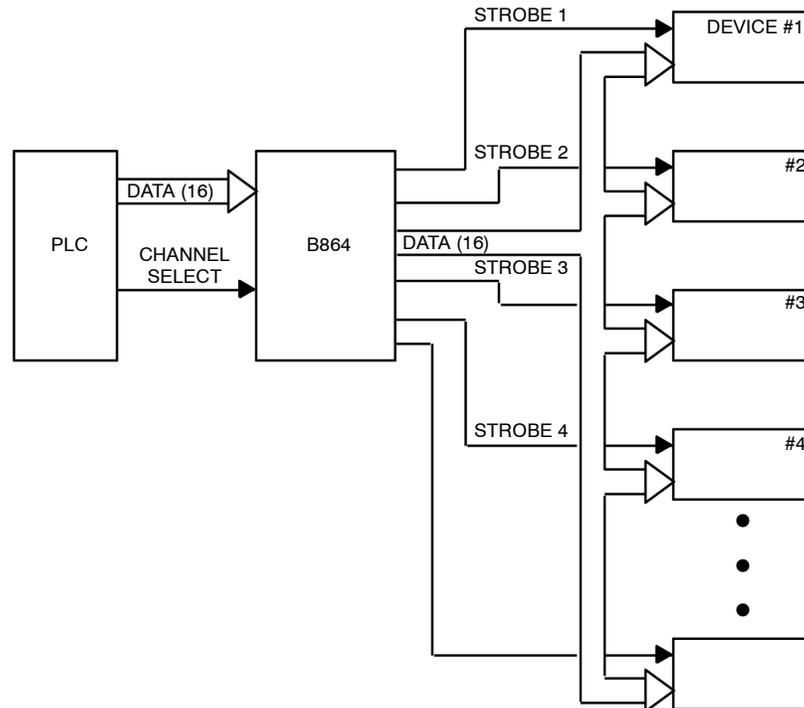

B864–001 Register Output, Switch Settings

Switch Settings Two toggle switches are located at the top of the module and are used to determine the type of communication with external devices. Both switches are user selectable.

1. Bin/BCD Switch
This toggle switch determines whether the output data is to be interpreted by the target devices as a BCD or a binary value.
2. Strobes Active Hi/Lo Switch
This toggle switch allows selection of either true-hi or true-lo for strobing output data.

Note: The relation between the I/O map selection, the BCD/binary switch setting, and the results at the output are summarized in the following table:


Table The following table identifies the relationship between the switch and I/O Map facility.

I/O Map Selection	B864 Switch Setting	Result
Binary	BCD	BCD
Binary	Binary	Binary
BCD	BCD	Erroneous
BCD	Binary	BCD

B864-001 Register Output, Field Connections

Terminal Numbering and Output Functions

User connections are made to a standard screw terminal strip. The rigid wiring system permits module insertion or removal without disturbing the wiring. The following illustration shows how to field connect the unit.

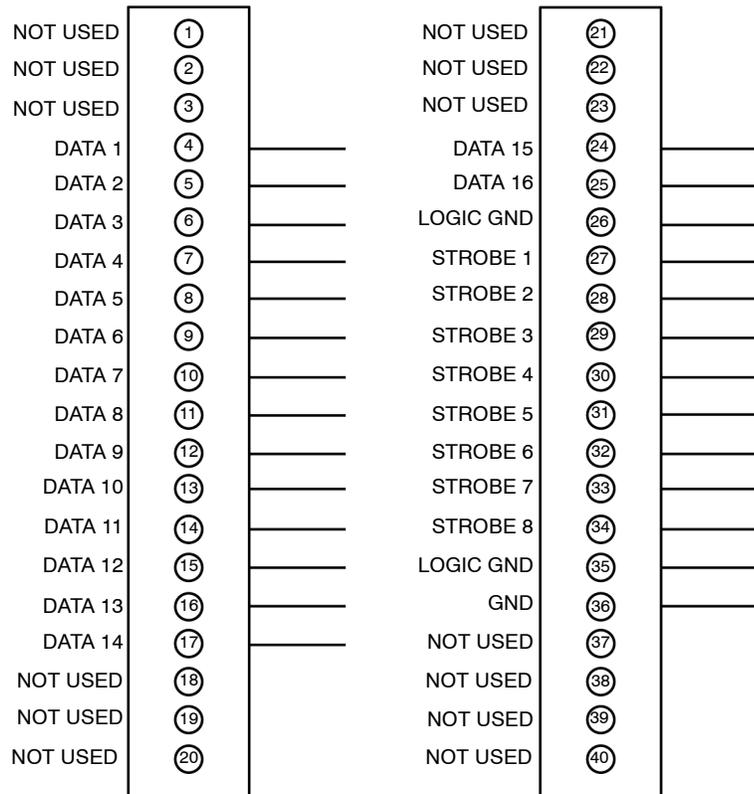


Pull-up Resistor Connection

Pull-up resistors must be installed at the active device end to use the B864 output module. The value of the pull-up resistor depends upon the number of devices that are attached to the data bus, as explained below. Each output meets 0.4 V maximum at 16 ma for a logic low and 3.3 V minimum at 16 mA for a logic high. If the current limit has been exceeded, the pull-up resistor values should be adjusted within specification; otherwise, spurious results may be obtained.

The following illustration indicates how the resistors are connected at the device end. For a single device consisting of 16 data lines, 16 1 k resistors are required, or, one 1 k resistor/data line. As additional devices are added to the data bus, the value of the pull-up resistor must be increased by 1 k. In other words, if two devices are used, the pull-up resistor must be 2 k, three devices require a 3 k pull-up, and so on, with the maximum number of 8 devices requiring 8 k of pull-up for each data line.

Pull-up Resistor Connection

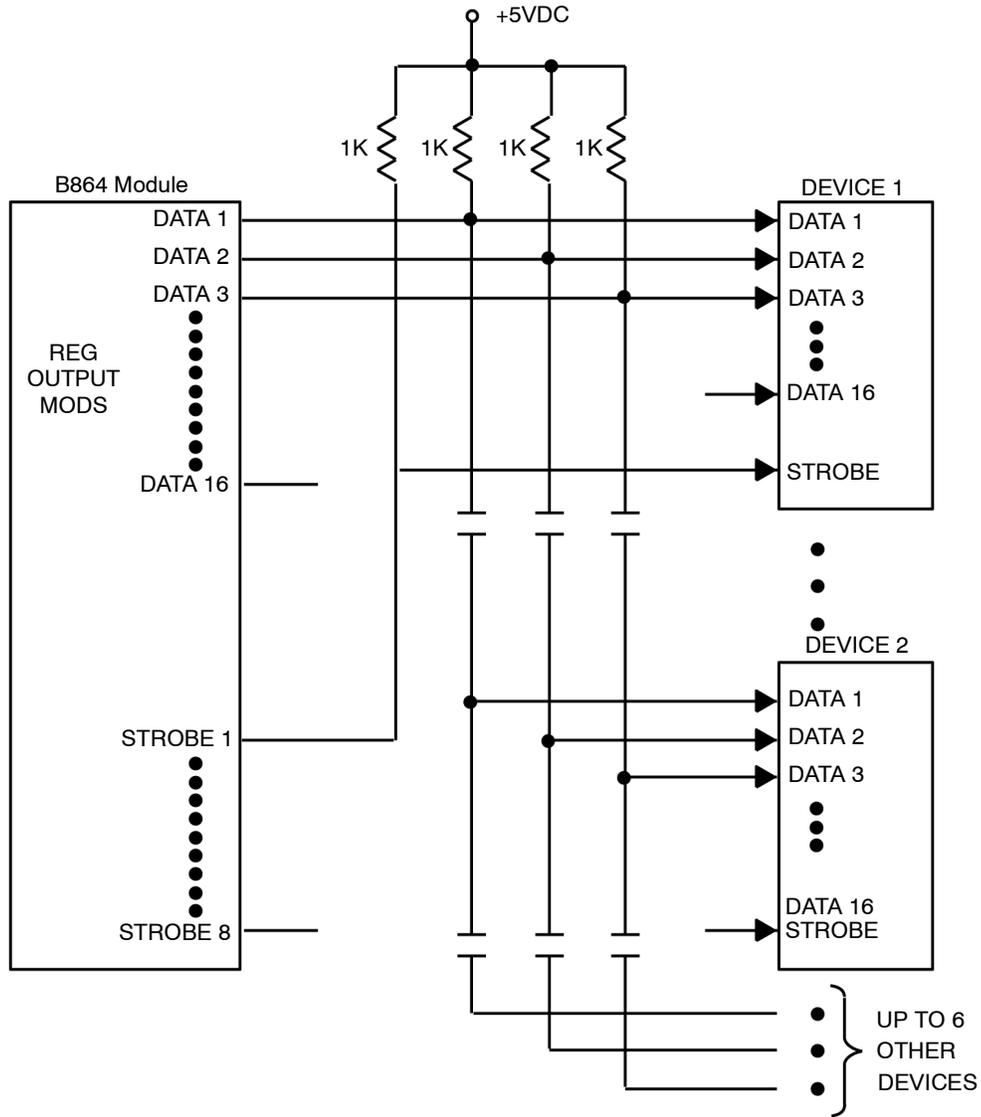

Note: Increase pull-up resistor value by 1 k for each additional device.

B864–001 Register Output, Specifications

Specification Table

The following table provides the specifications for the unit.

Module B864-001, Specification Table		
Description	TTL register output	
Number of Points	8 channels, 16 data lines	
Operating Voltage	5 V TTL	
Number of Groups	N/A	
Outputs/group	N/A	
Guaranteed Min. Levels	High State > 3.5 Vdc	
	Low State < 0.4 Vdc while sinking 16 mA	
Strobe Output Power	Two TTL loads @ 5 Vdc	
Strobe Width Timing	200 s 10%	
Module Throughput	11.3 ms	
Power Required	+5 V	100 mA
	+4.3 V	100 mA
	-5 V	0 mA
External Power Supply	A +5 Vdc external power supply is required for pull-up resistor VCC	
Field Device Requirements		Output Level
	TTL	Low: 0 < 0.8 Vdc @ 1.8A High: 1 > 2.4 Vdc @ 40A
	CMOS	Low: 0 < 1.6 Vdc @ 0.3A High: 1 > 3.3 Vdc @ 0.3A
Terminal Connector	AS-8535-000	

B864-001 Parameter Configuration

Parameter and Default Values

Parameter Configuration Window

Parameter Name	Value
MAPPING	BIT (%M-0X)
OUTPUTS STARTING ADDRESS	1
OUTPUTS ENDING ADDRESS	128
OUTPUT TYPE	BINARY

Module Configuration

Parameter Name	Value (Default)	Value (Options Available)	Description
Mapping	BIT (%M-0X)	WORD (%MW-4X)	
Outputs Starting Address	1	1	
Outputs Ending Address	128	8	
Output Type	BINARY	BCD	

Mapping Parameter References

	Modsoft, Concept, ProWORX	Unity
Reference Type	Mapped as 128 bits output 0x or Mapped as 8 registers output 4x	Mapped as 128 bits output %Mx or Mapped as 8 words output %MWx
Output Type	BIN/BCD	BIN/BCD

B865–001 Register Input

53

At a Glance

Purpose

This chapter describes the functional and physical characteristics of the B865–001 Register Input Module.

What's in this Chapter?

This chapter contains the following topics:

Topic	Page
B865–001 Register Input, Overview	516
B865–001 Register Input, Switch Settings	518
B865–001 Register Output, Field Connections	519
B865–001 Register Input, Specifications	522
B865–001 Parameter Configuration	524


B865–001 Register Input, Overview

The B865–001 register input module provides a 5 V TTL or CMOS-compatible interface between peripheral field devices and a PLC. The B865-001 is an eight-channel register module with eight 16-bit registers. A channel is defined as a 16-bit data path.

The module can operate in either BCD or binary mode. The desired mode is user-selectable, with the parallel 16-bit input having BCD values in the range 0000- 9999 and the binary input in the range 0000-FFFF.

The B865–001 operates in module-select mode, which updates the controller with eight input registers of new data samples on one scan period. The module-select feature ensures data integrity by sampling and comparing data from the user device twice during each channel's active strobe period. If the samples are equal, the data is accepted for further processing. If the samples are not equal, the old data is sent to the controller. If a channel has three consecutive no-compares, a 16-bit word containing all zeros is routed to the PLC.

The following diagram shows the schematic diagram for the B865-001 Register Input Module.

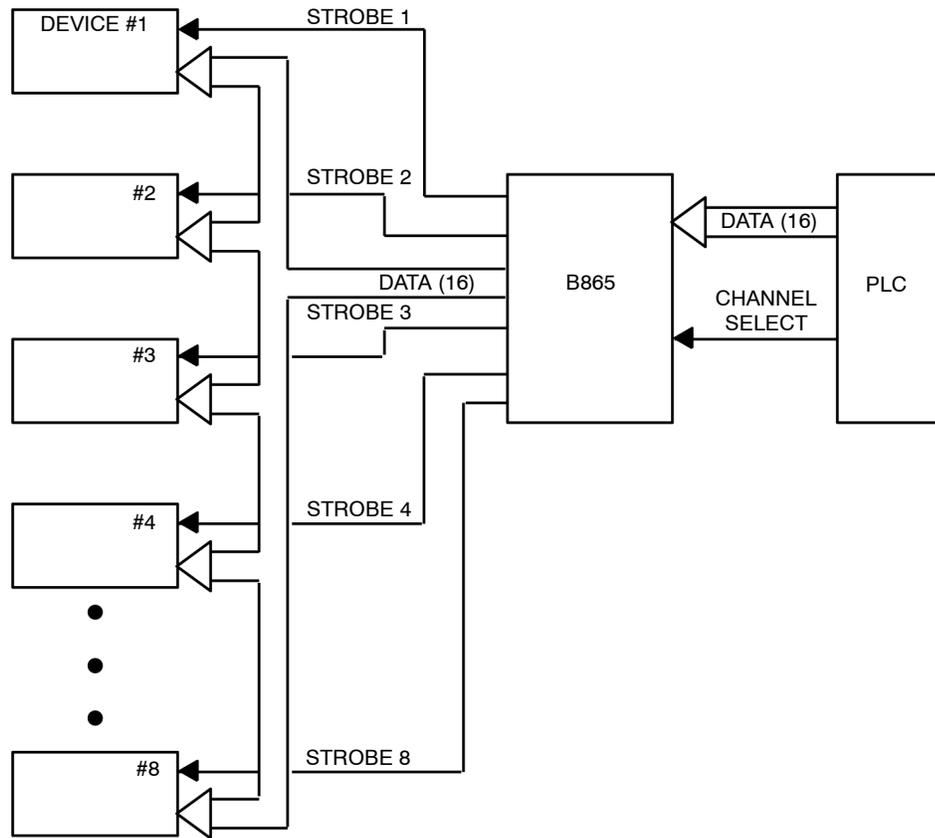

The B865-001 operates with a 16-bit data path. Data is routed from a device by means of a strobe line associated with each device. The datalines are common to all devices while the strobe performs the addressing function. The DC (data changing) signal from the field device is used for slowly changing data such as thumb wheel switches, and prevents erroneous information from being transferred to the PLC. This input needs only be used for slowly changing data that may cause the capture of erroneous information. The DC input connection is made on terminal 18 of the module's field side wiring strip.

B865–001 Register Input, Switch Settings

Switch Settings Two toggle switches are located at the top of the module and are used to determine the type of communication with external devices. Both switches are user selectable.

1. Data Polarity Switch
This toggle switch allows selection of true-hi or true-lo input data.
2. Bin/BCD Switch
This toggle switch determines whether the input data is to be interpreted by the controller as a BCD or a binary value.

Note: The switch and I/O map relationship is summarized in the following table.


Table The following table identifies the relationship between the switch and I/O map facility.

I/O Map Selection	B865 Switch Setting	Result
Binary	BCD	BCD
Binary	Binary	Binary
BCD	BCD	Erroneous
BCD	Binary	BCD

B865–001 Register Output, Field Connections

Terminal Numbering and Input Functions

User connections are made to a standard screw terminal strip. The rigid wiring system permits module insertion or removal without disturbing the wiring. Terminal numbering and input functions are shown on the following illustration.

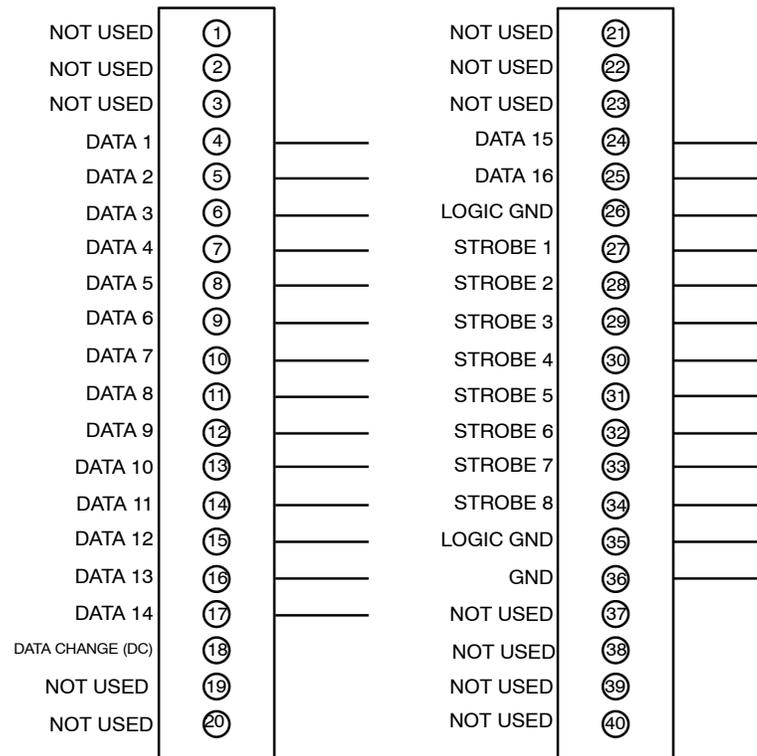


Pull-up Resistor Connection

Resistive pull-ups of 2.2 k Ω 10% for each strobe line must be provided. This is required on ACTIVE devices only. Thumb wheel switches, for example, do not require the addition of pull-up resistors.

The recommended location for the pull-up resistors is at the device end of the circuit. However, they will work at the module end as well.

The following illustration shows a typical circuit setup.

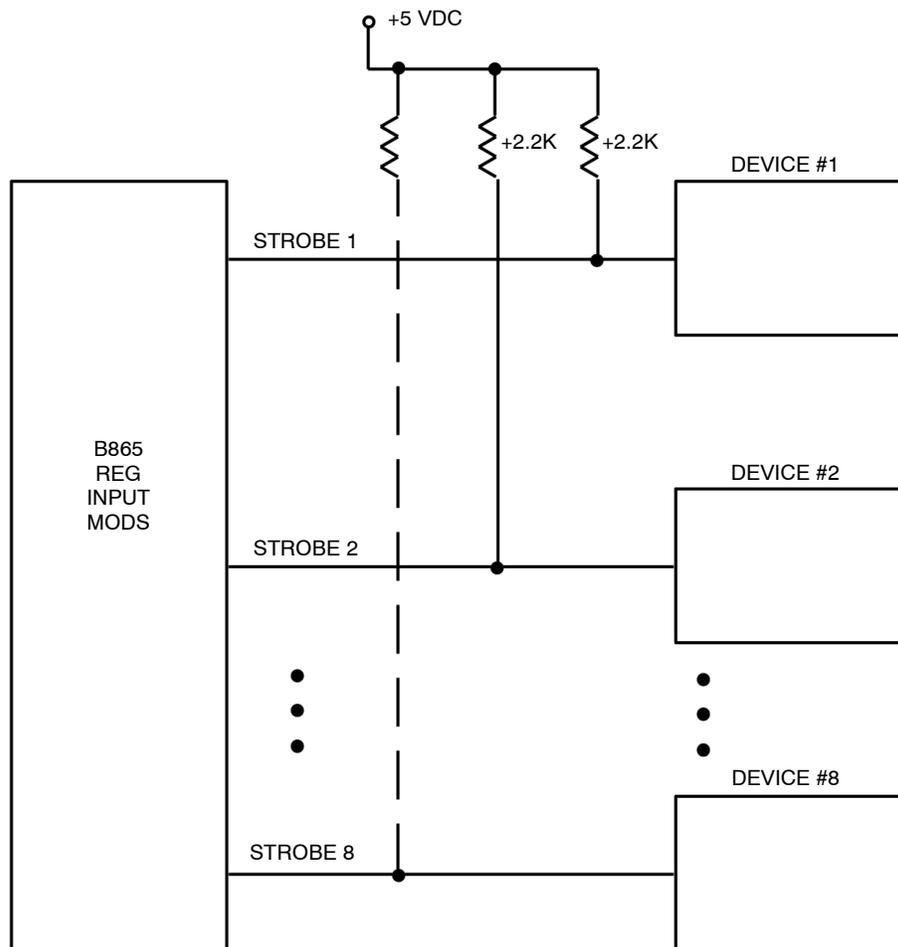

Strobe Type

Strobe lines for the B865 module are true-low. The opposite is the case in other Modicon I/O modules. Therefore, when multiple thumb wheel inputs require diode isolation, the polarity of the diodes may have to be reversed.

B865–001 Register Input, Specifications

Module B865–001, Specification Table

Description		TTL register input
Number of Points		8 channels, 16 data lines
Operating Voltage		5 V TTL
Number of Groups		NA
Outputs/group		NA
Guaranteed Min. Levels		High State > 3.5 Vdc
		Low State < 0.4 Vdc while sinking 16 mA
Strobe Output Power		2 TTL loads @ 5 Vdc
Strobe Width Timing		2 mS 10%
Data Set-up Time		Within 180 s after the strobe has gone active (LO), data must have sta-bilized on the field side inputs
Minimum Data Hold Time		100 s must be provided by user
Maximum Response Time	OFF → ON	20 ms
	ON → OFF	20 ms
Power Required	+5 V	400 mA
	+4.3 V	600 mA
	-5 V	0 mA
External Supply		A +5 Vdc external power supply is required for pull-up resistor VCC
Field Devices Requirements	Field Device	Output Level
	TTL	Low: 0 < 0.8 Vdc @ 1.6A
		High: 1 > 2.4 Vdc @ 40 A
	CMOS	Low: 0 < 1.6 Vdc @ 0.3 A
High: 1 > 3.3 Vdc @ 0.3 A		
Terminal Connector		AS-8535-000

Note: All user field devices must have outputs that feature latched, tri-state, or open collector, or wired or passive logic. The user must provide 2.2 k Ω 10% pull-up resistors for each strobe line.

B865-001 Parameter Configuration

Parameter and Default Values

Parameter Configuration Window

Parameter Name	Value
MAPPING	BIT (%I-1X)
INPUTS STARTING ADDRESS	1
INPUTS ENDING ADDRESS	128
INPUT TYPE	BINARY

Module Configuration

Parameter Name	Value (Default)	Value (Options Available)	Description
Mapping	BIT (%M-0X)	WORD (%IW-3X)	
Inputs Starting Address	1	1	
Inputs Ending Address	128	8	
Input Type	BINARY	BCD	

Mapping Parameter References

	Modsoft, Concept, ProWORX	Unity
Reference Type	Mapped as 128 bits input 1x or Mapped as 8 registers input 3x	Mapped as 128 bits input %Ix or Mapped as 8 words input %IWx
Input Type	BIN/BCD	BIN/BCD

B868–001 Register Output

54

At a Glance

Purpose

This chapter describes the functional and physical characteristics of the B868–001 Register Output Module.

What's in this Chapter?

This chapter contains the following topics:

Topic	Page
B868–001 Register Output, Overview	526
B868–001 Register Output, Switch Settings	527
B868–001 Register Output, Field Connections	528
B868–001 Register Output, Specifications	531
B868–001 Parameter Configuration	532

B868-001 Register Output, Overview


Overview

The B868-001 register output module provides a 5 V TTL or CMOS-compatible interface between a PLC and peripheral field devices. The B868-001 register output module operates in either BCD or binary mode.

The desired mode is operator selectable, with the 16-bit output either having BCD values in the range 0000 to 9999 or binary output in the range 0000 (HEX) to FFFF (HEX).

The B868-001 is a 8-channel register output module with four 16-bit registers and is operated in channel select mode. In the channel select mode, only one channel (16-bit register width) is transferred during each cycle. This is accomplished by employing a simple form of handshaking with the PC. A channel select word is sent by the PC to the B868 module, directing it to send a specific channel to the addressed field device. The B868 then echos back to the controller the channel address of the last valid transmission. Channel select requires 1 input and 2 consecutive output registers. The input register contains the channel number echo, while the output registers contain the channel address and the data.

The following is a simplified block diagram of the unit.

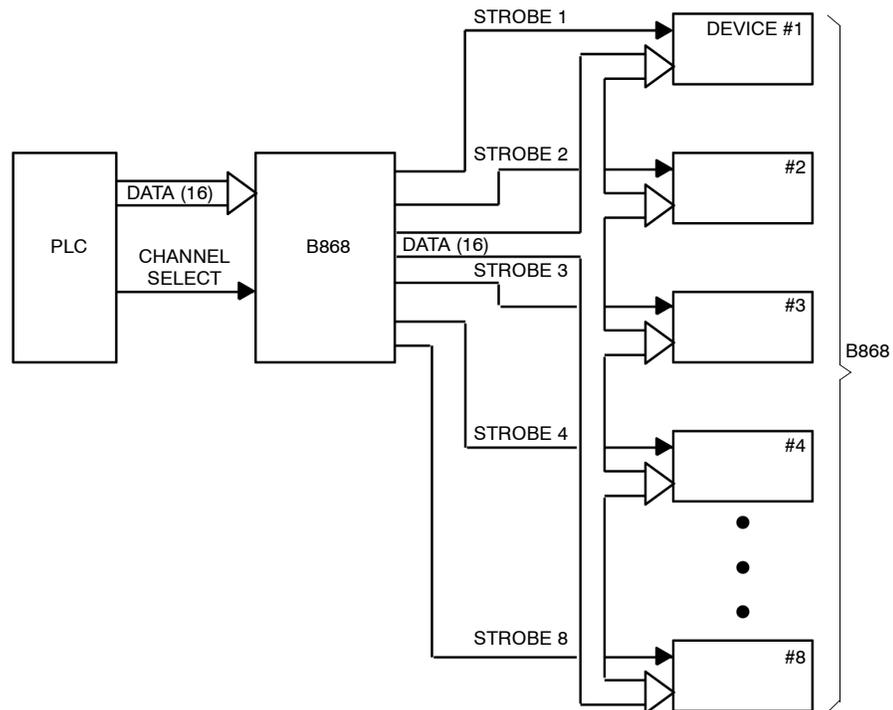

B868–001 Register Output, Switch Settings

Switch Settings

Two toggle switches are located at the top left of the module and are used to determine the type of communication with external devices. Both switches are user selectable.

1. Bin/BCD Switch

This toggle switch determines whether the output data is to be interpreted by the target devices as a BCD or a binary value.

2. Strobes Active Hi/Lo Switch

This toggle switch allows selection of either true-hi or true-lo for strobing output data.

Note: The relation between the I/O map selection, the BCD/binary switch setting, and the results at the output are summarized in the following table:

Table

The following table identifies the relationship between the switch and I/O Map facility.


I/O Map Selection	B868 Switch Setting	Result
Binary	BCD	BCD
Binary	Binary	Binary
BCD	BCD	Erroneous
BCD	Binary	BCD

Pull-up Resistor Connection

Pull-up resistors must be installed at the active device end to use the B868 output module. The value of the pull-up resistor depends upon the number of devices that are attached to the data bus, as explained below. Each output meets 0.4 V maximum at 16 mA for a logic low and 3.3 V minimum at 16 mA for a logic high. If the current limit has been exceeded, the pull-up resistor values should be adjusted within specification; otherwise, spurious results may be obtained.

The following illustration indicates how the resistors are connected at the device end. For a single device consisting of 16 data lines, 16 1 k resistors are required, or, one 1 k resistor per data line. As additional devices are added to the data bus, the value of the pull-up resistor must be increased by 1 k. In other words, if two devices are used, the pull-up resistor must be 2 k, three devices require a 3 k pull-up, and so on, with the maximum number of 8 devices requiring 8 k of pull-up for each data line.

Pull-up Resistor Connection

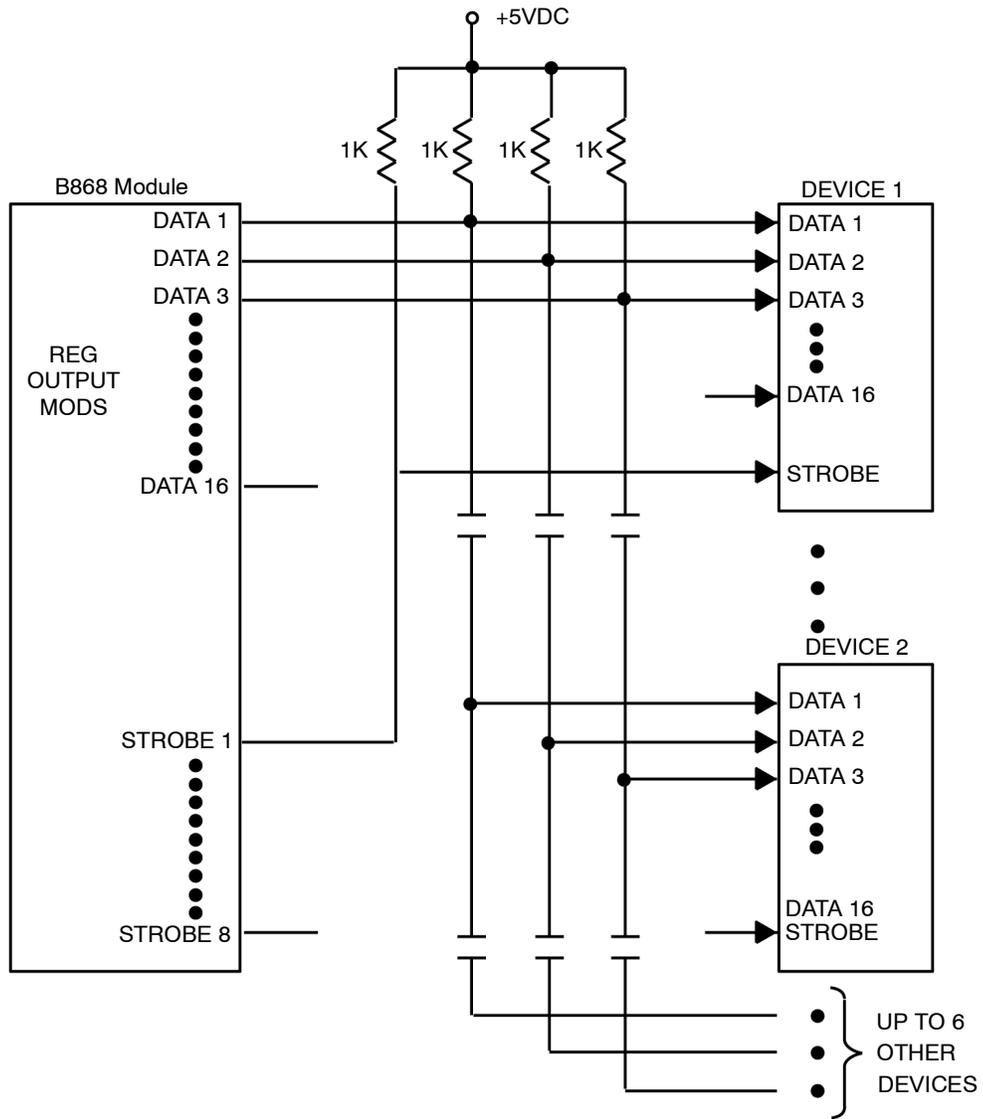

Note: Increase pull-up resistor value by 1 k for each additional device.

B868–001 Register Output, Specifications

Specification Table

The following table provides the specifications for the unit.

B868-001 Specifications		
Description		TTL register output
Number of Points		8 channels, 16 data lines
Operating Voltage		5 V TTL
Number of Groups		N/A
Outputs/group		N/A
Guaranteed Min. Levels		High State > 3.5 VDC
		Low State < 0.4 VDC while sinking 16 mA
Strobe Output Power		Two TTL loads @ 5 VDC
Strobe Width Timing		200 μ s \pm 10%
Response Time		11.3 ms between an OURBUS write and field update
Power Required	+5 VDC I/O	100 mA max.
	+4.3 VDC I/O	100 mA max.
External Power Supply		+5 VDC is required for pull-up resistor Vcc
Field Device Requirements	TTL output level	Low: < 0.8 VDC @ 1.6 mA High: > 2.4 VDC @ 40 μ A
	CMOS output level	Low: < 1.6 VDC @ 0.3 μ A High: > 3.3 VDC @ 0.3 μ A
Terminal Connector		AS-8535-000

Note: All user field devices must have outputs that feature latched, tristate, or open collector logic.

Note: The user must provide 1.0 k Ω \pm 10% pull-up resistors for each strobe line.

B868-001 Parameter Configuration

Parameter and Default Values

Parameter Configuration Window

Parameter Name	Value
MAPPING	BIT (%I-1X%M-0X)
INPUTS STARTING ADDRESS	1
INPUTS ENDING ADDRESS	16
OUTPUTS STARTING ADDRESS	1
OUTPUTS ENDING ADDRESS	32
OUTPUT TYPE	BINARY

Module Configuration

Parameter Name	Value (Default)	Value (Options Available)	Description
Mapping	BIT (%I-1X%M-0X)	WORD (%IW-3X%MW-4X)	
Inputs Starting Address	1	1	
Inputs Ending Address	16	1	
Outputs Starting Address	1	1	
Outputs Ending Address	32	2	
Output Type	BINARY	BCD	

Mapping Parameter References

	Modsoft, Concept, ProWORX	Unity
Reference Type Inputs	Mapped as 16 bits input 1x or Mapped as 1 register input 3x	Mapped as 16 bits input %Ix or Mapped as 1 word input %IWx
Reference Type Outputs	Mapped as 32 bits output 0x or Mapped as 2 registers output 4x	Mapped as 32 bits output %Mx or Mapped as 2 words output %MWx
Output Type	BIN/BCD	BIN/BCD

B869–002 Register Input

55

At a Glance

Purpose

This chapter describes the functional and physical characteristics of the B869–002 Register Input Module.

What's in this Chapter?

This chapter contains the following topics:

Topic	Page
B869–002 Register Input, Overview	536
B869–002 Register Input, Switch Settings	538
B869–002 Register Output, Field Connections	539
B869–002 Register Output, Specifications	541
B869–002 Parameter Configuration	542

B869–002 Register Input, Overview

Overview


The B869–002 register input module provides a 5 V TTL or CMOS-compatible interface between peripheral field devices and a PLC. The B869-002 is capable of inputting numeric 4-digit BCD data, or 16-bit binary data from field devices to the controller.

The module can operate in either BCD or binary mode. The desired mode is user-selectable, with the parallel 16-bit input having BCD values in the range 0000 to 9999 and the binary input in the range 0000 (HEX) to FFFF (HEX).

The B869-002 is an 8 channel device that operates in a channel select mode. In the channel select mode, only one channel (16-bit register width) is transferred during each cycle. This is accomplished by employing a simple form of handshaking with the PC. A channel select word is sent by the PC to the module, requesting data from a specific channel. The module then responds by sending the requested data, together with a channel select echo. Channel select mode requires 1 output and 2 consecutive input registers. The output register (Channel Select Reg) contains the address of the selected channel, while the 2 input registers contain the channel number echo and the data, respectively.

Schematic Diagram

The following figure shows the schematic diagram for the B869–002 Register Input Module.

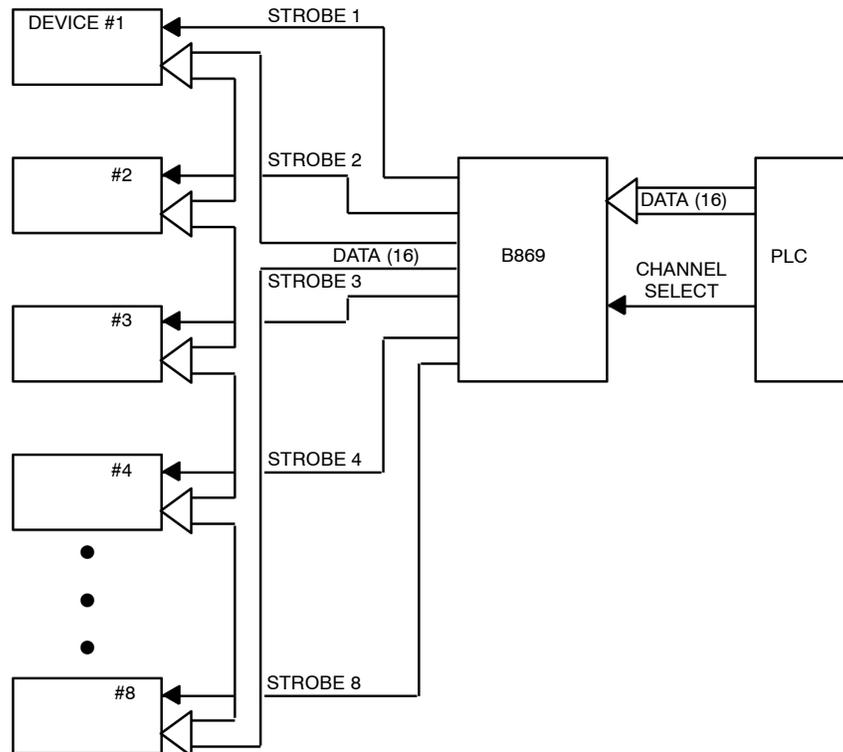

The B869–002 operates with a 16-bit data path. Data is routed in from a device by means of a strobe line associated with each device. The data lines are common to all devices while the strobe performs the addressing function. The channel select function permits the PC to transfer a single channel of 16 bits from a selected field device to the PC during one OURBUS cycle.

The DC (data changing) signal from the field device is used for slowly changing data such as thumb wheel switches and prevents erroneous information from being transferred to the PLC.

To avoid loading the bus when a device is not being addressed, any active device interfaced to the input module must have latched, tri-state, or open collector outputs.

B869–002 Register Input, Switch Settings

Switch Settings Two toggle switches are located at the top of the module and are used to determine the type of communication with external devices. Both switches are user selectable.

1. Data Polarity Switch
This toggle switch allows selection of true-hi or true-lo input data.
2. Bin/BCD Switch
This toggle switch determines whether the input data is to be interpreted by the controller as a BCD or a binary value.

Note: The switch and I/O map relationship is summarized in the following table.


Table The following table identifies the relationship between the switch and I/O map facility.

I/O Map Selection	B869 Switch Setting	Result
Binary	BCD	BCD
Binary	Binary	Binary
BCD	BCD	Erroneous
BCD	Binary	BCD

B869–002 Register Output, Field Connections

Terminal Numbering and Input Functions

User connections are made to a standard screw terminal strip. The rigid wiring system permits module insertion or removal without disturbing the wiring. Terminal numbering and input functions are shown on the following illustration.

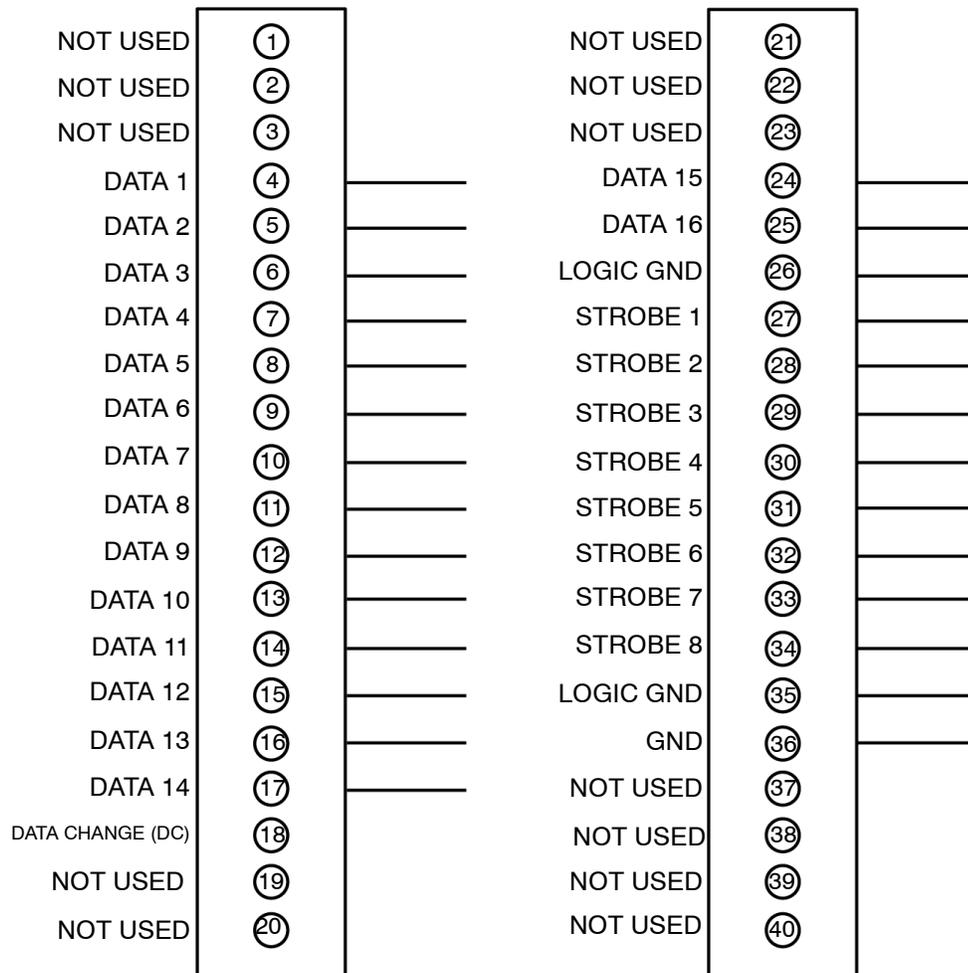


Pull-up Resistor Connection

Resistive pull-ups of $2.2\text{ k}\Omega \pm 10\%$ for each strobe line must be provided. This is required on ACTIVE devices only. Thumb wheel switches, for example, do not require the addition of pull-up resistors.

The recommended location for the pull-up resistors is at the device end of the circuit. However, they will work at the module end as well.

The following illustration shows a typical circuit setup.

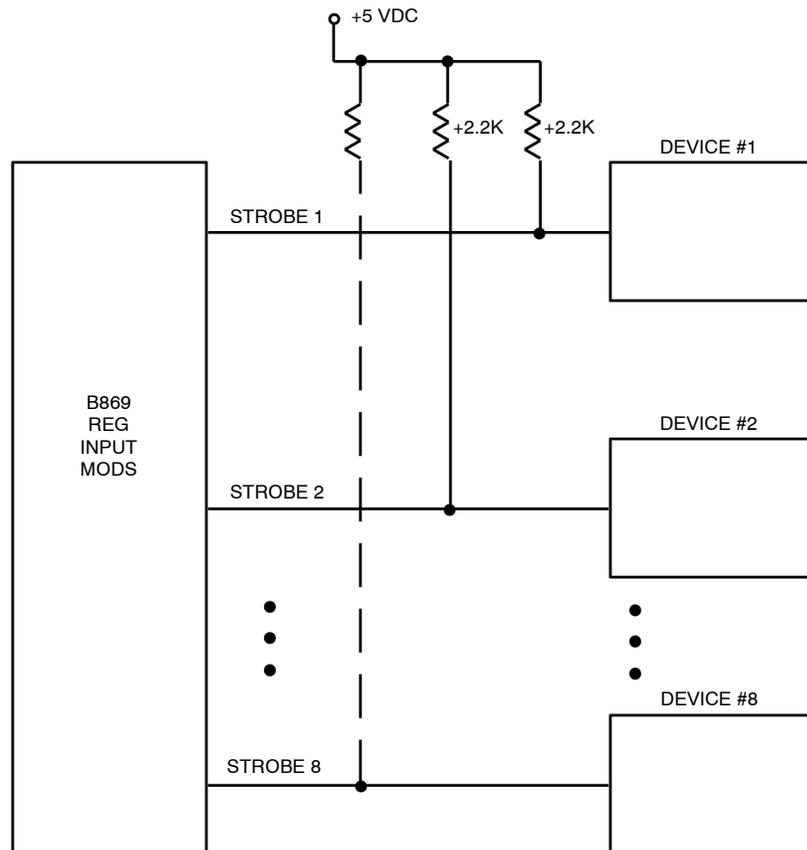

Strobe Type

Strobe lines for the B869 module are true-low. The opposite is the case in other Modicon I/O modules. Therefore, when multiple thumb wheel inputs require diode isolation, the polarity of the diodes may have to be reversed.

B869–002 Register Output, Specifications

Specification Table

The following table provides the specifications for the unit.

B869-002 Specifications		
Description	TTL register output	
Number of Points	8 channels, 16 data lines	
Operating Voltage	5 V TTL	
Number of Groups	N/A	
Outputs/group	N/A	
Guaranteed Min. Levels	High State > 3.5 VDC	
	Low State < 0.4 VDC while sinking 16 mA	
Strobe Output Power	Two TTL loads @ 5 VDC	
Strobe Width Timing	2 ms \pm 10%	
Data Set-up Time	Within 180 μ s after the strobe has gone active (LO), data must have stabilized on the field side inputs	
Minimum Data Hold Time	100 μ s must be provided by the user	
Response Time	20 ms between a field data change and an I/O Comm (OURBUS) update	
Power Required	+5 VDC I/O	400 mA max.
	+4.3 VDC I/O	600 mA max.
External Power Supply	+5 VDC may be required for pull-up Vcc	
Field Device Requirements	TTL output level	Low: < 0.8 VDC @ 1.6 mA High: > 2.4 VDC @ 40 μ A
	CMOS output level	Low: < 1.6 VDC @ 0.3 μ A High: > 3.3 VDC @ 0.3 μ A
Terminal Connector	AS-8535-000	

Note: All user field devices must have outputs that feature latched, tristate, open collector or wired or passive logic.

Note: The user must provide 2.2 k Ω \pm 10% pull-up resistors for each strobe line.

B869-002 Parameter Configuration

Parameter and Default Values

Parameter Configuration Window

Parameter Name	Value
MAPPING	BIT (%I-1X%M-OX)
INPUTS STARTING ADDRESS	1
INPUTS ENDING ADDRESS	32
OUTPUTS STARTING ADDRESS	1
OUTPUTS ENDING ADDRESS	16
OUTPUT TYPE	BINARY

1 : 140 XBP 3 : B869

Module Configuration

Parameter Name	Value (Default)	Value (Options Available)	Description
Mapping	BIT (%I-1X%M-OX)	WORD (%IW-3X%MW-4X)	
Inputs Starting Address	1	1	
Inputs Ending Address	32	2	
Outputs Starting Address	1	1	
Outputs Ending Address	16	1	
Output Type	BINARY	BCD	

Mapping Parameter References

	Modsoft, Concept, ProWORX	Unity
Reference Type Inputs	Mapped as 32 bits input 1x or Mapped as 2 registers input 3x	Mapped as 32 bits input %Ix or Mapped as 2 words input %IWx
Reference Type Outputs	Mapped as 16 bits output 0x or Mapped as 1 register output 4x	Mapped as 16 bits output %Mx or Mapped as 1 word output %MWx
Output Type	BIN/BCD	BIN/BCD

B881–001 Latched 24 Vdc Input

56

At a Glance

Purpose

This chapter describes the functional and physical characteristics of the B881–001 Latched 24 Vdc Input Module.

What's in this Chapter?


This chapter contains the following topics:

Topic	Page
B881–001 Latched 24 Vdc Input, Overview	546
B881–001 Latched 24 Vdc Input, Field Connections	549
B881–001 Latched 24 Vdc Input, Specifications	550
B881–001 Parameter Configuration	551

Module B881-001

B881-001 Latched 24 Vdc Input, Overview

The B881–001 Latched 24 Vdc Input Module senses and converts input signals from its field circuitry to a logic level used by Modicon PLC. The incoming signal causes the module to latch at the occurrence of the ON state and may be considered a latching event. The 24 Vdc, true high latched input module is capable of direct connection to any Modicon, true high dc output module (at proper voltage). The following illustration shows the B881–001 Latched 24 Vdc Input Module Simplified Block Diagram

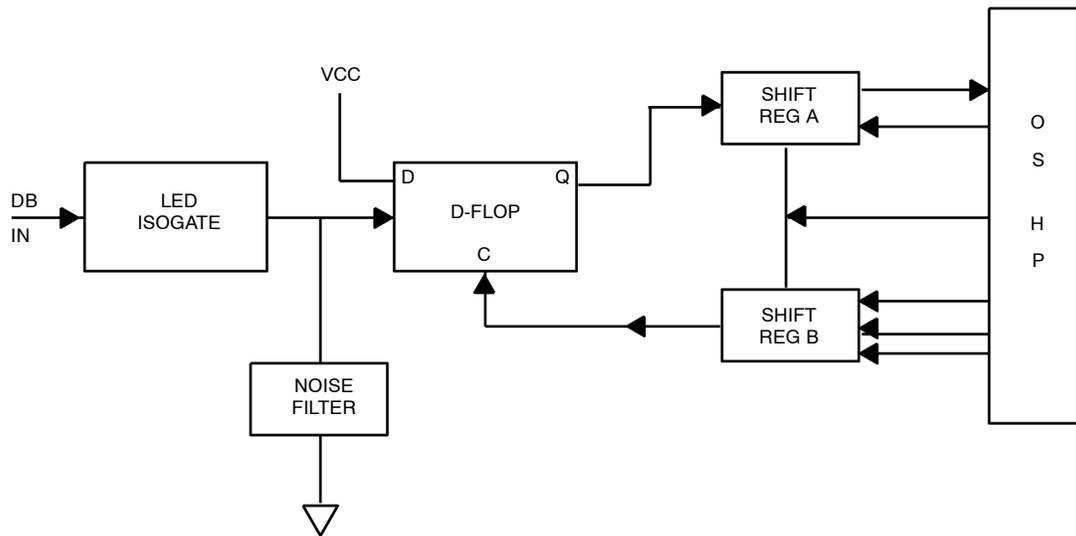

The latching mechanism exists solely to lockout subsequent incoming signals for the time it takes to communicate to the controller that a latching event occurred, receive an acknowledgement, and reset the latch. The latched input module does not affect the users field circuit, drive the controller or communicate information to it other than the fact that a latching event took place.

Signals on the 16-channel inputs are compared to a reference voltage nominally set to 75% of the group supply voltage. An input signal of 500 s minimum pulse width and equal to or exceeding the reference voltage threshold will cause a latched ON state for any given channel. An input signal voltage less than 25% of the group supply voltage will result in a system OFF state


.When the module senses and latches on the leading edge of the true-high, incoming field signal or data bit (DB), it clocks the D-type flip-flop on the low-to-high transition, in effect, capturing the latching event.

The module's ON state is communicated to the controller through Shift Register (A) and OBS chip via a handshake mechanism. The logic is then returned to the module from the CPU as an inverted signal through shift register (B) where it resets the flip-flop (latch condition) for that channel only. The reset latch is then available for another, low-to-high, event transition. To ensure that the controller has received a latched event, the module actually operates in a user programmed, echoed- data handshake mode. The handshake mechanism requires four to six scans before a new event can be recognized. Total scan time is software-limited to 200 ms maximum and hardware limited to 250 ms maximum. Thus, you should not attempt to record events with a repetition rate greater than one per second unless willing to analyze this actual system and program.

Note: Reversal of external load polarity will not cause circuit failure as the module is fused to protect its circuitry against overload currents and accidental polarity reversal.

B881-001 Latched 24 Vdc Input, Field Connections

User connections are made to a standard screw terminal strip. The rigid wiring system permits module insertion or removal without disturbing the wiring. The following illustration shows the field connections for the unit.

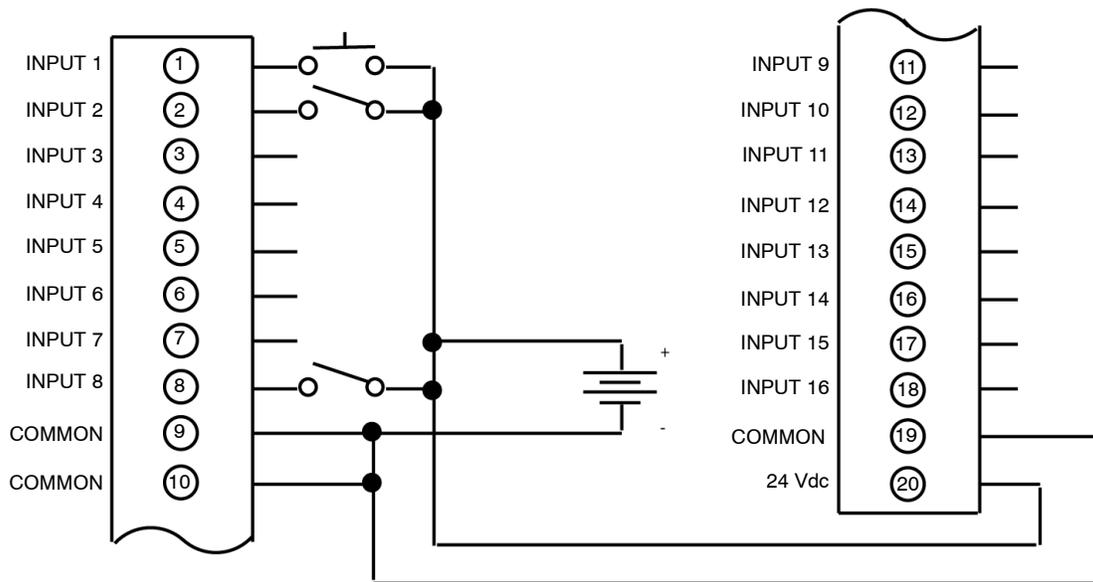

B881-001 Latched 24 Vdc Input, Specifications

Module B881-001, Specification Table

Description		24 Vdc (LATCH) input
Type of Operation		True High
Number of Points		16
Operating Range Voltage		20-28 Vdc
Number of Groups		1
Inputs/group		16
OFF → ON		≤25% of group supply voltage and input reset bit sent back to module
ON → OFF		≤25% of group supply voltage
ON Condition		≥75% of group supply voltage for .5 ms/min event pulse width
Maximum Input Voltage	Continuous	30 Vdc
	Inrush	40 Vdc for 10 ms
	ON current	6 mA @ 24 Vdc (typical)
Minimum Pulse Width		0.5 ms
Repetition Rate		1/s
Power Required	+5 V	30 mA
	+4.3 V	1.1 mA
	-5 V	0 mA
External Power Supply		24 Vdc (4 Vdc), 310 mA
Terminal Connector		AS-8534-000
Fuse		1/group, .75 A @ 250 Vdc

B881-001 Parameter Configuration

Parameter and Default Values

Parameter Configuration Window

Parameter Name	Value
MAPPING	BIT (%I-1X%M-0X)
INPUTS STARTING ADDRESS	1
INPUTS ENDING ADDRESS	16
OUTPUTS STARTING ADDRESS	1
OUTPUTS ENDING ADDRESS	16
OUTPUT TYPE	BINARY

Module Configuration

Parameter Name	Value (Default)	Value (Options Available)	Description
Mapping	BIT (%I-1X%M-0X)	WORD (%IW-3X%MW-4X)	
Inputs Starting Address	1	1	
Inputs Ending Address	16	1	
Outputs Starting Address	1	1	
Outputs Ending Address	16	1	
Output Type	BINARY	BCD	

Mapping Parameter References

	Modsoft, Concept, ProWORX	Unity
Reference Type Inputs	Mapped as 16 bits input 1x or Mapped as 1 register input 3x	Mapped as 16 bits input %Ix or Mapped as 1 word input %IWx
Reference Type Outputs	Mapped as 16 bits output 0x or Mapped as 1 register output 4x	Mapped as 16 bits output %Mx or Mapped as 1 word output %MWx
Output Type	BIN/BCD	BIN/BCD

B881–508 125 Vdc Output

57

At a Glance

Purpose

This chapter describes the functional and physical characteristics of the B881–508 125 Vdc Output Module.

What's in this Chapter?

This chapter contains the following topics:

Topic	Page
B881–508 125 Vdc Output, Overview	554
B881–508 125 Vdc Output, Fault Conditions	555
881–508 125 Vdc Output, Field Connections	556
B881–508 125 Vdc Output, Specifications	557
B881–508 Parameter Configuration	558


B881-508 125 Vdc Output, Overview

The B881-508 125 Vdc Output Module has eight isolated outputs. The outputs can serve 125 Vdc voltage relays, pilot lamps, motor starters, solenoids, valves, and any other load rated up to 140 Vdc (the outputs work in the range 5—140 Vdc).

Also, the B881 allows current surges within certain time limits. Internal fault flags report currents greater than 30 A, and currents between 5—30 A for a period greater than 500 ms. This shut down mode can only be cleared by resetting the point. Point control within ms provides fast response in critical situations. The B881-508 conforms to ANSI/IEEE C37.90 1978 duty cycle sequences.

In addition to the normal mode of controlling the outputs, the B881-508 allows the first four points to be independently controlled by external inputs through the field side connector. These external inputs are 24 Vdc active high. When a fault occurs during control by the external inputs, that input must be cycled (turned off) to clear the fault flag.

The following illustration is the B881-508 simplified schematic diagram



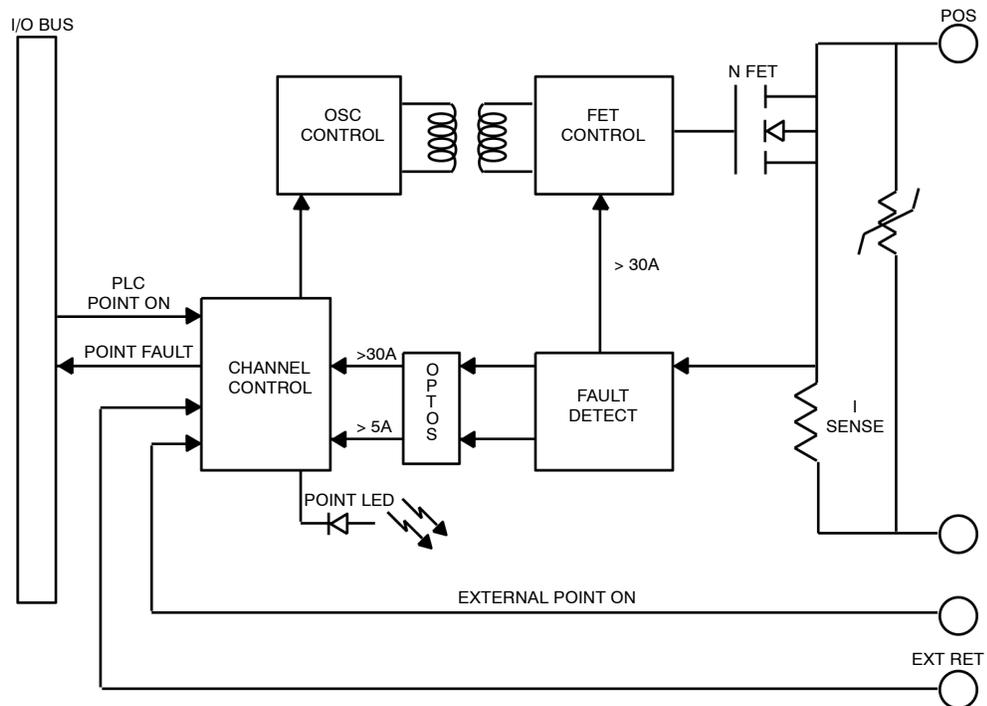


B881-508 125 Vdc Output, Fault Conditions

Overview

Over-current shutdown, as well as current surges greater than 500 ms are detected by the B881-508. Each point has a fault bit that can be accessed using the programming panel software. Each bit indicates either an over-current (greater than 30 A), or a current surge between 5 -3 A for a period greater than 500 ms. Although the B881-508 is I/O mapped as a 16-point bi-directional module, only the lower order eight inputs and outputs are used; the higher order eight inputs and outputs can not be used. Refer to the illustration below.


The following illustration shows the B881-508 fault flags

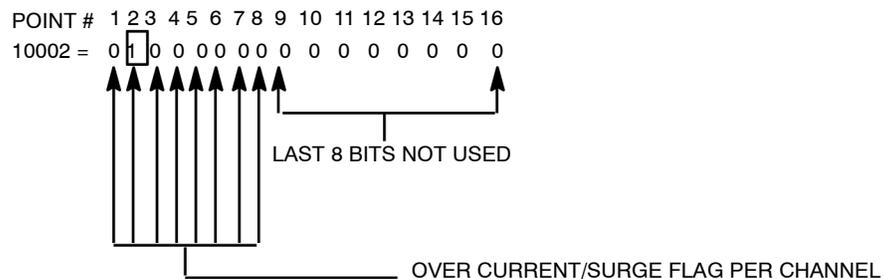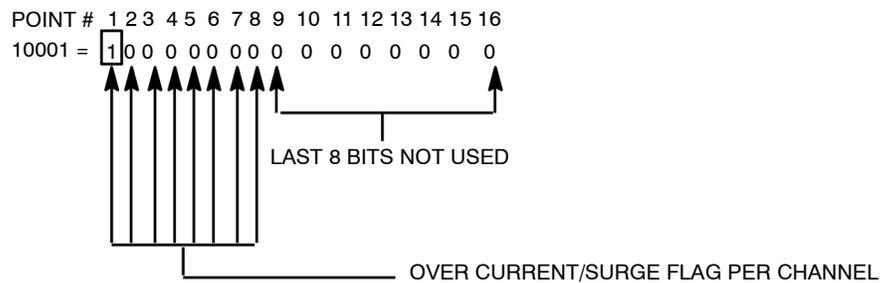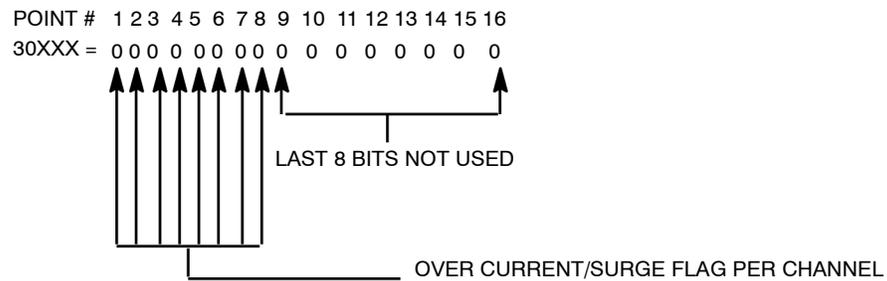

881-508 125 Vdc Output, Field Connections

Overview

User connections are made to a standard screw terminal strip. The rigid wiring system permits module insertion or removal without disturbing the wiring. The following illustration shows the B881-508 terminal numbering

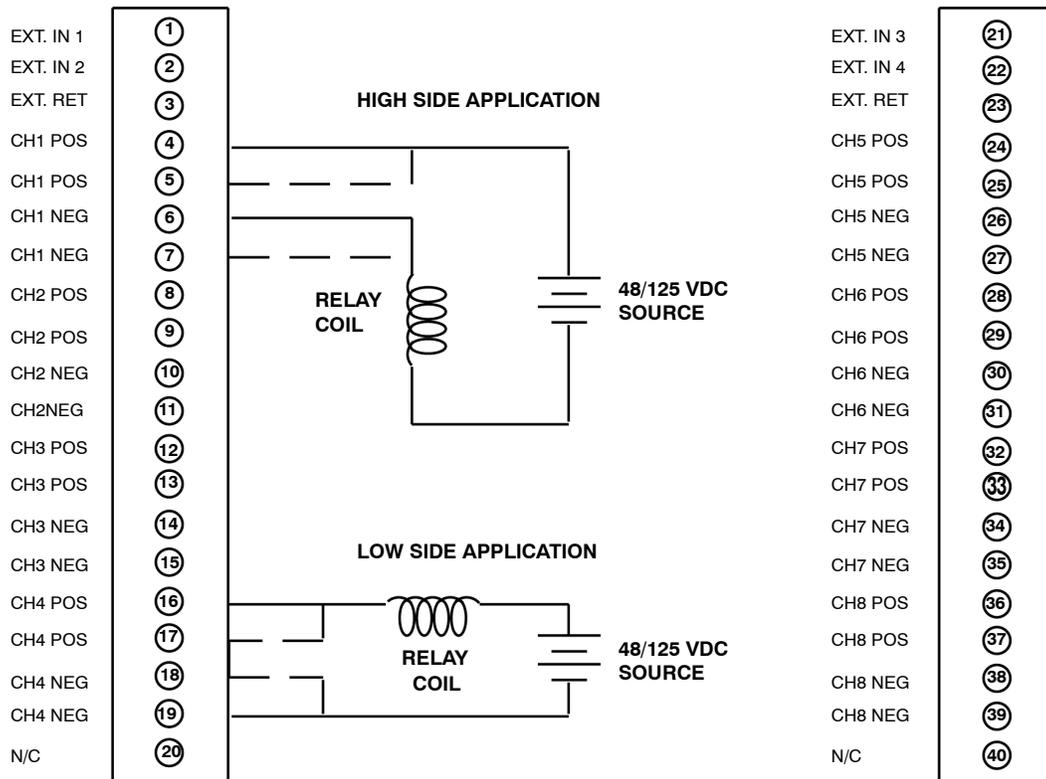

Note: Reverse voltage protection
 This module does not provide reverse voltage protection. Check for proper voltage polarity of the output wiring.

B881-508 125 Vdc Output, Specifications

B881-508, Specifications

Description	125 Vdc true high output	
Number of Points	8	
Operating Voltage	5-140 Vdc maximum	
Number of Groups	8	
Outputs/group	1	
Maximum Load Current	5.0 A continuous/channel maximum @ 25°C derated by 0.03 A/°C-4.0 A continuous per channel maximum @ 60°C 29.0 A/ module maximum	
Pulsed ON Cycle	500 ms maximum for 5-30 A load	
Inductance and Maximum Current/Channel	$I^2 L < 25 \text{ W}^*$	
	$I^2 LF < 0.5 \text{ W}^{**}$	
Wattage	< 24 W, 2.5 W/point maximum	
Minimum Load Current	75 mA	
Surge Current	30.0 A 1 cycle (500 ms)/channel maximum	
Minimum Load Current	75 mA	
Maximum Response Time	OFF → ON	<75 S
	ON → OFF	<100 S
Maximum OFF State Leakage Current	<3 mA	
ON State Voltage Drop Across Module	< 0.75 Vdc @ 4 A Load Current	
External Inputs	Response Time	75 S
	Working Voltage Range	19.2-28 Vdc
	Maximum Input Range	30 Vdc
	Mode of Operation	True High
Power Required	+5 V	300 mA
	+4.3 V	0 mA
	-5 V	0 mA
External Power Supply	5-140 Vdc field power supply	
Terminal Connector	AS-8535--000	
*Typical values of relay inductance and currents that can be switched safely at 1 s rates using this formula.		
**For repetitive pulses, use this formula.		

Note: Proper fusing of external circuitry is required, depending on the application.

B881–508 Parameter Configuration

Parameter and Default Values

Parameter Configuration Window

Parameter Name	Value
MAPPING	BIT (%I-1X%M-0X)
INPUTS STARTING ADDRESS	1
INPUTS ENDING ADDRESS	16
OUTPUTS STARTING ADDRESS	1
OUTPUTS ENDING ADDRESS	16
OUTPUT TYPE	BINARY

Module Configuration

Parameter Name	Value (Default)	Value (Options Available)	Description
Mapping	BIT (%I-1X%M-0X)	WORD (%IW-3X%MW-4X)	
Inputs Starting Address	1	1	
Inputs Ending Address	16	1	
Outputs Starting Address	1	1	
Outputs Ending Address	16	1	
Output Type	BINARY	BCD	

Mapping Parameter References

	Modsoft, Concept, ProWORX	Unity
Reference Type Input	Mapped as 16 bits input 1x or Mapped as 1 register input 3x	Mapped as 16 bits input %Ix or Mapped as 1 word input %IWx
Reference Type Outputs	Mapped as 16 bits output 0x or Mapped as 1 register output 4x	Mapped as 16 bits output %Mx or Mapped as 1 word output %MWx
Output Type	BIN/BCD	BIN/BCD

B882–032 24 Vdc Diagnostic Output and B818 20-28 Vac Discrete Output

58

At a Glance

Purpose

This chapter describes the functional and physical characteristics of the B882–032 24 Vdc Diagnostic Output Module and the B818 20-28 Vac Discrete Output Module.

What's in this Chapter?

This chapter contains the following topics:


Topic	Page
B882–032 24 Vdc Diagnostic Output, Overview	560
B882–032 24 Vdc Diagnostic Output, Fault Conditions	561
B882–032 24 Vdc Diagnostic Output, Field Connections	563
B818, 20-28 Vac Output, Keying and Wiring	564
B882–032 24 Vdc Diagnostic Output, Dip Switch Settings	566
B882–032 24 Vdc Diagnostic Output, Specifications	567
B818, 20-28 Vac Output, Specifications	568
B882–032 Parameter Configuration	569
B818 Parameter Configuration	570

B882-032 24 Vdc Diagnostic Output, Overview

The B882-032 diagnostic output module provides 32 points that make up four groups of eight outputs. Each group of eight outputs shares an external power supply voltage. The outputs work over the range of 20.0—28.0 Vdc, true high. It is capable of driving 24 Vdc relays, solenoids, pilot lamps, and other loads rated up to 1.0 A.

The B882-032 module also detects field fault conditions and turns the faulted point OFF for vital applications. The B882-032 diagnostic dc output module can detect open-load, over-current, over-voltage, and over-temperature conditions.

The following illustration is the B882-032 simplified block diagram

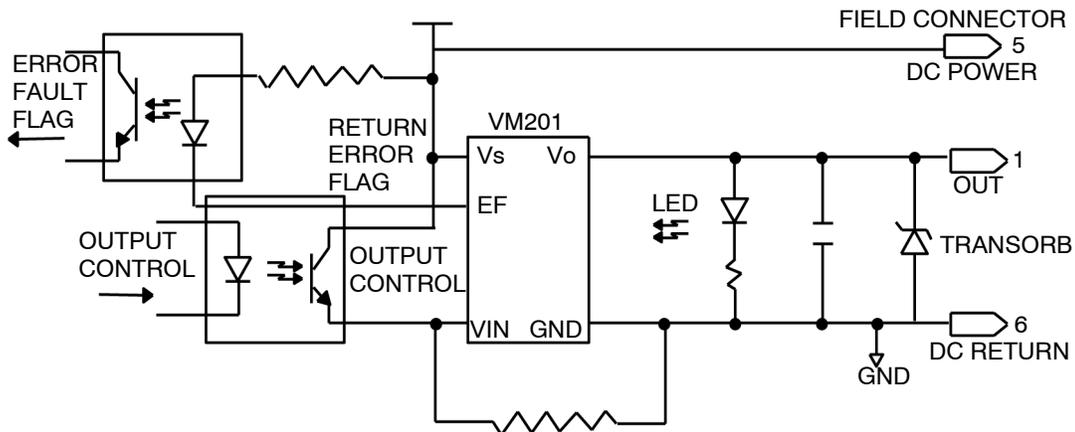

The functionality of the diagnostic dc output module can be selected according to the following criteria. It can be a bi-directional module (B882) with 32 discrete outputs and 32 discrete inputs which represent fault flags for each respective output. It can also be a uni-directional module (B818) having 32 discrete outputs without fault flags.

B882–032 24 Vdc Diagnostic Output, Fault Conditions

B882 Mode

Open-load, over-current, over-voltage and over-temperature fault conditions are detected by the diagnostic output module.

When an output fault is detected in the B882 mode, the module without controller intervention disarms the faulted output and reports the condition to the controller via discrete input (1x), or input register (3x) points. The point remains disarmed until the user's logic rearms the point by turning the point back on. To turn the point back on the user's logic must turn the point first off and then on.

Note: If the controller attempts to turn a faulted point back on, there must be a 2 - 5 s delay from the time of a fault to the time of cycling the faulted point on. When this delay is not given, the module ignores the change. When the fault point is brought low, the fault indicator clears in the 2-5 s range.

Note: If field power is lost, the module may detect faults. After field power is reapplied, all faults must be cleared

Note: Clearing faults prior to restarting

When a fault is detected in either the B882 or B818 mode, the source of the fault should be cleared prior to restarting the point. Failing to clear the source of a fault may result in damage to the

- power source
- driven field-side device
- module

B818 Mode

When an output fault is detected in the B818 mode, the module without controller intervention disarms the faulted output. Faults are not reported to the controller. To turn the point back on, the user's logic must first turn the point off and then on.

Note: If the controller attempts to turn a faulted point back on, there must be a 2 - 5 s delay from the time of a fault to the time of cycling the faulted point on. When this delay is not given, the module ignores the change. When the faulted point is brought low, the fault indicator clears in the 2 -5 s range.

Note: Loss of power.

If field power is lost in the B818 mode, the module may detect faults that are not visible to the controller.

- After field power is reapplied, the points must be turned OFF and then ON for all ON states.

Fault Definitions

Term	Definition
Open Load	When the load current is less than, or equal to 100 mA, the output is turned OFF and the fault flag is set. To prevent the fault flag from being set, a resistor should be placed between the output point and the group return. For example, @ 20 Vdc the minimum load is 200 Ω , @ 24Vdc the minimum load is 240 Ω , and @ 28 Vdc the minimum load is 280 Ω . When the output is already on and the load exceeds the open load trip level for one to one and a half ms, the output is turned OFF, and the fault flag is set.
Over Current	When the load current exceeds the over current trip level following the switching of a point from OFF to ON, the output is turned OFF, and the fault flag is set. When the output is already on and the current exceeds the over current trip level for one to one and a half ms, the output is turned OFF, and the fault flag is set.

Note: The over current trip level has a value of 3.5 A or greater. Over current greater than 12 A may cause point failure

Term	Definition
Over Voltage	If the external voltage supply exceeds the module's rating, the output point turns OFF, and a fault flag may be returned. The point requires cycling after the external supply returns to a safe operating level. The over-voltage trip level has a value greater than 31 Vdc. There is no time delay.
Over Temperature	When the junction temperature of the output transistor reaches 140°C or greater, the output is turned OFF, and the fault flag is set.


Note: the following about unused outputs in a B882

- Unused outputs should not be turned ON since their field points are not wired.
- Turning them ON will cause an open load fault and the active light will blink.
- The minimum load required is 100 mA.

B882-032 24 Vdc Diagnostic Output, Field Connections

User connections are made to a standard screw terminal strip. The rigid wiring system permits module insertion or removal without disturbing the wiring. Setting the DIP switch allows selection of bi-directional fault reporting or uni-directional non-fault reporting functionality prior to installation.

The following illustration shows the B882-032 terminal numbering and output connections

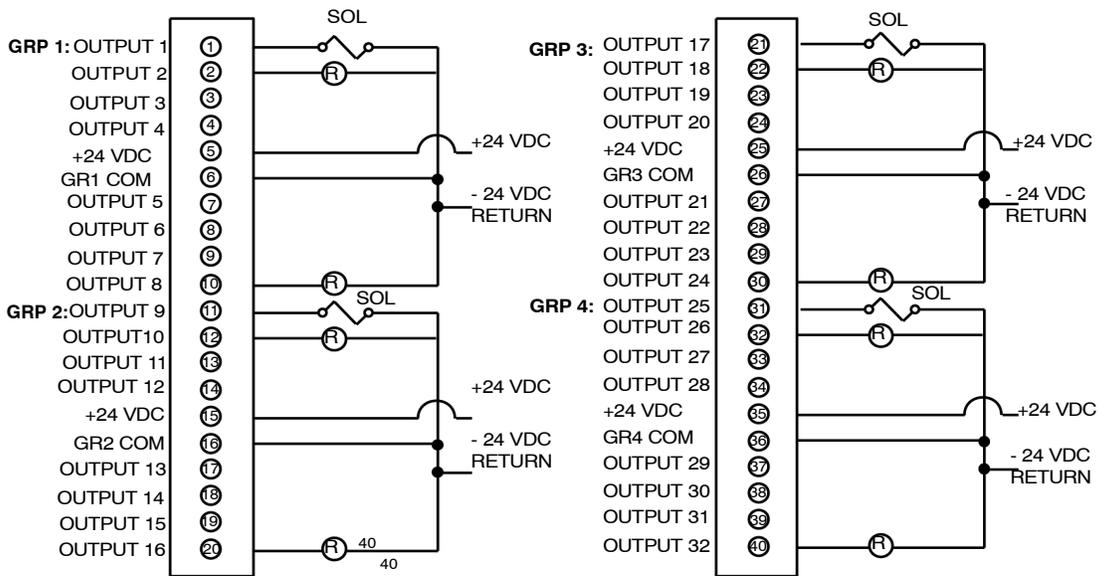

B818, 20-28 Vac Output, Keying and Wiring

Overview

User connections are made to a standard screw terminal strip. The rigid wiring system permits module insertion or removal without disturbing the wiring.


Terminal Numbering and Output Connections

The following figure shows terminal numbering and output connections for the the B818 module.

Grp 1 -> Output 1	1	21	Output 17 <- Grp 3
Output 2	2	22	Output 18
Output 3	3	23	Output 19
Output 4	4	24	Output 20
+24 VDC	5	25	+24 VDC
GND	6	26	GND
Output 5	7	27	Output 21
Output 6	8	28	Output 22
Output 7	9	29	Output 23
Output 8	10	30	Output 24
Grp 2 -> Output 9	11	31	Output 25 <- Grp 4
Output 10	12	32	Output 26
Output 11	13	33	Output 27
Output 12	14	34	Output 28
+24 VDC	15	35	+24 VDC
GND	16	36	GND
Output 13	17	37	Output 29
Output 14	18	38	Output 30
Output 15	19	39	Output 31
Output 16	20	40	Output 32

Mechanical Keying

The following figure shows the keying for the the B818 module.




B882–032 24 Vdc Diagnostic Output, Dip Switch Settings

The four-position dip switch is located on the rear of the module. This switch controls the functionality of the module (bi-directional or uni-directional). Set switch SW3 for either (B882) bi-directional fault reporting, or (B818) uni-directional non-fault reporting. Refer to the following illustration for switch settings. Also refer to the label located on the left side of the module itself. The following illustration shows the B882–032 dip switch settings

4-POSITION DIP-SWITCH

TOP OF MODULE



0	1
ON	OFF
DOWN	UP
LEFT	RIGHT

SWITCHES	FUNCTIONS
1 and 2	NOT USED, KEEP TO LEFT
3	MODULE FUNCTIONALITY
	FOR BI-DIRECTIONAL SW3 = R (B882)
	FOR UNI-DIRECTIONAL SW3 = L (B818)
4	NOT USED, KEEP TO LEFT

Note: Selecting the bi-directional module functionality (B882) allows 32 discrete outputs and 32 returned fault flags. Selecting the uni-directional module functionality (B818) allows 32 discrete outputs.

B882–032 24 Vdc Diagnostic Output, Specifications

B882-032 specifications

Description		24 Vdc diagnostic output
Type of Operation		True high
Number of Points		32
Operating Voltage		19.2-28 Vdc
Number of Groups		4
Outputs/group		8
ON State Voltage Drop		0.5 Vdc maximum @ 1 A
OFF State Leakage		1.0 mA maximum @ 28.0 Vdc
Minimum Load		100 mA
Maximum Continuous Current	per output	1.0 A
	per group	6.0 A
	per module	24.0 A
Surge Current	peak	7.5 A for 0.5 ms
	maximum	10 pulses/s with 1.0 A dc
Load Inductance		1 H maximum with no external diode suppression
Load Capacitance		1000 f maximum
Flags B882 Only	Open Load	100 mA or less
	Over Current	3.5 A or greater
	Over Voltage	31 Vdc or greater
	Over Temperature	140°C or greater
Maximum Response Time	OFF → ON	1 ms with a resistive load
	ON → OFF	1 ms with a resistive load
Power Required	+5 V	300 mA*
	+4.3 V	10 mA
	-5 V	0 mA
* When all outputs are ON, +5 V = 300mA. When all outputs are OFF, +5 V = 200 mA.		
External Power Supply		With nominal voltage of 24 Vdc re-quired to power the field side of the B882**
Terminal Connector		AS-8535-000
** The external power supply must provide power to the field side loads and the field side electronics. The amperage sizing requirements of this supply have three components: 160 mA/group maximum (all channels ON), plus steady state load current of all outputs capable of being ON simultaneously, plus the inrush current of all outputs capable of being switched simultaneously.		

B818, 20-28 Vac Output, Specifications

Specification Table

The following table provides the specifications for the unit.

B818 Specifications		
Description	32 point discrete output module	
Number of Points	32	
Operating Voltage	20-28 VAC cont.	
Number of Groups	4	
Outputs/group	8	
ON Current	Maximum/point	1 A
	Maximum/group	6 A
	Maximum/module	24 A
Power required	+ 5 V	300 mA
	+ 4.3 V	10 mA
	- 5 V	0 mA

B882–032 Parameter Configuration

Parameter and Default Values

Parameter Configuration Window

Parameter Name	Value
MAPPING	BIT (%I-1X%M-0X)
INPUTS STARTING ADDRESS	1
INPUTS ENDING ADDRESS	32
OUTPUTS STARTING ADDRESS	1
OUTPUTS ENDING ADDRESS	32
OUTPUT TYPE	BINARY

Module Configuration

Parameter Name	Value (Default)	Value (Options Available)	Description
Mapping	BIT (%I-1X%M-0X)	WORD (%IW-3X%MW-4X)	
Inputs Starting Address	1	1	
Inputs Ending Address	32	2	
Outputs Starting Address	1	1	
Outputs Ending Address	32	2	
Output Type	BINARY	BCD	

Mapping Parameter References

	Modsoft, Concept, ProWORX	Unity
Reference Type Inputs	Mapped as 32 bits input 1x or Mapped as 2 registers input 3x	Mapped as 32 bits input %Ix or Mapped as 2 words input %IWx
Reference Type Outputs	Mapped as 32 bits output 0x or Mapped as 2 registers output 4x	Mapped as 32 bits output %Mx or Mapped as 2 words output %MWx
Output Type	BIN/BCD	BIN/BCD

B818 Parameter Configuration

Parameter and Default Values

Parameter Configuration Window

Parameter Name	Value
MAPPING	BIT (%M-0X)
OUTPUTS STARTING ADDRESS	1
OUTPUTS ENDING ADDRESS	32
OUTPUT TYPE	BINARY

Module Configuration

Parameter Name	Value (Default)	Value (Options Available)	Description
Mapping	BIT (%M-0X)	WORD (%MW-4X)	
Outputs Starting Address	1	1	
Outputs Ending Address	32	2	
Output Type	BINARY	BCD	

Mapping Parameter References

	Modsoft, Concept, ProWORX	Unity
Reference Type	Mapped as 32 bits output 0x or Mapped as 2 registers output 4x	Mapped as 32 bits output %Mx or Mapped as 2 words output %MWx
Output Type	BIN/BCD	BIN/BCD

B882–116 24 Vdc Output

59

At a Glance

Purpose

This chapter describes the functional and physical characteristics of the B882–116 24 Vdc Output Module.

What's in this Chapter?

This chapter contains the following topics:

Topic	Page
B882–116 24 Vdc Output, Overview	572
B882–116 24 Vdc Output, Field Connections	573
B882–116 24 Vdc Output, Configuration	574
B882–116 24 Vdc Output, Switch Settings	577
B882–116 24 Vdc Output, Specifications	578
B882–116 Parameter Configuration	580

B882–116 24 Vdc Output, Overview

Overview


The B882–116 24 Vdc (16-point) output module monitors field points for both open and short circuit fault conditions. The module is designed for safety applications whereby it monitors essential field wiring.

Two test modes are available: pulse test mode, and no pulse test mode. In no pulse test mode, the module detects open circuits only when the output point is OFF, and short circuits only when the point is ON. Leakage current in the OFF state is less than 3 mA. Trip current to detect a short circuit is greater than 1 A. In pulse test mode, the module pulses the output to the opposite of the command state to determine the complete status of the output load. Pulse timing is: 500 s opposite state pulse once every second.

Note: Average currents in output circuits are changed by no more than 0.1% by full test mode.

Schematic diagram

The following illustration is the B882–116 simplified schematic diagram

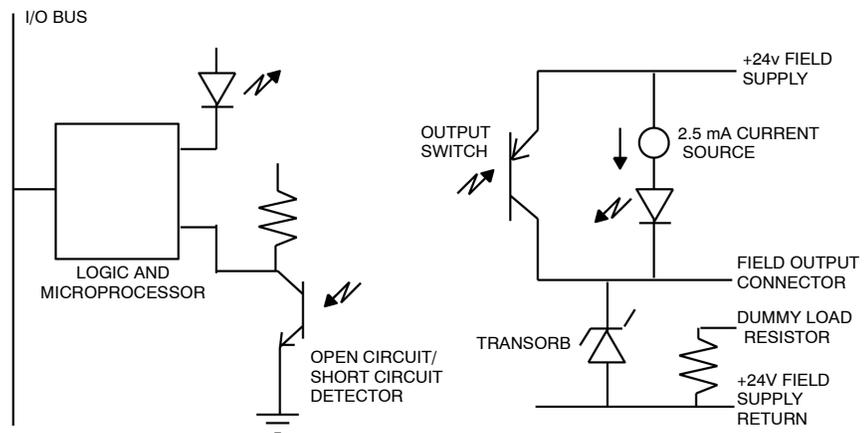


This leakage current is actually the 2.5 mA test current source. It cannot be turned OFF.

B882–116 24 Vdc Output, Field Connections

Overview

User connections are made to a standard screw terminal strip. The rigid wiring system permits module insertion or removal without disturbing the wiring.

The following illustration shows the B882–116 terminal numbering and output connections

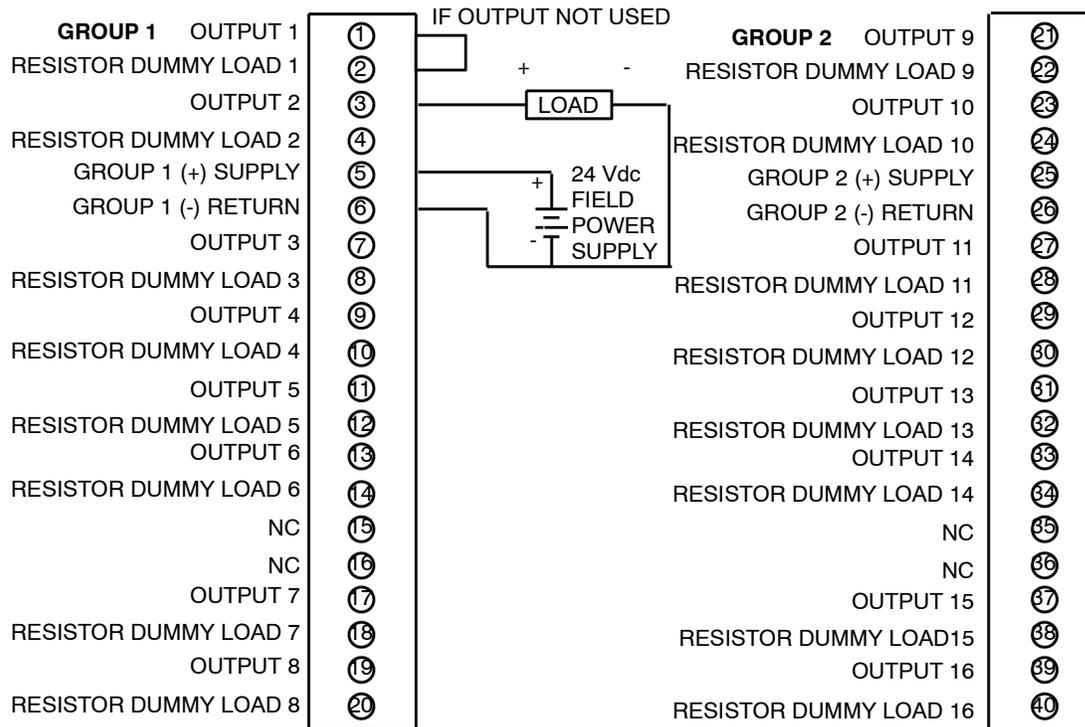

Note: The dummy load pin is only used to prevent an open circuit fault from being returned from an unused output.

B882–116 24 Vdc Output, Configuration


This module appears as a B882 module when configured—i.e., the module requires either four 16-bit words—two 3x input registers and two 4x holding registers or 32 discrete 0x outputs and 32 discrete 1x inputs.

The first holding register contains the command state programmed by the user. The input registers contains the faults detected. If an open circuit fault is detected on output point three, then a one is displayed in the 3x register at position three. If a short fault is detected on output point three, then a one is displayed in register 3x + 1 at position three. A one indicates a detected fault, whereas a zero indicates normal operation of that output point.

The module uses only three of the four configured 16-bit words. A point that is shorted disables the output current flow. Once a fault is detected the operation follows the following flow chart if the module is in the pulse test mode of operation. If not in pulse test mode, then reported faults are cleared when a command changes it to the opposite state. In either case the detection of a short will force the point off.

Note: The module will not work correctly with a J810 remote I/O processor.

The B882-116 full fault test mode only flow chart is shown in the illustration below.

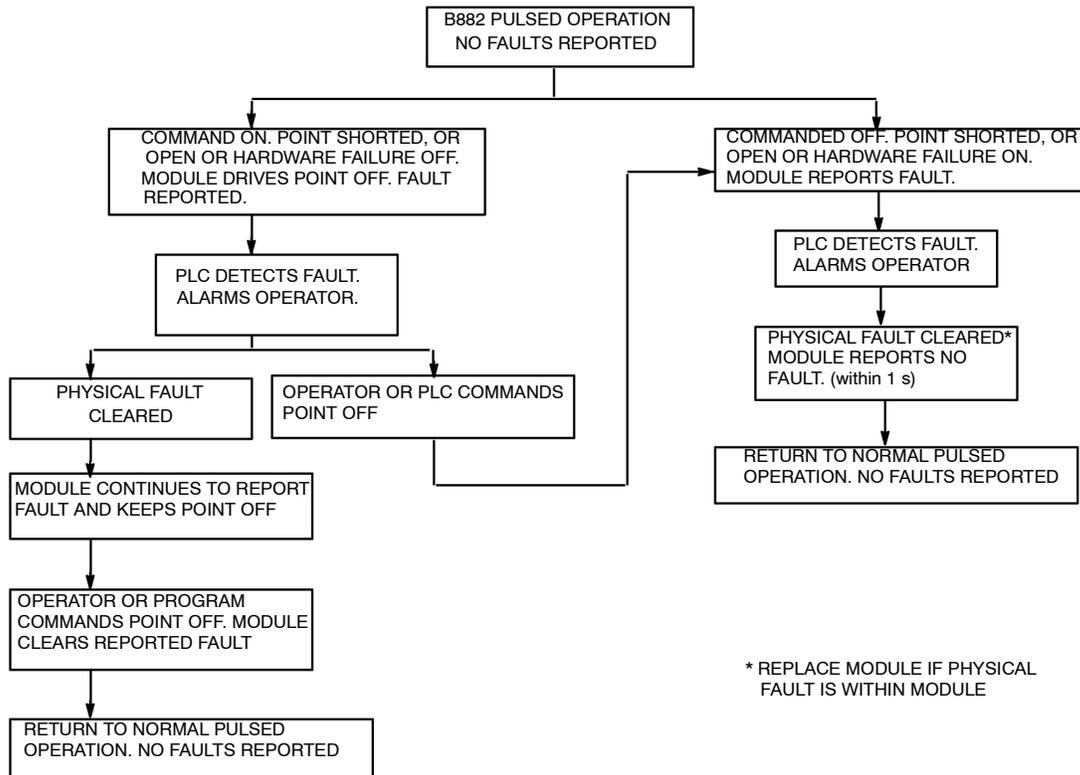

Data Registers

	MSB	PHYSICAL OUTPUTS	LSB		MSB	UNUSED OUTPUTS	LSB																										
40XXX	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	40XXX + 1	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16
30XXX	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	30XXX + 1	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16
	OPEN CIRCUIT								SHORT CIRCUIT																								

The B882–116 module mode behavior table is shown below.

Module Mode Behavior	Partial Test Mode	Full (PULSE) Test Mode
Use with high speed field devices	Yes	Not recommended
Finds opens when OFF	Yes	Yes
Finds opens when ON	No	Yes
Reaction to OPEN fault*	No Change	Point OFF
To clear open fault, close physical fault, then	See Note 1	Write 0
Finds shorts when OFF	No	Yes
Finds shorts when ON	Yes	Yes
Reaction to short fault*	Point OFF	Point OFF
To clear short fault, clear physical fault, then	See Note 2	Write 0
*In all cases faults are reported to the PLC via register entries for corresponding point and type of fault(s). In addition, the fault lamp for the corresponding group will blink until fault indication is cleared. Any points with detected short faults will be turned off independent of the command state from the PLC.		
Note 1: In partial test mode an open fault indication will be cleared by writing a 1 to the output point independent of the actual status of the output wiring.		
Note 2: In partial test mode a short fault indication will be cleared by writing a 0 to the output point independent of the actual status of the output wiring.		


B882–116 24 Vdc Output, Switch Settings

A two-position dip switch located on the rear of the module is used to select one of two test modes on a group basis. No pulse test mode detects open circuits only when the output is OFF, and shorts circuits only when the point is ON.

Pulse test mode pulses the output to the opposite of the command state to determine the status of the output load. Each individual switch relates to each group of eight output points. For example, DIP switch position #1 when set to ON enables pulse test fault sensing for group 1 (points 1-8). When a fault is detected the corresponding FAULT LED flashes independent of the test mode. When the switch is in the OFF position, no pulse test is performed.

The pulse dip-switch settings for the B882–116 module is shown below.

PULSE TEST SWITCH
2 POSITION DIP SWITCH
TOP OF MODULE



1	0
ON	OFF
LEFT	RIGHT
UP	DOWN

SWITCHES	FUNCTIONS
SW1 = 0	GROUP 1, PULSE TEST ENABLED
= 1	GROUP 1, NO TEST
SW2 = 0	GROUP 2, PULSE TEST ENABLED
= 1	GROUP 2, NO TEST

Note: When using binary and BCD format, remember that output 16 is the LSB of word one and word two is ignored by the module.

B882–116 24 Vdc Output, Specifications

B882–116 Specification Table

Description	24 Vdc output
Number of Points	16
Number of Groups	2
Outputs per Group	8
Working Voltage	19.2-30.0 Vdc

Note: The 24 V field supply must be rated to supply output load current +.5 A for the module, +5 A surge rating. This 5 A surge rating is required to correctly detect short circuits. Group input power fusing is recommended. The fuse should be rated for expected load current plus 5 A slo-blow.

Note: Low-voltage

When field supply drops from 24 to 0 V, an output current of up to 15 mA may be generated to points that are OFF. When field supply is below 19.2 V, reported output fault flags may be incorrect.

Module B882–116 Specification Table, Continued

ON State Voltage Drop	0.5 Vdc maximum @ 0.5 A
OFF State Leakage Current	3.0 mA maximum at 30.0 Vdc
	Maximum allowable load resistance 6 k Ω

Note: 3 mA x 6 k Ω = 18 V—i.e. leakage current produces enough voltage on a 6 k Ω load resistor to simulate a valid input signal.

Module B882-116 Specification Table, Continued

Inrush Current		1.0 A peak for 0.1 ms at 4 pulses/s while carrying 0.5 A dc
Continuous Current	Maximum	0.5 A
	Maximum/group	4.0 A
	Maximum/ module	8.0 A
Maximum Load Current		10 mA
Maximum Load Inductance		0.5 H @ 0.5 A, 4 Hz switching
Maximum Load Capacitance		4 F @ 4 Hz maximum switching frequency
Power Required	+5 V	350 mA maximum all outputs ON
	+4.3 V	10 mA
	-5 V	0 mA (not used)
Terminal Connector		AS-8535-000

B882–116 Parameter Configuration

Parameter and Default Values

Parameter Configuration Window

Parameter Name	Value
MAPPING	BIT (%I-1X%M-0X)
INPUTS STARTING ADDRESS	1
INPUTS ENDING ADDRESS	32
OUTPUTS STARTING ADDRESS	1
OUTPUTS ENDING ADDRESS	32
OUTPUT TYPE	BINARY

1 : 140 XBP 3 : B882

Module Configuration

Parameter Name	Value (Default)	Value (Options Available)	Description
Mapping	BIT (%I-1X%M-0X)	WORD (%IW-3X%MW-4X)	
Inputs Starting Address	1	1	
Inputs Ending Address	32	2	
Outputs Starting Address	1	1	
Outputs Ending Address	32	2	
Output Type	BINARY	BCD	

Mapping Parameter References

	Modsoft, Concept, ProWORX	Unity
Reference Type Inputs	Mapped as 32 bits input 1x or Mapped as 2 registers input 3x	Mapped as 32 bits input %Ix or Mapped as 2 words input %IWx
Reference Type Outputs	Mapped as 32 bits output 0x or Mapped as 2 registers output 3x	Mapped as 32 bits output %Mx or Mapped as 2 words output %MWx
Output Type	BIN/BCD	BIN/BCD

800 Series Special Purpose Modules



Introduction

At a Glance

This part provides an overview of the 800 Series special purpose modules. The content describes the modules' features.

What's in this Part?

This part contains the following chapters:

Chapter	Chapter Name	Page
60	B882–239 High Speed Counter	585
61	B883–001 High Speed Counter	593
62	B883–101 and B883–111 CAM	599
63	B883–200 Thermocouple Input Module	605
64	B883–201 RTD Input	613
65	B884–002 PID	621
66	B885–002 ASCII / BASIC	629

B882–239 High Speed Counter

60

At a Glance

Purpose

This chapter describes the functional and physical characteristics of the B882-269 High Speed Counter module.

What's in this Chapter?

This chapter contains the following topics:

Topic	Page
B882–239 High Speed Counter, Overview	586
B882–239 High Speed Counter, Keying and Wiring	587
B882–239 High Speed Counter, Specifications	589
B882–239 Parameter Configuration	591

B882–239 High Speed Counter, Overview

Overview

The B882-239 High Speed Counter module consists of two identical and independent counters that can be used in a variety of counting and comparison operations. Each counter is capable of counting up to 30,000 pulses per second. The B882 has a maximum count rate of either 30 kHz or 350 Hz and interfaces directly with OURBUS. The counting function is done by internal logic within the module itself and independent of controller scanning.

There are four field inputs, three field outputs, two user-selectable DIP switch inputs, a preset input from the programmable controller, and finally, an actual count output to the controller.

Features

- 2 independent counters
 - 0 to 30 kHz operation with a selectable low frequency filter
 - Each counter counts to 9999
 - The two counters can be cascaded to count to 99,999,999
 - Readily configurable to other applications
 - Four field inputs (0 to 32 VDC, true low) and three field outputs (0 to 32 VDC, true low) per counter
 - Counts high speed field pulses independent of the controller scan
 - Each counter automatically reports its current count to the PLC every scan
 - 800 Series diagnostic features such as personality code, health bit, field side status indicators, and communications ACTIVE indicator
 - Standard 800 Series industrial-grade design
-


B882–239 High Speed Counter, Keying and Wiring

Overview

User connections are made to a standard screw terminal strip. The rigid wiring system permits module insertion or removal without disturbing the wiring.



Terminal Numbering and Output Connections

Make field connections to the B882-239 via a high density 24 position plug with screw terminals. The screw terminals accept either solid or standard wire of 14 AWG or less and have a UL rating of 300VAC. Pin numbers are indicated with a label on both the plug and housing. The filed connector is polarized so that it cannot be seated upside down.

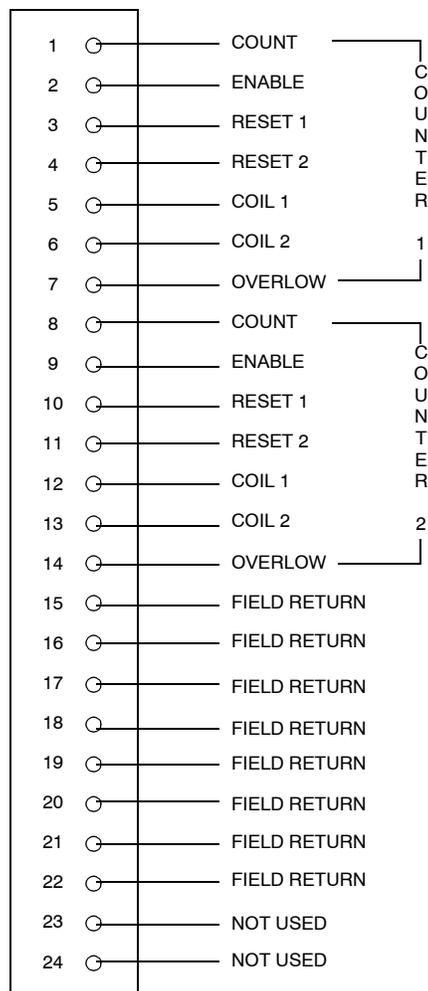

Mechanical Keying

Keying or housing slot key pin installation for the B882-239 module



■ = Pin

B882–239 High Speed Counter, Specifications

Specification Table Table contains circuit, electrical, and system characteristics of the B882-239.

Characteristic	Description	
Number of counters	2	
Number of auxiliary inputs	6	
Number of outputs	6	
Operating Voltage	5-24 Vdc	
Overvoltage	32 V	
Power required	+5 V	188 mA
	-5 V	0 mA
	-4.3 V	0 mA
Voltage range	5 Vdc	2.4 to 5.5 Vdc
	12 Vdc	6 to 16 Vdc
	24 Vdc	12 to 32 Vdc
Logical "1"	1.1 V (min) neg thresh 2.2 V (typ) neg thresh	True for both inputs and outputs
Logical "0"	3.5 V (max) pos thresh 2.7 V (typ) pos thresh	
Hysteresis	0.36 V (min) 0.49 V (typ)	
Maximum count frequency	high	30 kHz
	low	350 Hz
Input voltage range	0 V to field supply input voltage (32 V max)	
Topology	2 counters per module	
	Counter 1	Unidirectional up
	Counter 2	Unidirectional up
Visual indicators (LEDs)		
	1 FIELD POWER	On when field power is present

Characteristic	Description	
	1 ACTIVE	On when communicating with controller
	Counter 1	
	1 COUNT	
	3 input	ENABLE, RESET 1, RESET 2
	2 output	COIL 1, COIL 2
	1 OVF	
	Counter 2	
	1 COUNT	
	3 input	ENABLE, RESET 1, RESET 2
	2 output	COIL 1, COIL 2
	1 OVF	

B882–239 Parameter Configuration

Parameter and Default Values

Parameter Configuration Window

Parameter Name	Value
MAPPING	BIT (%I-1X%M-0X)
INPUT STARTING ADDRESS	129
INPUT ENDING ADDRESS	160
OUTPUT STARTING ADDRESS	129
OUTPUT ENDING ADDRESS	160
OUTPUT TYPE	BINARY

Module Configuration

Parameter Name	Value (Default)	Value (Options Available)	Description
Mapping	BIT (%I-1X%M-0X)	WORD (%IW-3X%MW-4X)	
Inputs Starting Address	129	1	
Inputs Ending Address	160	2	
Outputs Starting Address	129	1	
Outputs Ending Address	160	2	
Output Type	BINARY	BCD	

Mapping Parameter References

	Modsoft, Concept, ProWORX	Unity
Reference Type Inputs	Mapped as 32 bits input 1x or Mapped as 2 registers input 3x	Mapped as 32 bits input %Ix or Mapped as 2 words input %IWx
Reference Type Outputs	Mapped as 32 bits output 0x or Mapped as 2 registers output 4x	Mapped as 32 bits output %Mx or Mapped as 2 words output %MWx
Output Type	BIN/BCD	BIN/BCD

B883–001 High Speed Counter

61

At a Glance

Purpose

This chapter describes the functional and physical characteristics of the B883-001 High Speed Counter Module.

What's in this Chapter?

This chapter contains the following topics:

Topic	Page
B883–001 High Speed Counter, Overview	594
B883–001 High Speed Counter, Keying and Wiring	595
B883–001 High Speed Counter, Specifications	597
B883–001 Parameter Configuration	598

B883–001 High Speed Counter, Overview

Overview

The B883-001 High Speed Counter Module consists of two separate and independent counters and associated logic, and controls up to three outputs. After being configured, the module can operate independently of the PC and react to external events faster than the PC scan time. The module counters have the following characteristic:

Counter #1 has bi-directional (up/down) count capability and has two inputs, two set points, a programmable maximum count, and two outputs. Counter 1 will also accept input from a quadrature type device such as an encoder.

Counter #2 is an up counter and has one input, a programmable maximum count, and one output.

Both counters accept pulsed inputs of 0 to 5, 0 to 12, or 0 to 24 VDC at frequencies up to 50 KHz. the B883 options are selected by commands from the PC and by terminal wiring.

Counter #1 has three modes of operation. Counter #2 can accept input either from an external source or from one of two internal clocks. Both counters can be configured to operate in a wide variety of applications (refer to the section on programming the B883)

B883–001 High Speed Counter, Keying and Wiring

Overview

User connections are made to a standard screw terminal strip. The rigid wiring system permits module insertion or removal without disturbing the wiring.


Terminal Numbering and Output Connections

The following diagram shows terminal numbering and output connections for the the B883-001 module.

Counter 2 Output	10
Return	9
Counter 2 Enable	8
Counter 2 Reset	7
Counter 2 Input	6
Counter 2 Frequency	5
Return	4
Counter 1 Output 2	3
Counter 1 Output 1	2
Return	1
Counter 1 Enable	10
Counter 1 Marker	9
Counter 1 Preset	8
Input Select	7
Counter 1 Input B	6
Counter 1 Input A	5
Counter 1 Frequency	4
Return	3
Voltage Reference	2
Return	1

Mechanical Keying

The following figure shows the keying for the the B883-001 module.



B883–001 High Speed Counter, Specifications

Specification Table


The following table provides the specifications for the unit.

B883-001 Specifications		
Number of Counters		2
Number of Auxiliary Inputs		6
Number of Outputs		3
Operating voltage		5-24 Vdc
Overvoltage		Up to 30 Vdc
Power Required	+5 V	677 mA
	+4.3 V	0 mA
	-5 V	0 mA
Voltage Range	5 Vdc	2.4 to 5.5 Vdc
	12 Vdc	6 to 16 Vdc
	24 Vdc	12 to 32 Vdc
Transition	0 to 1	1 to 0
	5 Vdc	2.4 Vdc
	12 Vdc	5.6 Vdc
	24 Vdc	11.2 Vdc
Max Count Frequency		50 kHz
Ramp Time		7 V per sec
Topology: 2 counters/ module	Counter 1	bidirectional up/down
	Counter 2	unidirectional up
Visual indicators	1 LED/output	"on" when output is on
	1 "field power" indicator	"on" when field power is present
	1 "active" indicator	"on" when good communication with PC
	1 "PWR" indicator	"on" when backplane power applied

B883-001 Parameter Configuration

Parameter and Default Values

Parameter Configuration Window

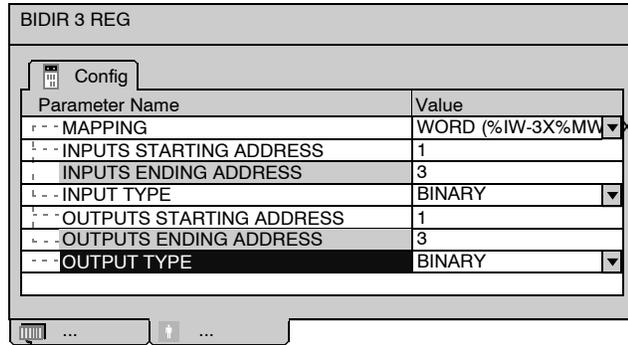

Module Configuration

Parameter Name	Value (Default)	Value (Options Available)	Description
Mapping	WORD (%IW-3X%MW-4X)	BIT (%I-1X%M-0X)	
Inputs Starting Address	1	1	
Inputs Ending Address	3	48	
Input Type	BINARY	-	
Outputs Starting Address	1	1	
Outputs Ending Address	3	48	
Output Type	BINARY	BCD	

Mapping Parameter References

	Modsoft, Concept, ProWORX	Unity
Reference Type Inputs	Mapped as 48 bits input 1x or Mapped as 3 registers input 3x	Mapped as 48 bits input %Ix or Mapped as 3 words input %IWx
Reference Type Outputs	Mapped as 48 bits output 0x or Mapped as 3 registers output 4x	Mapped as 48 bits output %Mx or Mapped as 3 words output %MWx
Output Type	BIN/BCD	BIN/BCD

B883–101 and B883–111 CAM

62

At a Glance

Purpose

This chapter describes the functional and physical characteristics of the B883-101 & B883-111 CAM Modules.

What's in this Chapter?

This chapter contains the following topics:

Topic	Page
B883-101 & B883-111 CAM, Overview	600
B883–101 and B883–111 CAM, Keying and Wiring	601
B883–101 and B883–111 CAM, Specifications	602
B883–101 and B883–111 Parameter Configuration	603

B883-101 & B883-111 CAM, Overview

Overview

The B883-111 CAM module with velocity compensation and the B883-101 CAM module are 800 series input/output (I/O) modules with added microprocessor control capabilities. These modules are used to automate the operation of metal shaping power presses for any mass production industry such as motor vehicle manufacture and assembly. Both models of the CAM module are physically indistinguishable and will be discussed as a single unit.

The CAM module receives a twelve-bit (plus control) parallel position code from an encoder. The module then transmits an eight-bit parallel control code to its discrete outputs based upon the received position data.

Operating instructions in command form are loaded into the module from a programmable controller by way of the I/O system. After the commands are loaded, position codes received by the module are processed and outputted by the CAM module at a 4.000 Hertz rate. This speed is in excess of the PC's scan rate. A total of 16 output intervals may be defined and distributed at random among eight outputs.

CAM module inputs will be accepted in binary, binary coded decimal (BCD) or Gray code.

If your application requires velocity compensation, choose the B883-111 module. The B883-111 module compensates for changes in velocity.

B883–101 and B883–111 CAM, Keying and Wiring

Overview

User connections are made to a standard screw terminal strip. The rigid wiring system permits module insertion or removal without disturbing the wiring.


Terminal Numbering and Output Connections

The following diagram shows terminal numbering and output connections for the the B883-101 and B883-111 modules.

Power Common	1	11	Field Power
O/P 1	2	12	NC
O/P 2	3	13	NC
O/P 3	4	14	NC
O/P 4	5	15	NC
NC	6	16	O/P 5
NC	7	17	O/P 6
NC	8	18	O/P 7
NC	9	19	O/P 8
Field Power	10	20	Power Common

Mechanical Keying

The following figure shows the keying for the the B883-101 and B883-111 modules.



B883–101 and B883–111 CAM, Specifications

Specification Table


The following table provides the specifications for the unit.

B883-101 & B883-111 Specifications		
Number of Inputs		12
Number of Outputs		8
Supply Voltage		Max. 7 Vdc
Operating Voltage		20.4 - 28.8 Vdc 25 mA - 1.9 A
Maximum velocity		4000 counts/sec
Topology		8 positive true saturated switches per module (12 Bit TTL/CMOS input)
Power required	+ 5 V	1000 mA
	+ 4.3 V	0 mA
	- 5V	0 mA
Visual indicators	1 active indicator	"on" when good communication with PC
	1 run indicator	"on" when in run mode

B883–101 and B883–111 Parameter Configuration

Parameter and Default Values

Parameter Configuration Window

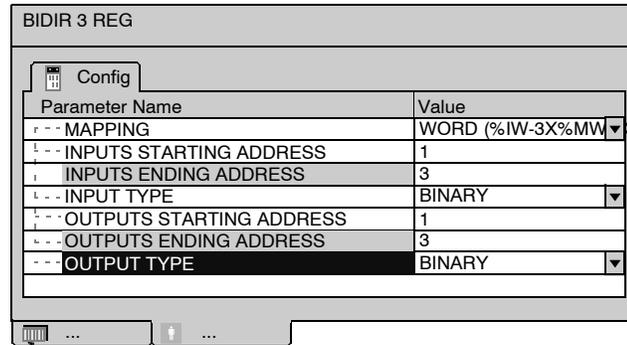

Module Configuration

Parameter Name	Value (Default)	Value (Options Available)	Description
Mapping	WORD (%IW-3X%MW-4X)	BIT (%I-1X%M-0X)	
Inputs Starting Address	1	1	
Inputs Ending Address	3	48	
Input Type	BINARY	-	
Outputs Starting Address	1	1	
Outputs Ending Address	3	48	
Output Type	BINARY	BCD	

Mapping Parameter References

	Modsoft, Concept, ProWORX	Unity
Reference Type Inputs	Mapped as 48 bits input 1x or Mapped as 3 registers input 3x	Mapped as 48 bits input %Ix or Mapped as 3 words input %IWx
Reference Type Outputs	Mapped as 48 bits output 0x or Mapped as 3 registers output 4x	Mapped as 48 bits output %Mx or Mapped as 3 words output %MWx
Output Type	BIN/BCD	BIN/BCD

B883–200 Thermocouple Input Module

63

At a Glance

Purpose

This chapter describes the functional and physical characteristics of the B883-200 Thermocouple Input Module.

What's in this Chapter?

This chapter contains the following topics:

Topic	Page
B883–200 Thermocouple Input, Overview	606
B883–200 Thermocouple Input, Keying and Wiring	607
B883–200 Thermocouple Input, Specifications	609
B883–200 Parameter Configuration	610

B883–200 Thermocouple Input, Overview

Overview

The Modicon B883-200 Thermocouple Input Module is a smart I/O module that multiplexes up to ten thermocouples into three consecutive input registers of the control system.

Each B883-200 module provides reference junction temperature compensation, open circuit detection, and linearization for ten thermocouples. Also built-in are self-calibration, internal diagnostics, and 800-series bus diagnostics.

Any mix of type B, E, J, K, R, S, T or N thermocouple operations or simple -20 to +80 mV input operations may be set by the user under program control.

For the thermocouple inputs, the PLC can access individual temperature readings in degrees Centigrade, Fahrenheit or in compensated millivolts. Each time the PLC scans the B883-200 module, it receives the specified temperature or millivolt reading along with open-circuit and module health data. The thermocouple wire is terminated on a special isothermal connector assembly on the housing. Each B883-200 module uses three consecutive input registers and three output registers.

B883–200 Thermocouple Input, Keying and Wiring

Overview

User connections are made to a standard screw terminal strip. The rigid wiring system permits module insertion or removal without disturbing the wiring.


Terminal Numbering and Output Connections

The following diagram shows terminal numbering and output connections for the the B883-200 module.

NC	1	2	NC
THERM 1+	3	4	THERM 1-
1	5	6	THERM 2+
THERM 2-	7	8	2
THERM 3+	9	10	THERM 3-
3	11	12	THERM 4+
THERM 4-	13	14	4
NC	15	16	THERM 5+
THERM 5-	17	18	5
GND	19	20	NC
CJC 2+	21	22	CJC 2-
THERM 6+	23	24	THERM 6-
6	25	26	THERM 7+
THERM 7-	27	28	7
THERM 8+	29	30	THERM 8-
8	31	32	THERM 9+
THERM 9-	33	34	9
NC	35	36	THERM 10+
THERM 10-	37	38	10
NC	39	40	NC

Mechanical Keying

The following figure shows the keying for the the B883-200 module.



B883–200 Thermocouple Input, Specifications

Specification Table


The following table provides the specifications for the unit.

B883-200 Specifications		
Description	Thermocouple input Type B,E,J,K,R,S,T,N or linear mV	
Inputs per Modules	10	
Max. Common Mode Voltage	200 Vdc/Vac (peak)	
Resolution Under Program Control	1°C, 1°F, 10 mV 0.1°C, 0.1°F, 1 mV	
Update Time	100 ms per selected channel 1 sec. max. all channels	
Power-up Time	13 sec. max.	
Warm-up Time	2 Min. max.	
Interface to PC	3 output registers (4xxxx) 3 input registers (3xxxx) Junction CJC=cold	
Power required	+ 5 V	400 mA
	+ 4.3 V	5 mA
	- 5 V	0 mA
Visual indicators compensation	1 "active" indicator	"on" when good communication wirth PC

B883–200 Parameter Configuration

Parameter and Default Values

Parameter Configuration Window

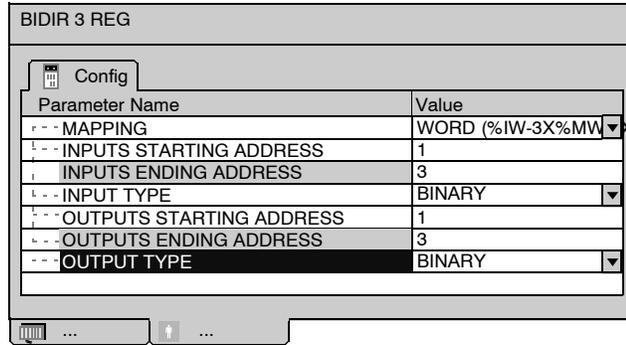

Module Configuration

Parameter Name	Value (Default)	Value (Options Available)	Description
Mapping	WORD (%IW-3X%MW-4X)	BIT (%I-1X%M-0X)	
Inputs Starting Address	1	1	
Inputs Ending Address	3	48	
Input Type	BINARY	-	
Outputs Starting Address	1	1	
Outputs Ending Address	3	48	
Output Type	BINARY	BCD	

Mapping Parameter References

	Modsoft, Concept, ProWORX	Unity
Reference Type Inputs	Mapped as 48 bits input 1x or Mapped as 3 registers input 3x	Mapped as 48 bits input %Ix or Mapped as 3 words input %IWx
Reference Type Outputs	Mapped as 48 bits output 0x or Mapped as 3 registers output 4x	Mapped as 48 bits output %Mx or Mapped as 3 words output %MWx
Output Type	BIN/BCD	BIN/BCD

B883–201 RTD Input

64

At a Glance

Purpose

This chapter describes the functional and physical characteristics of the B883-201 RTD Input Module.

What's in this Chapter?

This chapter contains the following topics:

Topic	Page
B883–201 RTD Input, Overview	614
B883–201 RTD Input, Keying and Wiring	615
B883–201 RTD Input, Specifications	617
B883–201 Parameter Configuration	618

B883–201 RTD Input, Overview

Overview

The B883-201 Resistance Temperature Detector (RTD) module is a smart I/O module that multiplexes up to eight two- or three-wire RTDs into three consecutive input registers of a control system.

Each B883-201 module provides linearization for any mix of 8 RTDs. Also built-in are self-calibration, internal diagnostics, and 800-Series bus diagnostics.

American standard platinum, European standard platinum per DIN, or linear resistance input can be selected by the user under program control.

When an RTD is selected, the PLC can access each individual temperature reading in Centigrade, Fahrenheit or in compensated millivolts. Each time the PLC scans the B883-201 module, it receives the specified temperature or millivolt reading along with open-circuit and module health data.

Each B883-201 uses three consecutive input registers and three output registers. These registers are assigned to the same slot within the channel.

B883–201 RTD Input, Keying and Wiring

Overview

User connections are made to a standard screw terminal strip. The rigid wiring system permits module insertion or removal without disturbing the wiring.


Terminal Numbering and Output Connections

The following diagram shows terminal numbering and output connections for the the B883-201 module.

NC	1	2	NC
NC	3	4	NC
NC	5	6	NC
NC	7	8	Ex 1 Hi
Sense 1 Hi	9	10	Ex 1 Lo
Shield 1	11	12	Ex 2 Hi
Sense 2 Hi	13	14	Ex 2 Lo
Shield 2	15	16	Ex 3 Hi
Sense 3 Hi	17	18	Ex 3 Lo
Shield 3	19	20	Ex 4 Hi
Sense 4 Hi	21	22	Ex 4 Lo
Shield 4	23	24	Ex 5 Hi
Sense 5 Hi	25	26	Ex 5 Lo
Shield 5	27	28	Ex 6 Hi
Sense 6 Hi	29	30	Ex 6 Lo
Shield 6	31	32	Ex 7 Hi
Sense 7 Hi	33	34	Ex 7 Lo
Shield 7	35	36	Ex 8 Hi
Sense 8 Hi	37	38	Ex 8 Lo
Shield 8	39	40	GND

**Mechanical
Keying**

The following figure shows the keying for the the B883-201 module.



B883–201 RTD Input, Specifications

Specification Table


The following table provides the specifications for the unit.

B883-201 Specifications		
Description	RTD input American or European 100 Ω Platinum	
Inputs per Module	8	
Max. Common Mode Voltage	7 Vdc/Vac (peak)	
Resolution Under Program Control	1°C, 1°F, 10 Ω 0.1°C, 0.1°F, 1 Ω	
Update Time	125 ms per selected channel 1 sec. max. all channels	
Power-up Time	13 sec. max.	
Warm-up Time	2 min. max.	
Interface to PC	3 output registers (4xxxx) 3 input registers (3xxxx)	
Power required	+ 5 V	640 mA
	+ 4.3 V	5 mA
	- 5 V	0 mA
Visual indicators	1 active indicator	"on" when good communication with PC For 2 wire RTD short and excitation

B883–201 Parameter Configuration

Parameter and Default Values

Parameter Configuration Window

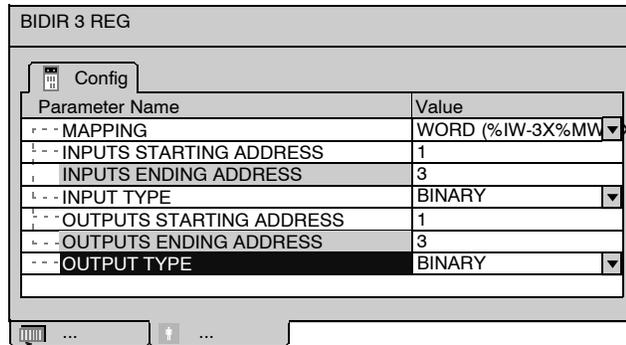

Module Configuration

Parameter Name	Value (Default)	Value (Options Available)	Description
Mapping	WORD (%IW-3X%MW-4X)	BIT (%I-1X%M-0X)	
Inputs Starting Address	1	1	
Inputs Ending Address	3	48	
Input Type	BINARY	-	
Outputs Starting Address	1	1	
Outputs Ending Address	3	48	
Output Type	BINARY	BCD	

Mapping Parameter References

	Modsoft, Concept, ProWORX	Unity
Reference Type Inputs	Mapped as 48 bits input 1x or Mapped as 3 registers input 3x	Mapped as 48 bits input %Ix or Mapped as 3 words input %IWx
Reference Type Outputs	Mapped as 48 bits output 0x or Mapped as 3 registers output 4x	Mapped as 48 bits output %Mx or Mapped as 3 words output %MWx
Output Type	BIN/BCD	BIN/BCD

B884–002 PID

65

At a Glance

Purpose

This chapter describes the functional and physical characteristics of the B884-002 PID Module.

What's in this Chapter?

This chapter contains the following topics:

Topic	Page
B884–002 PID, Overview	622
B884–002 PID Control, Keying and Wiring	623
B884–002 PID Control, Specifications	625
B884–002 Parameter Configuration	626

B884-002 PID, Overview

Overview

The B884-002 PID Module provides two completely independent and separate Proportional Integral Derivative (PID) loops. You can configure the PID loops for control strategies including open loop, closed loop, PID, PID on error squared and cascade control.

You configure the PID module using a configuration program (Part #SW-BDD-3DA) on an IBM or compatible personal computer. You can download the data either through the PLC or directly to the modules, where it is stored in a non-volatile EEPROM memory.

To ensure the highest accuracy and reliability, the module has fully floating, isolated and protected inputs and outputs. The module has seven independently configured analog inputs (4 voltage/current, 2 thermocouple, 1 frequency), two analog outputs, two discrete inputs and two discrete outputs. Each loop is assigned two voltage and one thermocouple inputs.

There is no need for any analog adjustments such as trimpots for zero, offset, or span, which results in superior accuracy, stability and reliability.

B884–002 PID Control, Keying and Wiring

Overview

User connections are made to a standard screw terminal strip. The rigid wiring system permits module insertion or removal without disturbing the wiring.


Terminal Numbering and Output Connections

The following diagram shows terminal numbering and output connections for the the B884-002 module.

RS422 TXD- —	1	2	— RS422 TXD+
RS422 RXD- —	3	4	— RS422 RXD+
RS232 Rx —	5	6	— RS232 Tx
RS232 RTS —	7	8	— RS232 CTS
RS422 En L —	9	10	— Signal GND
A Out 1+ —	11	12	— A Out 1Com
A Out 2+ —	13	14	— A Out 2 Com
NC —	15	16	— Disc In 1
Disc In 2 —	17	18	— Disc Out 1
Disc Out 2 —	19	20	— 24 VDC Com
24 VDC + —	21	22	— 24 VDC Com
Power In + —	23	24	— Power In Com
TC Bypass —	25	26	— NC (CJC)
NC (CJC) —	27	28	— THERM 1+
THERM 1- —	29	30	— THERM 2+
THERM 2- —	31	32	— A V/I 1+
A V/I 1- —	33	34	— A V/I 2+
A V/I 2- —	35	36	— A V/I 3+
A V/I 3- —	37	38	— A V/I 4+
A V/I 4- —	39	40	— NC

Mechanical Keying

The following figure shows the keying for the the B884-002 module.



B884–002 PID Control, Specifications

Specification Table

The following table provides the specifications for the unit.

B884-002 Specifications		
Description	PID Control Module	
External power supply requirements	24 VDC +/- 20% at 0.3 A	
Algorithms	P, PI, PD, PID	
Topology	4 analog inputs 2 thermocouple inputs 1 pulse input 2 discrete inputs 2 analog outputs 2 discrete outputs	
Interface to PC	4 output registers (4xxxx) 4 input registers (3xxxx) A=analog)	
Power required	+ 5 V	25 - 50 mA
	+ 4.3 V	2 mA
	- 5 V	0 mA
Visual indicators	1 "active" indicator	"on" when good communication with PC

B884-002 Parameter Configuration

Parameter and Default Values

Parameter Configuration Window

Parameter Name	Value
MAPPING	WORD (%IW-3X%MW)
INPUTS STARTING ADDRESS	1
INPUTS ENDING ADDRESS	4
INPUT TYPE	BINARY
OUTPUTS STARTING ADDRESS	1
OUTPUTS ENDING ADDRESS	4
OUTPUT TYPE	BINARY

Module Configuration

Parameter Name	Value (Default)	Value (Options Available)	Description
Mapping	WORD (%IW-3X%MW-4X)	BIT (%I-1X%M-0X)	
Inputs Starting Address	1	1	
Inputs Ending Address	4	64	
Input Type	BINARY	-	
Outputs Starting Address	1	1	
Outputs Ending Address	4	64	
Output Type	BINARY	BCD	

Mapping Parameter References

	Modsoft, Concept, ProWORX	Unity
Reference Type Inputs	Mapped as 64 bits input 1x or Mapped as 4 registers input 3x	Mapped as 64 bits input %Ix or Mapped as 4 words input %IWx
Reference Type Outputs	Mapped as 64 bits output 0x or Mapped as 4 registers output 4x	Mapped as 64 bits output %Mx or Mapped as 4 words output %MWx
Output Type	BIN/BCD	BIN/BCD

B885–002 ASCII / BASIC

66

At a Glance

Purpose

This chapter describes the functional and physical characteristics of the B885-002 ASCII / BASIC Module.

What's in this Chapter?

This chapter contains the following topics:

Topic	Page
B885–002 ASCII / BASIC, Overview	630
B885–002 ASCII / BASIC, Keying and Wiring	631
B885–002 ASCII / BASIC, Specifications	632
B885–002 Parameter Configuration	633

B885-002 ASCII / BASIC, Overview

Overview

The B885-002 ASCII / BASIC Module runs user-written BASIC programs independently of the controller's memory logic and scan. It also performs READ and WRITE commands to and from serial devices connected to either of the module's two RS 232/422 ports (jumper selectable). In addition, its real-time clock/calendar allows the module to run a BASIC program or flag and return a value to the PLC at a user specified date and time.

The module provides report generation, interactive operator interface, high level math, peripheral communication and data storage.

Using a dumb terminal or an IBM personal computer with Emulator Software (Part # SW-E885-1DA), you program the module's 53K of user memory. If you need more memory, you may provide an additional 32K of user EPROM. You can designate part of the memory as retentive variable memory to store formulas or other process parameters.

B885–002 ASCII / BASIC, Keying and Wiring

Overview

User connections are made to a standard screw terminal strip. The rigid wiring system permits module insertion or removal without disturbing the wiring.


Terminal Numbering and Output Connections

The following diagram shows terminal numbering and output connections for the the B885-002 module.

1	— N/A	Protective GND
2	— OUT	RS232 Send
3	— IN	RS232 Receive
4	— OUT	RS232 RTS
5	— IN	RS232 CTS
6	— IN	RS232 DSR
7	— N/A	RS232 & RS422
8	— CD*	Common
12	— OUT	RS422 RTS high
13	— OUT	RS422 RTS low
14	— OUT	RS422 SD high
15	— OUT	RS422 SD low
16	— IN	RS422 CTS low
17	— IN	RS422 CTS high
18	— OUT	+5 V
19	— IN	Select Input RS 422
20	— OUT	RS232 DTR
21	— IN	RS422 RD high
25	— IN	RS422 RD low

Mechanical Keying

The following figure shows the keying for the the B885-002 module.



B885-002 ASCII / BASIC, Specifications

Specification Table

The following table provides the specifications for the unit.

B885-002 Specifications		
Description	ASCII/Basic 64 k RAM, 2 RS232/422 Ports	
Interface to PC	6 input registers (3xxxx) 6 output registers (4xxxx)	
Carrier detect (CD)	For RS232 leave pins 18 and 19 unconnected For RS422 connect pins 18 and 19	
Power Required	RS 422 mode	RS 232 mode
+ 5 Vdc	500 mA	400 mA
+ 4.3 Vdc	1760 mA	1000 mA
- 5 Vdc	0 mA	0 mA
Visual indicators	1 "active" indicator	"on" when good communication with PC
	2 "port" indicators	"on" when active communications
	1 "battery ok" indicator	"on" when battery is ok
	1 "run" indicator	
	1 "power ok" indicator	

B885-002 Parameter Configuration

Parameter and Default Values

Parameter Configuration Window

Parameter Name	Value
MAPPING	WORD (%IW-3X%MW-4X)
INPUTS STARTING ADDRESS	1
INPUTS ENDING ADDRESS	6
INPUT TYPE	BINARY
OUTPUTS STARTING ADDRESS	1
OUTPUTS ENDING ADDRESS	6
OUTPUT TYPE	BINARY

Module Configuration

Parameter Name	Value (Default)	Value (Options Available)
Mapping	WORD (%IW-3X%MW-4X)	BIT (%I-1X%M-0X)
Inputs Starting Address	1	1
Inputs Ending Address	6	96
Input Type	BINARY	-
Outputs Starting Address	1	1
Outputs Ending Address	6	96
Output Type	BINARY	BCD

Mapping Parameter References

	Modsoft, Concept, ProWORX	Unity
Reference Type Inputs	Mapped as 96 bits input 1x or Mapped as 6 registers input 3x	Mapped as 96 bits input %Ix or Mapped as 6 words input %IWx
Reference Type Outputs	Mapped as 96 bits output 0x or Mapped as 6 registers output 4x	Mapped as 96 bits output %Mx or Mapped as 6 words output %MWx
Output Type	BIN/BCD	BIN/BCD

Index



Numerics

800 Series I/O Modules
I/O Map, 38
984LL notation, 25, 32

A

addressing
 examples, 34
 flat, 32
 modes, 31
 topological, 33
ASP890300, 87

B

B802-008 115 Vac Output, 279
B803-008 115 Vac Input, 285
B804-116 115 Vac Output, 291
B804-148 48 Vac Output, 297
B805-016 115 Vac Input, 303
B806-032 115 Vac Output, 309
B806-124 24 Vac Output, 317
B807-132 115 Vac Input, 323
B808-016 230 Vac Output, 331
B809-016 230 Vac Input, 337
B810-008 115 Vac Isolated Output, 343
B814-108 Relay Output, 349
B817-116 115 Vac Isolated Input, 357
B817-216 230 Vac Isolated Input, 357
B818 20-28 Vac Discrete Output, 559
B818 24 Vac Output, 365

B819-232 230 Vac Input, 371
B820-008 10-60 Vdc Output, 377
B821-108 10-60 Vdc Input, 383
B824-016 24 Vdc Output, 389
B825-106 24 Vdc Input, 395
B827-032 24 Vdc Input, 403
B828-016 5 V TTL Output, 409
B829-116 Fast Response 5 V TTL Input, 415
B832-016 24 Vdc Output, 421
B833-016 24 Vdc Input, 427
B836-016 12-250 Vdc Isolated Output, 433
B837-016 24 Vac/Vdc Input, 439
B838-032 24 Vdc Output, 445
B840-108 Relay Output, 451
B842-008 Reed Relay Output, 457
B846-001 Input Multiplexer, 111
B846-002 Input Multiplexer, 111
B849-016 48 V ac/dc Input, 463
B853-016 115 Vac/125 Vdc Input, 469
B855-016 Intrinsically Safe Input, 475
B862-001 Register Output, 485
B863-032 Monitored 24 Vdc Input, 493
B863-132 Vdc Input, 499
B864-001 Register Output, 507
B865-001 Register Input, 515
B868-001 Register Output, 525
B869-002 Register Input, 535
B872-100 Analog Output, 117
B872-200 Analog Output, 135
B873-002 Analog Input, 153
B873-012 Analog Input, 169
B875-002 Analog Input, 153

B875-012 Analog Input, 169
B875-102 High Speed Analog Input, 183
B875-111 Analog Input, 213
B875-200 Configurable A/D Input, 243
B877-111 Analog Input, 213
B881-001 Latched 24 Vdc Input, 545
B881-508 125 Vdc Output, 553
B882-032 24 Vdc Diagnostic Output, 559
B882-116 24 Vdc Output, 571
B882-239 High Speed Counter, 585
B883-001 High Speed Counter, 593
B883-101 CAM Module, 599
B883-111 CAM Module, 599
B883-200 Thermocouple Input, 605
B883-201 RTD Input, 613
B884-002 PID, 621
B885-002 ASCII / BASIC, 629

C

cable shields requirements, 44

F

field connections

B33-016 24 Vdc Input, 429
B803-008 115 Vac Input, 287
B804-116 115 Vac Output, 293
B804-148 48 Vac Output, 299
B805-016 115 Vac Input, 305
B806-032 115 Vac Output, 312
B806-124 24 Vac Output, 320
B807-132 115 Vac Input, 326
B808-016 230 Vac Output, 333
B809-016 230 Vac Input, 339
B810-008 115 Vac Output, 345
B814-108 Relay Output, 352
B817-116 115 Vac Isolated Input, 359
B817-216 230 Vac Isolated Input, 359
B818 24 Vdc Output, 367
B820-008 10-60 Vdc Output, 379
B821-108 10-60 Vdc Input, 385
B824-016 24 Vdc Output, 391
B825-016 24 Vdc Input, 397
B827-032 24 Vdc Input, 405
B828-016 5 V TTL Output, 411
B829-116 FR 5 V TTL Input, 417
B832-016 24 Vdc Output, 423
B836-016 12-250 Vdc Output, 435
B837-016 24 Vac/Vd Input, 441
B838-032 24 Vdc Output, 447
B840-108 Relay Output, 454
B842-008 Reed Relay Output, 459
B849-016 48 V ac/dc Input, 466
B853-016 115 Vac/125 Vdc Input, 472
B862-001 Register Output, 488
B863-032 Monitored 24 Vdc Input, 495
B863-132 24 Vdc Input, 502
B864-001 Register Output, 510
B865-001 Register Output, 519
B868-001 Register Output, 528
B869-002 Register Output, 539
B872-100, 122
B872-200 Analog Output, 142
B873-002 Analog Input, 164
B873-012 Analog Input, 178
B875-002 Analog Input, 164
B875-012 Analog Input, 178

B875-111 Analog Input, 220
B875-200 Configurable A/D Input, 250
B881-001 Latched 24 Vdc Input, 549
B881-508 125 Vdc Output, 556
B882-032 24 Vdc Diagnostic Output, 563
B882-116 24 Vdc Output, 573

G

grounding
 guidelines, 39
 requirements, 44

I

I/O line requirements, 44
IEC notation, 25, 32
indicators, 37

J

J890 RIO Interface, 55
J892 RIO Interface, 55

K

key pin assignments, 47

L

line filters requirements, 44

N

notation
 984LL, 25, 32
 IEC, 25, 32

P

P890 RIO Processor, 75
P892 RIO Processor, 75

parameter configurations

B802-008 115 Vac Output, 283
B803-008 115 Vac Input, 289
B804-116 115 Vac Output, 295
B804-148 48 Vac Output, 301
B805-016 115 Vac Input, 307
B806-032 115 Vac Output, 315
B806-124 24 Vac Output, 322
B807-132 115 Vac Input, 330
B808-016 230 Vac Output, 335
B809-016 230 Vac Input, 341
B810-008 115 Vac Isolated Output, 347
B814-108 Relay Output, 354
B816 Isolated Output, 355
B817-116 115 Vac Isolated Input, 363
B817-216 230 Vac Isolated Input, 363
B818 20-28 Vac Discrete Output, 570
B818 24 Vac Output, 369
B819-232 230 Vac Input, 375
B820-003 10-60 Vdc Output, 381
B821-108 10-60 Vdc Input, 388
B824-016 Vdc Output, 393
B825-016 24 Vdc Input, 399
B826-032 24 Vdc Output, 401
B827-032 24 Vdc Input, 407
B828-016 5 V TTL Output, 413
B829-116 FR 5 V TTL Input, 419
B832-016 24 Vdc Output, 425
B833-016 24 Vdc Input, 431
B836-016 12-250 Vdc Output, 438
B837-016 24 Vac/Vdc Input, 443
B838-032 24 Vdc Output, 449
B840-108 Relay Output, 456
B842-008 Reed Relay Output, 461
B846-001 Input Multiplexers, 116
B846-002 Input Multiplexers, 116
B849-016 48 V ac/dc Input, 468
B853-016 115 Vac/125 Vdc Input, 474
B855-016 Intrinsically Safe Input, 483
B862-001 Register Output, 492
B863-032 Monitored 24 Vdc Input, 497
B863-132 24 Vdc Input, 505
B864-001 Register Output, 514
B865-001 Register Input, 524
B868-001 Register Output, 532
B869-002 Register Input, 542

- B872-100 Analog Output, 133
- B872-200 Analog Output, 152
- B873-002 Analog Input, 167
- B873-012 Analog Input, 181
- B875-002 Analog Input, 168
- B875-012 Analog Input, 182
- B875-102 High Speed Analog Input, 212
- B875-111 Analog Input, 239
- B875-200 Configurable A/D Input, 273
- B877-111 Analog Input, 240
- B881-001 Latched 24 Vdc Input, 551
- B881-508 125 Vdc Output, 558
- B882-032 Vdc Diagnostic Output, 569
- B882-116 24 Vdc Output, 580
- B882-239 High Speed Counter, 591
- B883-001 High Speed Counter, 598
- B883-101 CAM, 603
- B883-111 CAM, 603
- B883-200 Thermocouple Input, 610
- B883-201 RTD Input, 618
- B884-002 PID, 626
- B885-002 ASCII/BASIC, 633
- power supplies
 - ASP890300, 92, 103, 105
 - safety message, 92
- power supply requirements, 44

Q

- quick start tests, 50

S

specifications

- ASP890300, 104
- B802-008 48 Vac Output, 282
- B803-008 115 Vac Input, 288
- B804-116 48 Vac Output, 294
- B804-148 48 Vac Output, 300
- B805-016 115 Vac Input, 306
- B806-032 115 Vac Output, 314
- B806-124 24 Vac Output, 321
- B807-132 115 Vac Input, 329
- B808-016 230 Vac Output, 334
- B809-016 230 Vac Input, 340
- B810-008 115 Vac Isolated Output, 346
- B814-108 Relay Output, 353
- B817-116 115 Vac Isolated Input, 362
- B817-216 230 Vac Isolated Input, 362
- B818 20-28 Vac Output, 568
- B818 24 Vdc Output, 368
- B819-232 32 Point Input, 374
- B820-008 10-60 Vdc Output, 380
- B821-108 10-60 Vdc Input, 386
- B824-016 24 Vdc Output, 392
- B825-016 24 Vdc Input, 398
- B827-032 24 Vdc Input, 406
- B828-016 5 V TTL Output, 412
- B829-116 FR 5 V TTL Input, 418
- B832-016 24 Vdc Output, 424
- B833-016 24 Vdc Input, 430
- B836-016 12-250 Vdc Output, 437
- B837-016 24 V ac/dc Input, 442
- B838-032 24 Vdc Output, 448
- B840-108 Relay Output, 455
- B842-008 Reed Relay Output, 460
- B846-001 Input Multiplexers, 115
- B846-002 Input Multiplexers, 115
- B849-016 48 V ac/dc Input, 467
- B853-016 115 Vac/125 Vdc Input, 473
- B855-016 Intrinsically Safe Input, 482
- B862-001 Register Output, 491
- B863-032 Monitored 24 Vdc Input, 496
- B863-132 24 Vdc Input, 504
- B864-001 Register Output, 513
- B865-001 Register Input, 522
- B868-001 Register Output, 531

- B869-002 Register Output, 541
- B872-100 Analog Input, 131
- B872-200 Analog Output, 151
- B873-002 Analog Input, 166
- B873-012 Analog Input, 180
- B875-002 Analog Input, 166
- B875-012 Analog Input, 180
- B875-102 High Speed Analog Input, 210
- B875-111 Analog Input, 237
- B875-200 Configurable A/D Input, 271
- B881-001 Latched 24 Vdc Input, 550
- B881-508 125 Vdc Output, 557
- B882-032 24 Vdc Diagnostic Output, 567
- B882-116 24 Vdc Output, 578
- B882-239 High Speed Counter, 589
- B883-001 High Speed Counter, 597
- B883-101 CAM, 602
- B883-111 CAM, 602
- B883-200 Thermocouple Input, 609
- B883-201 RTD Input, 617
- B884-002 PID Control, 625
- B885-002 ASCII/BASIC, 632
- environmental-analog modules, 51
- environmental-discrete modules, 52
- J890 and J892, 73, 84
- mechanical-analog modules, 51
- mechanical-discrete modules, 52

T

- technical specifications summary
 - analog modules, 27
 - discrete modules, 28
 - RIO modules, 26
 - special purpose modules, 30

V

- values
 - reading, 33

Artisan Technology Group is an independent supplier of quality pre-owned equipment

Gold-standard solutions

Extend the life of your critical industrial, commercial, and military systems with our superior service and support.

We buy equipment

Planning to upgrade your current equipment? Have surplus equipment taking up shelf space? We'll give it a new home.

Learn more!

Visit us at artisanng.com for more info on price quotes, drivers, technical specifications, manuals, and documentation.

Artisan Scientific Corporation dba Artisan Technology Group is not an affiliate, representative, or authorized distributor for any manufacturer listed herein.

We're here to make your life easier. How can we help you today?

(217) 352-9330 | sales@artisanng.com | artisanng.com

